

25 OAKHILL AVENUE, LONDON, NW3 7RD

Structural Engineer's Calculations for Planning

March 2023

Revision P2- Planning



Revision	Issued For	Date	Author
P1	PLANNING	20.10.2021	AZ
P2	PLANNING	29.03.2023	AZ

CONTENTS:

1	INTRODUCTION
2	RELEVANT DOCUMENTS
3	MBP – STRUCTURAL DRAWINGS
4	SECOND FLOOR STRUCTURE
5	FIRST FLOOR STRUCTURE
6	GROUND FLOOR SLAB STRUCTURE
7	BASEMENT RETAINING WALLS

1. INTRODUCTION:

This project covers the design of the refurbishment and the new basement extension at No 25 Oakhill Avenue. The current calculation includes the design of a reinforced concrete basement slab, underpinning of party walls, design of lining walls and new concrete slab above basement to accommodate new Ground Floor layouts as well as the structural elements for the upper floors.

2. RELEVANT DOCUMENTS:

- Site geological investigation carried out by GEA Geotechnical Engineers.
- MBP's Construction Method Statement
- MBP's Specification for the works
- MBP's Structural Drawings for the works

3. STRUCTURAL DRAWINGS:

- MBP-8536-100- PROPOSED BASEMENT GENERAL ARRANGEMENT
- MBP-8536-101- PROPOSED GROUND FLOOR GENERAL ARRANGEMENT
- MBP-8536-102- PROPOSED FIRST FLOOR GENERAL ARRANGEMENT
- MBP-8536-103- PROPOSED SECOND FLOOR GENERAL ARRANGEMENT
- MBP-8536-104- PROPOSED THIRD FLOOR GENERAL ARRANGEMENT
- MBP-8536-103- PROPOSED ROOF GENERAL ARRANGEMENT
- MBP-8536-200- PROPOSED SECTION 1-1 GENERAL ARRANGEMENT
- MBP-8236-210- PROPOSED SECTION A-A GENERAL ARRANGEMENT
- MBP-8236-211- PROPOSED SECTION B-B GENERAL ARRANGEMENT

4. SECOND FLOOR STRUCTURE

The analysis and design of steel and timber elements has been carried out using TEDDS. The steel beams and timber joists has been designed to carry out the domestic loads. Results can be found in Section 4.

5. FIRST FLOOR STRUCTURE

The analysis and design of the Flat Roof steel elements has been carried out using TEDDS. The steel beams have been designed to support existing walls above and new flat roof structure with rooflights. Results can be found in Section 5.

6. GROUND FLOOR SLAB STRUCTURE

The ground floor will be reinforced concrete spanning between liner walls and internal loadbearing elements, the maximum span for the slab to be 6.0m the verification has been carried out using TEDDS. Results can be found in Section 6.

7. BASEMENT RETAINING WALLS

The analysis and design of the RC liner walls, has been carried out using TEDDS. The liner walls have been designed to support ground floor load. Results can be found in Section 8.

MBP

consulting engineers

Michael Barclay Partnership


1 Lancaster Place WC2E 7ED

T 020 7240 1191 F 020 7240 2241

E london@mbp-uk.com

Job Title	Job Number	Sheet Number	Revision
25 OAKHILL AVENUE, LONDON	8536	4.1	P1
Calculation/sketch Title	Date	Author	Checked
SECTION 4 SECOND FLOOR STRUCTURE	MAR 2023	AZ	TH

GEOMETRY

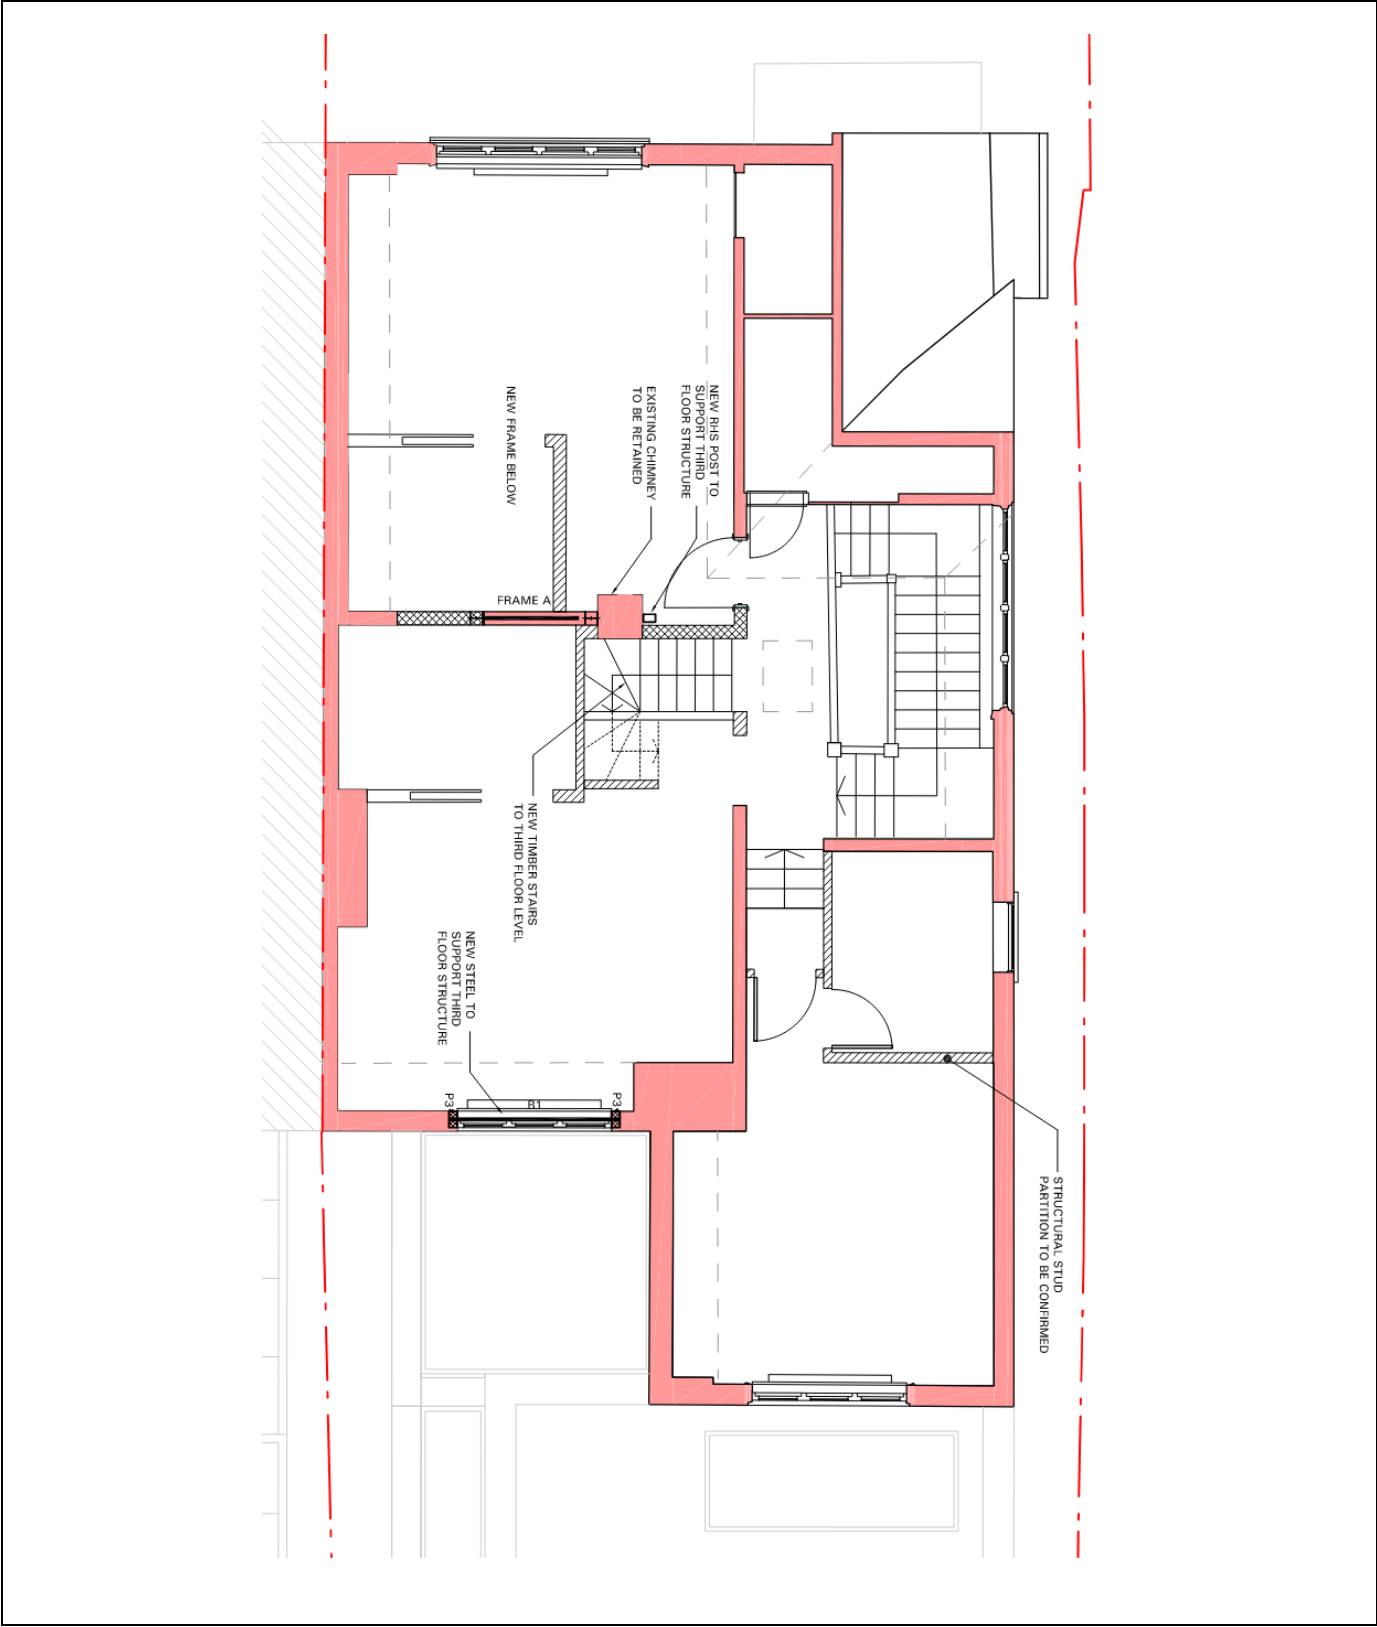

SECOND FLOOR PLAN

MBP	Michael Barclay Partnership
	consulting engineers
	1 Lancaster Place WC2E 7ED
T 020 7240 1191	F 020 7240 2241
E london@mbp-uk.com	

Job Title	Job Number	Sheet Number	Revision
25 OAKHILL AVENUE, LONDON	8536	4.3	P1
Calculation/sketch Title	Date	Author	Checked
SECTION 4	MAR 2023	AZ	TH
SECOND FLOOR STRUCTURE			

FRAME A

Max. span 1.4m

Load attracted from $11\text{m}/2 = 5.05\text{m}$

Hight of the wall – 2.6m


Loading on top memeber

	Dead load	Imposed load
Floor Loading	$1.15 \times 5.05 = 3.74 \text{ kN/m}$	$2.50 \times 0.5 = 8.12 \text{ kN/m}$
Wall	$4.30 \times 2.60 = 6.90 \text{ kN/m}$	
Total	<u>10.64 kN/m</u>	<u>8.12 kN/m</u>

STEEL BEAM ANALYSIS & DESIGN (EN1993-1-1:2005)

In accordance with EN1993-1-1:2005 incorporating Corrigenda February 2006 and April 2009 and the UK national annex

TEDDS calculation version 3.0.14

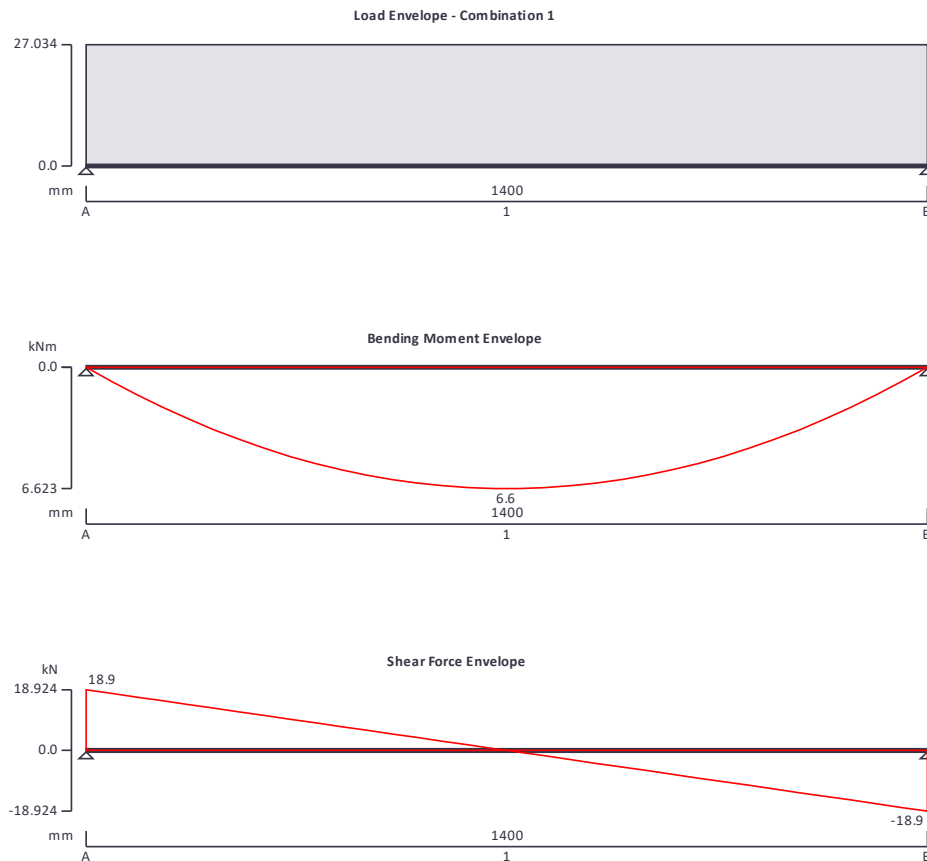

Support conditions

Support A

Vertically restrained

Rotationally free

Support B

Vertically restrained

Rotationally free

Applied loading

Beam loads

Permanent self weight of beam $\times 1$

Permanent full UDL 10.64 kN/m

Variable full UDL 8.12 kN/m

Load combinations

Load combination 1

Support A

Permanent $\times 1.35$

Variable $\times 1.50$

Permanent $\times 1.35$

Support B

Variable $\times 1.50$
Permanent $\times 1.35$
Variable $\times 1.50$
Analysis results

Maximum moment

 $M_{\max} = 6.6 \text{ kNm}$
 $M_{\min} = 0 \text{ kNm}$

Maximum shear

 $V_{\max} = 18.9 \text{ kN}$
 $V_{\min} = -18.9 \text{ kN}$

Deflection

 $\delta_{\max} = 0 \text{ mm}$
 $\delta_{\min} = 0 \text{ mm}$

Maximum reaction at support A

 $R_{A_{\max}} = 18.9 \text{ kN}$
 $R_{A_{\min}} = 18.9 \text{ kN}$

Unfactored permanent load reaction at support A

 $R_{A_{\text{Permanent}}} = 7.7 \text{ kN}$

Unfactored variable load reaction at support A

 $R_{A_{\text{Variable}}} = 5.7 \text{ kN}$

Maximum reaction at support B

 $R_{B_{\max}} = 18.9 \text{ kN}$
 $R_{B_{\min}} = 18.9 \text{ kN}$

Unfactored permanent load reaction at support B

 $R_{B_{\text{Permanent}}} = 7.7 \text{ kN}$

Unfactored variable load reaction at support B

 $R_{B_{\text{Variable}}} = 5.7 \text{ kN}$
Section details

Section type

UB 254x146x37 (BS4-1)

Steel grade

S275
EN 10025-2:2004 - Hot rolled products of structural steels

Nominal thickness of element

 $t = \max(t_f, t_w) = 10.9 \text{ mm}$


Nominal yield strength

 $f_y = 275 \text{ N/mm}^2$

Nominal ultimate tensile strength

 $f_u = 410 \text{ N/mm}^2$

Modulus of elasticity

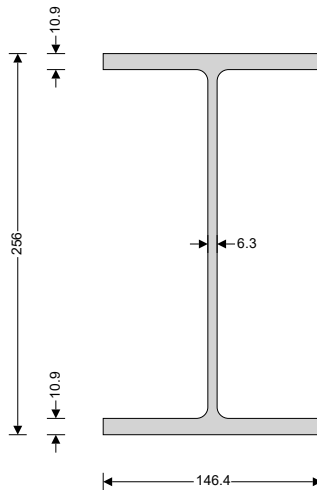 $E = 210000 \text{ N/mm}^2$

Partial factors - Section 6.1

Resistance of cross-sections

 $\gamma_{M0} = 1.00$

Resistance of members to instability

 $\gamma_{M1} = 1.00$

Resistance of tensile members to fracture

 $\gamma_{M2} = 1.10$
Lateral restraint

Span 1 has full lateral restraint

Effective length factors

Effective length factor in major axis

 $K_y = 1.000$

Effective length factor in minor axis

 $K_z = 1.000$

Effective length factor for torsion

 $K_{LT,A} = 1.000$
 $K_{LT,B} = 1.000$

Classification of cross sections - Section 5.5

 $\varepsilon = \sqrt{[235 \text{ N/mm}^2 / f_y]} = 0.92$

Internal compression parts subject to bending - Table 5.2 (sheet 1 of 3)

Width of section

 $c = d = 219 \text{ mm}$
 $c / t_w = 37.6 \times \varepsilon \leq 72 \times \varepsilon$ Class 1

Outstand flanges - Table 5.2 (sheet 2 of 3)

Width of section

 $c = (b - t_w - 2 \times r) / 2 = 62.5 \text{ mm}$
 $c / t_f = 6.2 \times \varepsilon \leq 9 \times \varepsilon$ Class 1

Section is class 1

Check shear - Section 6.2.6

Height of web

 $h_w = h - 2 \times t_f = 234.2 \text{ mm}$

Shear area factor

 $\eta = 1.000$
 $h_w / t_w < 72 \times \varepsilon / \eta$

Shear buckling resistance can be ignored

Design shear force

 $V_{Ed} = \max(\text{abs}(V_{\max}), \text{abs}(V_{\min})) = 18.9 \text{ kN}$

Shear area - cl 6.2.6(3)

 $A_v = \max(A - 2 \times b \times t_f + (t_w + 2 \times r) \times t_f, \eta \times h_w \times t_w) = 1759 \text{ mm}^2$

Design shear resistance - cl 6.2.6(2)

 $V_{c,Rd} = V_{pl,Rd} = A_v \times (f_y / \sqrt{3}) / \gamma_{M0} = 279.3 \text{ kN}$

PASS - Design shear resistance exceeds design shear force

Check bending moment major (y-y) axis - Section 6.2.5

Design bending moment

 $M_{Ed} = \max(\text{abs}(M_{s1_max}), \text{abs}(M_{s1_min})) = 6.6 \text{ kNm}$

Design bending resistance moment - eq 6.13

 $M_{c,Rd} = M_{pl,Rd} = W_{pl,y} \times f_y / \gamma_{M0} = 132.9 \text{ kNm}$

PASS - Design bending resistance moment exceeds design bending moment

Check vertical deflection - Section 7.2.1

Consider deflection due to variable loads

Limiting deflection

 $\delta_{lim} = L_{s1} / 360 = 3.9 \text{ mm}$

Maximum deflection span 1


 $\delta = \max(\text{abs}(\delta_{\max}), \text{abs}(\delta_{\min})) = 0.035 \text{ mm}$

PASS - Maximum deflection does not exceed deflection limit

STEEL BEAM ANALYSIS & DESIGN (EN1993-1-1:2005)

In accordance with EN1993-1-1:2005 incorporating Corrigenda February 2006 and April 2009 and the UK national annex

TEDDS calculation version 3.0.14

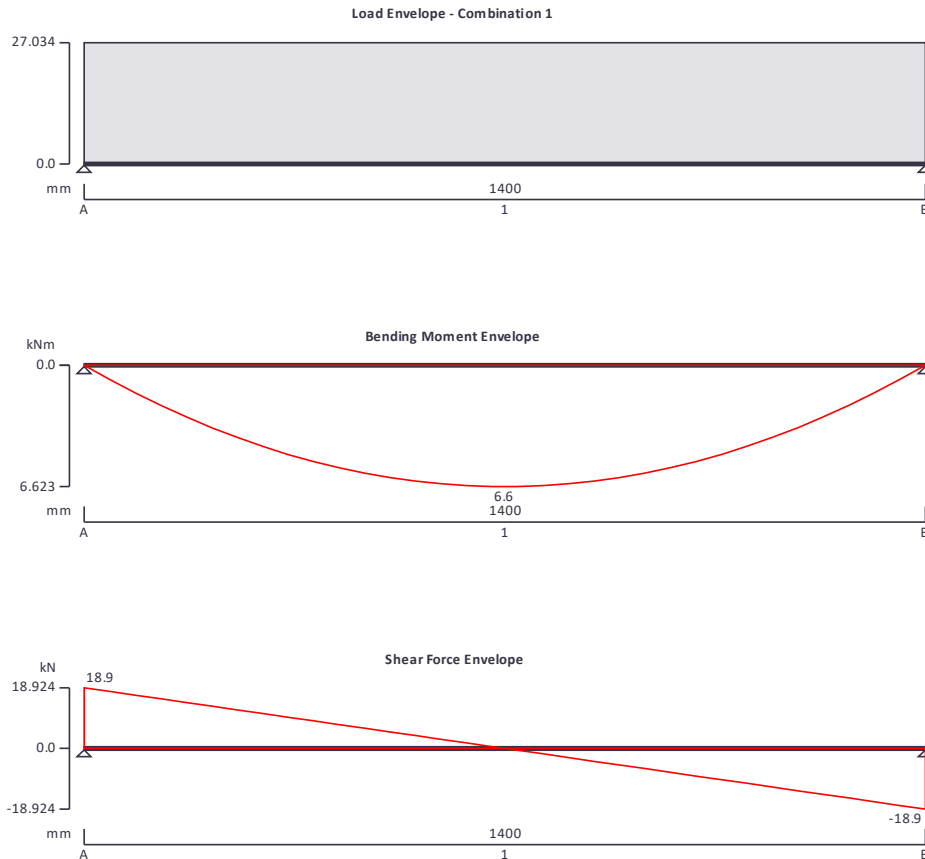

Support conditions

Support A

Vertically restrained

Rotationally free

Support B

Vertically restrained

Rotationally free

Applied loading

Beam loads

Permanent self weight of beam $\times 1$

Permanent full UDL 10.64 kN/m

Variable full UDL 8.12 kN/m

Load combinations

Load combination 1

Support A

Permanent $\times 1.35$

Variable $\times 1.50$

Permanent $\times 1.35$

Support B

Variable $\times 1.50$

Permanent $\times 1.35$

Variable $\times 1.50$

Analysis results

Maximum moment

$M_{\max} = 6.6 \text{ kNm}$

$M_{\min} = 0 \text{ kNm}$

Maximum shear

$V_{\max} = 18.9 \text{ kN}$

$V_{\min} = -18.9 \text{ kN}$

Deflection

$\delta_{\max} = 0 \text{ mm}$

$\delta_{\min} = 0 \text{ mm}$

Maximum reaction at support A

$R_{A_{\max}} = 18.9 \text{ kN}$

$R_{A_{\min}} = 18.9 \text{ kN}$

Unfactored permanent load reaction at support A

$R_{A_{\text{Permanent}}} = 7.7 \text{ kN}$

Unfactored variable load reaction at support A

$R_{A_{\text{Variable}}} = 5.7 \text{ kN}$

Maximum reaction at support B

$R_{B_{\max}} = 18.9 \text{ kN}$

$R_{B_{\min}} = 18.9 \text{ kN}$

Unfactored permanent load reaction at support B

$R_{B_{\text{Permanent}}} = 7.7 \text{ kN}$

Unfactored variable load reaction at support B

$R_{B_{\text{Variable}}} = 5.7 \text{ kN}$

Section details

Section type

UB 254x146x37 (BS4-1)

Steel grade

S275

EN 10025-2:2004 - Hot rolled products of structural steels

Nominal thickness of element

$t = \max(t_f, t_w) = 10.9 \text{ mm}$

Nominal yield strength


$f_y = 275 \text{ N/mm}^2$

Nominal ultimate tensile strength

$f_u = 410 \text{ N/mm}^2$

Modulus of elasticity

$E = 210000 \text{ N/mm}^2$

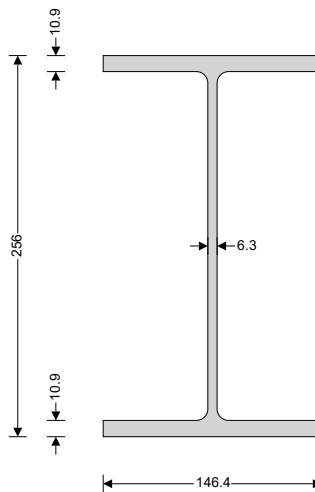

Partial factors - Section 6.1

Resistance of cross-sections

$\gamma_{M0} = 1.00$

Resistance of members to instability

$\gamma_{M1} = 1.00$

Resistance of tensile members to fracture

$\gamma_{M2} = 1.10$

Lateral restraint

Span 1 has full lateral restraint

Effective length factors

Effective length factor in major axis

$K_y = 1.000$

Effective length factor in minor axis

$$K_z = 1.000$$

Effective length factor for torsion

$$K_{LT,A} = 1.000$$

$$K_{LT,B} = 1.000$$

Classification of cross sections - Section 5.5

$$\varepsilon = \sqrt{[235 \text{ N/mm}^2 / f_y]} = 0.92$$

Internal compression parts subject to bending - Table 5.2 (sheet 1 of 3)

Width of section

$$c = d = 219 \text{ mm}$$

$$c / t_w = 37.6 \times \varepsilon \leq 72 \times \varepsilon \quad \text{Class 1}$$

Outstand flanges - Table 5.2 (sheet 2 of 3)

Width of section

$$c = (b - t_w - 2 \times r) / 2 = 62.5 \text{ mm}$$

$$c / t_f = 6.2 \times \varepsilon \leq 9 \times \varepsilon \quad \text{Class 1}$$

Section is class 1

Check shear - Section 6.2.6

Height of web

$$h_w = h - 2 \times t_f = 234.2 \text{ mm}$$

Shear area factor

$$\eta = 1.000$$

$$h_w / t_w < 72 \times \varepsilon / \eta$$

Shear buckling resistance can be ignored

Design shear force

$$V_{Ed} = \max(\text{abs}(V_{\max}), \text{abs}(V_{\min})) = 18.9 \text{ kN}$$

Shear area - cl 6.2.6(3)

$$A_v = \max(A - 2 \times b \times t_f + (t_w + 2 \times r) \times t_f, \eta \times h_w \times t_w) = 1759 \text{ mm}^2$$

Design shear resistance - cl 6.2.6(2)

$$V_{c,Rd} = V_{pl,Rd} = A_v \times (f_y / \sqrt{3}) / \gamma_{M0} = 279.3 \text{ kN}$$

PASS - Design shear resistance exceeds design shear force

Check bending moment major (y-y) axis - Section 6.2.5

Design bending moment

$$M_{Ed} = \max(\text{abs}(M_{s1_max}), \text{abs}(M_{s1_min})) = 6.6 \text{ kNm}$$

Design bending resistance moment - eq 6.13

$$M_{c,Rd} = M_{pl,Rd} = W_{pl,y} \times f_y / \gamma_{M0} = 132.9 \text{ kNm}$$

PASS - Design bending resistance moment exceeds design bending moment

Check vertical deflection - Section 7.2.1

Consider deflection due to variable loads

Limiting deflection

$$\delta_{lim} = L_{s1} / 360 = 3.9 \text{ mm}$$

Maximum deflection span 1

$$\delta = \max(\text{abs}(\delta_{\max}), \text{abs}(\delta_{\min})) = 0.035 \text{ mm}$$

PASS - Maximum deflection does not exceed deflection limit

MBP

consulting engineers

Michael Barclay Partnership


1 Lancaster Place WC2E 7ED

T 020 7240 1191 F 020 7240 2241

E london@mbp-uk.com

Job Title	Job Number	Sheet Number	Revision
25 OAKHILL AVENUE, LONDON	8536	5.1	P1
Calculation/sketch Title	Date	Author	Checked
SECTION 5 FIRST FLOOR STRUCTURE	MAR 2023	AZ	TH

GEOMETRY

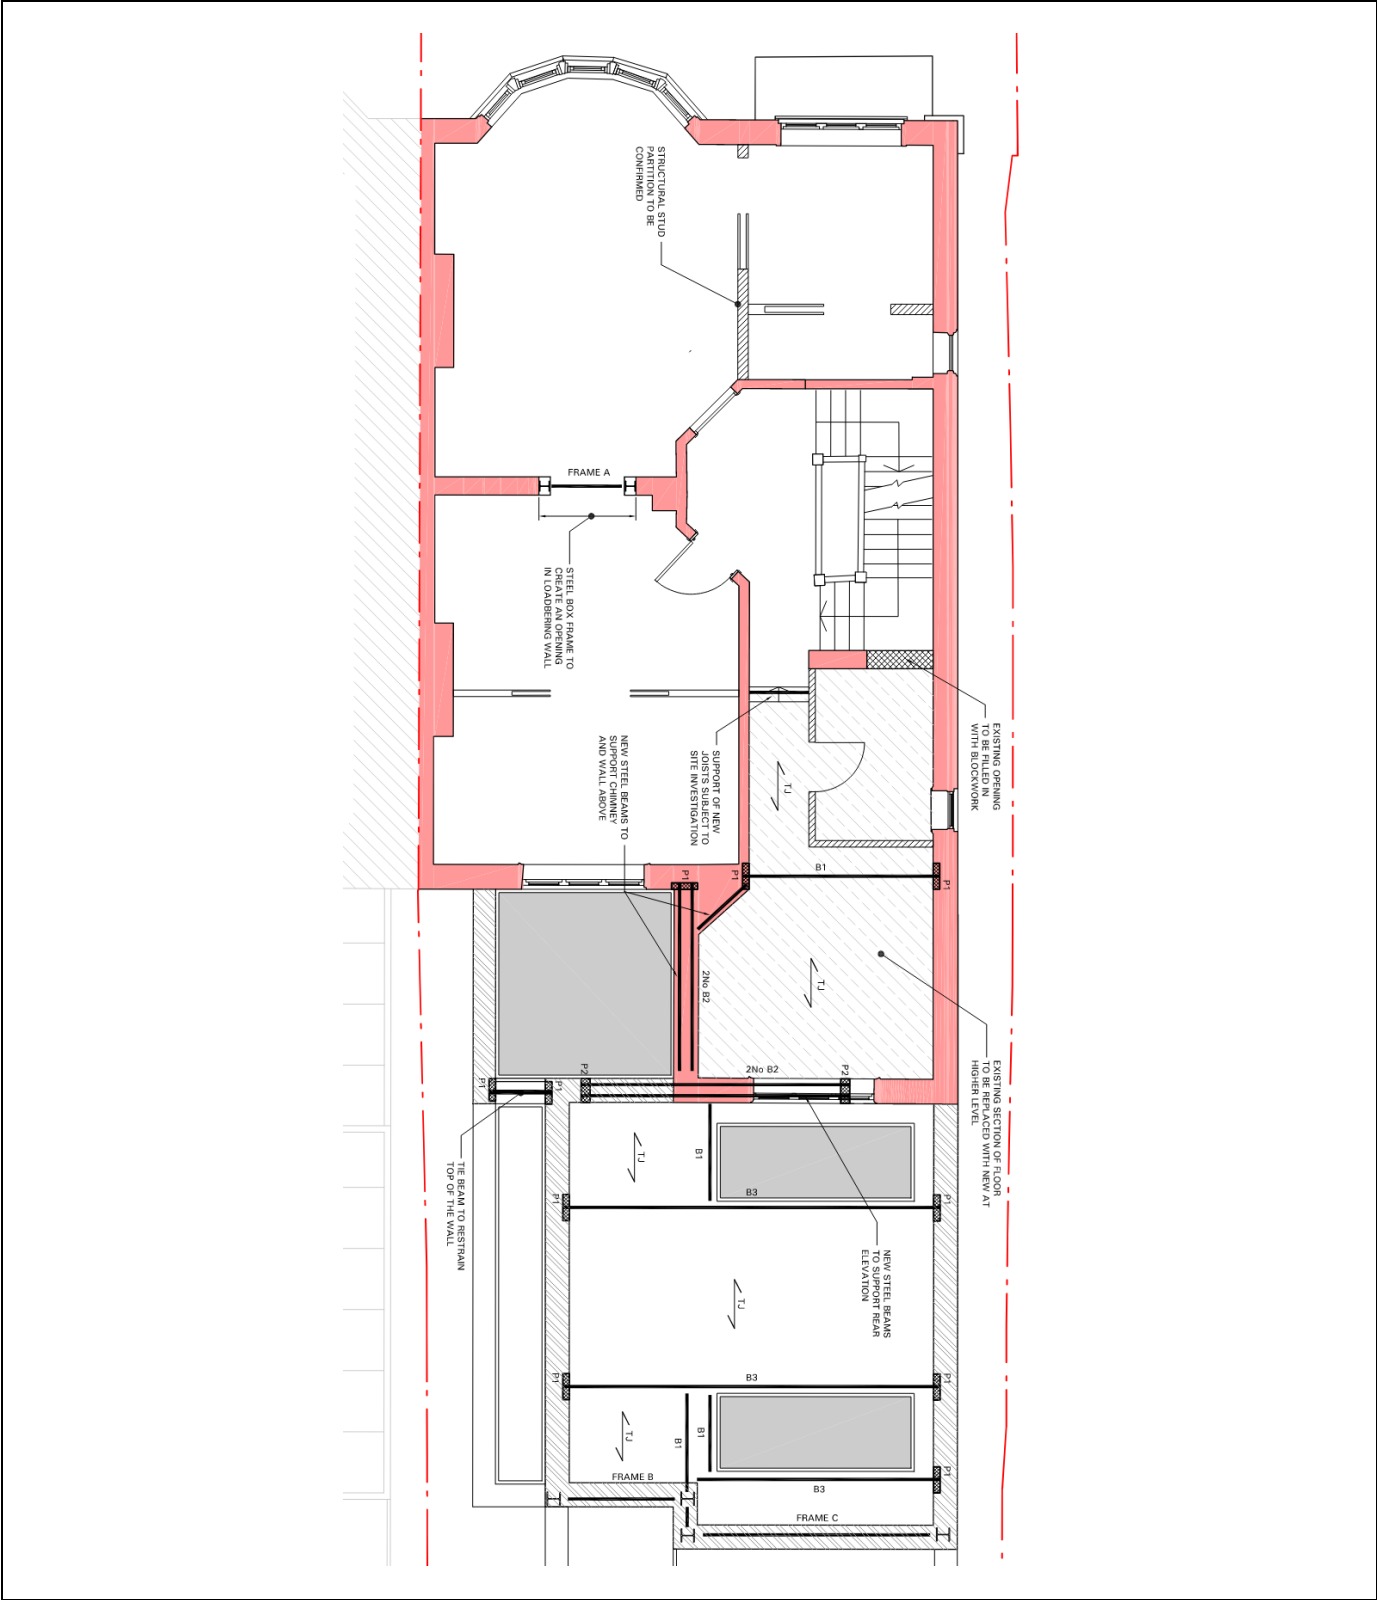

FIRST FLOOR PLAN

MBP

Michael Barclay Partnership

consulting engineers

1 Lancaster Place WC2E 7ED

T 020 7240 1191 F 020 7240 2241

E london@mbp-uk.com

Job Title	Job Number	Sheet Number	Revision
25 OAKHILL AVENUE, LONDON	8536	5.2	P1
Calculation/sketch Title	Date	Author	Checked
SECTION 5 FIRST FLOOR STRUCTURE	MAR 2023	AZ	TH

DEAD LOAD			
FLAT ROOF			
Flat roof finishes	0.50		
Waterproofing	0.20		
Insulation	0.10		
Timber joists	0.25		
Ceiling and services	0.25		
TOTAL	1.30	kN/m²	
FIRST FLOOR			
Floor finishes	0.25		
Boarding	0.15		
Timber joists	0.25		
Ceiling and services	0.25		
TOTAL	0.90	kN/m²	
Solid brick wall	4.30	kN/m²	
IMPOSED LOAD			
Imposed Load	2.50	kN/m²	

MBP	Michael Barclay Partnership
	consulting engineers
	1 Lancaster Place WC2E 7ED
T 020 7240 1191	F 020 7240 2241
E london@mbp-uk.com	

Job Title	Job Number	Sheet Number	Revision
25 OAKHILL AVENUE, LONDON	8536	5.4	P1
Calculation/sketch Title	Date	Author	Checked
SECTION 5	MAR 2023	AZ	TH
FIRST FLOOR STRUCTURE			

2No STEEL BEAM B2

Max. span 4.0m

Load attracted from timber floor $3.2\text{m}/2 = 1.6\text{m}$

Load attracted from Flat Roof $1.9\text{m}/2 = 0.8\text{m}$


	Dead load	Imposed load
First Floor	$0.9 \times 1.6 = 1.44 \text{ kN/m}$	$2.50 \times 1.6 = 4.00 \text{ kN/m}$
Flat Roof	$1.3 \times 0.9 = 1.20 \text{ kN/m}$	$2.50 \times 0.9 = 2.25 \text{ kN/m}$
TOTAL	2.64 kN/m	6.25 kN/m

Solid brick wall $4.30 \times 6.5\text{m} = \mathbf{28.00 \text{ kN/m}}$

STEEL BEAM ANALYSIS & DESIGN (EN1993-1-1:2005)

In accordance with EN1993-1-1:2005 incorporating Corrigenda February 2006 and April 2009 and the UK national annex

TEDDS calculation version 3.0.14

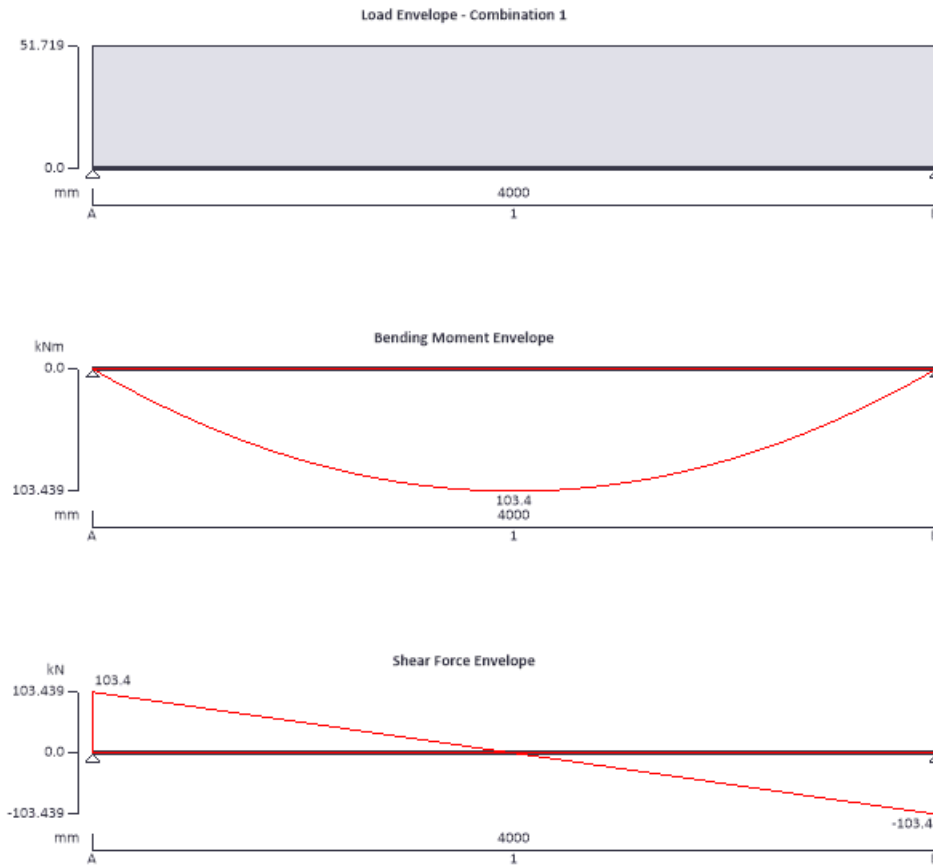

Support conditions

Support A

Vertically restrained

Rotationally free

Support B

Vertically restrained

Rotationally free

Applied loading

Beam loads

Permanent self weight of beam $\times 1$

Permanent full UDL 30.64 kN/m

Variable full UDL 6.25 kN/m

Load combinations

Load combination 1

Support A

Permanent $\times 1.35$

Variable $\times 1.50$

Permanent $\times 1.35$

Support B

Variable $\times 1.50$

Permanent $\times 1.35$

Variable $\times 1.50$

Analysis results

Maximum moment

$M_{\max} = 103.4 \text{ kNm}$

$M_{\min} = 0 \text{ kNm}$

Maximum shear

$V_{\max} = 103.4 \text{ kN}$

$V_{\min} = -103.4 \text{ kN}$

Deflection

$\delta_{\max} = 0.9 \text{ mm}$

$\delta_{\min} = 0 \text{ mm}$

Maximum reaction at support A

$R_{A_{\max}} = 103.4 \text{ kN}$

$R_{A_{\min}} = 103.4 \text{ kN}$

Unfactored permanent load reaction at support A

$R_{A_{\text{Permanent}}} = 62.7 \text{ kN}$

Unfactored variable load reaction at support A

$R_{A_{\text{Variable}}} = 12.5 \text{ kN}$

Maximum reaction at support B

$R_{B_{\max}} = 103.4 \text{ kN}$

$R_{B_{\min}} = 103.4 \text{ kN}$

Unfactored permanent load reaction at support B

$R_{B_{\text{Permanent}}} = 62.7 \text{ kN}$

Unfactored variable load reaction at support B

$R_{B_{\text{Variable}}} = 12.5 \text{ kN}$

Section details

Section type

2 x UB 254x146x37 (BS4-1)

Steel grade

S275

EN 10025-2:2004 - Hot rolled products of structural steels

Nominal thickness of element

$t = \max(t_f, t_w) = 10.9 \text{ mm}$

Nominal yield strength


$f_y = 275 \text{ N/mm}^2$

Nominal ultimate tensile strength

$f_u = 410 \text{ N/mm}^2$

Modulus of elasticity

$E = 210000 \text{ N/mm}^2$

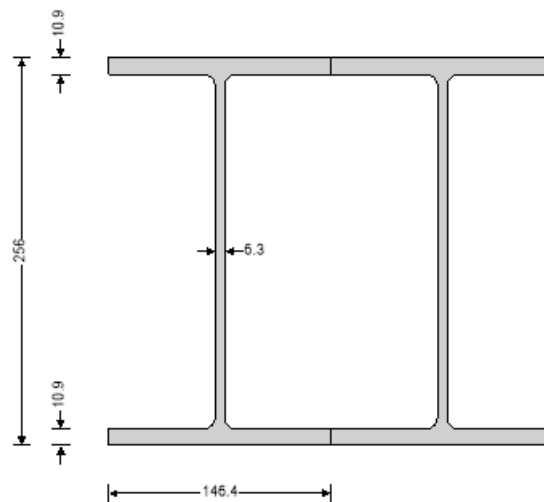

Partial factors - Section 6.1

Resistance of cross-sections

$\gamma_{M0} = 1.00$

Resistance of members to instability

$\gamma_{M1} = 1.00$

Resistance of tensile members to fracture

$\gamma_{M2} = 1.10$

Lateral restraint

Span 1 has full lateral restraint

Effective length factors

Effective length factor in major axis

$K_y = 1.000$

Project 25 OAKHILL AVENUE				Job Ref. 8536	
Section FIRST FLOOR STRUCTURE				Sheet no./rev. 5. 7	
Calc. by AZ	Date 28/03/2023	Chk'd by	Date	App'd by TH	Date 28/03/2023

Effective length factor in minor axis

$$K_z = 1.000$$

Effective length factor for torsion

$$K_{LT,A} = 1.000$$

$$K_{LT,B} = 1.000$$

Classification of cross sections - Section 5.5

$$\varepsilon = \sqrt{[235 \text{ N/mm}^2 / f_y]} = 0.92$$

Internal compression parts subject to bending - Table 5.2 (sheet 1 of 3)

Width of section

$$c = d = 219 \text{ mm}$$

$$c / t_w = 37.6 \times \varepsilon \leq 72 \times \varepsilon \quad \text{Class 1}$$

Outstand flanges - Table 5.2 (sheet 2 of 3)

Width of section

$$c = (b - t_w - 2 \times r) / 2 = 62.5 \text{ mm}$$

$$c / t_f = 6.2 \times \varepsilon \leq 9 \times \varepsilon \quad \text{Class 1}$$

Section is class 1

Check shear - Section 6.2.6

Height of web

$$h_w = h - 2 \times t_f = 234.2 \text{ mm}$$

Shear area factor

$$\eta = 1.000$$

$$h_w / t_w < 72 \times \varepsilon / \eta$$

Shear buckling resistance can be ignored

Design shear force

$$V_{Ed} = \max(\text{abs}(V_{\max}), \text{abs}(V_{\min})) = 103.4 \text{ kN}$$

Shear area - cl 6.2.6(3)

$$A_v = \max(A - 2 \times b \times t_f + (t_w + 2 \times r) \times t_f, \eta \times h_w \times t_w) = 1759 \text{ mm}^2$$

Design shear resistance - cl 6.2.6(2)

$$V_{c,Rd} = V_{pl,Rd} = N \times A_v \times (f_y / \sqrt{3}) / \gamma_{M0} = 558.7 \text{ kN}$$

PASS - Design shear resistance exceeds design shear force

Check bending moment major (y-y) axis - Section 6.2.5

Design bending moment

$$M_{Ed} = \max(\text{abs}(M_{s1_max}), \text{abs}(M_{s1_min})) = 103.4 \text{ kNm}$$

Design bending resistance moment - eq 6.13

$$M_{c,Rd} = M_{pl,Rd} = N \times W_{pl,y} \times f_y / \gamma_{M0} = 265.8 \text{ kNm}$$

PASS - Design bending resistance moment exceeds design bending moment

Check vertical deflection - Section 7.2.1

Consider deflection due to variable loads

Limiting deflection

$$\delta_{lim} = L_{s1} / 360 = 11.1 \text{ mm}$$

Maximum deflection span 1

$$\delta = \max(\text{abs}(\delta_{\max}), \text{abs}(\delta_{\min})) = 0.896 \text{ mm}$$

PASS - Maximum deflection does not exceed deflection limit

MBP	Michael Barclay Partnership
	consulting engineers
	1 Lancaster Place WC2E 7ED
T 020 7240 1191	F 020 7240 2241
E london@mbp-uk.com	

Job Title	Job Number	Sheet Number	Revision
25 OAKHILL AVENUE, LONDON	8536	5.8	P1
Calculation/sketch Title	Date	Author	Checked
SECTION 5	MAR 2023	AZ	TH
FIRST FLOOR STRUCTURE			

TYPICAL STEEL BEAM B3

Max. span 5.6m




Load attracted from $4.6\text{m}/2 = 2.3\text{m}$

	Dead load	Imposed load
Loading	$1.30 \times 2.30 = 3.00 \text{ kN/m}$	$2.50 \times 2.30 = 5.75 \text{ kN/m}$

STEEL BEAM ANALYSIS & DESIGN (EN1993-1-1:2005)

In accordance with EN1993-1-1:2005 incorporating Corrigenda February 2006 and April 2009 and the UK national annex

TEDDS calculation version 3.0.14

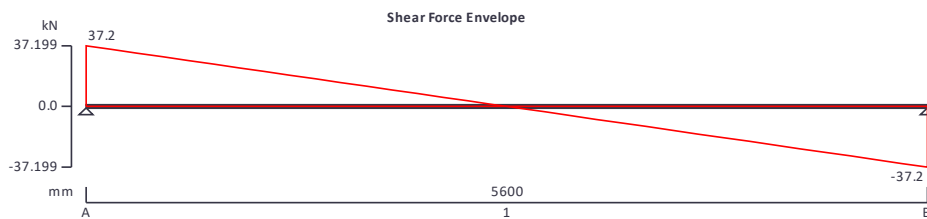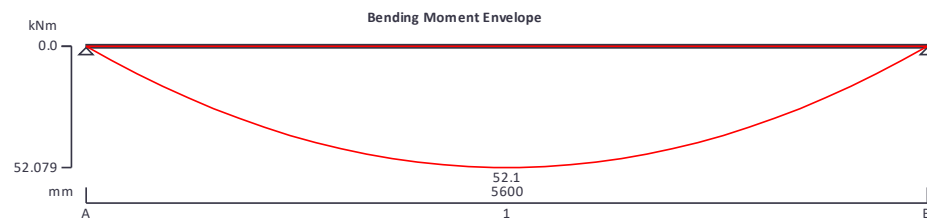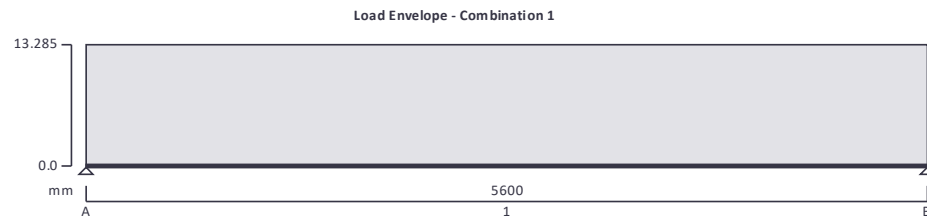

Support conditions

Support A

Vertically restrained

Rotationally free

Support B

Vertically restrained

Rotationally free

Applied loading

Beam loads

Permanent self weight of beam $\times 1$

Permanent full UDL 3 kN/m

Variable full UDL 5.75 kN/m

Load combinations

Load combination 1

Support A

Permanent $\times 1.35$

Variable $\times 1.50$

Permanent $\times 1.35$

Support B

Variable $\times 1.50$

Permanent $\times 1.35$

Variable $\times 1.50$
Analysis results

Maximum moment

 $M_{\max} = 52.1 \text{ kNm}$
 $M_{\min} = 0 \text{ kNm}$

Maximum shear

 $V_{\max} = 37.2 \text{ kN}$
 $V_{\min} = -37.2 \text{ kN}$

Deflection

 $\delta_{\max} = 7.7 \text{ mm}$
 $\delta_{\min} = 0 \text{ mm}$

Maximum reaction at support A

 $R_{A_{\max}} = 37.2 \text{ kN}$
 $R_{A_{\min}} = 37.2 \text{ kN}$

Unfactored permanent load reaction at support A

 $R_{A_{\text{Permanent}}} = 9.7 \text{ kN}$

Unfactored variable load reaction at support A

 $R_{A_{\text{Variable}}} = 16.1 \text{ kN}$

Maximum reaction at support B

 $R_{B_{\max}} = 37.2 \text{ kN}$
 $R_{B_{\min}} = 37.2 \text{ kN}$

Unfactored permanent load reaction at support B

 $R_{B_{\text{Permanent}}} = 9.7 \text{ kN}$

Unfactored variable load reaction at support B

 $R_{B_{\text{Variable}}} = 16.1 \text{ kN}$
Section details

Section type

UC 203x203x46 (BS4-1)

Steel grade

S275

EN 10025-2:2004 - Hot rolled products of structural steels

Nominal thickness of element

 $t = \max(t_f, t_w) = 11.0 \text{ mm}$


Nominal yield strength

 $f_y = 275 \text{ N/mm}^2$

Nominal ultimate tensile strength

 $f_u = 410 \text{ N/mm}^2$

Modulus of elasticity

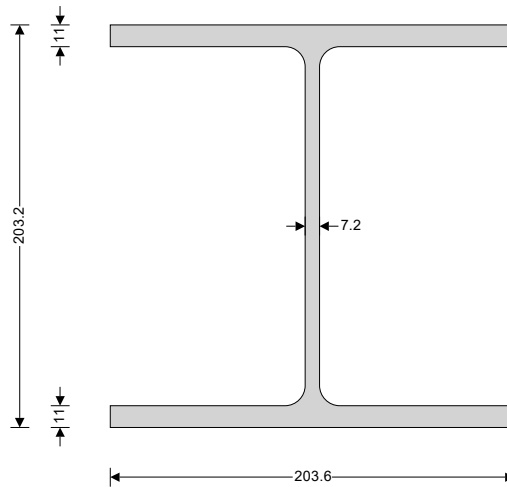 $E = 210000 \text{ N/mm}^2$

Partial factors - Section 6.1

Resistance of cross-sections

 $\gamma_{M0} = 1.00$

Resistance of members to instability

 $\gamma_{M1} = 1.00$

Resistance of tensile members to fracture

 $\gamma_{M2} = 1.10$
Lateral restraint

Span 1 has full lateral restraint

Effective length factors

Effective length factor in major axis

 $K_y = 1.000$

Project 25 OAKHILL AVENUE				Job Ref. 8536	
Section FIRST FLOOR STRUCTURE				Sheet no./rev. 5. 11	
Calc. by AZ	Date 28/03/2023	Chk'd by	Date	App'd by TH	Date 28/03/2023

Effective length factor in minor axis

$$K_z = 1.000$$

Effective length factor for torsion

$$K_{LT,A} = 1.000$$

$$K_{LT,B} = 1.000$$

Classification of cross sections - Section 5.5

$$\varepsilon = \sqrt{[235 \text{ N/mm}^2 / f_y]} = 0.92$$

Internal compression parts subject to bending - Table 5.2 (sheet 1 of 3)

Width of section

$$c = d = 160.8 \text{ mm}$$

$$c / t_w = 24.2 \times \varepsilon \leq 72 \times \varepsilon \quad \text{Class 1}$$

Outstand flanges - Table 5.2 (sheet 2 of 3)

Width of section

$$c = (b - t_w - 2 \times r) / 2 = 88 \text{ mm}$$

$$c / t_f = 8.7 \times \varepsilon \leq 9 \times \varepsilon \quad \text{Class 1}$$

Section is class 1

Check shear - Section 6.2.6

Height of web

$$h_w = h - 2 \times t_f = 181.2 \text{ mm}$$

Shear area factor

$$\eta = 1.000$$

$$h_w / t_w < 72 \times \varepsilon / \eta$$

Shear buckling resistance can be ignored

Design shear force

$$V_{Ed} = \max(\text{abs}(V_{\max}), \text{abs}(V_{\min})) = 37.2 \text{ kN}$$

Shear area - cl 6.2.6(3)

$$A_v = \max(A - 2 \times b \times t_f + (t_w + 2 \times r) \times t_f, \eta \times h_w \times t_w) = 1698 \text{ mm}^2$$

Design shear resistance - cl 6.2.6(2)

$$V_{c,Rd} = V_{pl,Rd} = A_v \times (f_y / \sqrt{3}) / \gamma_{M0} = 269.5 \text{ kN}$$

PASS - Design shear resistance exceeds design shear force

Check bending moment major (y-y) axis - Section 6.2.5

Design bending moment

$$M_{Ed} = \max(\text{abs}(M_{s1_max}), \text{abs}(M_{s1_min})) = 52.1 \text{ kNm}$$

Design bending resistance moment - eq 6.13

$$M_{c,Rd} = M_{pl,Rd} = W_{pl,y} \times f_y / \gamma_{M0} = 136.8 \text{ kNm}$$

PASS - Design bending resistance moment exceeds design bending moment

Check vertical deflection - Section 7.2.1

Consider deflection due to variable loads

Limiting deflection

$$\delta_{lim} = L_{s1} / 360 = 15.6 \text{ mm}$$

Maximum deflection span 1

$$\delta = \max(\text{abs}(\delta_{\max}), \text{abs}(\delta_{\min})) = 7.676 \text{ mm}$$

PASS - Maximum deflection does not exceed deflection limit

MBP	Michael Barclay Partnership
	consulting engineers
	1 Lancaster Place WC2E 7ED
T 020 7240 1191	F 020 7240 2241
E london@mbp-uk.com	

Job Title	Job Number	Sheet Number	Revision
25 OAKHILL AVENUE, LONDON	8536	5.12	P1
Calculation/sketch Title	Date	Author	Checked
SECTION 5	MAR 2023	AZ	TH
FIRST FLOOR STRUCTURE			

TYPICAL TIMBER JOISTS

Max. span 3.3m

	Dead load (excluding self weight)	Imposed load
Loading	0.9 kN/m ²	2.5 kN/m ²

TIMBER JOIST ANALYSIS & DESIGN (EN1995-1-1:2004)


In accordance with EN1995-1-1:2004 + A2:2014 incorporating corrigendum June 2006 and the UK national annex

Tedds calculation version 1.0.05

Joist details

Description 47 x 200 C18 timber joists

Joist spacing $S_{Joist} = 350 \text{ mm}$

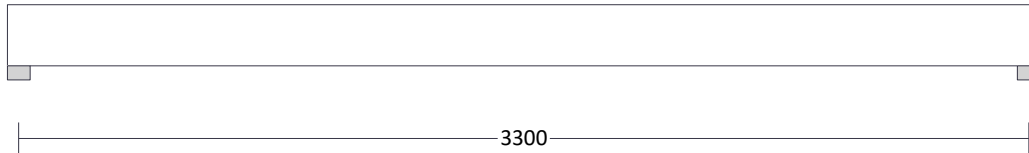

Forces input on Joist

Vertical permanent load on joist $F_{G_Joist} = 0.90 \text{ kN/m}^2$

Vertical imposed load on joist $F_{Q_Joist} = 2.50 \text{ kN/m}^2$

Joist loading details

Distributed loads

Vertical permanent load on joist $p_G = F_{G_Joist} \times S_{Joist} = 0.32 \text{ kN/m}$

Vertical imposed load on joist $p_Q = F_{Q_Joist} \times S_{Joist} = 0.88 \text{ kN/m}$

ANALYSIS

Tedds calculation version 1.0.36

Loading

Self weight included (Permanent x 1)

Load combination factors

Load combination	Permanent	Imposed	Snow	Wind
1.35G + 1.50Q (Strength)	1.35	1.50	0.00	0.00
1.00G + 1.00Q (Service)	1.00	1.00	0.00	0.00

Member Loads

Member	Load case	Load Type	Orientation	Description
Member	Permanent	UDL	GlobalZ	0.32 kN/m at 0 m to 3.3 m
Member	Imposed	UDL	GlobalZ	0.88 kN/m at 0 m to 3.3 m

Results

Total deflection

1.35G + 1.50Q (Strength) - Total deflection



1.00G + 1.00Q (Service) - Total deflection



Node deflections

Load combination: 1.35G + 1.50Q (Strength)

Node	Deflection		Rotation (°)	Co-ordinate system
	X (mm)	Z (mm)		
1	0	0	0.54079	
2	0	0	-0.54079	

Load combination: 1.00G + 1.00Q (Service)

Node	Deflection		Rotation (°)	Co-ordinate system
	X (mm)	Z (mm)		
1	0	0	0.37101	
2	0	0	-0.37101	

Total base reactions

Load case/combination	Force	
	FX (kN)	FZ (kN)
1.35G + 1.50Q (Strength)	0	5.9
1.00G + 1.00Q (Service)	0	4

Element end forces

Load combination: 1.35G + 1.50Q (Strength)


Element	Length (m)	Nodes Start/End	Axial force (kN)	Shear force (kN)	Moment (kNm)
1	3.3	1	0	-2.9	0
		2	0	-2.9	0

Load combination: 1.00G + 1.00Q (Service)

Element	Length (m)	Nodes Start/End	Axial force (kN)	Shear force (kN)	Moment (kNm)
1	3.3	1	0	-2	0
		2	0	-2	0

Forces

Strength combinations - Moment envelope (kNm)

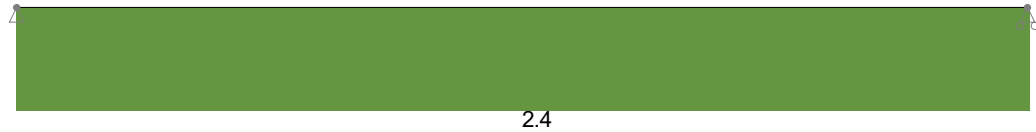

Strength combinations - Shear envelope (kN)



Member results

Envelope - Strength combinations

Member	Position (m)	Shear force (kN)	Moment (kNm)
Member	0	2.9 (max abs)	0 (min)
	1.65	0	2.4 (max)
	3.3	-2.9	0 (min)

Tedds calculation version 2.2.11

Member - Span 1

Partial factor for material properties and resistances

Partial factor for material properties - Table 2.3 $\gamma_M = 1.300$

Member details

Load duration - cl.2.3.1.2 Medium-term

Service class - cl.2.3.1.3 2


Timber section details

Number of timber sections in member N = 1

Breadth of sections b = 47 mm

Depth of sections h = 200 mm

Timber strength class - EN 338:2016 Table 1 C18

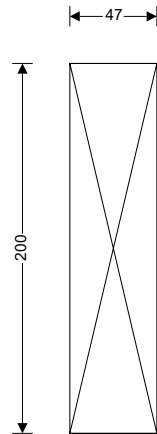

47x200 timber section

Cross-sectional area, A , 9400 mm²

Section modulus, W_y , 313333.3 mm³

Section modulus, W_z , 73633 mm³

Second moment of area, I_y , 31333333 mm⁴

Second moment of area, I_z , 1730383 mm⁴

Radius of gyration, i_y , 57.7 mm

Radius of gyration, i_z , 13.6 mm

Timber strength class C18

Characteristic bending strength, $f_{m,k}$, 18 N/mm²

Characteristic shear strength, $f_{v,k}$, 3.4 N/mm²

Characteristic compression strength parallel to grain, $f_{c,0,k}$, 18 N/mm²

Characteristic compression strength perpendicular to grain, $f_{c,90,k}$, 2.2 N/mm²

Characteristic tension strength parallel to grain, $f_{t,0,k}$, 10 N/mm²

Mean modulus of elasticity, $E_{0,mean}$, 9000 N/mm²

Fifth percentile modulus of elasticity, $E_{0,05}$, 6000 N/mm²

Shear modulus of elasticity, G_{mean} , 560 N/mm²

Characteristic density, ρ_k , 320 kg/m³

Mean density, ρ_{mean} , 380 kg/m³

Span details

Bearing length

 $L_b = 100$ mm

Member results summary	Unit	Capacity	Maximum	Utilisation	Result
Bearing stress	N/mm ²	1.5	0.6	0.419	PASS
Bending stress	N/mm ²	12.2	7.7	0.634	PASS
Shear stress	N/mm ²	2.3	0.7	0.304	PASS
Deflection	mm	13.2	12.7	0.962	PASS

Consider Combination 1 - 1.35G + 1.50Q (Strength)

Modification factors

Duration of load and moisture content - Table 3.1 $k_{mod} = 0.8$

Deformation factor - Table 3.2 $k_{def} = 0.8$

Bending stress re-distribution factor - cl.6.1.6(2) $k_m = 0.7$

Crack factor for shear resistance - cl.6.1.7(2) $k_{cr} = 0.67$

System strength factor - cl.6.6 $k_{sys} = 1.1$

Check design at start of span

Check compression perpendicular to the grain - cl.6.1.5

Design perpendicular compression - major axis $F_{c,y,90,d} = 2.933$ kN

Effective contact length $L_{b,ef} = L_b = 100$ mm

Design perpendicular compressive stress - exp.6.4 $\sigma_{c,y,90,d} = F_{c,y,90,d} / (b \times L_{b,ef}) = 0.624$ N/mm²

Design perpendicular compressive strength $f_{c,y,90,d} = k_{mod} \times k_{sys} \times f_{c,90,k} / \gamma_M = 1.489$ N/mm²
 $\sigma_{c,y,90,d} / (k_{c,90} \times f_{c,y,90,d}) = 0.419$

PASS - Design perpendicular compression strength exceeds design perpendicular compression stress

Check shear force - Section 6.1.7

Design shear force $F_{y,d} = 2.933$ kN

Design shear stress - exp.6.60 $\tau_{y,d} = 1.5 \times F_{y,d} / (k_{cr} \times b \times h) = 0.699$ N/mm²

Design shear strength $f_{v,y,d} = k_{mod} \times k_{sys} \times f_{v,k} / \gamma_M = 2.302$ N/mm²

Project 25 Oakhill Avenue				Job Ref. 8536	
Section SECTION 5				Sheet no./rev. 5.16	
Calc. by AZ	Date 28/03/2023	Chk'd by	Date	App'd by TH	Date 28/03/2023

$$\tau_{y,d} / f_{v,y,d} = 0.304$$

PASS - Design shear strength exceeds design shear stress

Check design 1650 mm along span

Check bending moment - Section 6.1.6

Design bending moment

$$M_{y,d} = 2.42 \text{ kNm}$$

Design bending stress

$$\sigma_{m,y,d} = M_{y,d} / W_y = 7.723 \text{ N/mm}^2$$

Design bending strength

$$f_{m,y,d} = k_{mod} \times k_{sys} \times f_{m,k} / \gamma_M = 12.185 \text{ N/mm}^2$$

$$\sigma_{m,y,d} / f_{m,y,d} = 0.634$$

PASS - Design bending strength exceeds design bending stress

Consider Combination 2 - 1.00G + 1.00Q (Service)

Check design 1650 mm along span

Check y-y axis deflection - Section 7.2

Instantaneous deflection

$$\delta_y = 7.1 \text{ mm}$$

Quasi-permanent variable load factor

$$\psi_2 = 0.3$$

Final deflection with creep

$$\delta_{y,Final} = \delta_y \times (1 + k_{def}) = 12.7 \text{ mm}$$

Allowable deflection

$$\delta_{y,Allowable} = L_{m1,s1} / 250 = 13.2 \text{ mm}$$

$$\delta_{y,Final} / \delta_{y,Allowable} = 0.962$$

PASS - Allowable deflection exceeds final deflection


RC SLAB DESIGN

In accordance with EN1992-1-1:2004 incorporating corrigendum January 2008 and the UK national annex

Tedds calculation version 1.0.21

Design summary

Description	Unit	Provided	Required	Utilisation	Result
Short span					
Reinf. at midspan	mm ² /m	1005	311	0.309	PASS
Bar spacing at midspan	mm	200	300	0.667	PASS
Shear at discont. supp	kN/m	103.9	23.8	0.229	PASS
Deflection ratio		27.83	39.31	0.708	PASS
Long span					
Reinf. at midspan	mm ² /m	1005	261	0.260	PASS
Bar spacing at midspan	mm	200	300	0.667	PASS
Shear at discont. supp	kN/m	99.0	23.8	0.240	PASS
Cover					
Min cover bottom	mm	30	26	0.867	PASS

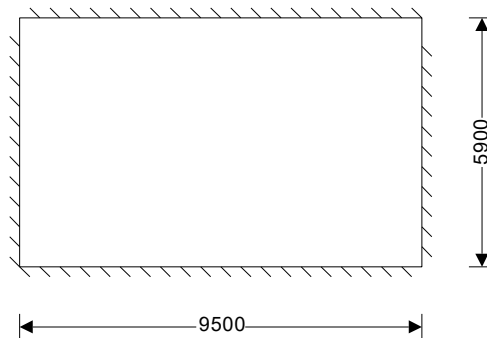

Slab definition

Slab reference name

250mm RC Slab

Type of slab

Two way spanning with restrained edges

Overall slab depth

h = 250 mm

Shorter effective span of panel

l_x = 5900 mm

Longer effective span of panel

l_y = 9500 mm

Support conditions

Four edges discontinuous

Bottom outer layer of reinforcement

Short span direction

Loading

Characteristic permanent action

G_k = 3.2 kN/m²

Characteristic variable action

Q_k = 2.5 kN/m²

Partial factor for permanent action

γ_G = 1.35

Partial factor for variable action

γ_Q = 1.50

Quasi-permanent value of variable action

ψ₂ = 0.30

Design ultimate load

q = γ_G × G_k + γ_Q × Q_k = 8.1 kN/m²

Quasi-permanent load

q_{SLS} = 1.0 × G_k + ψ₂ × Q_k = 4.0 kN/m²

Project 25 OAKHILL AVENUE				Job Ref. 8536	
Section GROUND FLOOR STRUCTURE				Sheet no./rev. 6. 4	
Calc. by AZ	Date 28/03/2023	Chk'd by	Date	App'd by TH	Date 28/03/2023

Concrete properties

Concrete strength class	C25/30
Characteristic cylinder strength	$f_{ck} = 25 \text{ N/mm}^2$
Partial factor (Table 2.1N)	$\gamma_c = 1.50$
Compressive strength factor (cl. 3.1.6)	$\alpha_{cc} = 0.85$
Design compressive strength (cl. 3.1.6)	$f_{cd} = 14.2 \text{ N/mm}^2$
Mean axial tensile strength (Table 3.1)	$f_{ctm} = 0.30 \text{ N/mm}^2 \times (f_{ck} / 1 \text{ N/mm}^2)^{2/3} = 2.6 \text{ N/mm}^2$
Maximum aggregate size	$d_g = 20 \text{ mm}$

Reinforcement properties

Characteristic yield strength	$f_{yk} = 500 \text{ N/mm}^2$
Partial factor (Table 2.1N)	$\gamma_s = 1.15$
Design yield strength (fig. 3.8)	$f_{yd} = f_{yk} / \gamma_s = 434.8 \text{ N/mm}^2$

Concrete cover to reinforcement

Nominal cover to outer bottom reinforcement	$c_{nom_b} = 30 \text{ mm}$
Fire resistance period to bottom of slab	$R_{btm} = 60 \text{ min}$
Axial distance to bottom reinf (Table 5.8)	$a_{fi_b} = 15 \text{ mm}$
Min. btm cover requirement with regard to bond	$c_{min,b_b} = 16 \text{ mm}$
Reinforcement fabrication	Not subject to QA system
Cover allowance for deviation	$\Delta C_{dev} = 10 \text{ mm}$
Min. required nominal cover to bottom reinf	$c_{nom_b_min} = 26.0 \text{ mm}$

PASS - There is sufficient cover to the bottom reinforcement

Reinforcement design at midspan in short span direction (cl.6.1)

Bending moment coefficient	$\beta_{sx_p} = 0.0968$
Design bending moment	$M_{x_p} = \beta_{sx_p} \times q \times l_x^2 = 27.2 \text{ kNm/m}$
Reinforcement provided	16 mm dia. bars at 200 mm centres
Area provided	$A_{sx_p} = 1005 \text{ mm}^2/\text{m}$
Effective depth to tension reinforcement	$d_{x_p} = h - c_{nom_b} - \phi_{x_p} / 2 = 212.0 \text{ mm}$
K factor	$K = M_{x_p} / (b \times d_{x_p}^2 \times f_{ck}) = 0.024$
Redistribution ratio	$\delta = 1.0$
K' factor	$K' = 0.598 \times \delta - 0.18 \times \delta^2 - 0.21 = 0.208$

$K < K'$ - Compression reinforcement is not required

Lever arm	$z = \min(0.95 \times d_{x_p}, d_{x_p} / 2 \times (1 + \sqrt{(1 - 3.53 \times K)})) = 201.4 \text{ mm}$
Area of reinforcement required for bending	$A_{sx_p_m} = M_{x_p} / (f_{yd} \times z) = 311 \text{ mm}^2/\text{m}$
Minimum area of reinforcement required	$A_{sx_p_min} = \max(0.26 \times (f_{ctm} / f_{yk}) \times b \times d_{x_p}, 0.0013 \times b \times d_{x_p}) = 283 \text{ mm}^2/\text{m}$
Area of reinforcement required	$A_{sx_p_req} = \max(A_{sx_p_m}, A_{sx_p_min}) = 311 \text{ mm}^2/\text{m}$

PASS - Area of reinforcement provided exceeds area required

Check reinforcement spacing

Reinforcement service stress	$\sigma_{sx_p} = (f_{yk} / \gamma_s) \times \min((A_{sx_p_m} / A_{sx_p}), 1.0) \times q_{SLS} / q = 65.8 \text{ N/mm}^2$
Maximum allowable spacing (Table 7.3N)	$s_{max_x_p} = 300 \text{ mm}$
Actual bar spacing	$s_{x_p} = 200 \text{ mm}$

PASS - The reinforcement spacing is acceptable

Project 25 OAKHILL AVENUE				Job Ref. 8536	
Section GROUND FLOOR STRUCTURE				Sheet no./rev. 6. 5	
Calc. by AZ	Date 28/03/2023	Chk'd by	Date	App'd by TH	Date 28/03/2023

Reinforcement design at midspan in long span direction (cl.6.1)

Bending moment coefficient	$\beta_{sy_p} = 0.0560$
Design bending moment	$M_{y_p} = \beta_{sy_p} \times q \times l_x^2 = 15.7 \text{ kNm/m}$
Reinforcement provided	16 mm dia. bars at 200 mm centres
Area provided	$A_{sy_p} = 1005 \text{ mm}^2/\text{m}$
Effective depth to tension reinforcement	$d_{y_p} = h - c_{nom_b} - \phi_{x_p} - \phi_{y_p} / 2 = 196.0 \text{ mm}$
K factor	$K = M_{y_p} / (b \times d_{y_p}^2 \times f_{ck}) = 0.016$
Redistribution ratio	$\delta = 1.0$
K' factor	$K' = 0.598 \times \delta - 0.18 \times \delta^2 - 0.21 = 0.208$

K < K' - Compression reinforcement is not required

Lever arm	$z = \min(0.95 \times d_{y_p}, d_{y_p}/2 \times (1 + \sqrt{(1 - 3.53 \times K)})) = 186.2 \text{ mm}$
Area of reinforcement required for bending	$A_{sy_p_m} = M_{y_p} / (f_{yd} \times z) = 194 \text{ mm}^2/\text{m}$
Minimum area of reinforcement required	$A_{sy_p_min} = \max(0.26 \times (f_{ctm}/f_{yk}) \times b \times d_{y_p}, 0.0013 \times b \times d_{y_p}) = 261 \text{ mm}^2/\text{m}$
Area of reinforcement required	$A_{sy_p_req} = \max(A_{sy_p_m}, A_{sy_p_min}) = 261 \text{ mm}^2/\text{m}$

PASS - Area of reinforcement provided exceeds area required

Check reinforcement spacing

Reinforcement service stress	$\sigma_{sy_p} = (f_{yk} / \gamma_s) \times \min((A_{sy_p_m}/A_{sy_p}), 1.0) \times q_{SLS} / q = 41.1 \text{ N/mm}^2$
Maximum allowable spacing (Table 7.3N)	$s_{max_y_p} = 300 \text{ mm}$
Actual bar spacing	$s_{y_p} = 200 \text{ mm}$

PASS - The reinforcement spacing is acceptable

Shear capacity check at short span discontinuous support

Shear force	$V_{x_d} = q \times l_x / 2 = 23.8 \text{ kN/m}$
Reinforcement provided	8 mm dia. bars at 200 mm centres
Area provided	$A_{sx_d} = 251 \text{ mm}^2/\text{m}$
Effective depth	$d_{x_d} = h - c_{nom_b} - \phi_{x_d} / 2 = 216.0 \text{ mm}$
Effective depth factor	$k = \min(2.0, 1 + (200 \text{ mm} / d_{x_d})^{0.5}) = 1.962$
Reinforcement ratio	$\rho_l = \min(0.02, A_{sx_d} / (b \times d_{x_d})) = 0.0012$
Minimum shear resistance	$V_{Rd,c_min} = 0.035 \text{ N/mm}^2 \times k^{1.5} \times (f_{ck} / 1 \text{ N/mm}^2)^{0.5} \times b \times d_{x_d}$ $V_{Rd,c_min} = 103.9 \text{ kN/m}$
Shear resistance constant (cl. 6.2.2)	$C_{Rd,c} = 0.18 \text{ N/mm}^2 / \gamma_c = 0.12 \text{ N/mm}^2$

$$V_{Rd,c_x_d} = \max(V_{Rd,c_min}, C_{Rd,c} \times k \times (100 \times \rho_l \times (f_{ck}/1 \text{ N/mm}^2))^{0.333} \times b \times d_{x_d}) = 103.9 \text{ kN/m}$$

PASS - Shear capacity is adequate (0.229)

Shear capacity check at long span discontinuous support

Shear force	$V_{y_d} = q \times l_x / 2 = 23.8 \text{ kN/m}$
Reinforcement provided	8 mm dia. bars at 200 mm centres
Area provided	$A_{sy_d} = 251 \text{ mm}^2/\text{m}$
Effective depth	$d_{y_d} = h - c_{nom_b} - \phi_{x_p} - \phi_{y_d} / 2 = 200.0 \text{ mm}$
Effective depth factor	$k = \min(2.0, 1 + (200 \text{ mm} / d_{y_d})^{0.5}) = 2.000$
Reinforcement ratio	$\rho_l = \min(0.02, A_{sy_d} / (b \times d_{y_d})) = 0.0013$
Minimum shear resistance	$V_{Rd,c_min} = 0.035 \text{ N/mm}^2 \times k^{1.5} \times (f_{ck} / 1 \text{ N/mm}^2)^{0.5} \times b \times d_{y_d}$ $V_{Rd,c_min} = 99.0 \text{ kN/m}$
Shear resistance constant (cl. 6.2.2)	$C_{Rd,c} = 0.18 \text{ N/mm}^2 / \gamma_c = 0.12 \text{ N/mm}^2$

Project 25 OAKHILL AVENUE				Job Ref. 8536	
Section GROUND FLOOR STRUCTURE				Sheet no./rev. 6. 6	
Calc. by AZ	Date 28/03/2023	Chk'd by	Date	App'd by TH	Date 28/03/2023

Shear resistance

$$V_{Rd,c,y,d} = \max(V_{Rd,c,min}, C_{Rd,c} \times k \times (100 \times \rho_l \times (f_{ck}/1 \text{ N/mm}^2))^{0.333} \times b \times d_{y,d}) = \mathbf{99.0 \text{ kN/m}}$$

PASS - Shear capacity is adequate (0.240)

Basic span-to-depth deflection ratio check (cl. 7.4.2)

Reference reinforcement ratio $\rho_0 = (f_{ck} / 1 \text{ N/mm}^2)^{0.5} / 1000 = \mathbf{0.0050}$

Required tension reinforcement ratio $\rho = \max(0.0035, A_{sx,p,req} / (b \times d_{x,p})) = \mathbf{0.0035}$

Required compression reinforcement ratio $\rho' = A_{scx,p,req} / (b \times d_{x,p}) = \mathbf{0.0000}$

Structural system factor (Table 7.4N) $K_\delta = \mathbf{1.0}$

Basic limit span-to-depth ratio (Exp. 7.16)

$$\text{ratio}_{lim,x,bas} = K_\delta \times [11 + 1.5 \times (f_{ck}/1 \text{ N/mm}^2)^{0.5} \times \rho_0 / \rho + 3.2 \times (f_{ck}/1 \text{ N/mm}^2)^{0.5} \times (\rho_0 / \rho - 1)^{1.5}] = \mathbf{26.20}$$

Mod span-to-depth ratio limit

$$\text{ratio}_{lim,x} = \min(40 \times K_\delta, \min(1.5, (500 \text{ N/mm}^2 / f_{yk}) \times (A_{sx,p} / A_{sx,p,m})) \times \text{ratio}_{lim,x,bas}) = \mathbf{39.31}$$

Actual span-to-eff. depth ratio

$$\text{ratio}_{act,x} = l_x / d_{x,p} = \mathbf{27.83}$$


PASS - Actual span-to-effective depth ratio is acceptable

Reinforcement summary

Midspan in short span direction	16 mm dia. bars at 200 mm centres B1
Midspan in long span direction	16 mm dia. bars at 200 mm centres B2
Discontinuous support in short span direction	8 mm dia. bars at 200 mm centres B1
Discontinuous support in long span direction	8 mm dia. bars at 200 mm centres B2

Reinforcement sketch

The following sketch is indicative only. Note that additional reinforcement may be required in accordance with clauses 9.2.1.2, 9.2.1.4 and 9.2.1.5 of EN 1992-1-1:2004 to meet detailing rules.

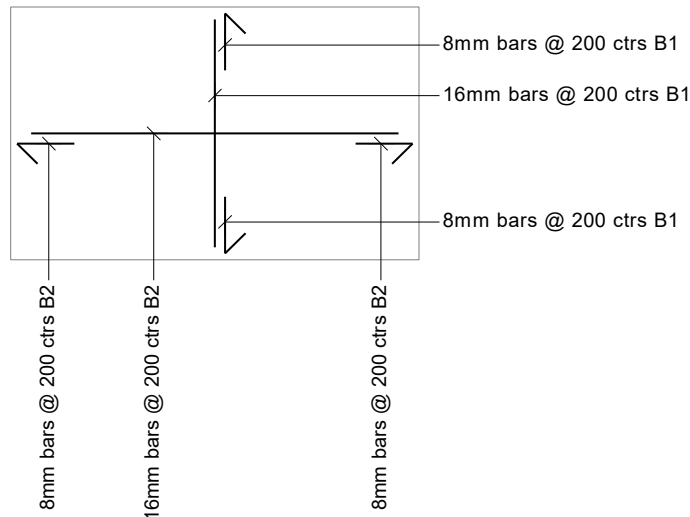

GEOMETRY



SECTION THROUGHT RETAINING WALL

MBP	Michael Barclay Partnership
	consulting engineers
	1 Lancaster Place WC2E 7ED
T 020 7240 1191	F 020 7240 2241
E london@mbp-uk.com	

Job Title	Job Number	Sheet Number	Revision
25 OAKHILL AVENUE, LONDON	8536	7.2	P1
Calculation/sketch Title	Date	Author	Checked
SECTION 7	MAR 2023	AZ	TH
RETAINING WALL CALCULATION			


575mm THICK RETAINING WALL

DEAD LOAD	
VERTICAL LOAD:	
Roof	$1.05 \text{ kN/m}^2 \times 1.1\text{m} = 2.15 \text{ kN/m}$
Second Floor	$0.90 \text{ kN/m}^2 \times 1.9\text{m} = 1.71 \text{ kN/m}$
Flat Roof	$1.30 \text{ kN/m}^2 \times 1.9\text{m} = 2.50 \text{ kN/m}$
Ground Floor	$6.80 \text{ kN/m}^2 \times 3.4\text{m} = 23.12 \text{ kN/m}$
TOTAL:	29.50 kN/m
Existing Wall	$6.31 \text{ kN/m}^2 \times 10\text{m} = 63.10 \text{ kN/m}$
GROUND FORCE: (trapezional force) height 4.4m, $\gamma = 18.5 \text{ kN/m}^3$	
IMPOSED LOAD	
VERTICAL LOAD:	
Roof	$0.6 \text{ kN/m}^2 \times 1.1\text{m} = 0.66 \text{ kN/m}$
Second Floor	$2.5 \text{ kN/m}^2 \times 1.9\text{m} = 4.75 \text{ kN/m}$
Flat Roof	$1.5 \text{ kN/m}^2 \times 1.9\text{m} = 2.85 \text{ kN/m}$
Ground Floor	$2.5 \text{ kN/m}^2 \times 3.4\text{m} = 8.50 \text{ kN/m}$
TOTAL:	16.76 kN/m
SURCHARGE:	5 kN/m^2
WATER:	Full high water level 3.0m above slab

575 mm thick Lining wall to be propped at the bottom by RC slab.

RETAINING WALL ANALYSIS (BS 8002:1994)

TEDDS calculation version 1.2.01.08

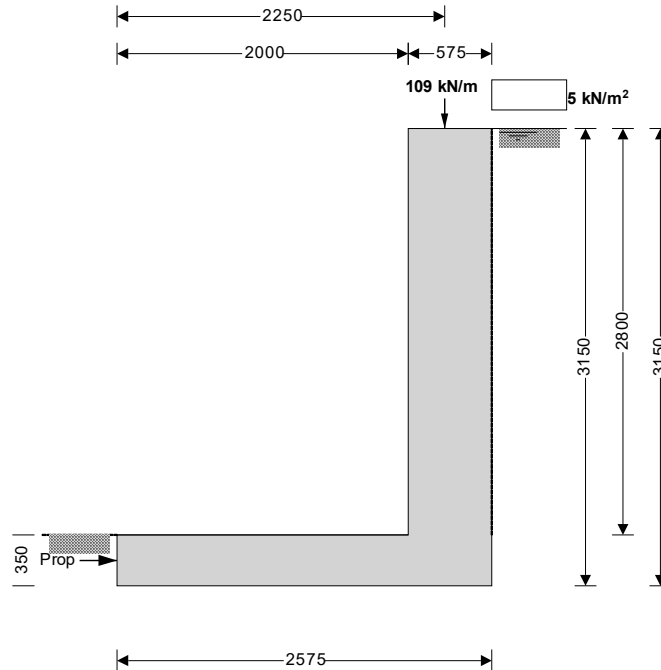

Wall details

Retaining wall type

Height of retaining wall stem

Thickness of wall stem

Length of toe

Length of heel

Overall length of base

Thickness of base

Depth of downstand

Position of downstand

Thickness of downstand

Height of retaining wall

Depth of cover in front of wall

Depth of unplanned excavation

Height of ground water behind wall

Height of saturated fill above base

Density of wall construction

Density of base construction

Angle of rear face of wall

Angle of soil surface behind wall

Effective height at virtual back of wall

Cantilever propped at base

$h_{\text{stem}} = 2800 \text{ mm}$

$t_{\text{wall}} = 575 \text{ mm}$

$l_{\text{toe}} = 2000 \text{ mm}$

$l_{\text{heel}} = 0 \text{ mm}$

$l_{\text{base}} = l_{\text{toe}} + l_{\text{heel}} + t_{\text{wall}} = 2575 \text{ mm}$

$t_{\text{base}} = 350 \text{ mm}$

$d_{\text{ds}} = 0 \text{ mm}$

$l_{\text{ds}} = 500 \text{ mm}$

$t_{\text{ds}} = 350 \text{ mm}$

$h_{\text{wall}} = h_{\text{stem}} + t_{\text{base}} + d_{\text{ds}} = 3150 \text{ mm}$

$d_{\text{cover}} = 0 \text{ mm}$

$d_{\text{exc}} = 0 \text{ mm}$

$h_{\text{water}} = 3150 \text{ mm}$

$h_{\text{sat}} = \max(h_{\text{water}} - t_{\text{base}} - d_{\text{ds}}, 0 \text{ mm}) = 2800 \text{ mm}$

$\gamma_{\text{wall}} = 24.0 \text{ kN/m}^3$

$\gamma_{\text{base}} = 24.0 \text{ kN/m}^3$

$\alpha = 90.0 \text{ deg}$

$\beta = 0.0 \text{ deg}$

$h_{\text{eff}} = h_{\text{wall}} + l_{\text{heel}} \times \tan(\beta) = 3150 \text{ mm}$

Retained material details

Mobilisation factor	$M = 1.5$
Moist density of retained material	$\gamma_m = 18.5 \text{ kN/m}^3$
Saturated density of retained material	$\gamma_s = 21.5 \text{ kN/m}^3$
Design shear strength	$\phi' = 34.0 \text{ deg}$
Angle of wall friction	$\delta = 0.7 \text{ deg}$

Base material details

Stiff clay	
Moist density	$\gamma_{mb} = 18.5 \text{ kN/m}^3$
Design shear strength	$\phi'_b = 34.0 \text{ deg}$
Design base friction	$\delta_b = 0.7 \text{ deg}$
Allowable bearing pressure	$P_{\text{bearing}} = 300 \text{ kN/m}^2$

Using Coulomb theory

Active pressure coefficient for retained material

$$K_a = \sin(\alpha + \phi')^2 / (\sin(\alpha)^2 \times \sin(\alpha - \delta) \times [1 + \sqrt{(\sin(\phi' + \delta) \times \sin(\phi' - \beta) / (\sin(\alpha - \delta) \times \sin(\alpha + \beta)))^2})] = 0.281$$

Passive pressure coefficient for base material


$$K_p = \sin(90 - \phi'_b)^2 / (\sin(90 - \delta_b) \times [1 - \sqrt{(\sin(\phi'_b + \delta_b) \times \sin(\phi'_b) / (\sin(90 + \delta_b)))^2})] = 3.620$$

At-rest pressure

At-rest pressure for retained material	$K_0 = 1 - \sin(\phi') = 0.441$
--	---------------------------------

Loading details

Surcharge load on plan	Surcharge = 5.0 kN/m^2
Applied vertical dead load on wall	$W_{\text{dead}} = 92.6 \text{ kN/m}$
Applied vertical live load on wall	$W_{\text{live}} = 16.8 \text{ kN/m}$
Position of applied vertical load on wall	$l_{\text{load}} = 2250 \text{ mm}$
Applied horizontal dead load on wall	$F_{\text{dead}} = 0.0 \text{ kN/m}$
Applied horizontal live load on wall	$F_{\text{live}} = 0.0 \text{ kN/m}$
Height of applied horizontal load on wall	$h_{\text{load}} = 0 \text{ mm}$

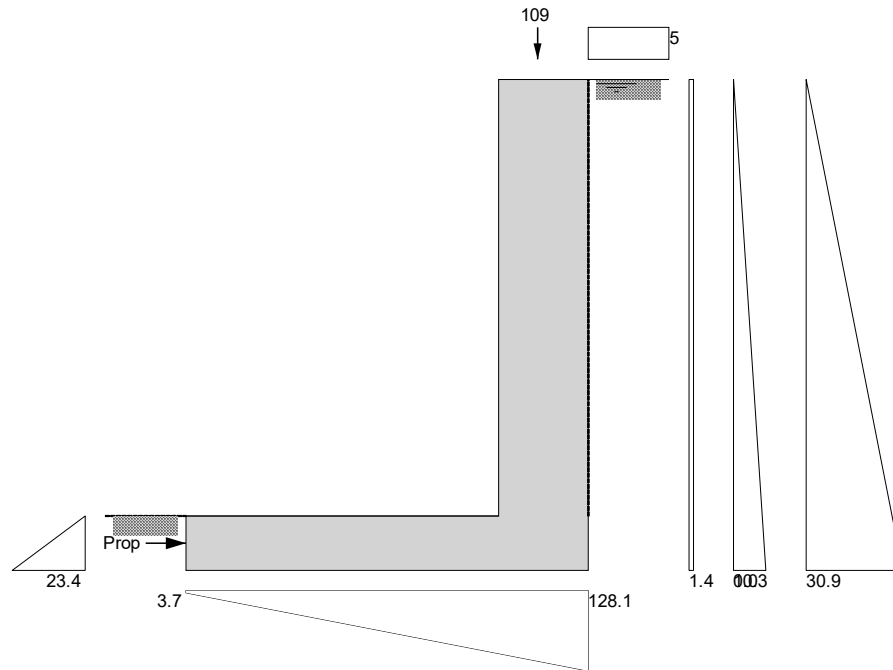

Loads shown in kN/m, pressures shown in kN/m²

Vertical forces on wall

Wall stem

$$W_{\text{wall}} = h_{\text{stem}} \times t_{\text{wall}} \times \gamma_{\text{wall}} = 38.6 \text{ kN/m}$$

Wall base

$$W_{\text{base}} = l_{\text{base}} \times t_{\text{base}} \times \gamma_{\text{base}} = 21.6 \text{ kN/m}$$

Applied vertical load

$$W_v = W_{\text{dead}} + W_{\text{live}} = 109.4 \text{ kN/m}$$

Total vertical load

$$W_{\text{total}} = W_{\text{wall}} + W_{\text{base}} + W_v = 169.6 \text{ kN/m}$$

Horizontal forces on wall

Surcharge

$$F_{\text{sur}} = K_a \times \cos(90 - \alpha + \delta) \times \text{Surcharge} \times h_{\text{eff}} = 4.4 \text{ kN/m}$$

Moist backfill below water table

$$F_{m_b} = K_a \times \cos(90 - \alpha + \delta) \times \gamma_m \times (h_{\text{eff}} - h_{\text{water}}) \times h_{\text{water}} = 0 \text{ kN/m}$$

Saturated backfill

$$F_s = 0.5 \times K_a \times \cos(90 - \alpha + \delta) \times (\gamma_s - \gamma_{\text{water}}) \times h_{\text{water}}^2 = 16.3 \text{ kN/m}$$

Water

$$F_{\text{water}} = 0.5 \times h_{\text{water}}^2 \times \gamma_{\text{water}} = 48.7 \text{ kN/m}$$

Total horizontal load

$$F_{\text{total}} = F_{\text{sur}} + F_{m_b} + F_s + F_{\text{water}} = 69.4 \text{ kN/m}$$

Calculate propping force

Passive resistance of soil in front of wall

$$F_p = 0.5 \times K_p \times \cos(\delta_b) \times (d_{\text{cover}} + t_{\text{base}} + d_{\text{ds}} - d_{\text{exc}})^2 \times \gamma_{\text{mb}} = 4.1 \text{ kN/m}$$

Propping force

$$F_{\text{prop}} = \max(F_{\text{total}} - F_p - (W_{\text{total}} - W_{\text{live}}) \times \tan(\delta_b), 0 \text{ kN/m})$$

$$F_{\text{prop}} = 63.4 \text{ kN/m}$$

Overturning moments

Surcharge

$$M_{\text{sur}} = F_{\text{sur}} \times (h_{\text{eff}} - 2 \times d_{\text{ds}}) / 2 = 7 \text{ kNm/m}$$

Moist backfill below water table

$$M_{m_b} = F_{m_b} \times (h_{\text{water}} - 2 \times d_{\text{ds}}) / 2 = 0 \text{ kNm/m}$$

Saturated backfill

$$M_s = F_s \times (h_{\text{water}} - 3 \times d_{\text{ds}}) / 3 = 17.1 \text{ kNm/m}$$

Water

$$M_{\text{water}} = F_{\text{water}} \times (h_{\text{water}} - 3 \times d_{\text{ds}}) / 3 = 51.1 \text{ kNm/m}$$

Total overturning moment

$$M_{\text{ot}} = M_{\text{sur}} + M_{m_b} + M_s + M_{\text{water}} = 75.2 \text{ kNm/m}$$

Restoring moments

Wall stem

$$M_{\text{wall}} = W_{\text{wall}} \times (l_{\text{toe}} + t_{\text{wall}} / 2) = 88.4 \text{ kNm/m}$$

Wall base

$$M_{base} = W_{base} \times l_{base} / 2 = \mathbf{27.8 \text{ kNm/m}}$$

Design vertical dead load

$$M_{dead} = W_{dead} \times l_{load} = \mathbf{208.4 \text{ kNm/m}}$$

Total restoring moment

$$M_{rest} = M_{wall} + M_{base} + M_{dead} = \mathbf{324.6 \text{ kNm/m}}$$

Check bearing pressure

Design vertical live load

$$M_{live} = W_{live} \times l_{load} = \mathbf{37.7 \text{ kNm/m}}$$

Total moment for bearing

$$M_{total} = M_{rest} - M_{ot} + M_{live} = \mathbf{287.1 \text{ kNm/m}}$$

Total vertical reaction

$$R = W_{total} = \mathbf{169.6 \text{ kN/m}}$$

Distance to reaction

$$x_{bar} = M_{total} / R = \mathbf{1693 \text{ mm}}$$

Eccentricity of reaction

$$e = \text{abs}((l_{base} / 2) - x_{bar}) = \mathbf{405 \text{ mm}}$$

Reaction acts within middle third of base

Bearing pressure at toe

$$p_{toe} = (R / l_{base}) - (6 \times R \times e / l_{base}^2) = \mathbf{3.7 \text{ kN/m}^2}$$

Bearing pressure at heel

$$p_{heel} = (R / l_{base}) + (6 \times R \times e / l_{base}^2) = \mathbf{128.1 \text{ kN/m}^2}$$

PASS - Maximum bearing pressure is less than allowable bearing pressure

RETAINING WALL DESIGN (BS 8002:1994)

TEDDS calculation version 1.2.01.08

Ultimate limit state load factors

Dead load factor	$\gamma_{f_d} = 1.4$
Live load factor	$\gamma_{f_l} = 1.6$
Earth and water pressure factor	$\gamma_{f_e} = 1.4$

Factored vertical forces on wall

Wall stem	$W_{wall_f} = \gamma_{f_d} \times h_{stem} \times t_{wall} \times \gamma_{wall} = 54.1 \text{ kN/m}$
Wall base	$W_{base_f} = \gamma_{f_d} \times l_{base} \times t_{base} \times \gamma_{base} = 30.3 \text{ kN/m}$
Applied vertical load	$W_{v_f} = \gamma_{f_d} \times W_{dead} + \gamma_{f_l} \times W_{live} = 156.5 \text{ kN/m}$
Total vertical load	$W_{total_f} = W_{wall_f} + W_{base_f} + W_{v_f} = 240.8 \text{ kN/m}$

Factored horizontal at-rest forces on wall

Surcharge	$F_{sur_f} = \gamma_{f_l} \times K_0 \times \text{Surcharge} \times h_{eff} = 11.1 \text{ kN/m}$
Moist backfill below water table	$F_{m_b_f} = \gamma_{f_e} \times K_0 \times \gamma_m \times (h_{eff} - h_{water}) \times h_{water} = 0 \text{ kN/m}$
Saturated backfill	$F_{s_f} = \gamma_{f_e} \times 0.5 \times K_0 \times (\gamma_s - \gamma_{water}) \times h_{water}^2 = 35.8 \text{ kN/m}$
Water	$F_{water_f} = \gamma_{f_e} \times 0.5 \times h_{water}^2 \times \gamma_{water} = 68.1 \text{ kN/m}$
Total horizontal load	$F_{total_f} = F_{sur_f} + F_{m_b_f} + F_{s_f} + F_{water_f} = 115 \text{ kN/m}$

Calculate propping force

Passive resistance of soil in front of wall	$F_{p_f} = \gamma_{f_e} \times 0.5 \times K_p \times \cos(\delta_b) \times (d_{cover} + t_{base} + d_{ds} - d_{exc})^2 \times \gamma_{mb} = 5.7 \text{ kN/m}$
Propping force	$F_{prop_f} = \max(F_{total_f} - F_{p_f} - (W_{total_f} - \gamma_{f_l} \times W_{live}) \times \tan(\delta_b), 0 \text{ kN/m})$ $F_{prop_f} = 106.7 \text{ kN/m}$

Factored overturning moments

Surcharge	$M_{sur_f} = F_{sur_f} \times (h_{eff} - 2 \times d_{ds}) / 2 = 17.5 \text{ kNm/m}$
Moist backfill below water table	$M_{m_b_f} = F_{m_b_f} \times (h_{water} - 2 \times d_{ds}) / 2 = 0 \text{ kNm/m}$
Saturated backfill	$M_{s_f} = F_{s_f} \times (h_{water} - 3 \times d_{ds}) / 3 = 37.6 \text{ kNm/m}$
Water	$M_{water_f} = F_{water_f} \times (h_{water} - 3 \times d_{ds}) / 3 = 71.5 \text{ kNm/m}$
Total overturning moment	$M_{ot_f} = M_{sur_f} + M_{m_b_f} + M_{s_f} + M_{water_f} = 126.6 \text{ kNm/m}$

Restoring moments

Wall stem	$M_{wall_f} = W_{wall_f} \times (l_{toe} + t_{wall} / 2) = 123.7 \text{ kNm/m}$
Wall base	$M_{base_f} = W_{base_f} \times l_{base} / 2 = 39 \text{ kNm/m}$
Design vertical load	$M_{v_f} = W_{v_f} \times l_{load} = 352 \text{ kNm/m}$
Total restoring moment	$M_{rest_f} = M_{wall_f} + M_{base_f} + M_{v_f} = 514.8 \text{ kNm/m}$

Factored bearing pressure

Total moment for bearing	$M_{total_f} = M_{rest_f} - M_{ot_f} = 388.1 \text{ kNm/m}$
Total vertical reaction	$R_f = W_{total_f} = 240.8 \text{ kN/m}$
Distance to reaction	$X_{bar_f} = M_{total_f} / R_f = 1612 \text{ mm}$
Eccentricity of reaction	$e_f = \text{abs}((l_{base} / 2) - X_{bar_f}) = 324 \text{ mm}$

Reaction acts within middle third of base

Bearing pressure at toe	$p_{toe_f} = (R_f / l_{base}) - (6 \times R_f \times e_f / l_{base}^2) = 22.9 \text{ kN/m}^2$
Bearing pressure at heel	$p_{heel_f} = (R_f / l_{base}) + (6 \times R_f \times e_f / l_{base}^2) = 164.2 \text{ kN/m}^2$
Rate of change of base reaction	$\text{rate} = (p_{toe_f} - p_{heel_f}) / l_{base} = -54.87 \text{ kN/m}^2/\text{m}$

Bearing pressure at stem / toe

$$p_{\text{stem_toe_f}} = \max(p_{\text{heel_f}} + (\text{rate} \times (l_{\text{heel}} + t_{\text{wall}})), 0 \text{ kN/m}^2) = \mathbf{132.6 \text{ kN/m}^2}$$

Bearing pressure at mid stem

$$p_{\text{stem_mid_f}} = \max(p_{\text{heel_f}} + (\text{rate} \times (l_{\text{heel}} + t_{\text{wall}} / 2)), 0 \text{ kN/m}^2) = \mathbf{148.4 \text{ kN/m}^2}$$

Bearing pressure at stem / heel

$$p_{\text{stem_heel_f}} = \max(p_{\text{heel_f}} + (\text{rate} \times l_{\text{heel}}), 0 \text{ kN/m}^2) = \mathbf{164.2 \text{ kN/m}^2}$$

Design of reinforced concrete retaining wall toe (BS 8002:1994)

Material properties

Characteristic strength of concrete

$$f_{\text{cu}} = \mathbf{35 \text{ N/mm}^2}$$

Characteristic strength of reinforcement

$$f_y = \mathbf{500 \text{ N/mm}^2}$$

Base details

Minimum area of reinforcement

$$k = \mathbf{0.13 \%}$$

Cover to reinforcement in toe

$$c_{\text{toe}} = \mathbf{50 \text{ mm}}$$

Calculate shear for toe design

Shear from bearing pressure

$$V_{\text{toe_bear}} = (p_{\text{toe_f}} + p_{\text{stem_toe_f}}) \times l_{\text{toe}} / 2 = \mathbf{155.5 \text{ kN/m}}$$

Shear from weight of base

$$V_{\text{toe_wt_base}} = \gamma_{\text{f_d}} \times \gamma_{\text{base}} \times l_{\text{toe}} \times t_{\text{base}} = \mathbf{23.5 \text{ kN/m}}$$

Total shear for toe design

$$V_{\text{toe}} = V_{\text{toe_bear}} - V_{\text{toe_wt_base}} = \mathbf{132 \text{ kN/m}}$$

Calculate moment for toe design

Moment from bearing pressure


$$M_{\text{toe_bear}} = (2 \times p_{\text{toe_f}} + p_{\text{stem_mid_f}}) \times (l_{\text{toe}} + t_{\text{wall}} / 2)^2 / 6 = \mathbf{169.3 \text{ kNm/m}}$$

Moment from weight of base

$$M_{\text{toe_wt_base}} = (\gamma_{\text{f_d}} \times \gamma_{\text{base}} \times t_{\text{base}} \times (l_{\text{toe}} + t_{\text{wall}} / 2)^2 / 2) = \mathbf{30.8 \text{ kNm/m}}$$

Total moment for toe design

$$M_{\text{toe}} = M_{\text{toe_bear}} - M_{\text{toe_wt_base}} = \mathbf{138.6 \text{ kNm/m}}$$

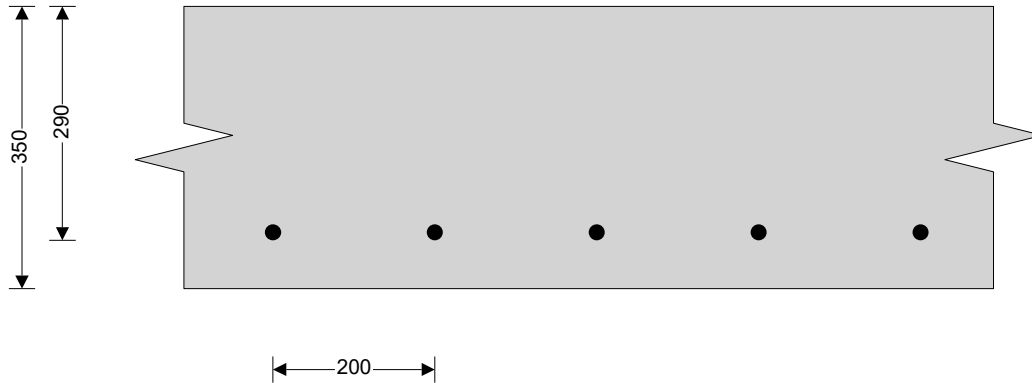

Check toe in bending

Width of toe

$$b = \mathbf{1000 \text{ mm/m}}$$

Depth of reinforcement

$$d_{\text{toe}} = t_{\text{base}} - c_{\text{toe}} - (\phi_{\text{toe}} / 2) = \mathbf{290.0 \text{ mm}}$$

Constant

$$K_{\text{toe}} = M_{\text{toe}} / (b \times d_{\text{toe}}^2 \times f_{\text{cu}}) = \mathbf{0.047}$$

Compression reinforcement is not required

Lever arm

$$z_{\text{toe}} = \min(0.5 + \sqrt{(0.25 - (\min(K_{\text{toe}}, 0.225) / 0.9))}, 0.95) \times d_{\text{toe}}$$

$$z_{\text{toe}} = \mathbf{274 \text{ mm}}$$

Area of tension reinforcement required

$$A_{\text{s_toe_des}} = M_{\text{toe}} / (0.87 \times f_y \times z_{\text{toe}}) = \mathbf{1163 \text{ mm}^2/\text{m}}$$

Minimum area of tension reinforcement

$$A_{\text{s_toe_min}} = k \times b \times t_{\text{base}} = \mathbf{455 \text{ mm}^2/\text{m}}$$

Area of tension reinforcement required

$$A_{\text{s_toe_req}} = \text{Max}(A_{\text{s_toe_des}}, A_{\text{s_toe_min}}) = \mathbf{1163 \text{ mm}^2/\text{m}}$$

Reinforcement provided

20 mm dia.bars @ 200 mm centres

Area of reinforcement provided

$$A_{\text{s_toe_prov}} = \mathbf{1571 \text{ mm}^2/\text{m}}$$

PASS - Reinforcement provided at the retaining wall toe is adequate

Check shear resistance at toe

Design shear stress

$$V_{toe} = V_{toe} / (b \times d_{toe}) = 0.455 \text{ N/mm}^2$$

Allowable shear stress

$$V_{adm} = \min(0.8 \times \sqrt{f_{cu} / 1 \text{ N/mm}^2}, 5) \times 1 \text{ N/mm}^2 = 4.733 \text{ N/mm}^2$$

PASS - Design shear stress is less than maximum shear stress

From BS8110:Part 1:1997 – Table 3.8

Design concrete shear stress

$$V_{c_toe} = 0.625 \text{ N/mm}^2$$

$V_{toe} < V_{c_toe}$ - No shear reinforcement required

Design of reinforced concrete retaining wall stem (BS 8002:1994)

Material properties

Characteristic strength of concrete

$$f_{cu} = 35 \text{ N/mm}^2$$

Characteristic strength of reinforcement

$$f_y = 500 \text{ N/mm}^2$$

Wall details

Minimum area of reinforcement

$$k = 0.13 \%$$

Cover to reinforcement in stem

$$C_{stem} = 50 \text{ mm}$$

Cover to reinforcement in wall

$$C_{wall} = 50 \text{ mm}$$

Factored horizontal at-rest forces on stem

Surcharge

$$F_{s_sur_f} = \gamma_{t_l} \times K_0 \times \text{Surcharge} \times (h_{eff} - t_{base} - d_{ds}) = 9.9 \text{ kN/m}$$

Moist backfill below water table

$$F_{s_m_b_f} = \gamma_{t_e} \times K_0 \times \gamma_m \times (h_{eff} - t_{base} - d_{ds} - h_{sat}) \times h_{sat} = 0 \text{ kN/m}$$

Saturated backfill

$$F_{s_s_f} = 0.5 \times \gamma_{t_e} \times K_0 \times (\gamma_s - \gamma_{water}) \times h_{sat}^2 = 28.3 \text{ kN/m}$$

Water

$$F_{s_water_f} = 0.5 \times \gamma_{t_e} \times \gamma_{water} \times h_{sat}^2 = 53.8 \text{ kN/m}$$

Calculate shear for stem design

Shear at base of stem

$$V_{stem} = F_{s_sur_f} + F_{s_m_b_f} + F_{s_s_f} + F_{s_water_f} - F_{prop_f} = -14.7 \text{ kN/m}$$

Calculate moment for stem design

Surcharge

$$M_{s_sur} = F_{s_sur_f} \times (h_{stem} + t_{base}) / 2 = 15.6 \text{ kNm/m}$$

Moist backfill below water table

$$M_{s_m_b} = F_{s_m_b_f} \times h_{sat} / 2 = 0 \text{ kNm/m}$$

Saturated backfill


$$M_{s_s} = F_{s_s_f} \times h_{sat} / 3 = 26.4 \text{ kNm/m}$$

Water

$$M_{s_water} = F_{s_water_f} \times h_{sat} / 3 = 50.2 \text{ kNm/m}$$

Total moment for stem design

$$M_{stem} = M_{s_sur} + M_{s_m_b} + M_{s_s} + M_{s_water} = 92.2 \text{ kNm/m}$$

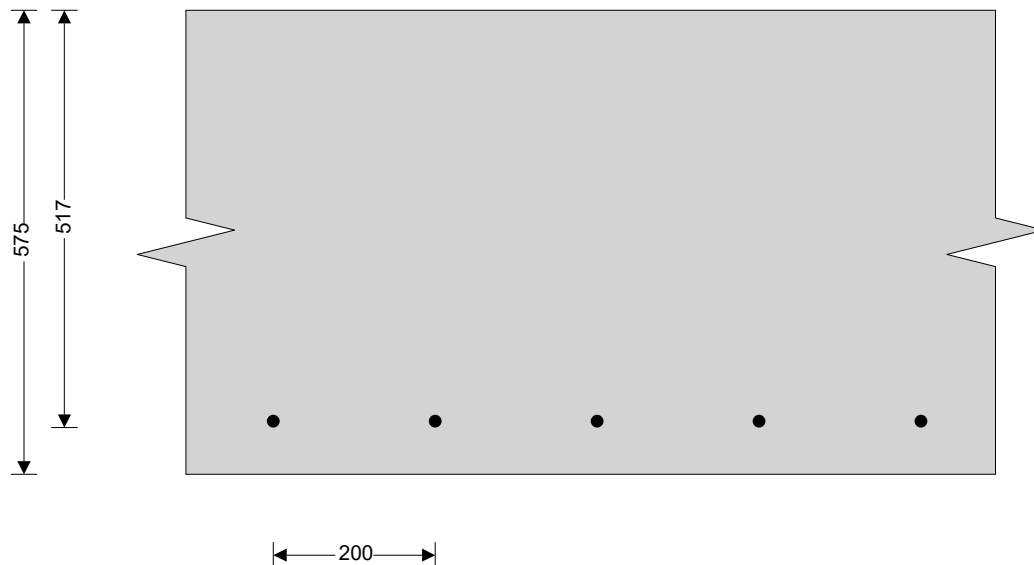

Check wall stem in bending

Width of wall stem

$$b = 1000 \text{ mm/m}$$

Depth of reinforcement

$$d_{\text{stem}} = t_{\text{wall}} - c_{\text{stem}} - (\phi_{\text{stem}} / 2) = 517.0 \text{ mm}$$

Constant

$$K_{\text{stem}} = M_{\text{stem}} / (b \times d_{\text{stem}}^2 \times f_{\text{cu}}) = 0.010$$

Compression reinforcement is not required

Lever arm

$$Z_{\text{stem}} = \min(0.5 + \sqrt{(0.25 - (\min(K_{\text{stem}}, 0.225) / 0.9))}, 0.95) \times d_{\text{stem}}$$

$$Z_{\text{stem}} = 491 \text{ mm}$$

Area of tension reinforcement required

$$A_{s_{\text{stem_des}}} = M_{\text{stem}} / (0.87 \times f_y \times Z_{\text{stem}}) = 432 \text{ mm}^2/\text{m}$$

Minimum area of tension reinforcement

$$A_{s_{\text{stem_min}}} = k \times b \times t_{\text{wall}} = 748 \text{ mm}^2/\text{m}$$

Area of tension reinforcement required

$$A_{s_{\text{stem_req}}} = \text{Max}(A_{s_{\text{stem_des}}}, A_{s_{\text{stem_min}}}) = 748 \text{ mm}^2/\text{m}$$

Reinforcement provided

$$16 \text{ mm dia. bars @ } 200 \text{ mm centres}$$

Area of reinforcement provided

$$A_{s_{\text{stem_prov}}} = 1005 \text{ mm}^2/\text{m}$$

PASS - Reinforcement provided at the retaining wall stem is adequate

Check shear resistance at wall stem

Design shear stress

$$v_{\text{stem}} = V_{\text{stem}} / (b \times d_{\text{stem}}) = -0.028 \text{ N/mm}^2$$

Allowable shear stress

$$v_{\text{adm}} = \min(0.8 \times \sqrt{f_{\text{cu}} / 1 \text{ N/mm}^2}, 5) \times 1 \text{ N/mm}^2 = 4.733 \text{ N/mm}^2$$

PASS - Design shear stress is less than maximum shear stress

From BS8110:Part 1:1997 – Table 3.8

Design concrete shear stress

$$v_{c_{\text{stem}}} = 0.410 \text{ N/mm}^2$$

$v_{\text{stem}} < v_{c_{\text{stem}}}$ - No shear reinforcement required

Check retaining wall deflection

Basic span/effective depth ratio

$$\text{ratio}_{\text{bas}} = 7$$

Design service stress

$$f_s = 2 \times f_y \times A_{s_{\text{stem_req}}} / (3 \times A_{s_{\text{stem_prov}}}) = 247.9 \text{ N/mm}^2$$

Modification factor

$$\text{factor}_{\text{tens}} = \min(0.55 + (477 \text{ N/mm}^2 - f_s) / (120 \times (0.9 \text{ N/mm}^2 + (M_{\text{stem}} / (b \times d_{\text{stem}}^2)))), 2) = 2.00$$

Maximum span/effective depth ratio


$$\text{ratio}_{\text{max}} = \text{ratio}_{\text{bas}} \times \text{factor}_{\text{tens}} = 14.00$$

Actual span/effective depth ratio

$$\text{ratio}_{\text{act}} = h_{\text{stem}} / d_{\text{stem}} = 5.42$$

PASS - Span to depth ratio is acceptable

Indicative retaining wall reinforcement diagram

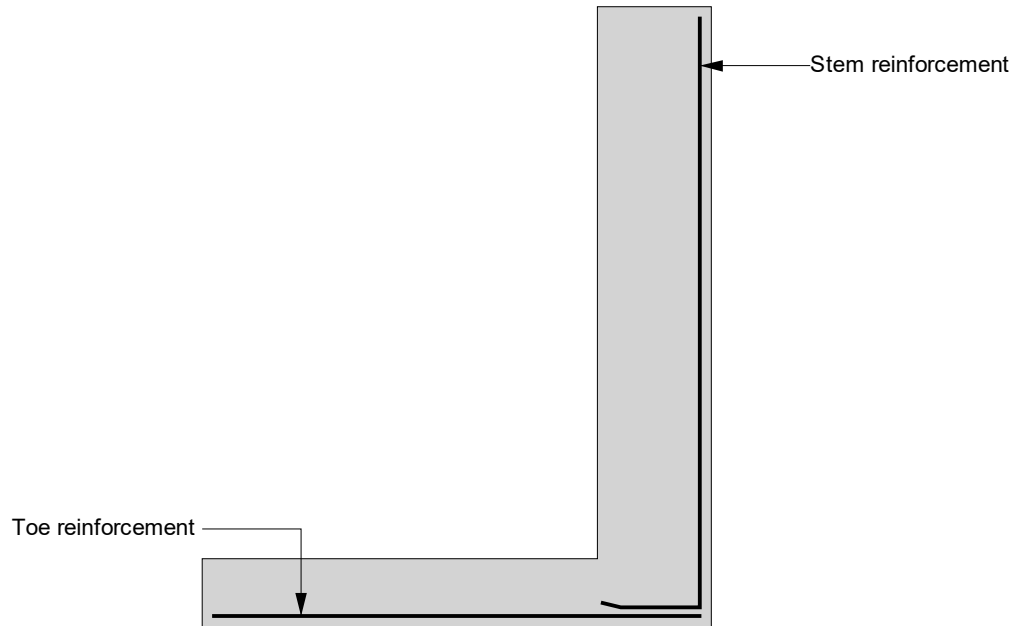

Toe bars - 20 mm dia. @ 200 mm centres - (1571 mm²/m)

Stem bars - 16 mm dia. @ 200 mm centres - (1005 mm²/m)

MBP	Michael Barclay Partnership
	consulting engineers
	1 Lancaster Place WC2E 7ED
T 020 7240 1191	F 020 7240 2241
E london@mbp-uk.com	

Job Title	Job Number	Sheet Number	Revision
25 OAKHILL AVENUE, LONDON	8536	7.12	P1
Calculation/sketch Title	Date	Author	Checked
SECTION 7	MAR 2023	AZ	TH
RETAINING WALL CALCULATION			


250mm THICK RETAINING WALL

DEAD LOAD	
VERTICAL LOAD:	
Flat Roof	$1.30 \text{ kN/m}^2 \times 1.6\text{m} = 2.10 \text{ kN/m}$
Ground Floor	$6.80 \text{ kN/m}^2 \times 3.4\text{m} = 23.12 \text{ kN/m}$
TOTAL:	25.22 kN/m
New Cavity Wall	$4.04 \text{ kN/m}^2 \times 4.3\text{m} = 8.34 \text{ kN/m}$
GROUND FORCE: (trapezional force) height 4.4m, $\gamma = 18.5 \text{ kN/m}^3$	
IMPOSED LOAD	
VERTICAL LOAD:	
Flat Roof	$1.5 \text{ kN/m}^2 \times 1.6\text{m} = 2.40 \text{ kN/m}$
Ground Floor	$2.5 \text{ kN/m}^2 \times 3.4\text{m} = 8.50 \text{ kN/m}$
TOTAL:	10.90 kN/m
SURCHARGE:	5 kN/m^2
WATER:	Full high water level 3.0m above slab

250mm lining wall to be propped at the top and at the bottom by RC slab.

RETAINING WALL ANALYSIS (BS 8002:1994)

TEDDS calculation version 1.2.01.08

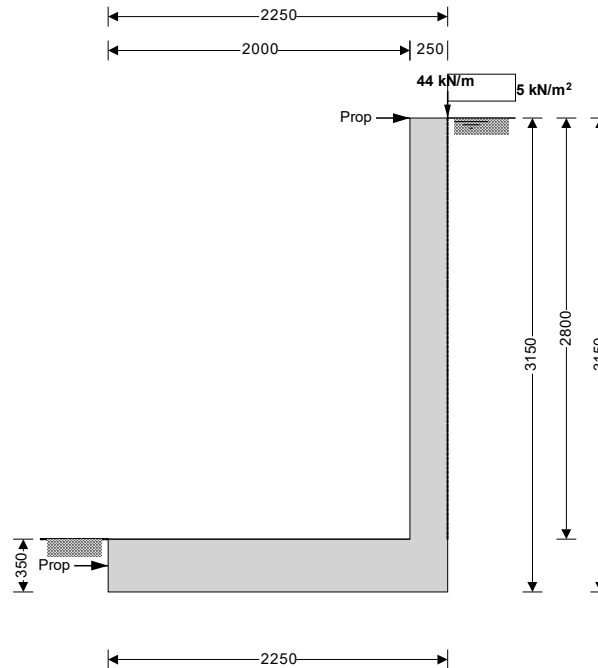

Wall details

Retaining wall type
Height of retaining wall stem
Thickness of wall stem
Length of toe
Length of heel
Overall length of base
Thickness of base
Depth of downstand
Position of downstand
Thickness of downstand
Height of retaining wall
Depth of cover in front of wall
Depth of unplanned excavation
Height of ground water behind wall
Height of saturated fill above base
Density of wall construction
Density of base construction
Angle of rear face of wall
Angle of soil surface behind wall
Effective height at virtual back of wall

Cantilever propped at both

$h_{\text{stem}} = 2800 \text{ mm}$
 $t_{\text{wall}} = 250 \text{ mm}$
 $l_{\text{toe}} = 2000 \text{ mm}$
 $l_{\text{heel}} = 0 \text{ mm}$
 $l_{\text{base}} = l_{\text{toe}} + l_{\text{heel}} + t_{\text{wall}} = 2250 \text{ mm}$
 $t_{\text{base}} = 350 \text{ mm}$
 $d_{\text{ds}} = 0 \text{ mm}$
 $l_{\text{ds}} = 500 \text{ mm}$
 $t_{\text{ds}} = 350 \text{ mm}$
 $h_{\text{wall}} = h_{\text{stem}} + t_{\text{base}} + d_{\text{ds}} = 3150 \text{ mm}$
 $d_{\text{cover}} = 0 \text{ mm}$
 $d_{\text{exc}} = 0 \text{ mm}$
 $h_{\text{water}} = 3150 \text{ mm}$
 $h_{\text{sat}} = \max(h_{\text{water}} - t_{\text{base}} - d_{\text{ds}}, 0 \text{ mm}) = 2800 \text{ mm}$
 $\gamma_{\text{wall}} = 24.0 \text{ kN/m}^3$
 $\gamma_{\text{base}} = 24.0 \text{ kN/m}^3$
 $\alpha = 90.0 \text{ deg}$
 $\beta = 0.0 \text{ deg}$
 $h_{\text{eff}} = h_{\text{wall}} + l_{\text{heel}} \times \tan(\beta) = 3150 \text{ mm}$

Retained material details

Mobilisation factor
 $M = 1.5$

Moist density of retained material $\gamma_m = 18.5 \text{ kN/m}^3$

Saturated density of retained material $\gamma_s = 21.5 \text{ kN/m}^3$

Design shear strength $\phi' = 34.0 \text{ deg}$

Angle of wall friction $\delta = 0.7 \text{ deg}$

Base material details

Stiff clay

Moist density $\gamma_{mb} = 18.5 \text{ kN/m}^3$

Design shear strength $\phi'_b = 34.0 \text{ deg}$

Design base friction $\delta_b = 0.7 \text{ deg}$

Allowable bearing pressure $P_{\text{bearing}} = 300 \text{ kN/m}^2$

Using Coulomb theory

Active pressure coefficient for retained material

$$K_a = \sin(\alpha + \phi')^2 / (\sin(\alpha)^2 \times \sin(\alpha - \delta) \times [1 + \sqrt{(\sin(\phi' + \delta) \times \sin(\phi' - \beta) / (\sin(\alpha - \delta) \times \sin(\alpha + \beta)))})^2] = 0.281$$

Passive pressure coefficient for base material

$$K_p = \sin(90 - \phi'_b)^2 / (\sin(90 - \delta_b) \times [1 - \sqrt{(\sin(\phi'_b + \delta_b) \times \sin(\phi'_b) / (\sin(90 + \delta_b)))})^2] = 3.620$$

At-rest pressure

At-rest pressure for retained material $K_0 = 1 - \sin(\phi') = 0.441$

Loading details

Surcharge load on plan Surcharge = **5.0 kN/m²**

Applied vertical dead load on wall $W_{\text{dead}} = 33.6 \text{ kN/m}$


Applied vertical live load on wall $W_{\text{live}} = 10.9 \text{ kN/m}$

Position of applied vertical load on wall $l_{\text{load}} = 2250 \text{ mm}$

Applied horizontal dead load on wall $F_{\text{dead}} = 0.0 \text{ kN/m}$

Applied horizontal live load on wall $F_{\text{live}} = 0.0 \text{ kN/m}$

Height of applied horizontal load on wall $h_{\text{load}} = 0 \text{ mm}$

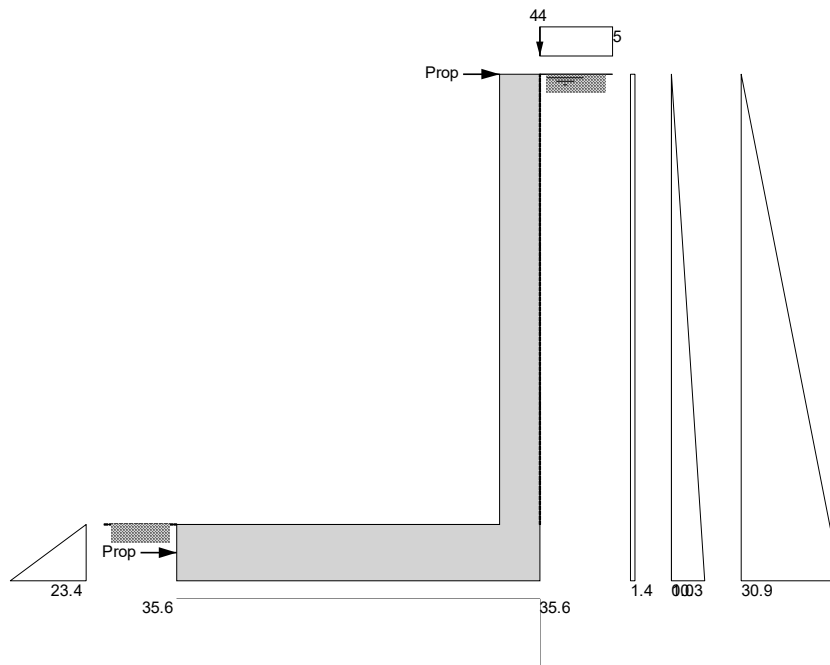

Loads shown in kN/m, pressures shown in kN/m²

Vertical forces on wall

Wall stem

$$W_{\text{wall}} = h_{\text{stem}} \times t_{\text{wall}} \times \gamma_{\text{wall}} = 16.8 \text{ kN/m}$$

Wall base

$$W_{\text{base}} = l_{\text{base}} \times t_{\text{base}} \times \gamma_{\text{base}} = 18.9 \text{ kN/m}$$

Applied vertical load

$$W_v = W_{\text{dead}} + W_{\text{live}} = 44.5 \text{ kN/m}$$

Total vertical load

$$W_{\text{total}} = W_{\text{wall}} + W_{\text{base}} + W_v = 80.2 \text{ kN/m}$$

Horizontal forces on wall

Surcharge

$$F_{\text{sur}} = K_a \times \cos(90 - \alpha + \delta) \times \text{Surcharge} \times h_{\text{eff}} = 4.4 \text{ kN/m}$$

Moist backfill below water table

$$F_{m_b} = K_a \times \cos(90 - \alpha + \delta) \times \gamma_m \times (h_{\text{eff}} - h_{\text{water}}) \times h_{\text{water}} = 0 \text{ kN/m}$$

Saturated backfill

$$F_s = 0.5 \times K_a \times \cos(90 - \alpha + \delta) \times (\gamma_s - \gamma_{\text{water}}) \times h_{\text{water}}^2 = 16.3 \text{ kN/m}$$

Water

$$F_{\text{water}} = 0.5 \times h_{\text{water}}^2 \times \gamma_{\text{water}} = 48.7 \text{ kN/m}$$

Total horizontal load

$$F_{\text{total}} = F_{\text{sur}} + F_{m_b} + F_s + F_{\text{water}} = 69.4 \text{ kN/m}$$

Calculate total propping force

Passive resistance of soil in front of wall

$$F_p = 0.5 \times K_p \times \cos(\delta_b) \times (d_{\text{cover}} + t_{\text{base}} + d_{\text{ds}} - d_{\text{exc}})^2 \times \gamma_{\text{mb}} = 4.1 \text{ kN/m}$$

Propping force

$$F_{\text{prop}} = \max(F_{\text{total}} - F_p - (W_{\text{total}} - W_{\text{live}}) \times \tan(\delta_b), 0 \text{ kN/m})$$

$$F_{\text{prop}} = 64.4 \text{ kN/m}$$

Overturning moments

Surcharge

$$M_{\text{sur}} = F_{\text{sur}} \times (h_{\text{eff}} - 2 \times d_{\text{ds}}) / 2 = 7 \text{ kNm/m}$$

Moist backfill below water table

$$M_{m_b} = F_{m_b} \times (h_{\text{water}} - 2 \times d_{\text{ds}}) / 2 = 0 \text{ kNm/m}$$

Saturated backfill

$$M_s = F_s \times (h_{\text{water}} - 3 \times d_{\text{ds}}) / 3 = 17.1 \text{ kNm/m}$$

Water

$$M_{\text{water}} = F_{\text{water}} \times (h_{\text{water}} - 3 \times d_{\text{ds}}) / 3 = 51.1 \text{ kNm/m}$$

Total overturning moment

$$M_{\text{ot}} = M_{\text{sur}} + M_{m_b} + M_s + M_{\text{water}} = 75.2 \text{ kNm/m}$$

Restoring moments

Wall stem

$$M_{\text{wall}} = W_{\text{wall}} \times (l_{\text{toe}} + t_{\text{wall}} / 2) = 35.7 \text{ kNm/m}$$

Wall base

$$M_{\text{base}} = W_{\text{base}} \times l_{\text{base}} / 2 = 21.3 \text{ kNm/m}$$

Design vertical dead load

$$M_{\text{dead}} = W_{\text{dead}} \times l_{\text{load}} = 75.5 \text{ kNm/m}$$

Total restoring moment

$$M_{\text{rest}} = M_{\text{wall}} + M_{\text{base}} + M_{\text{dead}} = 132.5 \text{ kNm/m}$$

Check bearing pressure

Total vertical reaction

$$R = W_{\text{total}} = 80.2 \text{ kN/m}$$

Distance to reaction

$$x_{\text{bar}} = l_{\text{base}} / 2 = 1125 \text{ mm}$$

Eccentricity of reaction

$$e = \text{abs}((l_{\text{base}} / 2) - x_{\text{bar}}) = 0 \text{ mm}$$

Reaction acts within middle third of base

Bearing pressure at toe

$$p_{\text{toe}} = (R / l_{\text{base}}) - (6 \times R \times e / l_{\text{base}}^2) = 35.6 \text{ kN/m}^2$$

Bearing pressure at heel

$$p_{\text{heel}} = (R / l_{\text{base}}) + (6 \times R \times e / l_{\text{base}}^2) = 35.6 \text{ kN/m}^2$$

PASS - Maximum bearing pressure is less than allowable bearing pressure

Calculate propping forces to top and base of wall

Propping force to top of wall

$$F_{\text{prop_top}} = (M_{\text{ot}} - M_{\text{rest}} + R \times l_{\text{base}} / 2 - F_{\text{prop}} \times t_{\text{base}} / 2) / (h_{\text{stem}} + t_{\text{base}} / 2) = 7.263 \text{ kN/m}$$

Propping force to base of wall

$$F_{\text{prop_base}} = F_{\text{prop}} - F_{\text{prop_top}} = 57.174 \text{ kN/m}$$

RETAINING WALL DESIGN (BS 8002:1994)

TEDDS calculation version 1.2.01.08

Ultimate limit state load factors

Dead load factor	$\gamma_{f_d} = 1.4$
Live load factor	$\gamma_{f_l} = 1.6$
Earth and water pressure factor	$\gamma_{f_e} = 1.4$

Factored vertical forces on wall

Wall stem	$W_{wall_f} = \gamma_{f_d} \times h_{stem} \times t_{wall} \times \gamma_{wall} = 23.5 \text{ kN/m}$
Wall base	$W_{base_f} = \gamma_{f_d} \times l_{base} \times t_{base} \times \gamma_{base} = 26.5 \text{ kN/m}$
Applied vertical load	$W_{v_f} = \gamma_{f_d} \times W_{dead} + \gamma_{f_l} \times W_{live} = 64.4 \text{ kN/m}$
Total vertical load	$W_{total_f} = W_{wall_f} + W_{base_f} + W_{v_f} = 114.4 \text{ kN/m}$

Factored horizontal at-rest forces on wall

Surcharge	$F_{sur_f} = \gamma_{f_l} \times K_0 \times \text{Surcharge} \times h_{eff} = 11.1 \text{ kN/m}$
Moist backfill below water table	$F_{m_b_f} = \gamma_{f_e} \times K_0 \times \gamma_m \times (h_{eff} - h_{water}) \times h_{water} = 0 \text{ kN/m}$
Saturated backfill	$F_{s_f} = \gamma_{f_e} \times 0.5 \times K_0 \times (\gamma_s - \gamma_{water}) \times h_{water}^2 = 35.8 \text{ kN/m}$
Water	$F_{water_f} = \gamma_{f_e} \times 0.5 \times h_{water}^2 \times \gamma_{water} = 68.1 \text{ kN/m}$
Total horizontal load	$F_{total_f} = F_{sur_f} + F_{m_b_f} + F_{s_f} + F_{water_f} = 115 \text{ kN/m}$

Calculate total propping force

Passive resistance of soil in front of wall	$F_{p_f} = \gamma_{f_e} \times 0.5 \times K_p \times \cos(\delta_b) \times (d_{cover} + t_{base} + d_{ds} - d_{exc})^2 \times \gamma_{mb} = 5.7 \text{ kN/m}$
Propping force	$F_{prop_f} = \max(F_{total_f} - F_{p_f} - (W_{total_f} - \gamma_{f_l} \times W_{live}) \times \tan(\delta_b), 0 \text{ kN/m})$ $F_{prop_f} = 108.1 \text{ kN/m}$

Factored overturning moments

Surcharge	$M_{sur_f} = F_{sur_f} \times (h_{eff} - 2 \times d_{ds}) / 2 = 17.5 \text{ kNm/m}$
Moist backfill below water table	$M_{m_b_f} = F_{m_b_f} \times (h_{water} - 2 \times d_{ds}) / 2 = 0 \text{ kNm/m}$
Saturated backfill	$M_{s_f} = F_{s_f} \times (h_{water} - 3 \times d_{ds}) / 3 = 37.6 \text{ kNm/m}$
Water	$M_{water_f} = F_{water_f} \times (h_{water} - 3 \times d_{ds}) / 3 = 71.5 \text{ kNm/m}$
Total overturning moment	$M_{ot_f} = M_{sur_f} + M_{m_b_f} + M_{s_f} + M_{water_f} = 126.6 \text{ kNm/m}$

Restoring moments

Wall stem	$M_{wall_f} = W_{wall_f} \times (l_{toe} + t_{wall} / 2) = 50 \text{ kNm/m}$
Wall base	$M_{base_f} = W_{base_f} \times l_{base} / 2 = 29.8 \text{ kNm/m}$
Design vertical load	$M_{v_f} = W_{v_f} \times l_{load} = 145 \text{ kNm/m}$
Total restoring moment	$M_{rest_f} = M_{wall_f} + M_{base_f} + M_{v_f} = 224.7 \text{ kNm/m}$

Factored bearing pressure

Total vertical reaction	$R_f = W_{total_f} = 114.4 \text{ kN/m}$
Distance to reaction	$x_{bar_f} = l_{base} / 2 = 1125 \text{ mm}$
Eccentricity of reaction	$e_f = \text{abs}((l_{base} / 2) - x_{bar_f}) = 0 \text{ mm}$

Reaction acts within middle third of base

Bearing pressure at toe	$p_{toe_f} = (R_f / l_{base}) - (6 \times R_f \times e_f / l_{base}^2) = 50.8 \text{ kN/m}^2$
Bearing pressure at heel	$p_{heel_f} = (R_f / l_{base}) + (6 \times R_f \times e_f / l_{base}^2) = 50.8 \text{ kN/m}^2$
Rate of change of base reaction	$\text{rate} = (p_{toe_f} - p_{heel_f}) / l_{base} = 0.00 \text{ kN/m}^2/\text{m}$
Bearing pressure at stem / toe	$p_{stem_toe_f} = \max(p_{toe_f} - (\text{rate} \times l_{toe}), 0 \text{ kN/m}^2) = 50.8 \text{ kN/m}^2$

Bearing pressure at mid stem

$$p_{\text{stem_mid_f}} = \max(p_{\text{toe_f}} - (\text{rate} \times (l_{\text{toe}} + t_{\text{wall}} / 2)), 0 \text{ kN/m}^2) = 50.8 \text{ kN/m}^2$$

Bearing pressure at stem / heel

$$p_{\text{stem_heel_f}} = \max(p_{\text{toe_f}} - (\text{rate} \times (l_{\text{toe}} + t_{\text{wall}})), 0 \text{ kN/m}^2) = 50.8 \text{ kN/m}^2$$

Calculate propping forces to top and base of wall

Propping force to top of wall

$$F_{\text{prop_top_f}} = (M_{\text{ot_f}} - M_{\text{rest_f}} + R_f \times l_{\text{base}} / 2 - F_{\text{prop_f}} \times t_{\text{base}} / 2) / (h_{\text{stem}} + t_{\text{base}} / 2) = 3.934 \text{ kN/m}$$

Propping force to base of wall

$$F_{\text{prop_base_f}} = F_{\text{prop_f}} - F_{\text{prop_top_f}} = 104.177 \text{ kN/m}$$

Design of reinforced concrete retaining wall toe (BS 8002:1994)

Material properties

Characteristic strength of concrete

$$f_{\text{cu}} = 35 \text{ N/mm}^2$$

Characteristic strength of reinforcement

$$f_y = 500 \text{ N/mm}^2$$

Base details

Minimum area of reinforcement

$$k = 0.13 \%$$

Cover to reinforcement in toe

$$c_{\text{toe}} = 50 \text{ mm}$$

Calculate shear for toe design

Shear from bearing pressure

$$V_{\text{toe_bear}} = (p_{\text{toe_f}} + p_{\text{stem_toe_f}}) \times l_{\text{toe}} / 2 = 101.7 \text{ kN/m}$$

Shear from weight of base

$$V_{\text{toe_wt_base}} = \gamma_{\text{f_d}} \times \gamma_{\text{base}} \times l_{\text{toe}} \times t_{\text{base}} = 23.5 \text{ kN/m}$$

Total shear for toe design

$$V_{\text{toe}} = V_{\text{toe_bear}} - V_{\text{toe_wt_base}} = 78.2 \text{ kN/m}$$

Calculate moment for toe design

Moment from bearing pressure


$$M_{\text{toe_bear}} = (2 \times p_{\text{toe_f}} + p_{\text{stem_mid_f}}) \times (l_{\text{toe}} + t_{\text{wall}} / 2)^2 / 6 = 114.8 \text{ kNm/m}$$

Moment from weight of base

$$M_{\text{toe_wt_base}} = (\gamma_{\text{f_d}} \times \gamma_{\text{base}} \times t_{\text{base}} \times (l_{\text{toe}} + t_{\text{wall}} / 2)^2 / 2) = 26.6 \text{ kNm/m}$$

Total moment for toe design

$$M_{\text{toe}} = M_{\text{toe_bear}} - M_{\text{toe_wt_base}} = 88.2 \text{ kNm/m}$$

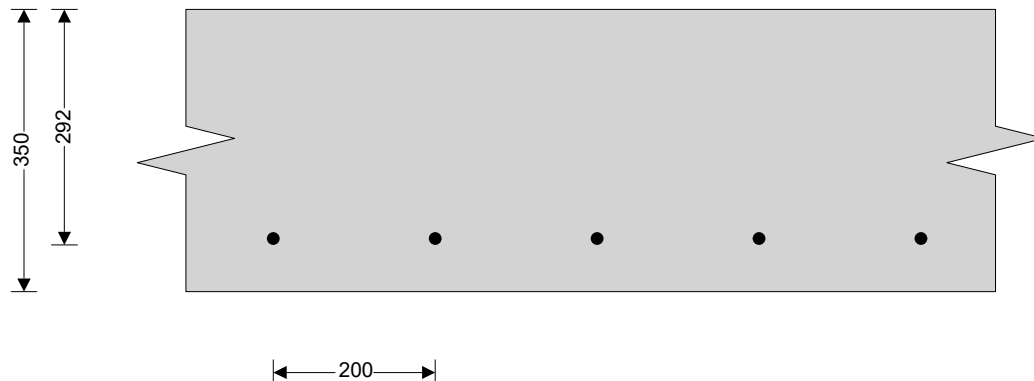

Check toe in bending

Width of toe

$$b = 1000 \text{ mm/m}$$

Depth of reinforcement

$$d_{\text{toe}} = t_{\text{base}} - c_{\text{toe}} - (\phi_{\text{toe}} / 2) = 292.0 \text{ mm}$$

Constant

$$K_{\text{toe}} = M_{\text{toe}} / (b \times d_{\text{toe}}^2 \times f_{\text{cu}}) = 0.030$$

Compression reinforcement is not required

Lever arm

$$z_{\text{toe}} = \min(0.5 + \sqrt{(0.25 - (\min(K_{\text{toe}}, 0.225) / 0.9))}, 0.95) \times d_{\text{toe}}$$

$$z_{\text{toe}} = 277 \text{ mm}$$

Area of tension reinforcement required

$$A_{\text{s_toe_des}} = M_{\text{toe}} / (0.87 \times f_y \times z_{\text{toe}}) = 731 \text{ mm}^2/\text{m}$$

Minimum area of tension reinforcement

$$A_{\text{s_toe_min}} = k \times b \times t_{\text{base}} = 455 \text{ mm}^2/\text{m}$$

Area of tension reinforcement required

$$A_{\text{s_toe_req}} = \text{Max}(A_{\text{s_toe_des}}, A_{\text{s_toe_min}}) = 731 \text{ mm}^2/\text{m}$$

Project 25 OAK HILL ROAD, LONDON				Job Ref. 8415	
Section RETAINING WALL				Sheet no./rev. 7. 19	
Calc. by AZ	Date 28/03/2023	Chk'd by	Date	App'd by TH	Date 28/03/2023

Reinforcement provided

16 mm dia.bars @ 200 mm centres

Area of reinforcement provided

$A_{s_toe_prov} = 1005 \text{ mm}^2/\text{m}$

PASS - Reinforcement provided at the retaining wall toe is adequate

Check shear resistance at toe

Design shear stress

$V_{toe} = V_{toe} / (b \times d_{toe}) = 0.268 \text{ N/mm}^2$

Allowable shear stress

$V_{adm} = \min(0.8 \times \sqrt{f_{cu}} / 1 \text{ N/mm}^2, 5) \times 1 \text{ N/mm}^2 = 4.733 \text{ N/mm}^2$

PASS - Design shear stress is less than maximum shear stress

From BS8110:Part 1:1997 – Table 3.8

Design concrete shear stress

$V_{c_toe} = 0.536 \text{ N/mm}^2$

$V_{toe} < V_{c_toe}$ - No shear reinforcement required

Design of reinforced concrete retaining wall stem (BS 8002:1994)

Material properties

Characteristic strength of concrete

$f_{cu} = 35 \text{ N/mm}^2$

Characteristic strength of reinforcement

$f_y = 500 \text{ N/mm}^2$

Wall details

Minimum area of reinforcement

$k = 0.13 \%$

Cover to reinforcement in stem

$C_{stem} = 50 \text{ mm}$

Cover to reinforcement in wall

$C_{wall} = 50 \text{ mm}$

Factored horizontal at-rest forces on stem

Surcharge

$F_{s_sur_f} = \gamma_{f_l} \times K_0 \times \text{Surcharge} \times (h_{eff} - t_{base} - d_{ds}) = 9.9 \text{ kN/m}$

Moist backfill below water table

$F_{s_m_b_f} = \gamma_{f_e} \times K_0 \times \gamma_m \times (h_{eff} - t_{base} - d_{ds} - h_{sat}) \times h_{sat} = 0 \text{ kN/m}$

Saturated backfill

$F_{s_s_f} = 0.5 \times \gamma_{f_e} \times K_0 \times (\gamma_s - \gamma_{water}) \times h_{sat}^2 = 28.3 \text{ kN/m}$

Water

$F_{s_water_f} = 0.5 \times \gamma_{f_e} \times \gamma_{water} \times h_{sat}^2 = 53.8 \text{ kN/m}$

Calculate shear for stem design

Surcharge

$V_{s_sur_f} = 5 \times F_{s_sur_f} / 8 = 6.2 \text{ kN/m}$

Moist backfill below water table

$V_{s_m_b_f} = F_{s_m_b_f} \times (8 - (n^2 \times (4 - n))) / 8 = 0 \text{ kN/m}$

Saturated backfill

$V_{s_s_f} = F_{s_s_f} \times (1 - (a^2 \times ((5 \times L) - a_i) / (20 \times L^3))) = 22.6 \text{ kN/m}$

Water

$V_{s_water_f} = F_{s_water_f} \times (1 - (a^2 \times ((5 \times L) - a_i) / (20 \times L^3))) = 43.1 \text{ kN/m}$

Total shear for stem design

$V_{stem} = V_{s_sur_f} + V_{s_m_b_f} + V_{s_s_f} + V_{s_water_f} = 71.9 \text{ kN/m}$

Calculate moment for stem design

Surcharge

$M_{s_sur} = F_{s_sur_f} \times L / 8 = 3.7 \text{ kNm/m}$

Moist backfill below water table

$M_{s_m_b} = F_{s_m_b_f} \times a_i \times (2 - n)^2 / 8 = 0 \text{ kNm/m}$

Saturated backfill

$M_{s_s} = F_{s_s_f} \times a_i \times ((3 \times a_i^2) - (15 \times a_i \times L) + (20 \times L^2)) / (60 \times L^2) = 11.2 \text{ kNm/m}$

Water

$M_{s_water} = F_{s_water_f} \times a_i \times ((3 \times a_i^2) - (15 \times a_i \times L) + (20 \times L^2)) / (60 \times L^2) = 21.4 \text{ kNm/m}$

Total moment for stem design

$M_{stem} = M_{s_sur} + M_{s_m_b} + M_{s_s} + M_{s_water} = 36.2 \text{ kNm/m}$

Calculate moment for wall design

Surcharge

$M_{w_sur} = 9 \times F_{s_sur_f} \times L / 128 = 2.1 \text{ kNm/m}$

Moist backfill below water table

$M_{w_m_b} = F_{s_m_b_f} \times a_i \times [((8 - n^2 \times (4 - n))^2 / 16) - 4 \times n \times (4 - n)] / 8 = 0 \text{ kNm/m}$

Saturated backfill


$M_{w_s} = F_{s_s_f} \times [a_i^2 \times ((5 \times L) - a_i) / (20 \times L^3) - (x - b_i)^3 / (3 \times a_i^2)] = 5 \text{ kNm/m}$

Water

$M_{w_water} = F_{s_water_f} \times [a_i^2 \times ((5 \times L) - a_i) / (20 \times L^3) - (x - b_i)^3 / (3 \times a_i^2)] = 9.6 \text{ kNm/m}$

Total moment for wall design

$M_{wall} = M_{w_sur} + M_{w_m_b} + M_{w_s} + M_{w_water} = 16.6 \text{ kNm/m}$

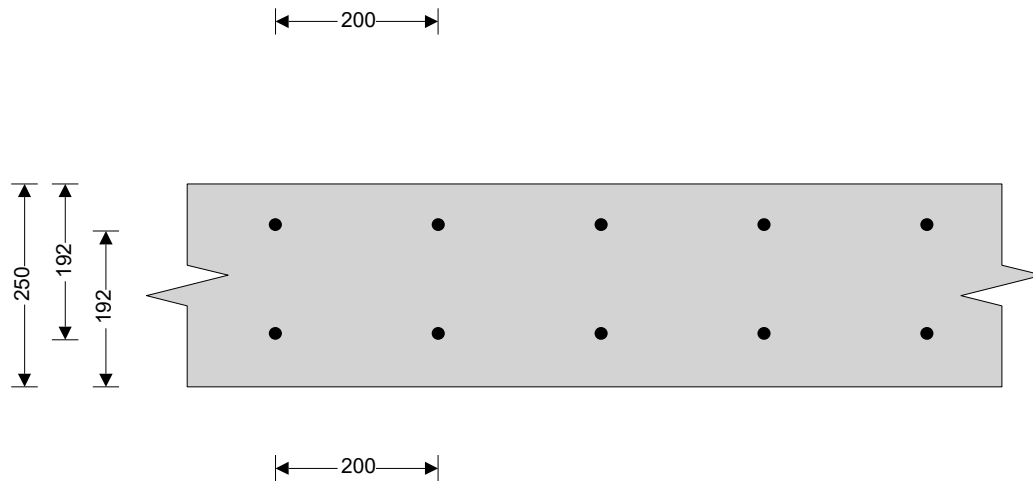

Check wall stem in bending

Width of wall stem

$$b = 1000 \text{ mm/m}$$

Depth of reinforcement

$$d_{\text{stem}} = t_{\text{wall}} - c_{\text{stem}} - (\phi_{\text{stem}} / 2) = 192.0 \text{ mm}$$

Constant

$$K_{\text{stem}} = M_{\text{stem}} / (b \times d_{\text{stem}}^2 \times f_{\text{cu}}) = 0.028$$

Compression reinforcement is not required

Lever arm

$$z_{\text{stem}} = \min(0.5 + \sqrt{(0.25 - (\min(K_{\text{stem}}, 0.225) / 0.9))}, 0.95) \times d_{\text{stem}}$$

$$z_{\text{stem}} = 182 \text{ mm}$$

Area of tension reinforcement required

$$A_{s_{\text{stem_des}}} = M_{\text{stem}} / (0.87 \times f_y \times z_{\text{stem}}) = 457 \text{ mm}^2/\text{m}$$

Minimum area of tension reinforcement

$$A_{s_{\text{stem_min}}} = k \times b \times t_{\text{wall}} = 325 \text{ mm}^2/\text{m}$$

Area of tension reinforcement required

$$A_{s_{\text{stem_req}}} = \text{Max}(A_{s_{\text{stem_des}}}, A_{s_{\text{stem_min}}}) = 457 \text{ mm}^2/\text{m}$$

Reinforcement provided

16 mm dia.bars @ 200 mm centres

Area of reinforcement provided

$$A_{s_{\text{stem_prov}}} = 1005 \text{ mm}^2/\text{m}$$

PASS - Reinforcement provided at the retaining wall stem is adequate

Check shear resistance at wall stem

Design shear stress

$$v_{\text{stem}} = V_{\text{stem}} / (b \times d_{\text{stem}}) = 0.374 \text{ N/mm}^2$$

Allowable shear stress

$$v_{\text{adm}} = \min(0.8 \times \sqrt{f_{\text{cu}} / 1 \text{ N/mm}^2}, 5) \times 1 \text{ N/mm}^2 = 4.733 \text{ N/mm}^2$$

PASS - Design shear stress is less than maximum shear stress

From BS8110:Part 1:1997 – Table 3.8

Design concrete shear stress

$$v_{c_{\text{stem}}} = 0.685 \text{ N/mm}^2$$

$v_{\text{stem}} < v_{c_{\text{stem}}}$ - No shear reinforcement required

Check mid height of wall in bending

Depth of reinforcement

$$d_{\text{wall}} = t_{\text{wall}} - c_{\text{wall}} - (\phi_{\text{wall}} / 2) = 192.0 \text{ mm}$$

Constant

$$K_{\text{wall}} = M_{\text{wall}} / (b \times d_{\text{wall}}^2 \times f_{\text{cu}}) = 0.013$$

Compression reinforcement is not required

Lever arm

$$z_{\text{wall}} = \min(0.5 + \sqrt{(0.25 - (\min(K_{\text{wall}}, 0.225) / 0.9))}, 0.95) \times d_{\text{wall}}$$

$$z_{\text{wall}} = 182 \text{ mm}$$

Area of tension reinforcement required

$$A_{s_{\text{wall_des}}} = M_{\text{wall}} / (0.87 \times f_y \times z_{\text{wall}}) = 210 \text{ mm}^2/\text{m}$$

Minimum area of tension reinforcement

$$A_{s_{\text{wall_min}}} = k \times b \times t_{\text{wall}} = 325 \text{ mm}^2/\text{m}$$

Area of tension reinforcement required

$$A_{s_{\text{wall_req}}} = \text{Max}(A_{s_{\text{wall_des}}}, A_{s_{\text{wall_min}}}) = 325 \text{ mm}^2/\text{m}$$

Reinforcement provided

16 mm dia.bars @ 200 mm centres

Area of reinforcement provided

$A_{s_wall_prov} = 1005 \text{ mm}^2/\text{m}$

PASS - Reinforcement provided to the retaining wall at mid height is adequate

Check retaining wall deflection

Basic span/effective depth ratio

$ratio_{bas} = 20$

Design service stress

$f_s = 2 \times f_y \times A_{s_stem_req} / (3 \times A_{s_stem_prov}) = 151.5 \text{ N/mm}^2$

Modification factor

$factor_{tens} = \min(0.55 + (477 \text{ N/mm}^2 - f_s) / (120 \times (0.9 \text{ N/mm}^2 + (M_{stem} / (b \times d_{stem}^2)))), 2) = 1.99$

Maximum span/effective depth ratio


$ratio_{max} = ratio_{bas} \times factor_{tens} = 39.81$

Actual span/effective depth ratio

$ratio_{act} = h_{stem} / d_{stem} = 14.58$

PASS - Span to depth ratio is acceptable

Indicative retaining wall reinforcement diagram

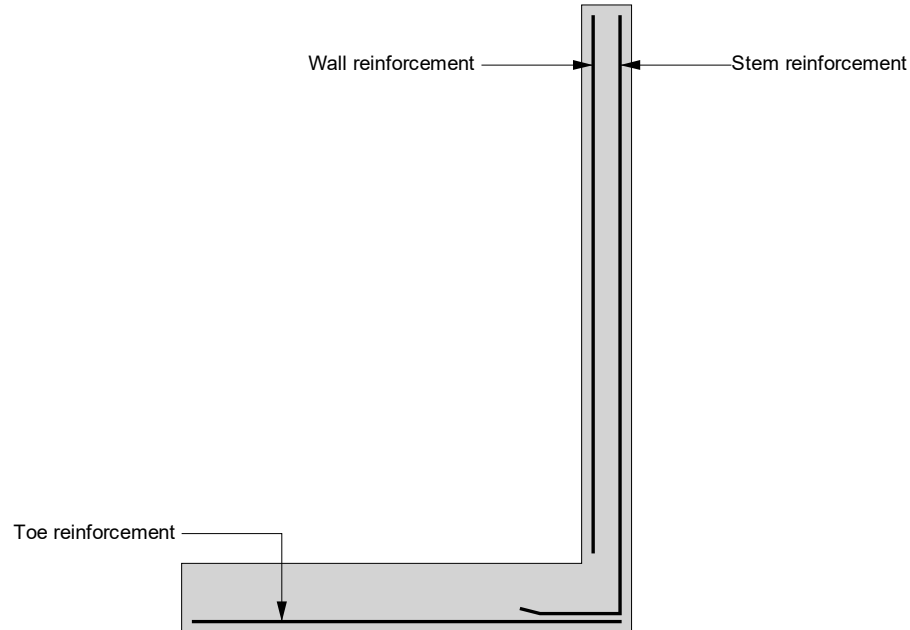

Toe bars - 16 mm dia.@ 200 mm centres - (1005 mm²/m)

Wall bars - 16 mm dia.@ 200 mm centres - (1005 mm²/m)

Stem bars - 16 mm dia.@ 200 mm centres - (1005 mm²/m)

Calculations Prepared by:



Name (Engineer)
Agnieszka Zajac MSc Eng
For Michael Barclay Partnership LLP

Calculations Approved by:



Name (Principal)
Tony Hayes BSc (Hons) CEng MIStructE
Date 28/03/2023