

Environmental Equipment Corporation Lt Richmond House, Churchfield Road Walton on Thames Surrey. KT12 2TP t: 01932 230940 f: 01932 230941 e: info@eec.co.uk

Project:

UCL LMS Small Works - SW16 Darwin Building

Title:

**Plant Noise Impact Assessment** 











Environmental Equipment Corporation Ltd Richmond House, Churchfield Road Walton on Thames Surrey. KT12 2TP t: 01932 230940 f: 01932 230941 e: info@eec.co.uk

Report Title		UCL LMS Small Works - SW16 Darwin Building			
		Plant Noise Impact Asses	Sment		
Reference		AO/EC19789-2			
Version		0			
Issue Date		8 February 2023			
Client		University College London			
Author		Alex Oakes BSc(Hons)			
		Acoustic Engineer			
Checked		Tim Meed BSc(Hons) MIOA			
		Director			
Revision	Date	Author	Checked		

### **CONTENTS:**

1	INTRODUCTION	1
2	SITE	1
3	GUIDANCE	2
4	MEASUREMENTS & SURVEY DETAILS	2
5	EQUIPMENT	3
6	RESULTS	3
7	PLANT ASSESSMENT	4
8	CONCLUSIONS	5

APPENDIX A:

APPENDIX B:

Site Plan & Measurement Location

APPENDIX C:

APPENDIX D:

APPENDIX E:

Survey Results (Tabular)

APPENDIX F:

Published Plant Noise Data











### 1 INTRODUCTION

- 1.01 Environmental Equipment Corporation Limited has been commissioned by University College London to undertake a noise assessment of two new chiller units to serve the UCL Darwin Building.
- 1.02 This noise assessment has been conducted in accordance with the policies and requirements of the Camden London Borough Council (CLBC) and is based on a noise survey carried out at the site over a typical weekday period.
- 1.03 This assessment includes:
  - the setting of plant noise limits in accordance with the requirements of CLBC and national planning policy, standards and guidance; and
  - the prediction of noise impacts at the worst affected noise sensitive receptors based on the proposed items of plant and their location.
- 1.04 This report is prepared solely for University College London. Environmental Equipment Corporation Limited accepts no responsibility for its use by any third party. Note that the contents contained herein are produced for the purposes of review by relevant Planning Authority departments and do not constitute a detailed design or specification document to be used for the purposes of construction. Subsequent development of noise mitigation schemes shall engage EEC Ltd and University College London so as to support the conclusions of this report.
- 1.05 Whilst every effort has been made to ensure that this report is easy to understand, it is necessarily technical in nature. To assist the reader, an explanation of the terminology used in this report is contained in Appendix A.

### 2 SITE

- 2.01 UCL Darwin Building is an existing multi-storey, multi-block educational building on the UCL campus, located in a predominantly commercial area of Bloomsbury.
- 2.02 The property is bound by the following:
  - North UCL Medical Sciences building and associated labs/teaching spaces;
  - East UCL Malet Place Engineering Building;
  - South Further educational facilities of the Darwin Building, with Torrington Place roadway and retail units beyond; and
  - West Student Accommodation of Arthur Tattersall House.
- 2.03 This application is for two Trane CGB-025 Chiller Units, which are to be located in an existing rooftop plant area, as presented in Appendix B.
- 2.04 The chillers will run in duty/stand-by with only one unit ever being in operation at a given time.
- 2.05 The closest noise sensitive receptors to the proposed plant items are the following:
  - Arthur Tattersall House student accommodation to the west of the site;
- 2.06 All other noise sensitive receptors are at a greater distance from the proposed location of the units, or are protected by more screening by the intervening structures, and as such will be subject to lower levels of noise.



- 3.01 Local and National Planning Policy for the Camden London Borough Council (CLBC) is presented in Appendix C of this document.
- 3.02 The below extract is taken from CLBC supplementary planning guidance for protection of Amenity dated January 2021 and provides guidance on how the Local Authority will assess acoustic reports:

"When assessing acoustic reports, the council will consider the reported measurements against the noise thresholds set out in Appendix 3 of the Local Plan. The thresholds are expressed as 'effect levels', which sets out a hierarchy of expected changes in behaviour and impact on health and wellbeing in response to increasing noise levels (measured in decibels – dB) The 'effect levels' are summarised below and explained in detail in National Planning Practice Guidance (NPPG).

- No observed effect level (NOEL) the level below which no effect can be detected on health and quality of life.
- Lowest observable adverse effect level (LOAEL) the level above which changes in behaviour (e.g. closing windows for periods of the day) and adverse effects on health (e.g. sleep disturbance) and quality of life can be detected.
- Significant observed adverse effect level (SOAEL) the level above which adverse effects on health and quality of life occur. This could include psychological stress, regular sleep deprivation and loss of appetite."

NPPG does not define any of the above effect levels numerically.

In accordance with the current National Planning Policy the noise impact from new plant should be assessed in line with the requirements of 'BS4142:2014: Methods for rating and assessing industrial and commercial sound'. The methodology provided can be used to assess the likelihood of any adverse impacts numerically based on the noise emitted as it affects noise sensitive receivers, including any corrections for the character of the noise against existing background noise levels.

### 4 MEASUREMENTS & SURVEY DETAILS

- 4.01 Environmental noise measurements were carried out over a weekend period by Messrs Vanguardia, between 1330 hours on Friday 4<sup>th</sup> March 2022 and concluded 1200 hours Monday 9<sup>th</sup> March 2022, to establish the existing noise levels at the site. The survey methodology and results produced by Messrs Vanguardia in Chapter 4 of their Planning Compliance Report (ref: 0042039-0820-0-AA-RP-0001) are set out below.
- 4.02 Noise measurements have been carried out at the following position, as shown in Appendix B and described as:
  - Position 1: Suspended from a 5<sup>th</sup> floor office window of the Darwin Building, overlooking 113 Gower Street. "as the measurement microphone was positioned around 1-metre from the edge of the Darwin Building facade, a -3 dB correction has been applied to all measured noise indices, to compensate for the effect of facade reflections. "



- 4.03 This position is considered to be representative of the nearest windows to the proposed chiller locations.
- 4.04 The Vanguardia noise report includes the following record in respect of weather conditions during the measurement periods:

"Prevailing weather conditions during the survey indicate very little (to no) rainfall observed, with an average wind speed of around 5.9 m/s across the duration of the survey period, which exceeds the recommended average wind speed limit of 5 m/s in Paragraph 6.4. of BS4142:2014 by +0.9 m/s. This excess in wind speed is not deemed sufficient to have significantly increased measured sound pressure levels and therefore no correction to the raw survey dataset is required. "

### **5 EQUIPMENT**

- 5.01 The equipment used by Vanguardia for the survey was as follows:-
  - "A Larson-Davis LxT "Sound Expert" sound level meter (serial no. 0003813) was used in conjunction with a Larson-Davis PRMLxT1L preamplifier (serial no. 027653) fitted with a PCB Piezotronics 377A13 (1/2-inch, prepolarised) pressure microphone (serial no. LW135909). A proprietary windshield was attached to the microphone, to which the effect on the free-field frequency response up to 10 kHz is negligible.
  - The equipment holds current UKAS or equivalent accreditation and serial numbers as follows:
- 5.02 Relevant details from the setup and calibration are noted as follows:

The instrument assembly (including the microphone extension cable) was calibrated before and after the survey to a linear sound pressure level of 114.0 dB (±0.2 dB SPL) using a Larson-Davis CAL-200 Field Calibrator (serial no. 13713) to observe the presence of any calibration drifts, of which none were detected at the end of the survey. The field calibrator conforms to "Class 1" precision in accordance with British Standard; BS EN 60942:2018 Electroacoustics. Sound Calibrators.

Certificates of periodic calibration for the instrument assembly and field calibrator, provided by a traceable UK source, are contained in Appendix C of Messrs Vanguardia' Planning Compliance Report".

### 6 RESULTS

- 6.01 A list of the levels measured is included in Appendix D and represented graphically in Appendix E.
- 6.02 A summary of the time averaged ambient levels and lowest measured background levels over the measurement periods are shown in Table 6.1. The minimum  $L_{A90}$  is the lowest fifteen-minute measurement in the specified period.

Position	Period	Average L <sub>Aeq,T</sub> – dB	Minimum L <sub>A90</sub> – dB
1	Day time (0700-2300 hrs)	55	51
1	Night (2300-0700 hrs)	50	49

Table 6.1: Free-Field Measured Ambient and Lowest Background Noise Levels



### 7 PLANT ASSESSMENT

- 7.01 This application is for the installation of two new chiller units to be located on the rooftop of the Darwin building, in an existing plant area.
- 7.02 Based on the standard requirements of Camden London Borough Council and the lowest measured background noise level in each time period, Table 7.1 sets out the recommended noise limits that the proposed items of plant should meet.
- 7.03 Please note, that in accordance with the requirements of Camden London Borough Council, the proposed noise limits are based on being 10 dB below the measured background noise level.

Location	Period	Measured Existing L <sub>A90,T</sub>	Proposed Noise Limit L <sub>Ar</sub>
Arthur Tattersall	Day (0700-2300)	51 dB	41 dB
House	Night (2300-0700)	49 dB	39 dB

Table 7.1: Suggested Plant Noise Emission Limits Based on Lowest Measured L<sub>A90</sub>, Free-field dB

- 7.04 Note that the limits suggested above are rating levels and as such any design should take into account the acoustic characteristics of the plant. In this instance the proposed units display none of the characteristics whereby the acoustic correction should be applied.
- 7.05 Assuming the proposed items meet the noise limits set out in Table 7.1 noise will be below the NOEL with respect to the NPPF.
- 7.06 The proposed chiller units have a manufacturer stated sound power level of 77 dB(A). With the two units running in duty/stand-by only, noise contributions from only one chiller unit have been assessed. Copies of the manufacturer's plant data sheets are included in Appendix F.
- 7.07 To mitigate structure borne noise, it is proposed that the two new chiller units both be installed on suitable anti-vibration equipment.
- 7.08 Predicted noise levels have been calculated at the closest noise sensitive windows, the east facing windows of Arthur Tattersall House student accommodation.
- 7.09 Other residential receptors located further from the site will be subject to lower noise levels than those predicted at the above locations.
- 7.10 Tables 7.2 7.3 present the results of worst-case plant noise predictions at the worst-case locations.

Item	Noise Level	Notes		
Trane CGB-025 Chiller Unit	77 dB(A)	Sound Power Level		
Traile CGB-023 Criller Offic	77 UB(A)	(Single unit)		
Barrier Effect	- 5 dB	No line of sight to proposed		
Barrier Effect	- 3 uB	plant location		
Point Source area Losses over	- 38 dB	Distance to closest window		
32 metres	- 38 UB	Distance to closest window		
Reflections	0 dB	No additional reflections		
Total Noise Level	34 dB(A)	Arthur Tattersall House		

**Table 7.2: Arthur Tattersall House Plant Noise Calculation** 

Property	Period	Proposed Noise Limit L <sub>Ar</sub>	Predicted L <sub>Aeq,T</sub>	Exceedance of noise limit
Arthur Tattersall House	Daytime (0700 – 2300)	41 dB	34 dB	- 7 dB
	Night-time (2300 – 0700)	39 dB	34 dB	- 5 dB

Table 7.3: Assessment of Predicted Noise Levels Based on Proposed Noise Limit, Free-field dB(A)

- 7.11 It can be seen from the above tables that the noise limits are not exceeded during any period at the closest noise sensitive receiver of Arthur Tattersall house.
- 7.12 Assuming that the proposed plant is included in the installation, predicted noise levels will meet the requirements of the Local Authority during all periods of operation and at the closest noise sensitive receptors.
- 7.13 The proposed scheme of vibration isolation will also mitigate the transfer of vibration to the supporting and connecting structures and ensure that the airborne sound mitigation design is not compromised.
- 7.14 With respect to the NPPF, achieving the noise limits would be classified as being below the NOEL.

### 8 CONCLUSIONS

- 8.01 University College London has appointed Environmental Equipment Corporation Limited to undertake a noise assessment for two new Trane CGB-025 Chiller units to serve the UCL Darwin Building.
- 8.02 The assessment has been carried out in accordance with national planning guidance and the requirements of the Camden London Borough Council, and is based on an environmental noise survey conducted at the site over a mid-week period.
- 8.03 A noise assessment has been undertaken to evaluate the potential noise impact of the proposed condensers at the closest existing residential receptors.
- 8.04 Plant noise limits have been set based on the methodology contained in BS4142, the results of a background noise survey and the requirements of Camden London Borough Council, to control the noise from the proposed condenser units. In accordance with the Camden London Borough Council, the noise limit has been set 10 dB below the lowest measured background noise level.
- 8.05 Predictions have shown that the noise criterion is met at all assessment locations during all periods of the condenser's proposed operation.
- 8.06 Assessing the site in accordance with the principles of the National Planning Policy Framework has shown that predicted noise levels would be below the level at which no effects are observed to occur, the NOEL.
- 8.07 On the basis of this assessment it is considered that noise does not pose a material constraint to the operation of the condenser units.

### **APPENDIX A**

### **GLOSSARY OF TECHNICAL TERMS**



### **ACOUSTIC TERMINOLOGY**

Absorption Classes	The sound absorption of a material is rated from Class A to Class E, where Class A materials provide the highest level of sound absorption.
Ambient Noise	Noise levels measured in the absence of noise requiring control, frequently measured to determine the
Levels	situation prior to the additional of a new noise source.
dB	Decibel. The logarithmic unit of sound level.
dBA	A-weighted decibel. The A-weighting approximates the response of the human ear.
D <sub>nT,w</sub>	Weighted standardized level difference. A single number quantity of the sound level difference between two rooms. $D_{nT,w}$ is typically used to measure the on-site sound insulation performance of a building element such as a wall, floor or ceiling. Measured in accordance with BS EN ISO 16283-1 and weighted in accordance with BS EN ISO 717-1.
$D_{n,e,w}$	The weighted element-normalized level difference. A single number rating of the sound reduction provided by a sound passing through an individual element. D <sub>n,e,w</sub> is typically used to define the sound insulation provided by ventilators. Measured in accordance with BS EN ISO 10140-2:2010 and rated in accordance with BS EN ISO 717-1.
Flanking	Transmission of sound energy through paths adjacent to the building element being considered. For example, sound may be transmitted around a wall by travelling up into the ceiling space and then down into the adjacent room.
Frequency	Sound can occur over a range of frequencies extending from the very low, such as the rumble of thunder, up to the very high such as the crash of cymbals. Sound is generally described over the frequency range from 63Hz to 4kHz, roughly equal to the range of frequencies on a piano.
Impact Sound	Sound produced by an object impacting directly on a building structure, such as footfall noise or chairs scrapping on a floor.
L <sub>Aeq,t</sub>	The equivalent continuous sound level measured in dBA. This is commonly referred to as the average noise level. 't' is the interval time for the measurement. Typically 't' of 16hrs and 8hrs is used for day and night time ambient noise respectively or 't' is defined by the period of interest in BS4142 assessments.
L <sub>A90,t</sub>	The noise level exceeded for 90% of the measurement period, measured in dBA. This is commonly referred to as the background noise level.
L' <sub>nT,w</sub>	Weighted, standardized impact sound pressure level. A single number rating of the impact sound insulation of a floor/ceiling when impacted on by a standard "tapper" machine. The lower the L' <sub>nT,w</sub> , the better the acoustic performance. Measured in accordance with BBS EN ISO 140-7 and rated in accordance with BS EN ISO 717-2.
NR	Noise Rating. A single number rating which is based on the sound level in the octave bands 31.5Hz – 8kHz inclusive, generally used to assess noise from mechanical services in buildings.
Octave Band	Frequencies are often grouped together into octaves for analysis. Octave bands are labelled by their centre frequency which are: 63Hz, 125Hz, 250Hz, 500Hz, 1kHz, 2kHz and 4kHz.
Reverberation Time $(T_{mf})$	Reverberation time is used for assessing the acoustic qualities of a space. It is defined as the time it takes for an impulse to decay by 60dB. $T_{mf}$ is the arithmetic average of the reverberation time in the mid frequency bands (500Hz, 1kHz and 2kHz).
$R_{\rm w}$	Weighted sound reduction index. A single number rating of the sound insulation performance of a specific building element. $R_{\rm w}$ is measured in a laboratory. $R_{\rm w}$ is commonly used by manufacturers to describe the sound insulation performance of building elements such as plasterboard and concrete. Measured in accordance with BS EN ISO 10140-2:2010 and rated in accordance with BS EN ISO 717-1.
Sound Absorption	When sound hits a surface, some of the sound energy is absorbed by the surface material. Sound absorption refers to the ability of a material to absorb sound, rated from 0, complete reflection, to 1, complete absorption.
Sound Insulation	When sound hits a surface, some of the sound energy travels through the material. 'Sound insulation' refers to the ability of a material to prevent the travel of sound.
Structure-borne transmission	Transmission of sound energy as vibrations via the structure of a building.



### **APPENDIX B**

# SITE PLAN & MEASUREMENT LOCATION



### **APPENDIX C**

# PLANNING POLICY AND GUIDANCE



### Camden Local Plan Appendix 3 – Noise Thresholds

Table C: Noise levels applicable to proposed industrial and commercial developments (including plant and machinery)

Existing Noise sensitive receptor	Assessment Location	Design Period	LOAEL (Green)	LOAEL to SOAEL (Amber)	SOAL (Red)
Dwellings**	Garden used for main amenity (free field) and Outside living or dining or bedroom window (façade)	Day	'Rating level' 10dB* below background	'Rating level' between 9dB below and 5dB above background	'Rating level' greater than 5dB above background
Dwellings**	Outside bedroom window (façade)	Night	'Rating level' 10dB* below background and no events exceeding 57dBL <sub>Amax</sub>	'Rating level' between 9dB below and 5dB above background or noise events between 57dB and 88dB LAmax	'Rating level' greater than 5dB above background and/or events exceeding 88dBL <sub>Amax</sub>

\*10dB should be increased to 15dB if the noise contains audible tonal elements. (day and night). However, if it can be demonstrated that there is no significant difference in the character of the residual background noise and the specific noise from the proposed development then this reduction may not be required. In addition, a frequency analysis (to include, the use of Noise Rating (NR) curves or other criteria curves) for the assessment of tonal or low frequency noise may be required.

\*\*levels given are for dwellings, however, levels are use specific and different levels will apply dependent on the use of the premises.

The periods in Table C correspond to 0700 hours to 2300 hours for the day and 2300 hours to 0700 hours for the night. The Council will take into account the likely times of occupation for types of development and will be amended according to the times of operation of the establishment under consideration.

There are certain smaller pieces of equipment on commercial premises, such as extract ventilation, air conditioning units and condensers, where achievement of the rating levels (ordinarily determined by a BS:4142 assessment) may not afford the necessary protection. In these cases, the Council will generally also require a NR curve specification of NR35 or below, dependant on the room (based upon measured or predicted Leq,5mins noise levels in octave bands) 1 metre from the façade of affected premises, where the noise sensitive premise is located in a quiet background area.



### National Planning Policy Framework and the Noise Policy Statement for England

The Department for Communities and Local Government published the National Planning Policy Framework (NPPF) on 27<sup>th</sup> March 2012 (as amended on 20<sup>th</sup> July 2021) and upon its publication, the majority of planning policy statements and guidance notes were withdrawn, including Planning Policy Guidance 24 Planning and Noise, which previously presented the government's overarching planning policy on noise.

Paragraph 174 in Section 15 of the NPPF (2021), entitled Conserving and enhancing the natural environment, states that:

"Planning policies and decisions should contribute to and enhance the natural and local environment by:

e) preventing new and existing development from contributing to, being put at unacceptable risk from, or being adversely affected by, unacceptable levels of soil, air, water or noise pollution or land instability..."

Paragraph 185 in Section 15 also states that:

"Planning policies and decisions should also ensure that new development is appropriate for its location taking into account the likely effects (including cumulative effects) of pollution on health, living conditions and the natural environment, as well as the potential sensitivity of the site or the wider area to impacts that could arise from the development. In doing so they should:

- a) mitigate and reduce to a minimum potential adverse impacts resulting from noise from new development and avoid noise giving rise to significant adverse impacts on health and the quality of life;
- b) identify and protect tranquil areas which have remained relatively undisturbed by noise and are prized for their recreational and amenity value for this reason..."

The Department for Environment Food and Rural Affairs published the Noise Policy Statement for England (NPSE) in March 2010. The explanatory note of NPSE defines the following terms used in the NPPF:

"NOEL - No Observed Effect Level

This is the level below which no effect can be detected. In simple terms, below this level, there is no detectable effect on health and quality of life due to the noise.

LOAEL - Lowest Observed Adverse Effect Level

This is the level above which adverse effects on health and quality of life can be detected.

2.21 Extending these concepts for the purpose of this NPSE leads to the concept of a significant observed adverse effect level.

SOAEL - Significant Observed Adverse Effect Level

This is the level above which significant adverse effects on health and quality of life occur."

The NPSE does not define any of the above effect levels numerically.



The NPSE presents the Noise Policy Aims as:

"Through the effective management and control of environmental, neighbour and neighbourhood noise within the context of Government policy and sustainable development:

avoid significant adverse impacts on health and quality of life; mitigate and minimise adverse impacts on health and quality of life; and

It can be seen that the first two bullet points are similar to Section 11 of the NPPF, with a third aim that seeks to improve health and quality of life. The NPSE later expands on the Noise Policy Aims, stating:

where possible, contribute to the improvement of health and quality of life."

- 2.23 The first aim of the NPSE states that significant adverse effects on health and quality of life should be avoided while also taking into account the guiding principles of sustainable development (paragraph 1.8).
- 2.24 The second aim of the NPSE refers to the situation where the impact lies somewhere between LOAEL and SOAEL. It requires that all reasonable steps should be taken to mitigate and minimise adverse effects on health and quality of life while also taking into account the guiding principles of sustainable development (paragraph 1.8). This does not mean that such adverse effects cannot occur.
- 2.25 This aim (the third aim), seeks where possible, positively to improve health and quality of life through the pro-active management of noise while also taking into account the guiding principles of sustainable development (paragraph 1.8), recognising that there will be opportunities for such measures to be taken and that they will deliver potential benefits to society. The protection of quiet places and quiet times as well as the enhancement of the acoustic environment will assist with delivering this aim."

It is clear that noise described in the NPSE as SOAEL that would lead to significant adverse effects should be avoided, although there is no definition as to what constitutes a significant adverse effect. Similarly, noise should be mitigated where it is high enough to lead to adverse effects, termed the LOAEL, but not so high that it leads to significant adverse effects.

### **British Standard 4142**

To assess the acceptability of the resultant noise levels we have consulted the relevant standards. BS 4142:2014 'Methods for rating and assessing industrial and commercial sound' has been used to assess the likelihood any adverse impacts based on the resultant noise level from the new plant item, including any corrections for the character of the noise against the existing background noise level.

BS4142 gives guidance on assessing the likelihood of adverse impacts by calculating a 'rating level' of the new noise source and comparing its magnitude at noise sensitive locations to the existing or underlying background noise level. The background noise level is subtracted from the 'rating level' to assess the likelihood of complaints:

- The greater the difference the greater the likelihood of complaints.
- A difference of around +10dB or more is an indication of a significant adverse impact, depending on the context.
- A difference of +5dB is likely to be an indication of an adverse impact, depending on the context.



 The lower the rating level is relative to the measured background noise level, the less likely it is that the specific sound source will have an adverse impact or significant adverse impact. Where the rating level does not exceed the background sound level, this is an indication of the specific sound source having a low sound impact, depending on the context.

This assessment is carried out over a one hour period for the daytime and a fifteen minute period for the night-time. For the purposes of the standard it states that daytime and night-time are typically 07:00 to 23:00 hours and 23:00 to 07:00 hours respectively.

The 'rating level' of the noise source is obtained taking the following factors into consideration:

- The new plant noise (the specific noise) is measured or predicted in terms of LAeq.
- An additional correction shall be included if the noise contains a distinguishable, discrete continuous note, if the noise contains distinct impulses or if the noise is irregular enough to attract attention. The value for any tonal noise can be an addition of up to 6dB and for impulsive noise of up to 9dB.

BS 4142 goes onto state that:

'The significance of sound of an industrial and/or commercial nature depends upon both the margin by which the rating level of the specific sound source exceeds the background sound level and the context in which the sound occurs. An effective assessment cannot be conducted without an understanding of the reason(s) for the assessment and the context in which the sound occurs/will occur. When making assessments and arriving at decisions, therefore, it is essential to place the sound in context.'

BS4142 has been referenced in setting noise limits for any fixed plant proposed as part of the proposed development.



# SURVEY RESULTS (TABULAR)



# APPENDIX D- NOISE SURVEY DATASET

Record #	Date	Time	Run Duration	LAeq	LAFmin	LAFmax	LAF90.00	LAeq
1	2022-03-04	13:30:00	00:15:00.0	64.9	55.4	80.3	57.9	64.9
2	2022-03-04	13:45:00	00:15:00.0	67.3	55.6	91.4	58.0	67.3
3	2022-03-04	14:00:00	00:15:00.0	79.1	55.9	107.2	58.8	79.1
4	2022-03-04	14:15:00	00:15:00.0	65.4	55.1	81.9	57.6	65.4
5	2022-03-04	14:30:00	00:15:00.0	66.9	55.5	85.0	58.5	66.9
6	2022-03-04	14:45:00	00:15:00.0	64.5	55.2	73.4	58.0	64.5
7	2022-03-04	15:00:00	00:15:00.0	65.3	55.8	84.8	58.8	65.3
8	2022-03-04	15:15:00	00:15:00.0	64.7	55.0	80.2	57.6	64.7
9	2022-03-04	15:30:00	00:15:00.0	65.1	55.6	76.0	58.6	65.1
10	2022-03-04	15:45:00	00:15:00.0	65.8	55.4	80.1	58.2	65.8
11	2022-03-04	16:00:00	00:15:00.0	65.3	55.5	75.2	60.0	65.3
12	2022-03-04	16:15:00	00:15:00.0	66.1	54.4	74.8	58.9	66.1
13	2022-03-04	16:30:00	00:15:00.0	67.4	55.4	88.1	58.5	67.4
14	2022-03-04	16:45:00	00:15:00.0	66.7	56.0	76.0	59.5	66.7
15	2022-03-04	17:00:00	00:15:00.0	66.2	54.7	75.2	57.5	66.2
16	2022-03-04	17:15:00	00:15:00.0	74.9	56.0	99.4	59.2	74.9
17	2022-03-04	17:30:00	00:15:00.0	65.7	55.1	79.9	58.4	65.7
18	2022-03-04	17:45:00	00:15:00.0	65.5	54.9	79.8	57.7	65.5
19	2022-03-04	18:00:00	00:15:00.0	65.4	53.9	72.9	57.9	65.4
20	2022-03-04	18:15:00	00:15:00.0	65.4	53.6	78.9	58.7	65.4
21	2022-03-04	18:30:00	00:15:00.0	65.6	54.8	76.2	59.7	65.6
22	2022-03-04	18:45:00	00:15:00.0	65.5	54.3	85.4	57.2	65.5
23	2022-03-04	19:00:00	00:15:00.0	63.5	53.6	72.5	56.7	63.5
24	2022-03-04	19:15:00	00:15:00.0	70.4	54.3	94.5	57.5	70.4
25	2022-03-04	19:30:00	00:15:00.0	65.5	54.1	83.0	56.8	65.5
26	2022-03-04	19:45:00	00:15:00.0	64.0	53.5	74.7	57.0	64.0
27	2022-03-04	20:00:00	00:15:00.0	66.3	54.3	93.4	57.5	66.3
28	2022-03-04	20:15:00	00:15:00.0	64.2	54.1	75.8	56.3	64.2
29	2022-03-04	20:30:00	00:15:00.0	63.2	53.1	71.7	56.2	63.2
30	2022-03-04	20:45:00	00:15:00.0	63.4	53.2	76.3	55.9	63.4
31	2022-03-04	21:00:00	00:15:00.0	64.2	53.6	78.4	56.2	64.2
32	2022-03-04	21:15:00	00:15:00.0	62.6	52.4	74.7	55.2	62.6
33	2022-03-04	21:30:00	00:15:00.0	63.8	53.1	87.8	55.5	63.8
34	2022-03-04	21:45:00	00:15:00.0	66.9	53.5	90.5	56.6	66.9
35	2022-03-04	22:00:00	00:15:00.0	63.0	52.6	82.6	54.9	63.0
36	2022-03-04	22:15:00	00:15:00.0	62.4	52.8	75.9	55.3	62.4
37	2022-03-04	22:30:00	00:15:00.0	71.6	52.3	98.1	55.2	71.6
38	2022-03-04	22:45:00	00:15:00.0	62.8	53.1	74.9	55.8	62.8
39	2022-03-04	23:00:00	00:15:00.0	61.8	52.7	71.7	54.8	61.8
40	2022-03-04	23:15:00	00:15:00.0	62.3	52.7	77.4	54.8	62.3
41	2022-03-04	23:30:00	00:15:00.0	64.7	53.2	77.4	56.5	64.7
41	2022-03-04	23:45:00	00:15:00.0	64.1		78.7	55.1	64.1
	2022-03-04				53.0			
43		00:00:00	00:15:00.0	64.4	52.7	77.7	55.8	64.4
44	2022-03-05	00:15:00	00:15:00.0	64.1	52.9	74.2	55.2	64.1
45	2022-03-05	00:30:00	00:15:00.0	63.3	52.7	76.9	55.9	63.3
46	2022-03-05	00:45:00	00:15:00.0	64.0	53.3	78.8	55.8	64.0
47	2022-03-05	01:00:00	00:15:00.0	62.9	52.9	78.2	54.9	62.9
48	2022-03-05	01:15:00	00:15:00.0	62.4	52.5	71.8	54.8	62.4
49	2022-03-05	01:30:00	00:15:00.0	62.8	52.6	76.4	55.5	62.8

### UCL BIOSCIENCES: CLEO & CDB HORD PLANNING COMPLIANCE REPORT (NOISE)



50	2022-03-05	01:45:00	00:15:00.0	62.8	52.4	77.5	54.7	62.
51	2022-03-05	02:00:00	00:15:00.0	61.9	51.8	74.5	54.2	61.
52	2022-03-05	02:15:00	00:15:00.0	61.4	51.9	70.6	54.0	61.
53	2022-03-05	02:30:00	00:15:00.0	61.2	52.0	76.7	53.9	61.
54	2022-03-05	02:45:00	00:15:00.0	62.8	51.8	86.6	53.8	62.
55	2022-03-05	03:00:00	00:15:00.0	60.1	51.5	70.7	53.6	60.
56	2022-03-05	03:15:00	00:15:00.0	60.2	51.8	72.3	53.0	60.
57	2022-03-05	03:30:00	00:15:00.0	60.1	52.0	71.1	53.3	60.
58	2022-03-05	03:45:00	00:15:00.0	60.6	51.7	72.1	53.9	60.
59	2022-03-05	04:00:00	00:15:00.0	60.0	51.6	69.4	53.0	60
60	2022-03-05	04:15:00	00:15:00.0	60.2	51.8	73.9	53.6	60
61	2022-03-05	04:30:00	00:15:00.0	60.2	52.1	73.1	53.3	60
62	2022-03-05	04:45:00	00:15:00.0	61.0	52.4	72.9	54.4	61
63	2022-03-05	05:00:00	00:15:00.0	59.7	52.5	69.9	53.7	59.
64	2022-03-05	05:15:00	00:15:00.0	60.8	51.6	74.5	53.1	60.
65	2022-03-05	05:30:00	00:15:00.0	58.8	51.7	70.7	52.8	58.
66	2022-03-05	05:45:00	00:15:00.0	59.0	51.9	70.3	53.0	59.
67	2022-03-05	06:00:00	00:15:00.0	60.5	51.6	73.9	53.1	60.
68	2022-03-05	06:15:00	00:15:00.0	60.9	51.6	73.6	53.1	60.
69	2022-03-05	06:30:00	00:15:00.0	60.4	51.9	75.7	53.2	60.
70	2022-03-05	06:45:00	00:15:00.0	61.4	52.1	75.7	53.8	61.
71	2022-03-05	07:00:00	00:15:00.0	62.5	52.6	79.4	54.5	62.
72	2022-03-05	07:15:00	00:15:00.0	61.4	52.7	73.6	54.1	61.
73	2022-03-05	07:30:00	00:15:00.0	62.5	52.8	75.6	54.8	62.
74	2022-03-05	07:45:00	00:15:00.0	62.0	52.9	71.9	54.8	62.
75	2022-03-05	08:00:00	00:15:00.0	63.3	55.1	84.6	56.5	63.
76	2022-03-05	08:15:00	00:15:00.0	65.1	55.2	84.2	56.7	65.
77	2022-03-05	08:30:00	00:15:00.0	67.9	55.2	78.2	57.4	67.
78	2022-03-05	08:45:00	00:15:00.0	62.2	55.3	75.8	56.6	62.
79	2022-03-05	09:00:00	00:15:00.0	63.0	55.4	73.1	56.9	63
80	2022-03-05	09:15:00	00:15:00.0	62.6	55.7	75.7	57.3	62
81	2022-03-05	09:30:00	00:15:00.0	63.7	55.6	81.3	57.1	63
82	2022-03-05	09:45:00	00:15:00.0	63.6	55.4	81.1	56.9	63.
83	2022-03-05	10:00:00	00:15:00.0	62.5	55.4	73.7	57.0	62.
84	2022-03-05	10:15:00	00:15:00.0	65.9	55.7	88.8	57.6	65
85	2022-03-05	10:30:00	00:15:00.0	63.6	56.0	73.8	58.1	63
86	2022-03-05	10:45:00	00:15:00.0	63.7	55.9	75.8	57.6	63.
87	2022-03-05	11:00:00	00:15:00.0	64.4	55.9	84.0	57.7	64.
88	2022-03-05	11:15:00	00:15:00.0	64.0	56.3	77.8	58.2	64.
89	2022-03-05	11:30:00	00:15:00.0	62.7	55.7	71.0	57.5	62.
90	2022-03-05	11:45:00	00:15:00.0	63.5	56.2	74.8	57.4	63.
91	2022-03-05	12:00:00	00:15:00.0	63.5	55.9	71.2	57.7	63.
92	2022-03-05	12:15:00	00:15:00.0	64.8	56.0	77.8	58.5	64.
93	2022-03-05	12:30:00	00:15:00.0	64.6	55.6	73.9	58.4	64.
94	2022-03-05	12:45:00	00:15:00.0	63.9	56.4	80.6	58.2	63.
95	2022-03-05	13:00:00	00:15:00.0	63.4	55.7	72.8	58.1	63.
96	2022-03-05	13:15:00	00:15:00.0	65.2	56.3	86.3	58.1	65.
97	2022-03-05	13:30:00	00:15:00.0	64.0	56.0	75.8	57.6	64.
98	2022-03-05	13:45:00	00:15:00.0	68.2	56.2	90.4	59.6	68.
99	2022-03-05	14:00:00	00:15:00.0	64.8	56.2	77.0	58.4	64.





100	2022-03-05	14:15:00	00:15:00.0	64.2	56.0	82.9	57.9	64.2
101	2022-03-05	14:30:00	00:15:00.0	64.4	55.6	73.4	58.3	64.4
102	2022-03-05	14:45:00	00:15:00.0	64.1	55.9	74.1	58.1	64.1
103	2022-03-05	15:00:00	00:15:00.0	64.7	56.4	75.9	59.7	64.7
104	2022-03-05	15:15:00	00:15:00.0	63.8	53.8	75.5	56.2	63.8
105	2022-03-05	15:30:00	00:15:00.0	65.2	53.9	86.6	56.8	65.2
106	2022-03-05	15:45:00	00:15:00.0	62.9	54.4	74.2	56.8	62.9
107	2022-03-05	16:00:00	00:15:00.0	63.6	54.6	76.1	57.0	63.6
108	2022-03-05	16:15:00	00:15:00.0	64.0	54.8	76.2	57.4	64.0
109	2022-03-05	16:30:00	00:15:00.0	63.1	53.7	73.9	56.6	63.1
110	2022-03-05	16:45:00	00:15:00.0	64.4	53.4	76.7	57.4	64.4
111	2022-03-05	17:00:00	00:15:00.0	64.6	53.7	80.3	57.1	64.6
112	2022-03-05	17:15:00	00:15:00.0	64.4	55.0	76.5	58.0	64.4
113	2022-03-05	17:30:00	00:15:00.0	64.8	54.9	79.3	57.7	64.8
114	2022-03-05	17:45:00	00:15:00.0	63.3	53.9	72.6	56.3	63.3
115	2022-03-05	18:00:00	00:15:00.0	63.2	54.2	72.8	57.4	63.2
116	2022-03-05	18:15:00	00:15:00.0	63.9	53.8	72.4	57.1	63.9
117	2022-03-05	18:30:00	00:15:00.0	64.4	53.9	76.3	57.2	64.4
118	2022-03-05	18:45:00	00:15:00.0	65.3	54.5	76.7	57.0	65.3
119	2022-03-05	19:00:00	00:15:00.0	64.6	53.8	72.1	57.8	64.6
120	2022-03-05	19:15:00	00:15:00.0	64.6	53.3	77.8	57.1	64.6
121	2022-03-05	19:30:00	00:15:00.0	71.2	53.8	96.8	57.7	71.2
122	2022-03-05	19:45:00	00:15:00.0	63.6	53.4	73.8	56.6	63.6
123		20:00:00		65.3		80.4	57.6	65.3
	2022-03-05		00:15:00.0		53.7			
124	2022-03-05	20:15:00	00:15:00.0	64.7	54.6	76.0	58.2	64.7
125	2022-03-05	20:30:00	00:15:00.0	63.7	53.2	73.6	55.7	63.7
126	2022-03-05	20:45:00	00:15:00.0	63.5	53.0	79.8	55.9	63.5
127	2022-03-05	21:00:00	00:15:00.0	63.4	52.9	72.0	56.1	63.4
128	2022-03-05	21:15:00	00:15:00.0	64.6	53.0	80.4	54.9	64.6
129	2022-03-05	21:30:00	00:15:00.0	62.7	52.5	71.8	55.3	62.7
130	2022-03-05	21:45:00	00:15:00.0	63.1	53.2	72.0	55.8	63.1
131	2022-03-05	22:00:00	00:15:00.0	64.7	53.5	86.8	56.3	64.7
132	2022-03-05	22:15:00	00:15:00.0	64.2	53.6	73.4	56.3	64.2
133	2022-03-05	22:30:00	00:15:00.0	63.7	53.8	75.0	56.5	63.7
134	2022-03-05	22:45:00	00:15:00.0	62.5	52.9	71.2	55.7	62.5
135	2022-03-05	23:00:00	00:15:00.0	62.8	53.5	73.6	55.6	62.8
136	2022-03-05	23:15:00	00:15:00.0	63.8	53.1	78.8	55.8	63.8
137	2022-03-05	23:30:00	00:15:00.0	63.6	53.3	75.8	56.1	63.6
138	2022-03-05	23:45:00	00:15:00.0	63.2	52.4	75.2	55.8	63.2
139	2022-03-06	00:00:00	00:15:00.0	61.7	52.2	73.1	54.5	61.7
140	2022-03-06	00:15:00	00:15:00.0	63.9	52.2	86.9	54.1	63.9
141	2022-03-06	00:30:00	00:15:00.0	62.6	52.0	74.3	54.1	62.6
142	2022-03-06	00:45:00	00:15:00.0	64.0	52.2	84.3	54.7	64.0
143	2022-03-06	01:00:00	00:15:00.0	62.1	52.4	74.6	55.2	62.1
144	2022-03-06	01:15:00	00:15:00.0	62.4	52.3	75.9	54.5	62.4
145	2022-03-06	01:30:00	00:15:00.0	61.4	51.9	73.6	53.2	61.4
146	2022-03-06	01:45:00	00:15:00.0	62.7	52.5	79.7	54.7	62.7
147	2022-03-06	02:00:00	00:15:00.0	61.2	51.7	71.5	53.6	61.2
148	2022-03-06	02:15:00	00:15:00.0	61.1	51.7	74.9	53.1	61.1
149	2022-03-06	02:30:00	00:15:00.0	61.6	51.8	85.5	53.8	61.6



### 0042039-0820-0-AA-RP-0001



450	2022 02 05	02.45.00	00:15:00.0	64.4	E1 2	72.2	E2.6	
150 151	2022-03-06 2022-03-06	02:45:00 03:00:00	00:15:00.0 00:15:00.0	61.4 61.1	51.3 52.5	72.3 70.4	53.6 54.0	61.4
152						70.4	53.5	61.2
153	2022-03-06	03:15:00	00:15:00.0	61.2 60.2	51.6	70.7	53.6	
	2022-03-06	03:30:00	00:15:00.0		51.9			60.2
154	2022-03-06	03:45:00	00:15:00.0	59.8	51.6	71.1	52.9	59.8
155	2022-03-06	04:00:00	00:15:00.0	59.6	50.9	72.6	53.2	59.6
156	2022-03-06	04:15:00	00:15:00.0	58.5	50.6	75.5	51.8	58.5
157	2022-03-06	04:30:00	00:15:00.0	57.7	51.1	69.7	52.2	57.7
158	2022-03-06	04:45:00	00:15:00.0	59.5	50.8	76.2	51.8	59.5
159	2022-03-06	05:00:00	00:15:00.0	59.0	50.5	74.2	51.8	59.0
160	2022-03-06	05:15:00	00:15:00.0	59.4	50.8	72.8	52.3	59.4
161	2022-03-06	05:30:00	00:15:00.0	57.7	50.5	69.5	51.6	57.
162	2022-03-06	05:45:00	00:15:00.0	58.1	50.7	77.5	51.8	58.3
163	2022-03-06	06:00:00	00:15:00.0	59.7	50.8	73.7	51.9	59.
164	2022-03-06	06:15:00	00:15:00.0	57.9	50.5	69.4	52.2	57.9
165	2022-03-06	06:30:00	00:15:00.0	60.2	50.8	76.9	52.0	60.2
166	2022-03-06	06:45:00	00:15:00.0	60.6	50.9	73.4	52.5	60.0
167	2022-03-06	07:00:00	00:15:00.0	58.9	50.9	73.6	52.0	58.9
168	2022-03-06	07:15:00	00:15:00.0	58.9	51.1	71.5	52.5	58.
169	2022-03-06	07:30:00	00:15:00.0	59.2	51.2	75.9	52.4	59.
170	2022-03-06	07:45:00	00:15:00.0	60.1	51.3	73.4	52.7	60.
171	2022-03-06	08:00:00	00:15:00.0	59.7	51.4	72.8	52.7	59.
172	2022-03-06	08:15:00	00:15:00.0	58.6	50.9	70.9	51.9	58.
173	2022-03-06	08:30:00	00:15:00.0	62.0	51.8	76.2	53.9	62.
174	2022-03-06	08:45:00	00:15:00.0	65.9	51.3	79.9	52.4	65.
175	2022-03-06	09:00:00	00:15:00.0	60.4	51.2	73.3	53.1	60.
176	2022-03-06	09:15:00	00:15:00.0	61.0	51.5	76.6	52.8	61.
177	2022-03-06	09:30:00	00:15:00.0	60.7	51.9	70.0	54.3	60.
178	2022-03-06	09:45:00	00:15:00.0	60.2	51.2	70.9	52.9	60.
179	2022-03-06	10:00:00	00:15:00.0	60.7	51.7	72.5	53.7	60.
180	2022-03-06	10:15:00	00:15:00.0	61.2	51.3	70.4	53.9	61.
181	2022-03-06	10:30:00	00:15:00.0	61.9	51.5	79.0	54.0	61.
182	2022-03-06	10:45:00	00:15:00.0	61.5	51.9	70.5	54.3	61.
183	2022-03-06	11:00:00	00:15:00.0	62.5	51.7	81.7	54.0	62.
184	2022-03-06	11:15:00	00:15:00.0	62.5	52.3	79.4	54.6	62.
185	2022-03-06	11:30:00	00:15:00.0	61.5	52.2	75.5	54.2	61.
186	2022-03-06	11:45:00	00:15:00.0	61.8	52.0	80.6	54.5	61.
187	2022-03-06	12:00:00	00:15:00.0	61.7	52.5	75.0	54.7	61.
188	2022-03-06	12:15:00	00:15:00.0	61.9	53.5	71.7	55.5	61.
189	2022-03-06	12:30:00	00:15:00.0	62.1	51.9	71.2	54.5	62.
190	2022-03-06	12:45:00	00:15:00.0	62.9	51.9	75.5	55.5	62.
191	2022-03-06	13:00:00	00:15:00.0	62.2	53.0	73.5	55.4	62.
192	2022-03-06	13:15:00	00:15:00.0	63.7	53.1	84.8	56.3	63.7
193	2022-03-06	13:30:00	00:15:00.0	64.0	52.5	83.0	56.8	64.0
194	2022-03-06	13:45:00	00:15:00.0					_
				61.6	52.0	76.3	54.2	61.0
195	2022-03-06	14:00:00	00:15:00.0	61.4	52.3	69.8	55.2	61.4
196	2022-03-06	14:15:00	00:15:00.0	62.9	52.9	80.7	55.5	62.9
197	2022-03-06	14:30:00	00:15:00.0	62.6	51.9	76.4	55.1	62.
198	2022-03-06	14:45:00	00:15:00.0	62.8	52.6	81.9	55.7	62.8





200	2022-03-06	15:15:00	00:15:00.0	62.1	53.2	73.1	55.7	62.1
201	2022-03-06	15:30:00	00:15:00.0	62.1	51.9	77.5	54.2	62.1
202	2022-03-06	15:45:00	00:15:00.0	62.0	53.0	69.8	55.9	62.0
203	2022-03-06	16:00:00	00:15:00.0	63.5	52.3	77.9	55.3	63.5
204	2022-03-06	16:15:00	00:15:00.0	61.3	52.5	68.4	55.0	61.3
205	2022-03-06	16:30:00	00:15:00.0	62.2	51.8	72.6	55.7	62.2
206	2022-03-06	16:45:00	00:15:00.0	62.9	52.0	74.8	55.3	62.9
207	2022-03-06	17:00:00	00:15:00.0	62.9	52.7	73.6	55.4	62.9
208	2022-03-06	17:15:00	00:15:00.0	64.2	52.0	85.3	54.6	64.2
209	2022-03-06	17:30:00	00:15:00.0	63.2	53.8	74.5	56.2	63.2
210	2022-03-06	17:45:00	00:15:00.0	63.1	52.1	78.6	55.3	63.1
211	2022-03-06	18:00:00	00:15:00.0	63.0	53.2	72.8	55.6	63.0
212	2022-03-06	18:15:00	00:15:00.0	71.3	53.3	94.4	55.4	71.3
213	2022-03-06	18:30:00	00:15:00.0	62.8	51.5	74.0	55.2	62.8
214	2022-03-06	18:45:00	00:15:00.0	63.5	52.4	77.4	56.2	63.5
215	2022-03-06	19:00:00	00:15:00.0	63.1	51.6	73.5	54.8	63.1
216	2022-03-06	19:15:00	00:15:00.0	63.8	52.7	78.1	55.6	63.8
217	2022-03-06	19:30:00	00:15:00.0	63.9	52.0	78.1	55.8	63.9
218	2022-03-06	19:45:00	00:15:00.0	63.5	52.4	83.6	54.8	63.5
219	2022-03-06	20:00:00	00:15:00.0	62.6	51.6	77.4	54.1	62.6
220	2022-03-06	20:15:00	00:15:00.0	68.8	51.8	94.6	53.9	68.8
221	2022-03-06	20:30:00	00:15:00.0	64.1	52.2	85.8	54.7	64.1
222	2022-03-06	20:45:00	00:15:00.0	61.3	51.9	73.4	54.0	61.3
223	2022-03-06	21:00:00	00:15:00.0	63.8	51.4	85.0	53.9	63.8
224	2022-03-06	21:15:00	00:15:00.0	62.8	51.2	78.7	53.7	62.8
225	2022-03-06	21:30:00	00:15:00.0	61.1	51.0	73.2	53.1	61.1
226	2022-03-06	21:45:00	00:15:00.0	61.5	52.1	70.3	54.1	61.5
227	2022-03-06	22:00:00	00:15:00.0	59.4	51.4	69.8	53.4	59.4
228	2022-03-06	22:15:00	00:15:00.0	61.3	52.4	71.4	54.1	61.3
229	2022-03-06	22:30:00	00:15:00.0	61.1	51.6	72.4	53.5	61.1
230	2022-03-06	22:45:00	00:15:00.0	59.7	51.3	70.2	53.0	59.7
231	2022-03-06	23:00:00	00:15:00.0	60.6	50.9	73.4	52.9	60.0
232	2022-03-06	23:15:00	00:15:00.0	62.0	51.7	75.9	53.8	62.0
233	2022-03-06	23:30:00	00:15:00.0	61.1	51.0	78.1	53.1	61.:
234	2022-03-06	23:45:00	00:15:00.0	61.2	51.3	75.5	53.0	61.2
235	2022-03-07	00:00:00	00:15:00.0	60.8	51.1	71.9	52.9	60.8
236	2022-03-07	00:05:00	00:15:00.0	63.3	51.4	88.5	52.9	63.3
237	2022-03-07	00:30:00	00:15:00.0	60.2	50.7	76.6	52.5	60.2
238	2022-03-07	00:35:00	00:15:00.0	59.4	50.5	74.9	51.9	59.4
239	2022-03-07	01:00:00		58.7	50.5	74.3	51.8	58.7
	2022-03-07		00:15:00.0					
240	2022-03-07	01:15:00 01:30:00	00:15:00.0	59.2	50.7	74.3	51.9	59.2
241			00:15:00.0	57.4	50.3	72.0	51.6	57.4
242	2022-03-07	01:45:00	00:15:00.0	58.9	50.2	77.0	51.4	58.9
243	2022-03-07	02:00:00	00:15:00.0	59.5	50.5	77.3	51.6	59.5
244	2022-03-07	02:15:00	00:15:00.0	59.1	50.8	74.1	52.2	59.1
245	2022-03-07	02:30:00	00:15:00.0	57.6	50.5	69.8	51.6	57.6
246	2022-03-07	02:45:00	00:15:00.0	57.2	50.6	70.5	51.8	57.2
247	2022-03-07	03:00:00	00:15:00.0	58.1	50.6	73.3	51.6	58.1
248	2022-03-07	03:15:00	00:15:00.0	57.0	50.6	70.6	51.7	57.0
249	2022-03-07	03:30:00	00:15:00.0	57.9	50.7	75.0	51.7	57.9





250	2022-03-07	03:45:00	00:15:00.0	57.7	50.8	69.6	52.2	57.7
251	2022-03-07	04:00:00	00:15:00.0	58.5	50.5	73.3	51.8	58.5
252	2022-03-07	04:15:00	00:15:00.0	58.0	50.9	72.6	51.9	58.0
253	2022-03-07	04:30:00	00:15:00.0	58.1	50.9	71.2	51.8	58.1
254	2022-03-07	04:45:00	00:15:00.0	57.5	50.7	74.8	51.6	57.5
255	2022-03-07	05:00:00	00:15:00.0	57.6	50.7	70.6	52.1	57.6
256	2022-03-07	05:15:00	00:15:00.0	60.1	50.8	77.3	51.9	60.1
257	2022-03-07	05:30:00	00:15:00.0	60.7	51.3	74.7	53.0	60.7
258	2022-03-07	05:45:00	00:15:00.0	62.3	51.7	75.5	53.1	62.3
259	2022-03-07	06:00:00	00:15:00.0	62.4	51.9	74.2	54.1	62.4
260	2022-03-07	06:15:00	00:15:00.0	62.9	51.9	73.7	53.6	62.
261	2022-03-07	06:30:00	00:15:00.0	63.4	51.7	75.2	54.1	63.4
262	2022-03-07	06:45:00	00:15:00.0	64.6	51.9	82.4	55.0	64.
263	2022-03-07	07:00:00	00:15:00.0	65.0	52.6	79.1	55.3	65.
264	2022-03-07	07:15:00	00:15:00.0	64.6	53.1	77.2	55.9	64.
265	2022-03-07	07:30:00	00:15:00.0	65.6	53.3	75.5	56.8	65.
266	2022-03-07	07:45:00	00:15:00.0	66.2	53.0	84.6	58.7	66.
267	2022-03-07	08:00:00	00:15:00.0	66.2	54.0	80.7	57.0	66.
268	2022-03-07	08:15:00	00:15:00.0	66.8	53.7	81.5	57.0	66.
269	2022-03-07	08:30:00	00:15:00.0	68.4	53.8	79.5	57.6	68.
270	2022-03-07	08:45:00	00:15:00.0	66.2	54.3	80.2	57.7	66.
271	2022-03-07	09:00:00	00:15:00.0	70.8	53.9	94.7	57.8	70.
272	2022-03-07	09:15:00	00:15:00.0	64.5	53.9	75.6	57.3	64.
273	2022-03-07	09:30:00	00:15:00.0	65.4	54.7	75.7	58.5	65.
274	2022-03-07	09:45:00	00:15:00.0	63.8	55.0	73.3	57.1	63.
275	2022-03-07	10:00:00	00:15:00.0	63.5	54.2	73.6	57.1	63
276	2022-03-07	10:15:00	00:15:00.0	66.5	56.8	86.1	60.6	66.
277	2022-03-07	10:30:00	00:15:00.0	64.1	54.2	78.9	58.6	64.
278	2022-03-07	10:45:00	00:15:00.0	64.5	54.5	75.1	58.7	64.
279	2022-03-07	11:00:00	00:15:00.0	68.9	58.2	93.5	61.4	68.
280	2022-03-07	11:15:00	00:15:00.0	65.0	53.7	81.4	58.2	65.
281	2022-03-07	11:30:00	00:15:00.0	69.4	54.4	91.7	58.3	69.
282	2022-03-07	11:45:00	00:15:00.0	65.6	53.8	79.8	58.8	65.
283	2022-03-07	12:00:00	00:15:00.0	64.8	54.8	75.2	57.3	64.
284	2022-03-07	12:15:00	00:15:00.0	65.4	54.4	82.5	58.0	65.
285	2022-03-07	12:30:00	00:15:00.0	64.6	53.4	75.4	58.7	64.
286	2022-03-07	12:45:00	00:15:00.0	66.6	55.2	87.5	59.0	66.
287	2022-03-07	13:00:00	00:15:00.0	65.4	54.2	81.3	57.7	65.4
288	2022-03-07	13:15:00	00:15:00.0	64.3	53.8	80.3	58.2	64.
289	2022-03-07		00:15:00.0	65.6	53.7	78.4	58.6	65.
289	2022-03-07	13:30:00	00:15:00.0	64.4	54.3	76.0	57.9	64.
290		13:45:00		69.0	54.0	95.8		69.
	2022-03-07	14:00:00	00:15:00.0				58.3	_
292	2022-03-07	14:15:00	00:15:00.0	65.2	54.7	76.6	59.0	65.
293	2022-03-07	14:30:00	00:15:00.0	65.2	54.4	83.4	57.0	65.
294	2022-03-07	14:45:00	00:15:00.0	64.0	54.2	73.9	58.3	64.
295	2022-03-07	15:00:00	00:15:00.0	77.4	55.1	107.2	58.4	77.
296	2022-03-07	15:15:00	00:15:00.0	63.9	53.7	75.3	57.3	63.
297	2022-03-07	15:30:00	00:15:00.0	64.3	54.3	81.0	57.4	64.
298	2022-03-07	15:45:00	00:15:00.0	64.1	54.7	74.4	58.2	64.:
299	2022-03-07	16:00:00	00:15:00.0	79.3	53.7	107.0	58.1	79.





300	2022-03-07	16:15:00	00:15:00.0	71.8	54.8	99.4	57.6	71.8
301	2022-03-07	16:30:00	00:15:00.0	67.1	55.8	79.4	58.8	67.1
302	2022-03-07	16:45:00	00:15:00.0	65.0	54.6	75.1	58.0	65.0
303	2022-03-07	17:00:00	00:15:00.0	68.2	55.5	98.1	59.2	68.2
304	2022-03-07	17:15:00	00:15:00.0	66.9	56.0	83.8	59.0	66.9
305	2022-03-07	17:30:00	00:15:00.0	66.0	56.5	83.9	60.5	66.0
306	2022-03-07	17:45:00	00:15:00.0	63.8	54.6	74.6	57.5	63.8
307	2022-03-07	18:00:00	00:15:00.0	64.4	54.9	76.5	57.5	64.4
308	2022-03-07	18:15:00	00:15:00.0	64.0	54.4	81.2	57.3	64.0
309	2022-03-07	18:30:00	00:15:00.0	64.6	54.9	85.6	58.2	64.6
310	2022-03-07	18:45:00	00:15:00.0	64.1	52.9	79.9	56.8	64.1
311	2022-03-07	19:00:00	00:15:00.0	63.0	53.8	78.5	56.2	63.0
312	2022-03-07	19:15:00	00:15:00.0	63.3	53.1	73.9	56.0	63.3
313	2022-03-07	19:30:00	00:15:00.0	63.0	53.4	72.9	55.7	63.0
314	2022-03-07	19:45:00	00:15:00.0	63.5	52.7	75.6	55.7	63.5
315	2022-03-07	20:00:00	00:15:00.0	64.1	53.4	79.1	56.6	64.1
316	2022-03-07	20:15:00	00:15:00.0	63.2	52.4	75.0	55.4	63.2
317	2022-03-07	20:30:00	00:15:00.0	63.0	52.4	76.0	55.1	63.0
318	2022-03-07	20:45:00	00:15:00.0	62.3	51.9	73.8	53.8	62.
319	2022-03-07	21:00:00	00:15:00.0	62.2	51.9	72.8	54.1	62.2
320	2022-03-07	21:15:00	00:15:00.0	62.4	51.5	79.9	54.1	62.4
321	2022-03-07	21:30:00	00:15:00.0	61.0	51.7	71.9	53.7	61.0
322	2022-03-07	21:45:00	00:15:00.0	60.6	52.0	73.5	54.3	60.
323	2022-03-07	22:00:00	00:15:00.0	61.9	52.7	76.8	54.9	61.9
324	2022-03-07	22:15:00	00:15:00.0	61.7	53.8	73.3	55.1	61.
325	2022-03-07	22:30:00	00:15:00.0	65.0	53.0	87.8	54.7	65.0
326	2022-03-07	22:45:00	00:15:00.0	61.9	53.1	79.5	55.1	61.9
327	2022-03-07	23:00:00	00:15:00.0	62.2	53.0	75.4	54.8	62.2
328	2022-03-07	23:15:00	00:15:00.0	59.5	50.7	70.9	52.7	59.
329	2022-03-07	23:30:00	00:15:00.0	60.5	51.3	70.6	53.2	60.5
330	2022-03-07	23:45:00	00:15:00.0	59.9	51.0	71.0	52.8	59.9
331	2022-03-08	00:00:00	00:15:00.0	61.8	52.4	86.5	53.8	61.
332	2022-03-08	00:15:00	00:15:00.0	59.6	50.8	74.0	52.5	59.0
333	2022-03-08	00:30:00	00:15:00.0	61.3	50.8	83.5	52.4	61.
334	2022-03-08	00:45:00	00:15:00.0	59.0	50.5	70.7	52.3	59.
335	2022-03-08	01:00:00	00:15:00.0	59.0	50.8	71.6	52.1	59.0
336	2022-03-08	01:15:00	00:15:00.0	57.9	50.8	71.8	52.3	57.9
337	2022-03-08	01:30:00	00:15:00.0	57.7	50.6	78.3	52.0	57.
338	2022-03-08	01:45:00	00:15:00.0	58.7	50.5	71.0	51.6	58.
339	2022-03-08	02:00:00	00:15:00.0	58.1	51.1	73.0	52.7	58.:
340	2022-03-08	02:15:00	00:15:00.0	57.4	50.5	72.2	51.6	57.4
341	2022-03-08	02:30:00	00:15:00.0	58.2	50.4	73.0	51.6	58.2
342	2022-03-08	02:45:00	00:15:00.0	56.8	51.0	67.8	52.5	56.8
343	2022-03-08	03:00:00	00:15:00.0	57.1	50.3	71.3	51.2	57.3
344	2022-03-08	03:15:00	00:15:00.0	57.5	50.5	75.6	52.3	57.5
345	2022-03-08	03:30:00	00:15:00.0	58.4	50.4	71.9	52.0	58.4
346	2022-03-08	03:45:00	00:15:00.0	56.9	50.4	71.6	51.5	56.9
347	2022-03-08	04:00:00	00:15:00.0	57.4	50.9	71.0	52.3	57.4
348	2022-03-08	04:00:00	00:15:00.0	58.3	51.0	71.8	52.3	
J40	2022-03-00	04.13.00	00.13.00.0	30.3	31.0	11.0	JZ.3	58.3

### UCL BIOSCIENCES: CLEO & CDB HORD PLANNING COMPLIANCE REPORT (NOISE)



350	2022-03-08	04:45:00	00:15:00.0	75.9	51.2	105.5	52.8	75.9
351	2022-03-08	05:00:00	00:15:00.0	59.0	50.9	72.7	51.8	59.0
352	2022-03-08	05:15:00	00:15:00.0	60.8	51.1	74.2	52.6	60.8
353	2022-03-08	05:30:00	00:15:00.0	60.7	51.7	74.5	53.3	60.7
354	2022-03-08	05:45:00	00:15:00.0	60.0	51.4	74.9	52.6	60.0
355	2022-03-08	06:00:00	00:15:00.0	61.7	52.1	72.5	53.8	61.7
356	2022-03-08	06:15:00	00:15:00.0	62.8	51.8	75.1	53.8	62.8
357	2022-03-08	06:30:00	00:15:00.0	63.6	52.2	72.9	54.9	63.6
358	2022-03-08	06:45:00	00:15:00.0	64.7	52.8	77.2	55.6	64.7
359	2022-03-08	07:00:00	00:15:00.0	63.6	52.6	76.0	55.9	63.6
360	2022-03-08	07:15:00	00:15:00.0	64.9	53.5	76.7	55.9	64.9
361	2022-03-08	07:30:00	00:15:00.0	65.3	53.3	84.7	56.2	65.3
362	2022-03-08	07:45:00	00:15:00.0	65.2	54.1	77.8	56.2	65.2
363	2022-03-08	08:00:00	00:15:00.0	66.7	55.2	78.6	58.0	66.7
364	2022-03-08	08:15:00	00:15:00.0	65.4	53.8	76.1	57.9	65.4
365	2022-03-08	08:30:00	00:15:00.0	66.7	54.5	78.6	58.3	66.7
366	2022-03-08	08:45:00	00:15:00.0	69.4	55.1	92.1	58.9	69.4
367	2022-03-08	09:00:00	00:15:00.0	66.3	56.0	78.0	59.6	66.3
368	2022-03-08	09:15:00	00:15:00.0	64.8	54.5	78.0	57.8	64.8
369	2022-03-08	09:15:00	00:15:00.0	64.8	54.8	83.2	58.6	64.8
370	2022-03-08	09:45:00	00:15:00.0	64.7	56.1	76.2	58.7	64.7
371	2022-03-08	10:00:00	00:15:00.0	65.1	55.6	78.8	59.1	65.1
372	2022-03-08	10:15:00	00:15:00.0	64.1	55.5	75.3	57.6	64.1
373	2022-03-08	10:30:00	00:15:00.0	64.9	55.9	77.8	60.3	64.9
374	2022-03-08	10:45:00	00:15:00.0	64.3		77.9	59.1	64.3
375	2022-03-08		00:15:00.0	64.9	55.8	76.5	57.5	64.9
376	2022-03-08	11:00:00	00:15:00.0	66.0	55.1 55.2	86.7	58.8	66.0
377		11:15:00				79.8		65.8
378	2022-03-08	11:30:00 11:45:00	00:15:00.0	65.8	57.7	78.1	61.5 59.1	65.1
379	2022-03-08		00:15:00.0	65.1	55.1			68.4
380	2022-03-08	12:00:00	00:15:00.0	68.4 65.0	58.1 55.0	90.4 76.5	60.9 58.4	65.0
381	2022-03-08 2022-03-08	12:15:00 12:30:00	00:15:00.0 00:15:00.0	64.9	55.4	75.3	58.4	64.9
382		12:45:00		64.3	55.2	76.6	58.2	64.3
383	2022-03-08 2022-03-08		00:15:00.0			77.0	58.3	65.6
384	2022-03-08	13:00:00 13:15:00	00:15:00.0 00:15:00.0	65.6 67.5	55.4 55.8	90.4	59.4	67.5
385	2022-03-08	13:30:00	00:15:00.0	63.6	56.6	76.5	59.4	63.6
386	2022-03-08	13:45:00	00:15:00.0	67.5	55.2	89.3	57.7	67.5
387		14:00:00						
388	2022-03-08	14:00:00	00:15:00.0	65.1 64.9	56.3 57.9	80.6 75.8	60.1	65.1 64.9
389	2022-03-08 2022-03-08	14:15:00	00:15:00.0 00:15:00.0	67.3	54.3	90.1	57.8	67.3
390	2022-03-08	14:45:00	00:15:00.0	63.5	54.3	78.9	57.6	63.5
391	2022-03-08	15:00:00	00:15:00.0	66.7	55.0	91.8	59.3	66.7
392	2022-03-08	15:15:00	00:15:00.0	64.3	53.7	83.2	56.7	64.3
393	2022-03-08	15:30:00	00:15:00.0	80.4	54.0	104.1	58.0	80.4
393	2022-03-08	15:45:00	00:15:00.0	65.5	55.0	86.2	58.3	65.5
						93.4	58.8	69.6
395	2022-03-08	16:00:00	00:15:00.0	69.6	54.9			
396	2022-03-08	16:15:00	00:15:00.0	65.6	54.5	89.0	57.6	65.6
397	2022-03-08	16:30:00	00:15:00.0	64.5	54.8	77.2	58.6	64.5
398	2022-03-08	16:45:00	00:15:00.0	73.7	55.5	100.1	59.2	73.7
399	2022-03-08	17:00:00	00:15:00.0	64.5	55.2	76.7	57.9	64.5





400	2022-03-08	17:15:00	00:15:00.0	64.8	55.0	81.9	57.5	64.
401	2022-03-08	17:30:00	00:15:00.0	70.1	54.6	96.3	58.9	70.
402	2022-03-08	17:45:00	00:15:00.0	63.7	55.3	74.3	58.5	63.
403	2022-03-08	18:00:00	00:15:00.0	64.7	54.3	78.5	58.7	64.
404	2022-03-08	18:15:00	00:15:00.0	64.6	57.1	75.9	59.7	64.
405	2022-03-08	18:30:00	00:15:00.0	74.9	54.6	96.6	57.9	74.
406	2022-03-08	18:45:00	00:15:00.0	64.1	54.1	80.0	57.9	64.
407	2022-03-08	19:00:00	00:15:00.0	69.1	53.4	95.0	56.6	69.
408	2022-03-08	19:15:00	00:15:00.0	64.8	54.0	83.9	56.9	64.
409	2022-03-08	19:30:00	00:15:00.0	63.0	53.0	74.8	56.0	63.
410	2022-03-08	19:45:00	00:15:00.0	68.5	54.5	93.6	57.6	68.
411	2022-03-08	20:00:00	00:15:00.0	62.0	53.7	72.6	55.7	62.
412	2022-03-08	20:15:00	00:15:00.0	62.3	52.7	79.2	56.0	62.
413	2022-03-08	20:30:00	00:15:00.0	62.1	53.0	72.3	56.1	62.
414	2022-03-08	20:45:00	00:15:00.0	62.2	52.7	75.1	54.9	62.
415	2022-03-08	21:00:00	00:15:00.0	63.0	53.6	82.3	56.0	63.
416	2022-03-08	21:15:00	00:15:00.0	62.6	52.8	75.6	55.3	62.
417	2022-03-08	21:30:00	00:15:00.0	61.6	52.9	72.9	54.9	61.
418	2022-03-08	21:45:00	00:15:00.0	72.9	52.8	100.1	55.1	72.
419	2022-03-08	22:00:00	00:15:00.0	61.9	52.2	73.5	54.5	61.
420	2022-03-08	22:15:00	00:15:00.0	61.7	52.6	75.9	55.0	61.
421	2022-03-08	22:30:00	00:15:00.0	61.5	52.5	73.6	54.9	61.
422	2022-03-08	22:45:00	00:15:00.0	61.8	50.9	76.8	54.3	61.
423	2022-03-08	23:00:00	00:15:00.0	61.8	52.0	76.7	54.9	61.
424	2022-03-08	23:15:00	00:15:00.0	60.8	51.1	71.9	54.2	60.
425	2022-03-08	23:30:00	00:15:00.0	70.0	51.9	98.2	54.2	70.
426	2022-03-08	23:45:00	00:15:00.0	60.6	51.4	71.3	53.4	60.
427	2022-03-09	00:00:00	00:15:00.0	59.8	51.8	69.0	53.7	59.
428	2022-03-09	00:15:00	00:15:00.0	59.8	51.4	72.0	53.2	59.
429	2022-03-09	00:30:00	00:15:00.0	61.1	51.2	81.8	53.3	61.
430	2022-03-09	00:45:00	00:15:00.0	59.2	51.5	70.8	53.5	59.
431	2022-03-09	01:00:00	00:15:00.0	60.2	51.8	78.3	53.3	60.
432	2022-03-09	01:15:00	00:15:00.0	57.7	51.2	71.0	53.0	57.
433	2022-03-09	01:30:00	00:15:00.0	58.5	50.8	69.7	52.9	58.
434	2022-03-09	01:45:00	00:15:00.0	58.4	50.7	75.7	52.1	58.
435	2022-03-09	02:00:00	00:15:00.0	59.8	50.6	82.7	53.2	59.
436	2022-03-09	02:15:00	00:15:00.0	59.8	50.8	72.8	52.5	59.
437	2022-03-09	02:30:00	00:15:00.0	58.0	51.1	76.1	52.5	58.
438	2022-03-09	02:45:00	00:15:00.0	59.2	50.7	75.5	52.7	59.
439	2022-03-09	03:00:00	00:15:00.0	57.3	51.2	69.5	52.6	57.
440	2022-03-09	03:15:00	00:15:00.0	57.0	51.1	68.9	52.8	57.
441	2022-03-09	03:30:00	00:15:00.0	60.1	51.1	83.7	52.5	60.
442	2022-03-09	03:45:00	00:15:00.0	58.4	51.2	75.7	53.0	58.
443	2022-03-09	04:00:00	00:15:00.0	59.1	51.7	71.9	53.1	59.
444	2022-03-09	04:15:00	00:15:00.0	56.7	51.1	69.9	52.7	56.
445	2022-03-09	04:30:00	00:15:00.0	56.3	51.0	69.8	53.0	56.
446	2022-03-09	04:45:00	00:15:00.0	58.1	50.9	70.0	52.6	58.
447	2022-03-09	05:00:00	00:15:00.0	58.1	51.0	68.6	52.5	58.
448	2022-03-09	05:15:00	00:15:00.0	59.8	51.8	74.3	53.7	59.
449	2022-03-09	05:30:00	00:15:00.0	59.3	52.3	72.1	53.5	59.

### 0042039-0820-0-AA-RP-0001

UCL BIOSCIENCES: CLEO & CDB HORD PLANNING COMPLIANCE REPORT (NOISE)




450	2022-03-09	05:45:00	00:15:00.0	61.5	51.3	78.5	53.2	61.5
451	2022-03-09	06:00:00	00:15:00.0	61.1	52.3	72.3	53.9	61.1
452	2022-03-09	06:15:00	00:15:00.0	63.2	53.1	75.8	55.0	63.2
453	2022-03-09	06:30:00	00:15:00.0	62.6	52.5	73.1	54.8	62.6
454	2022-03-09	06:45:00	00:15:00.0	63.0	53.8	75.4	55.5	63.0
455	2022-03-09	07:00:00	00:15:00.0	64.4	53.1	82.2	55.6	64.4
456	2022-03-09	07:15:00	00:15:00.0	64.9	52.8	79.6	56.0	64.9
457	2022-03-09	07:30:00	00:15:00.0	64.6	52.4	75.1	56.8	64.6
458	2022-03-09	07:45:00	00:15:00.0	66.0	53.6	79.3	56.5	66.0
459	2022-03-09	08:00:00	00:15:00.0	67.0	55.6	79.4	60.8	67.0
460	2022-03-09	08:15:00	00:15:00.0	65.6	54.9	75.4	58.2	65.6
461	2022-03-09	08:30:00	00:15:00.0	65.7	54.5	76.6	58.8	65.7
462	2022-03-09	08:45:00	00:15:00.0	64.8	55.8	75.3	59.2	64.8
463	2022-03-09	09:00:00	00:15:00.0	65.7	55.0	86.0	59.3	65.7
464	2022-03-09	09:15:00	00:15:00.0	66.0	55.4	85.8	58.3	66.0
465	2022-03-09	09:30:00	00:15:00.0	64.6	55.4	77.2	58.2	64.6
466	2022-03-09	09:45:00	00:15:00.0	65.0	55.5	73.7	58.7	65.0
467	2022-03-09	10:00:00	00:15:00.0	64.3	55.0	72.9	58.1	64.3
468	2022-03-09	10:15:00	00:15:00.0	67.4	55.6	92.5	57.8	67.4
469	2022-03-09	10:30:00	00:15:00.0	64.8	55.9	80.6	58.0	64.8
470	2022-03-09	10:45:00	00:15:00.0	69.9	56.5	94.3	59.7	69.9
471	2022-03-09	11:00:00	00:15:00.0	75.9	56.6	98.5	60.4	75.9
472	2022-03-09	11:15:00	00:15:00.0	65.8	55.8	83.5	59.9	65.8
473	2022-03-09	11:30:00	00:15:00.0	65.4	55.0	82.0	58.3	65.4
474	2022-03-09	11:45:00	00:15:00.0	64.6	56.1	76.1	58.8	64.6

**APPENDIX E** 

SURVEY RESULTS (GRAPHICAL)



# **Noise Level Time History at SW16 Darwin Building**

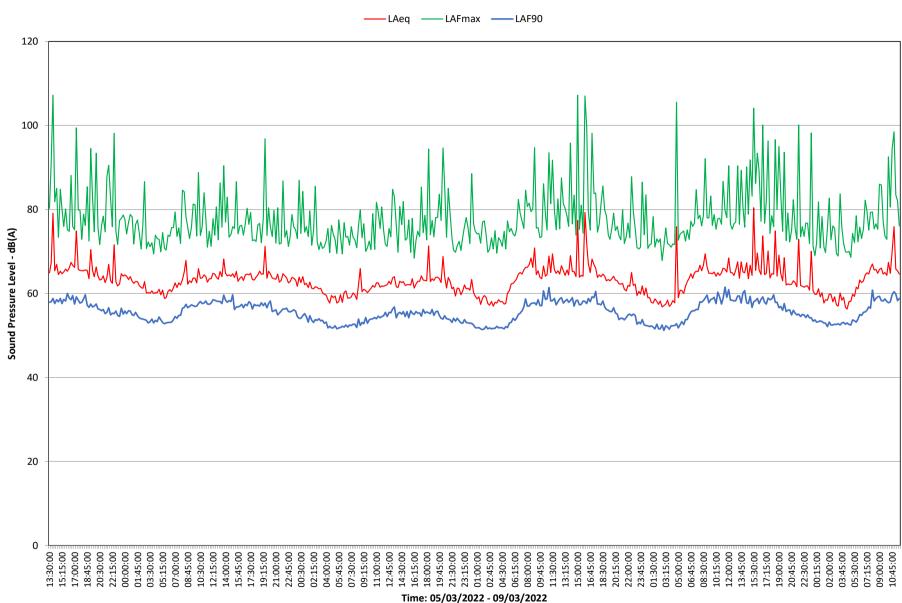

# quietly moving forward

### **APPENDIX F**

### **PUBLISHED PLANT NOISE DATA**

Acoustics									
Outdoor sound power level 77 dBA									
Outdoor sound pressure	1m	5m	10m	20m					
	60 dBA	51 dBA	45 dBA	40 dBA					