

- LEGEND
- SMOKE DETECTOR (HIGH PERFORMANCE)
  - COMBINED SMOKE & HEAT DETECTOR
  - FIRE ALARM VOICE EVACUATION SPEAKER
  - XENON FLASHING BEACON
  - BREAK GLASS CALL POINT
  - NEW WIRELESS EVCS REFUGE CALL POINT . 2 WAY SPEECH STAINLESS STEEL FINISH WITH "T" COIL TYPE "B" STANDARD CALL POINT AS PER KTP OR DEAFALERTER.

FIRE ALARM AND PAVA DETECTORS WILL GENERALLY BE FIXED TO SOFFITS IN EXPOSED SERVICES AREAS AND ON CEILINGS WHERE SUSPENDED CEILINGS.

ALL CABLING WILL BE INSTALLED ON TRAY CONTAINMENT ON PRIMARY ROUTES AND IN CONDUIT OR SURFACE CLIPPED TO DEVICES.

REFER TO 6101 SERIES DRAWINGS FOR PRIMARY CONTAINMENT ROUTES.

S4 - P02	20/02/2023	LBC ISSUE	KR	SH
S4 - P02	28/10/2022	TENDER ISSUE	KR	SH
S2 - P01	30/09/2022	INFORMATION ISSUE.	KR	SH
SUIT- REV	DATE	DESCRIPTION	DRN	CHK

**FOR INFORMATION**


THIS DRAWING IS COPYRIGHT. DO NOT SCALE FROM DRAWING. THE CONTRACTOR AND THEIR SUB-CONTRACTORS ARE TO VERIFY ALL DIMENSIONS ON SITE BEFORE MAKING SHOP DRAWINGS OR COMMENCING MANUFACTURE.

**KJ TAIT**  
ENGINEERS

1 Fitzroy Square  
London W1T 5HF  
T +44 (0) 207 388 0952  
E london@kjtait.com  
W www.kjtait.com

PROJECT INFORMATION				
CLIENT	OXFORD VICTORIA HOUSE			
PROJECT	DEVELOPMENT LTD LONDON, WC1B 4DA			
DRAWING INFORMATION				
DRAWING TITLE	ELECTRICAL SERVICES BASEMENT LEVEL 1 FIRE DETECTION & PAVA STRATEGY LAYOUT			
DESIGNED BY	KR	DATE	SEPT. 2022	
DRAWN BY	MZ	KJT JOB No.		
SCALE	1:150 @ A1		L3221	
JOB CODE	ORIGIN-VOL-LEVEL-TYPE-ROLE-CLASS NUMBER			SUIT- REV
L3221	KJT-ZZ-B1-DR-E-6801			S4-P02



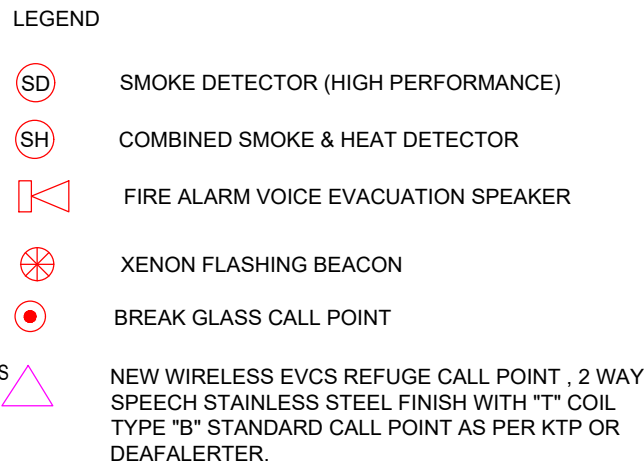

S4 - P02	20/02/2023	LBC ISSUE	KR	SH
S4 - P02	28/10/2022	TENDER ISSUE	KR	SH
S2 - P01	30/09/2022	INFORMATION ISSUE.	KR	SH
SUIT- REV STATUS	DATE	DESCRIPTION	DRN	CHK

THIS DRAWING IS COPYRIGHT. DO NOT SCALE FROM DRAWING.  
THE CONTRACTOR AND THEIR SUB-CONTRACTORS ARE TO VERIFY ALL DIMENSIONS  
ON SITE BEFORE MAKING SHOP DRAWINGS OR COMMENCING MANUFACTURE.

PROJECT INFORMATION			
CLIENT	OXFORD VICTORIA HOUSE		
PROJECT	DEVELOPMENT LTD LONDON, WC1B 4DA		
DRAWING INFORMATION			
DRAWING TITLE	ELECTRICAL SERVICES BASEMENT LEVEL 2 FIRE DETECTION & PAVA STRATEGY LAYOUT		
DESIGNED BY	KR	DATE	SEPT. 2022
DRAWN BY	MZ	KJT JOB NO.	
SCALE	1:150 @ A1		L3221
JOB CODE	ORIGINAL-LEVEL-TYPE-ROOM-CLASS NUMBER		SUIT-REV
L3221	KJT-ZZ-B2-DR-E-6801		S4-P02





- LEGEND
- SD SMOKE DETECTOR (HIGH PERFORMANCE)
  - SH COMBINED SMOKE & HEAT DETECTOR
  - V FIRE ALARM VOICE EVACUATION SPEAKER
  - X XENON FLASHING BEACON
  - B BREAK GLASS CALL POINT
  - IFU FIRE ALARM INTERFACE MODULE
  - EVCS RCP NEW WIRELESS EVCS REFUGE CALL POINT, 2 WAY SPEECH STAINLESS STEEL FINISH WITH "T" COIL TYPE "B" STANDARD CALL POINT AS PER KTP OR DEAFALERTER.
- FIRE ALARM AND PAVA DETECTORS WILL GENERALLY BE FIXED TO SOFFITS IN EXPOSED SERVICES AREAS AND ON CEILINGS WHERE SUSPENDED CEILINGS.
- ALL CABLING WILL BE INSTALLED ON TRAY CONTAINMENT ON PRIMARY ROUTES AND IN CONDUIT OR SURFACE CLIPPED TO DEVICES.
- REFER TO 6101 SERIES DRAWINGS FOR PRIMARY CONTAINMENT ROUTES.

S4 - P02	20/02/2023	LBC ISSUE	KR	SH
S4 - P02	28/10/2022	TENDER ISSUE	KR	SH
S2 - P01	30/09/2022	INFORMATION ISSUE	KR	SH
SUIT- REV	DATE	DESCRIPTION	DRN	CHK
STATUS				

## FOR INFORMATION


THIS DRAWING IS COPYRIGHT. DO NOT SCALE FROM DRAWING. THE CONTRACTOR AND THEIR SUB-CONTRACTORS ARE TO VERIFY ALL DIMENSIONS ON SITE BEFORE MAKING SHOP DRAWINGS OR COMMENCING MANUFACTURE.

**KJ TAIT**  
ENGINEERS

1 Fitzroy Square  
London W1T 5HF  
T +44 (0) 207 388 0952  
E london@kjtait.com  
W www.kjtait.com

PROJECT INFORMATION				
CLIENT	OXFORD VICTORIA HOUSE			
PROJECT	DEVELOPMENT LTD			
	LONDON, WC1B 4DA			
DRAWING INFORMATION				
DRAWING TITLE	ELECTRICAL SERVICES LOWER GROUND FLOOR FIRE DETECTION & PAVA STRATEGY LAYOUT			
DESIGNED BY	KR	DATE	SEPT. 2022	
DRAWN BY	MZ	KJT JOB No.		
SCALE	1:150 @ A1	L3221		
JOB CODE	ORIGIN-VOL-LEVEL-TYPE-ROLE-CLASS NUMBER	SUIT- REV		
L3221	KJT-ZZ-LG-DR-E-6801	S4-P02		



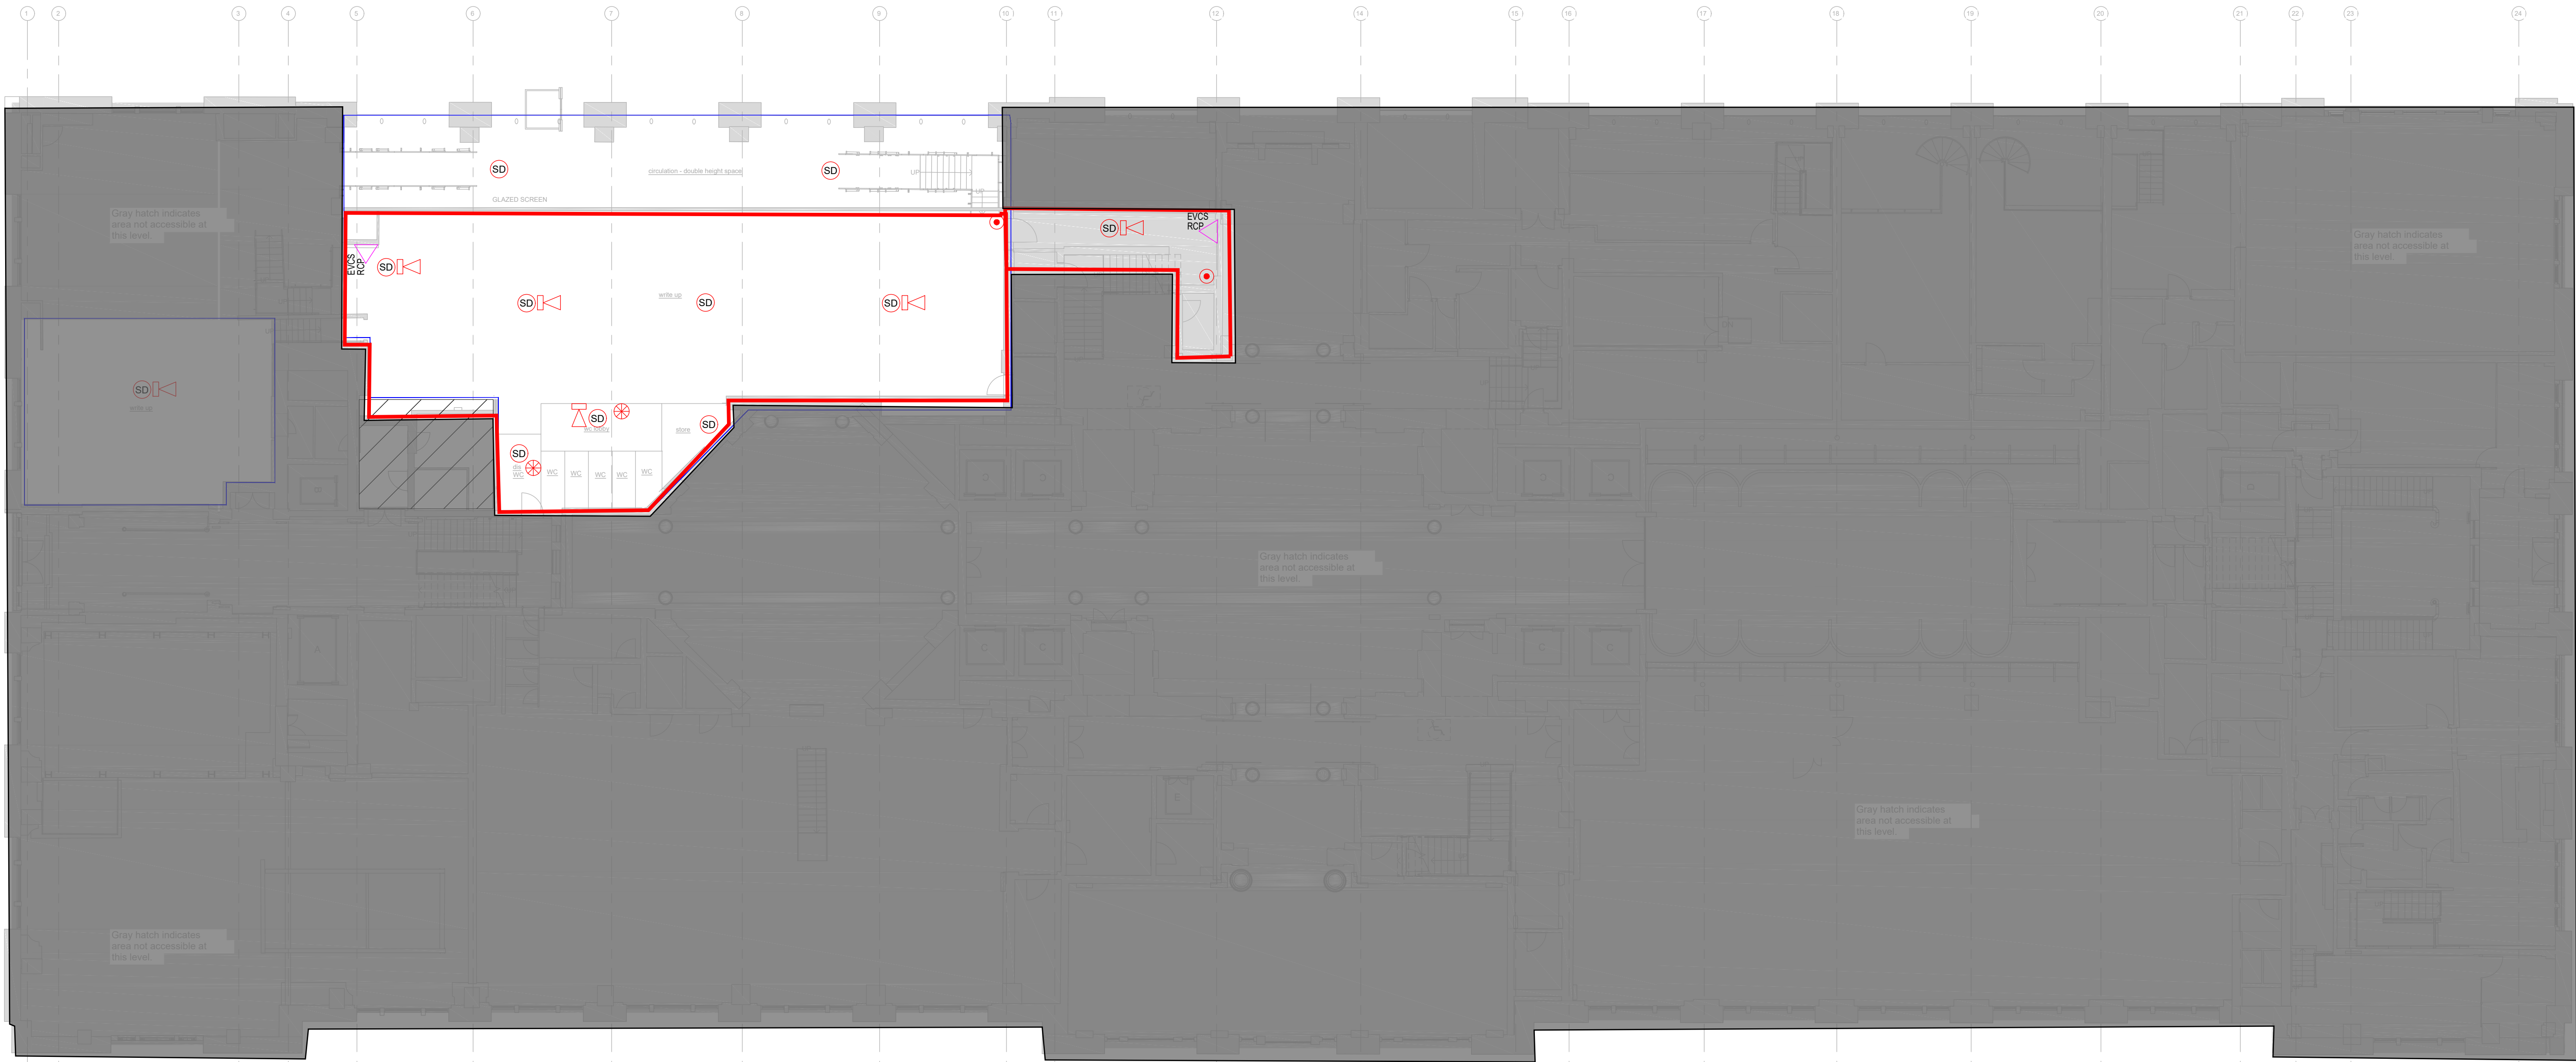

LEGEND

- SD SMOKE DETECTOR (HIGH PERFORMANCE)
- SH COMBINED SMOKE & HEAT DETECTOR
- K FIRE ALARM VOICE EVACUATION SPEAKER
- X XENON FLASHING BEACON
- BREAK GLASS CALL POINT

EVCS RCP NEW WIRELESS EVCS REFUGE CALL POINT . 2 WAY SPEECH STAINLESS STEEL FINISH WITH "T" COIL TYPE "B" STANDARD CALL POINT AS PER KTP OR DEAFALERTER.

FIRE ALARM AND PAVA DETECTORS WILL GENERALLY BE FIXED TO SOFFITS IN EXPOSED SERVICES AREAS AND ON CEILINGS WHERE SUSPENDED CEILINGS.

ALL CABLING WILL BE INSTALLED ON TRAY CONTAINMENT ON PRIMARY ROUTES AND IN CONDUIT OR SURFACE CLIPPED TO DEVICES.

REFER TO 6101 SERIES DRAWINGS FOR PRIMARY CONTAINMENT ROUTES.

S4 - P02	20/02/2023	LBC ISSUE	KR	SH
S4 - P02	28/10/2022	TENDER ISSUE	KR	SH
S2 - P01	30/09/2022	INFORMATION ISSUE.	KR	SH
SUIT- REV	DATE	DESCRIPTION	DRN	CHK

FOR INFORMATION

THIS DRAWING IS COPYRIGHT. DO NOT SCALE FROM DRAWING. THE CONTRACTOR AND THEIR SUB-CONTRACTORS ARE TO VERIFY ALL DIMENSIONS ON SITE BEFORE MAKING SHOP DRAWINGS OR COMMENCING MANUFACTURE.

**KJ TAIT**  
ENGINEERS  
1 Fitzroy Square  
London W1T 5HF  
T +44 (0) 207 388 0952  
E london@kjtait.com  
W www.kjtait.com

PROJECT INFORMATION			
CLIENT	OXFORD VICTORIA HOUSE		
PROJECT	DEVELOPMENT LTD LONDON, WC1B 4DA		
DRAWING INFORMATION			
DRAWING TITLE	ELECTRICAL SERVICES MEZZANINE LEVEL FIRE DETECTION & PAVA STRATEGY LAYOUT		
DESIGNED BY	KR	DATE	SEPT. 2022
DRAWN BY	MZ	KJT JOB No.	
SCALE	1:150 @ A1		L3221
JOB CODE	ORIGIN-VOL-LEVEL-TYPE-ROLE-CLASS NUMBER KJT-ZZ-MZ-DR-E-6801		SUIT-REV S4-P02





LEGEND

- SMOKE DETECTOR (HIGH PERFORMANCE)
- COMBINED SMOKE & HEAT DETECTOR
- FIRE ALARM VOICE EVACUATION SPEAKER
- XENON FLASHING BEACON
- BREAK GLASS CALL POINT

NEW WIRELESS EVCs REFUGE CALL POINT - 2 WAY SPEECH STAINLESS STEEL FINISH WITH "T" COIL TYPE "B" STANDARD CALL POINT AS PER KTP OR DEAFALERTER.

FIRE ALARM AND PAVA DETECTORS WILL GENERALLY BE FIXED TO SOFFITS IN EXPOSED SERVICES AREAS AND ON CEILINGS WHERE SUSPENDED CEILINGS.

ALL CABLING WILL BE INSTALLED ON TRAY CONTAINMENT ON PRIMARY ROUTES AND IN CONDUIT OR SURFACE CLIPPED TO DEVICES.

REFER TO 6101 SERIES DRAWINGS FOR PRIMARY CONTAINMENT ROUTES.

S4 - P02	20/02/2023	LBC ISSUE	KR	SH
S4 - P02	28/10/2022	TENDER ISSUE	KR	SH
S2 - P01	30/09/2022	INFORMATION ISSUE	KR	SH
SUIT- REV	DATE	DESCRIPTION	DRN	CHK
STATUS				

FOR INFORMATION

THIS DRAWING IS COPYRIGHT. DO NOT SCALE FROM DRAWING. THE CONTRACTOR AND THEIR SUB-CONTRACTORS ARE TO VERIFY ALL DIMENSIONS ON SITE BEFORE MAKING SHOP DRAWINGS OR COMMENCING MANUFACTURE.

**KJ TAIT**  
ENGINEERS

1 Fitzroy Square  
London W1T 5HF  
T +44 (0) 207 388 0952  
E london@kjtait.com  
W www.kjtait.com

PROJECT INFORMATION			
CLIENT	OXFORD VICTORIA HOUSE		
PROJECT	DEVELOPMENT LTD LONDON, WC1B 4DA		
DRAWING INFORMATION			
DRAWING TITLE	ELECTRICAL SERVICES UPPER GROUND FLOOR FIRE DETECTION & PAVA STRATEGY LAYOUT		
DESIGNED BY	KR	DATE	SEPT. 2022
DRAWN BY	MZ	KJT JOB No.	
SCALE	1:150 @ A1		L3221
JOB CODE	ORIGIN-VOL-LEVEL-TYPE-ROLE-CLASS NUMBER	SUIT- REV	
L3221	KJT-ZZ-UG-DR-E-6801	S4-P02	