


# Indicative Detail 1: Reception, GF

The proposed DRRU (Disable-Refuge-Remote-Unit) panel will utilise the existing cabling route between the device and the riser (in the adjacent service room GSR).




Reception on the ground floor, looking west toward the lifts and service room. All devices shown are indicative of locations only. Not to scale.

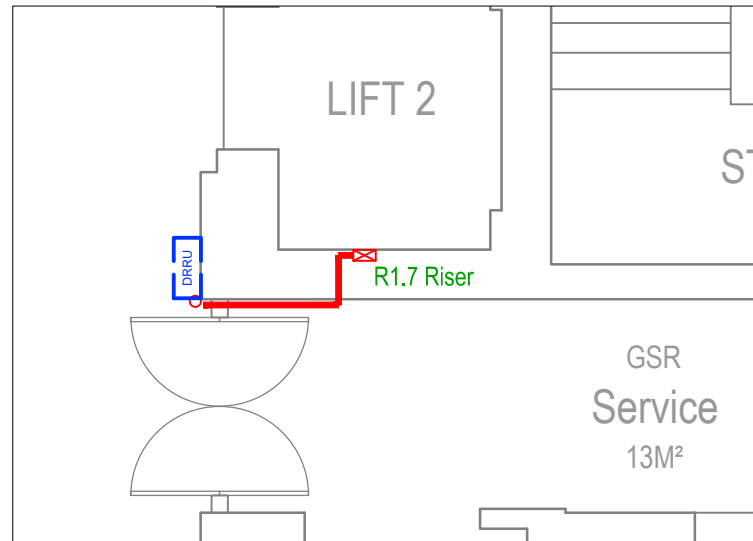

Floorplan showing the relevant proposed devices and existing cable route.

## Notes

1. This drawing is an Outline Design showing the relative location of the proposed devices. The final locations of the proposed devices are subject to the final assessment to be carried out by the specialist contractors once listed building consent has been granted.
2. If the proposal materially differs from the outline design included here, a new LBC application will be submitted. Additional details can be provided as a Discharge of Condition if required.
3. This drawing indicates design intent only and shall not be used as an installation or working drawing.

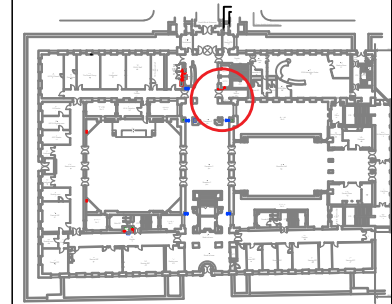

## Key

- Existing device to be removed
- Indicative location of the existing riser
- Proposed galvanised conduit
- Proposed Disabled Refuge Remote Unit
- Proposed Loop-Powered Wireless Gateway
- Proposed Sounder (& Beacon)
- Proposed penetration

JOB TITLE

Senate House Library


University of London

DRAWING TITLE

INDICATIVE DETAIL (Proposed)

Detail 1

JOB No	DWG No	REV
N2865	401	A
DRAWN BY	CHECKED BY	SCALE (@A4)
DYT	NS	N/A
		DATE
		May/23

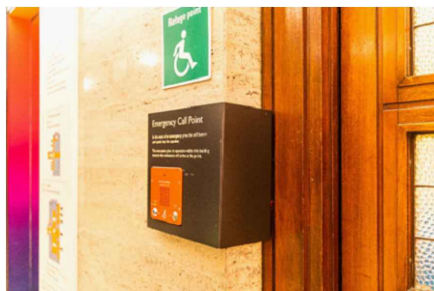

Existing DRRU panel.



Proposed DRRU to be installed. For further details of this device, please refer to Appendix 5 of the heritage, design & access statement.

STEPHEN LEVRANT  
HERITAGE ARCHITECTURE



62 British Grove, London, W4 2NL  
E-mail: info@heritagearchitecture.co.uk T: 020 8748 5501