

APPENDIX B

STRUCTURAL CALCULATIONS

WE ARE SYMMETRYS

STRUCTURAL CALCULATION PACKAGE

70 LADY MARGARET ROAD

22276-SYM-XX-XX-RP-S-0001

MAY 2023

REV B





		Job No.	Sheet No.	Revision
		22276	1	A
Job Title	70 Lady Margaret Road	Date	Made by	Checked By
Section	Introduction	May-2023	KL	EB

INTRODUCTION

The structure comprises a four-storey retaining structure and proposed three-storey extension structure. It is proposed to demolish the existing extension, replace by excavating and forming a new one-storey basement with three-storey superstructure, with 2 No. of stair, one to rear garden and one to retaining structure.

CODES OF PRACTICE

The following codes and standards have been used within this document:

- BS EN 1990 Eurocode: Basis of structural design
- BS EN 1991 Eurocode 1: Action on structures

EXECUTIVE SUMMARY

The proposed development involves the demolition of the existing extension structure. A new basement excavated 1-level underground. Above ground the proposed extension consists of ground plus 3 storeys attached to existing retained structure.



Job No.	Sheet No.	Revision
22276	2	A
Date	Made by	Checked By
May-2023	KL	EB

Job Title	70 Lady Margaret Road
Section	Introduction

Prepared by:

Ka Ka Lo
Beng(Hons), GIStructE
Graduate Structural Engineer at SymmetryS

Checked and Signed by:

Ernest Bohm
BArch(Hons), MSc
Senior Structural Engineer at SymmetryS



		Job No.	Sheet No.	Revision
		21286	3	A
Job Title	70 Lady Margaret Road	Date	Made by	Checked By
Section	Vertical Loads	May-2023	KL	EB

Vertical Loads
for
70 Lady Margaret Road



Job No.	Sheet No.	Revision
22276	4	1
Date	Made by	Checked By
01/05/2023	KL	EB

Job Title 70 Lady Margaret Road

Section Vertical Loads

Loading

The retaining and propose structure for a multi-level structure. This four-storey building is divided into four sections with different and determine the appropriate load acting on each section.

live load

Area	Ok(kN/m ²)	Façade material	Loading (m ²)
Floors	1.5	Concrete	2.5
Stairs	2.5	Brickwork	1
Balconies	2.5		

Proposed Structure

Storey	Height(m)	Floor material	Trib Area (m ²)	Dead Load (kNm ²)	Live Load (kNm ²)	SSL (kN/m ²)	UDL(kN/m ²)
New Basement	2.84	250mm RC Slab	38.3	6.25	2	8.25	11.4375
Existing Basement	1.9	250mm RC Slab	19.87	6.25	2	8.25	11.4375
Ground	3.1	250mm RC Slab	131.74	6.25	2	8.25	11.4375
1st	3.1	250mm RC Slab	79.67	6.25	2	8.25	11.4375
2nd	3.1	250mm RC Slab	76.88	6.25	2	8.25	11.4375
3rd	3.1	250mm RC Slab	63.6	6.25	2	8.25	11.4375
Roof	/	250mm RC Slab	131.74	6.25	0.6	6.85	9.3375

Storey	Material	Height	Loading	Loading Storey	Trib Area (m ²)	Total SSL (kN/m ²)	Total USL (kN/m ²)
New Basement	Concrete	2.84	7.1	Basement & Ground floor	37.81	23.35	32.2125
Existing Basement	Concrete	1.9	4.75	Ground floor	9.56	15.1	20.775
Ground	Brickwork	3.1	3.1	Ground floor to 2nd floor	12.72	31.6	43.65
1st	Brickwork	2.7	2.7	Ground to 3rd floor	70.89	39.85	55.0875
2nd	Brickwork	2.3	2.3	Basement to 3rd floor	19.87	48.1	66.525
3rd	Brickwork	2.3	2.3	Existing Stairs	4.87	47.5	65.625
				New Stairs	1.98	23.75	32.8125

Wall	Loading Storey	Length	Façade Load (kN/m)
A	GF	3.3	3.1
B	GF	0.9	3.1
C	B1+GF	3.5	10.2
D	B1	2.7	7.1
E	B1+GF	6.8	10.2
F	B1	4.7	7.1
G	GF	7.4	3.1
H	B1	1.8	7.1
I	B1	1.9	7.1
J	B1+GF	2.8	10.2
K	GF+1F+2F	1.5	8.1
L	GF+1F+2F	2.3	8.1

Wall	Loading Storey	Length	Façade Load (kN/m)
M	GF+1F+2F	3.3	8.1
N	GF+1F+2F	3.3	8.1
O	GF+1F+2F+3F	2.8	10.4
P	GF+1F+2F+3F	3.8	10.4
Q	GF+1F+2F+3F	9.6	10.4
R	GF+1F+2F+3F	2.6	10.4
S	B1+GF+1F+2F+3F	2.3	15.15
T	B1+GF+1F+2F+3F	7.0	15.15
U	B1+GF+1F+2F+3F	8.7	15.15
V	GF+1F+2F+3F	4.4	10.4
W	B1+GF+1F+2F+3F	1.7	15.15
X	B1+GF+1F+2F+3F	2.2	15.15




Job Title 70 Lady Margaret Road


Section Vertical Loads

Job No.	Sheet No.	Revision
22276	5	1
Date	Made by	Checked By
01/05/2023	KL	EB

Site Plan

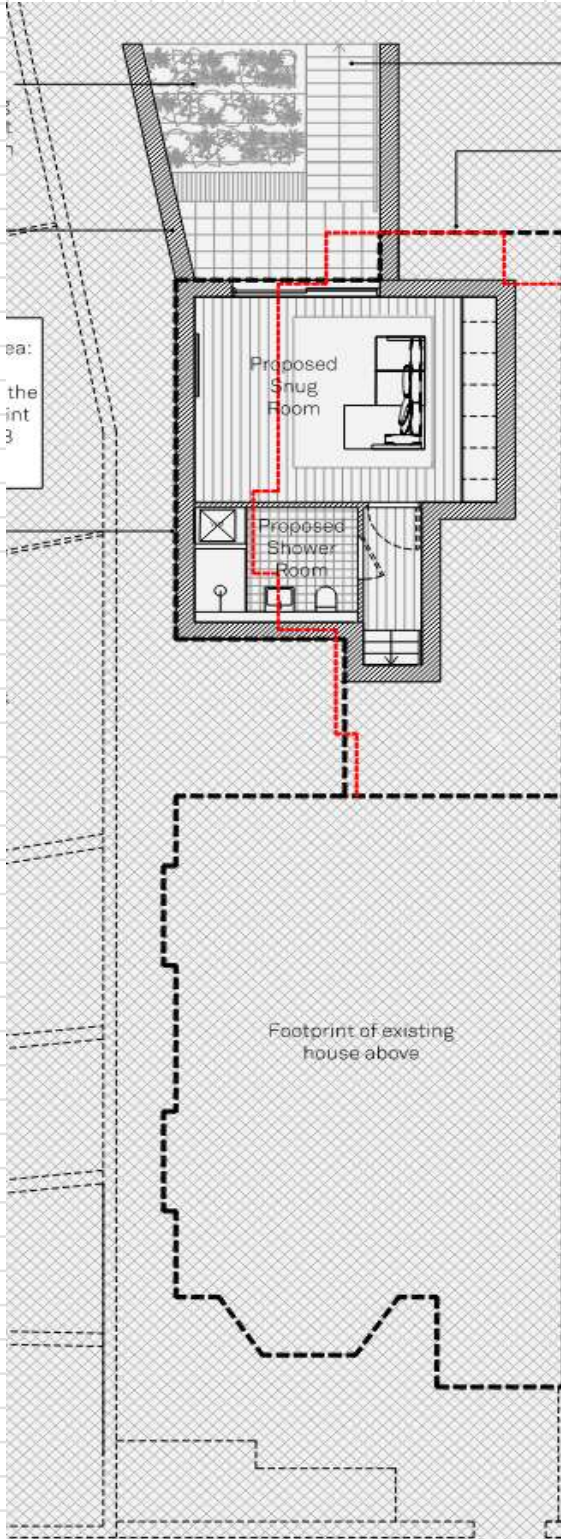

Proposed Basement Plan

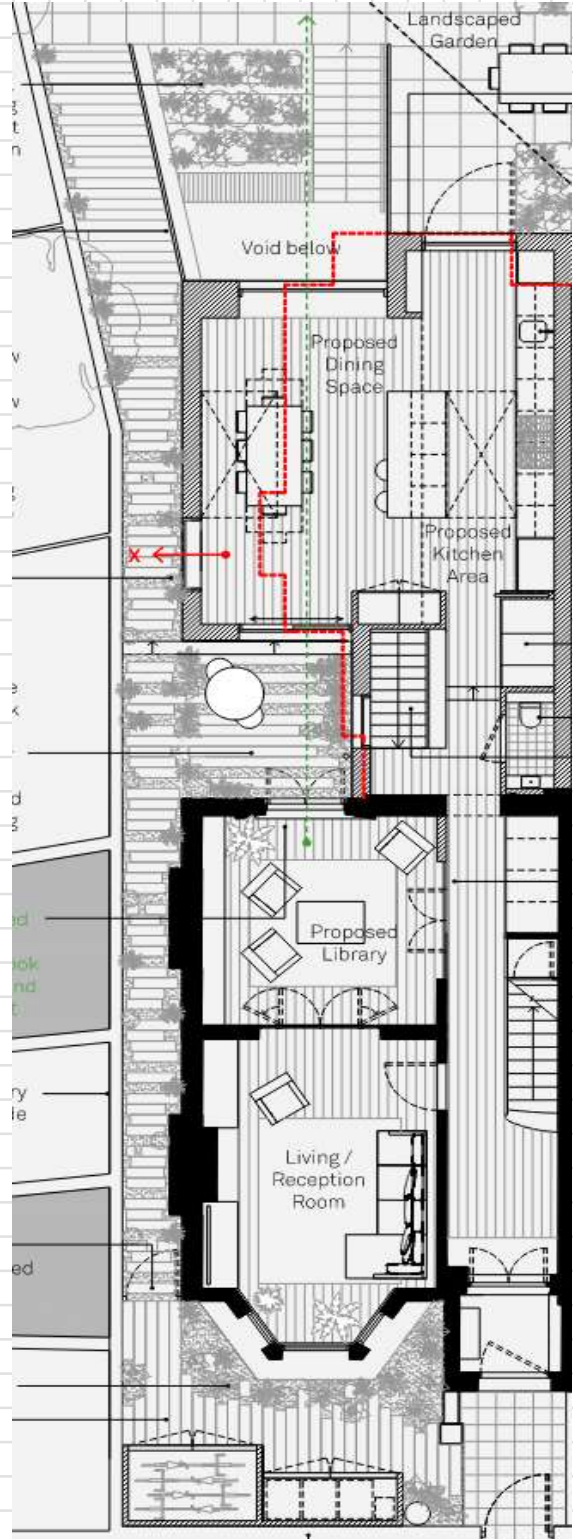

Proposed Ground Floor Plan




Job Title 70 Lady Margaret Road


Section Vertical Loads

Job No.	Sheet No.	Revision
22276	6	1
Date	Made by	Checked By
01/05/2023	KL	EB

Site Plan

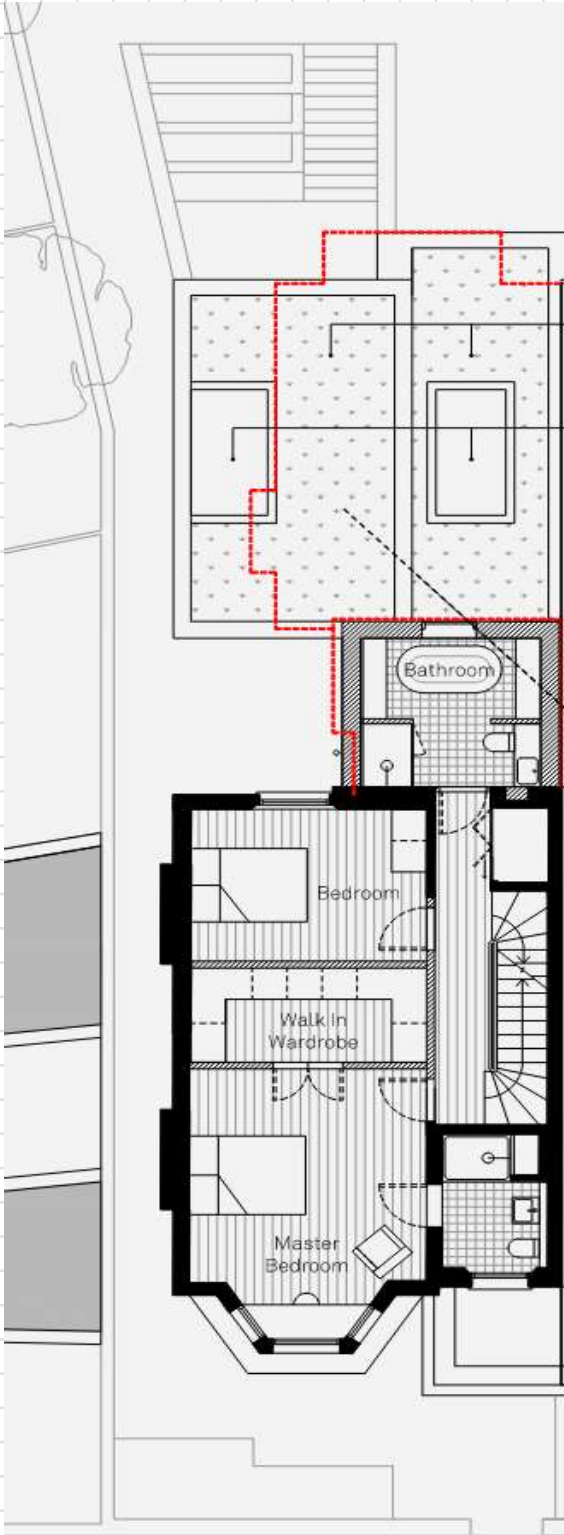

Proposed First Floor Plan

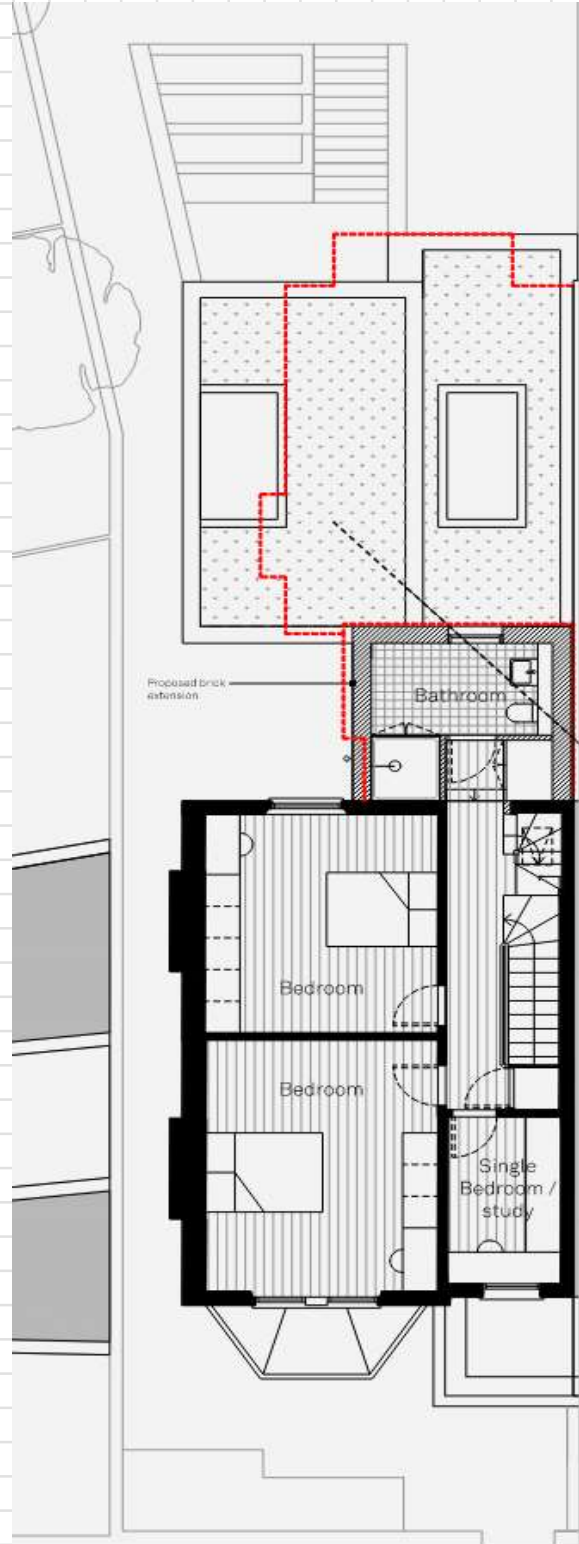

Proposed Second Floor Plan




Job Title 70 Lady Margaret Road


Section Vertical Loads

Job No.	Sheet No.	Revision
22276	7	1
Date	Made by	Checked By
01/05/2023	KL	EB

Loading Plan

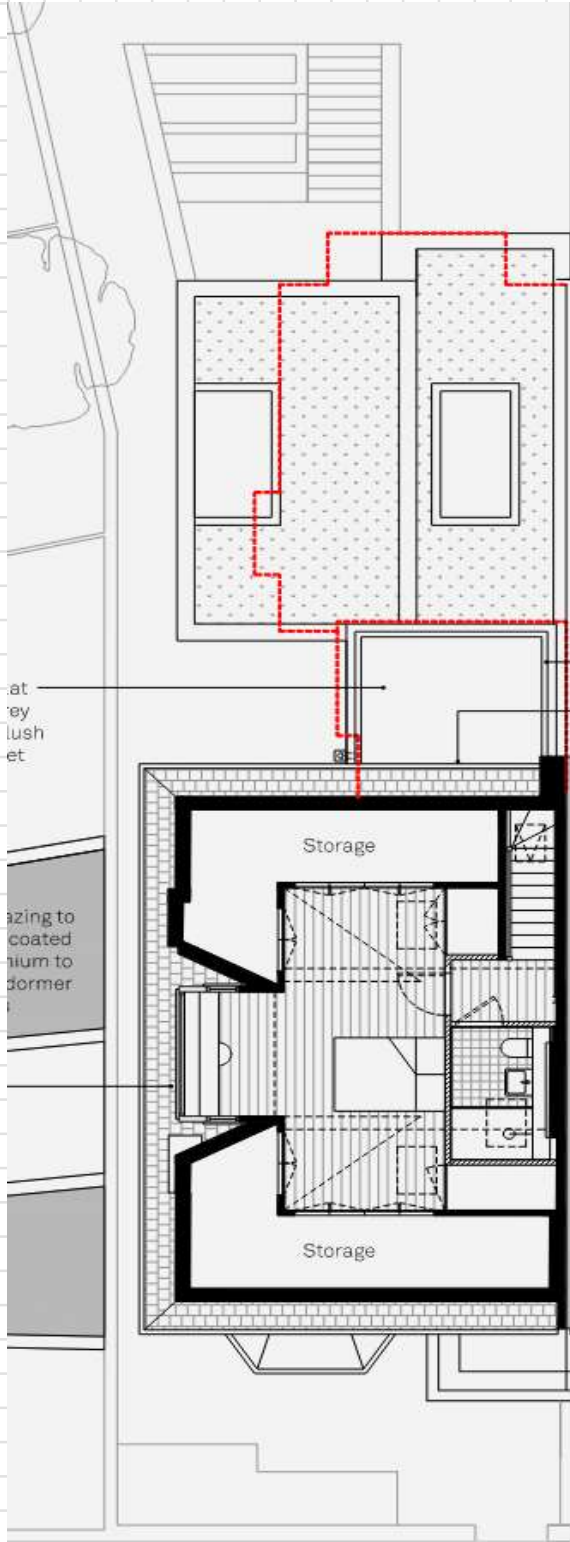

Proposed Third Floor Plan

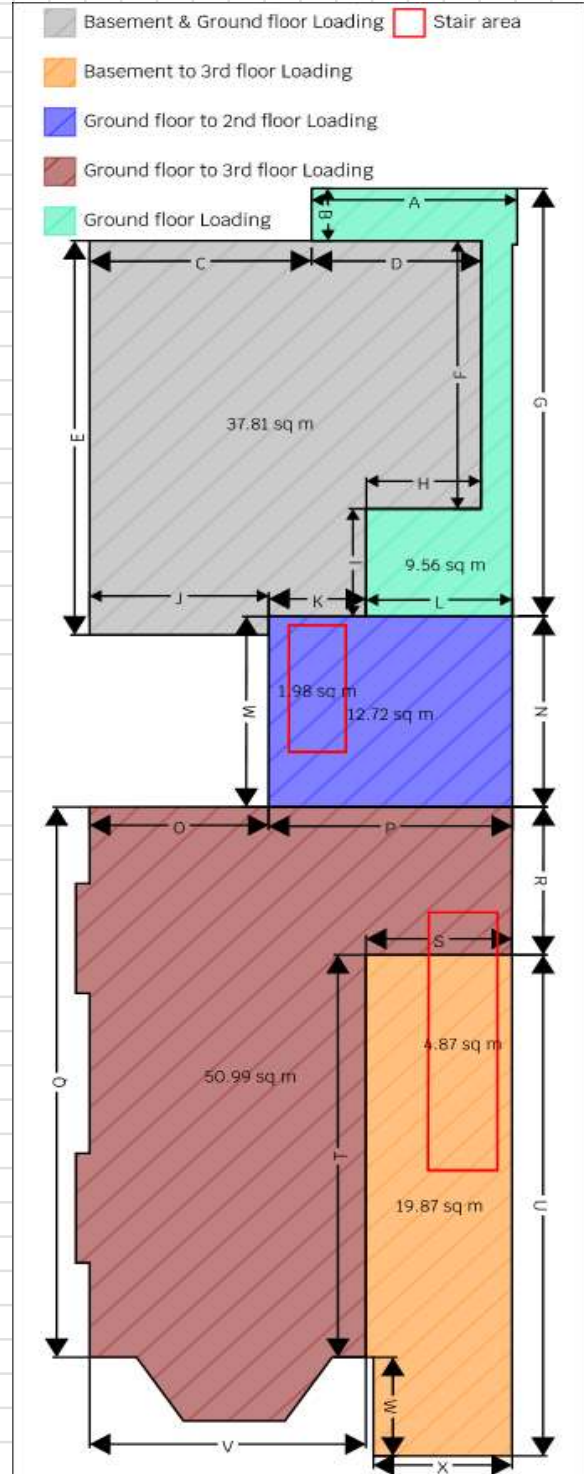

Loading section



		Job No.	Sheet No.	Revision
		21286	7	A
Job Title	70 Lady Margaret Road	Date	Made by	Checked By
Section	Structural Calculations	May-2023	KL	EB

Structural Calculations for 70 Lady Margaret Road



Job Title 70 Lady Margaret Road
Section Structural Calculations

Job No.	Sheet No.	Revision
22276	8	1
Date	Made by	Checked By
01/05/2023	KL	EB

Design of a basement slab for heave

Expected heave forces

Detailed analysis has been undertaken by GEA

Approximate conservative heave forces

Excavation depth	=	2.8	m		
Hydrostatic pressure	=	2.8	x	10	= 28 kN/m ²
Oberburden pressure	=	2.8	x	18	= 51 kN/m ²
Therefore expected heave	=	28	+	0.5*(51.12-28)	= 40 kN/m ²

Basement Slab Selfweight

Selfweight	=	0.3	x	25	= 6.3 kN/m ²
Screed	=	0.075	x	24	= 1.8 kN/m ²
		Total	=		8.1 kN/m ²

Uplift Design

Overall Uplift	=	40	-	8.05	= 31.7 kN/m ²
Therefore - ULS	=	31.7	x	1.5	= 47.6 kN/m ²

The basement slab will be designed to transmit forces to the retaining wall foundations spanning between both sides of the retaining walls.

The distance between the foundations is = 3.2 m

Therefore: $M_{max} = \frac{47.565 \times (3.2^2)}{8} = 60.86 \text{ kNm}$



Job No.	Sheet No.	Revision
22276	9	1
Date	Made by	Checked By
01/05/2023	KL	EB

Job Title 70 Lady Margaret Road
Section Structural Calculations

Design of a baement slab for heave					
Slab Properties					
Design Moment, M	=	60.86 kNm	fcu	=	30 N/mm ² γ _c = 1.50
β _b	=	1.00	f _y	=	500 N/mm ² γ _s = 1.15
span	=	3200 mm	Steel Class	=	A
Slab thickness, h	=	250 mm			
Bar Ø	=	12			
cover	=	50 mm			
Check					
d = 250 - 50 - 12/2 = 194.0 mm					
K' = 0.156 > K = 0.054 ok					
z = 194.0 [0.5 + (0.25 - 0.054 / 0.893)] ^{1/2} = 181.6 < 0.95d = 184.3 mm					
A _s = 60.86E6 / 500 / 181.5 x 1.15 = 771 > min A _s = 325 mm ² /m					
PROVIDE H12 @ 150 = 754 mm ² /m					
f _s = 2/3 x 500 x 771 / 754 / 1.00 = 341.0 N/mm ²					
Tens mod factor = 0.55 + (477 - 341.0) / 120 / (0.9 + 1.617) = 1.000					
Comp mod factor = 1 + 0.691 / (3 + 0.691) = 1.187					
Permissible L/d = 20.0 x 1.000 x 1.187 = 23.750					
Actual L/d = 3200 / 194.0 = 16.495 ok					
Therefore:					
Deflection is ok					
Maximum spacing is ok					
Minimum spacing is ok					

ELEMENT DESIGN to BS 8110:2005

SOLID SLABS

Originated from R0C11.xls v4.0 © 2006 - 2010 TCC

INPUT Location **70 Lady Margaret Road NW5 2NP**

Design moment, M **60.86** kNm/m fcu **30** N/mm² γ_c = **1.50**

β_b **1.00** f_y **500** N/mm² γ_s = **1.15**

span **3200** mm steel class **A**

Height, h **250** mm Section location **SIMPLY SUPPORTED SP**

Bar Ø **12** mm Compression steel **SPECIFY**

cover **50** mm to these bars (deflection control only)

OUTPUT 70 Lady Margaret Road NW5 2NP Compression steel = H16@150(0.691%)

d = 250 - 50 - 12/2 = 194.0 mm

(3.4.4.4) K' = 0.156 > K = 0.054 ok

(3.4.4.4) z = 194.0 [0.5 + (0.25 - 0.054 / 0.893)]^{1/2} = 181.6 < 0.95d = 184.3 mm

(3.4.4.1) A_s = 60.86E6 / 500 / 181.5 x 1.15 = 771 > min A_s = 325 mm²/m

PROVIDE H12 @ 150 = 754 mm²/m

(Eqn 8) f_s = 2/3 x 500 x 771 / 754 / 1.00 = 341.0 N/mm²

(Eqn 7) Tens mod factor = 0.55 + (477 - 341.0) / 120 / (0.9 + 1.617) = 1.000

(Equation 9) Comp mod factor = 1 + 0.691 / (3 + 0.691) = 1.187

(3.4.6.3) Permissible L/d = 20.0 x 1.000 x 1.187 = 23.750

Actual L/d = 3200 / 194.0 = 16.495 ok



Project 70 Lady Margaret Road				Job no. 22276	
Calcs for Retaining Wall A				Start page no./Revision 1	
Calcs by KL	Calcs date 22/05/2023	Checked by EB	Checked date 13/03/2023	Approved by	Approved date

RETAINING WALL ANALYSIS

In accordance with EN1997-1:2004 incorporating Corrigendum dated February 2009 and the UK National Annex incorporating Corrigendum No.1

Tedds calculation version 2.9.17

Retaining wall details

Stem type	Cantilever
Stem height	$h_{stem} = 3000$ mm
Stem thickness	$t_{stem} = 300$ mm
Angle to rear face of stem	$\alpha = 90$ deg
Stem density	$\gamma_{stem} = 25$ kN/m ³
Toe length	$l_{toe} = 4000$ mm
Base thickness	$t_{base} = 250$ mm
Base density	$\gamma_{base} = 25$ kN/m ³
Height of retained soil	$h_{ret} = 3000$ mm
Angle of soil surface	$\beta = 0$ deg
Depth of cover	$d_{cover} = 0$ mm
Height of water	$h_{water} = 2000$ mm
Water density	$\gamma_w = 9.8$ kN/m ³

Retained soil properties

Soil type	Firm clay
Moist density	$\gamma_{mr} = 18$ kN/m ³
Saturated density	$\gamma_{sr} = 18$ kN/m ³
Characteristic effective shear resistance angle	$\phi'_{r,k} = 22$ deg
Characteristic wall friction angle	$\delta_{r,k} = 11$ deg

Base soil properties


Soil type	Stiff silty clay
Soil density	$\gamma_b = 19$ kN/m ³
Characteristic effective shear resistance angle	$\phi'_{b,k} = 22$ deg
Characteristic wall friction angle	$\delta_{b,k} = 11$ deg
Characteristic base friction angle	$\delta_{bb,k} = 14.7$ deg
Presumed bearing capacity	$P_{bearing} = 150$ kN/m ²

Loading details

Variable surcharge load	Surcharge _Q = 5 kN/m ²
Vertical line load at 4150 mm	$P_{G1} = 60$ kN/m
	$P_{Q1} = 9$ kN/m



Project 70 Lady Margaret Road				Job no. 22276	
Calcs for Retaining Wall A				Start page no./Revision 2	
Calcs by KL	Calcs date 22/05/2023	Checked by EB	Checked date 13/03/2023	Approved by	Approved date

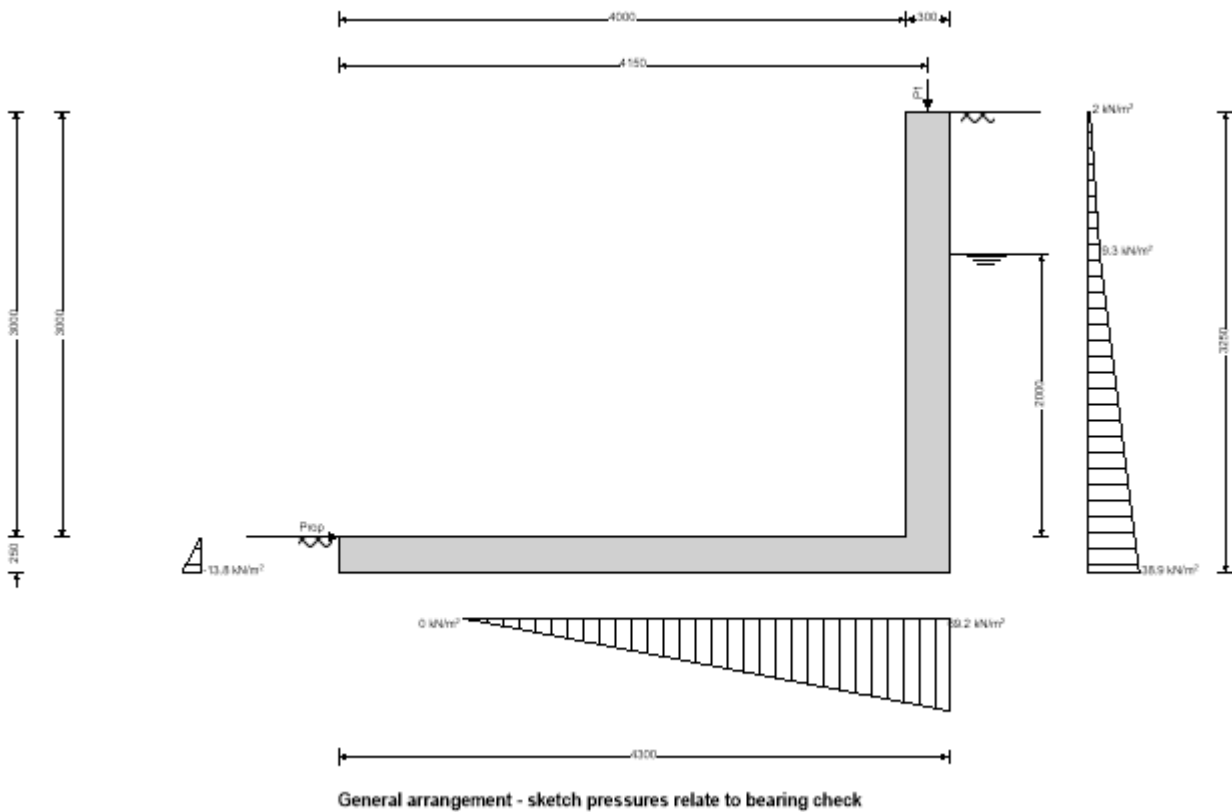

Calculate retaining wall geometry

Base length	$l_{base} = l_{toe} + t_{stem} = 4300 \text{ mm}$
Saturated soil height	$h_{sat} = h_{water} + d_{cover} = 2000 \text{ mm}$
Moist soil height	$h_{moist} = h_{ret} - h_{water} = 1000 \text{ mm}$
Length of surcharge load	$l_{sur} = l_{heel} = 0 \text{ mm}$
- Distance to vertical component	$x_{sur_v} = l_{base} - l_{heel} / 2 = 4300 \text{ mm}$
Effective height of wall	$h_{eff} = h_{base} + d_{cover} + h_{ret} = 3250 \text{ mm}$
- Distance to horizontal component	$x_{sur_h} = h_{eff} / 2 = 1625 \text{ mm}$
Area of wall stem	$A_{stem} = h_{stem} \times t_{stem} = 0.9 \text{ m}^2$
- Distance to vertical component	$x_{stem} = l_{toe} + t_{stem} / 2 = 4150 \text{ mm}$
Area of wall base	$A_{base} = l_{base} \times t_{base} = 1.075 \text{ m}^2$
- Distance to vertical component	$x_{base} = l_{base} / 2 = 2150 \text{ mm}$

Using Coulomb theory

Active pressure coefficient	$K_A = \frac{\sin(\alpha + \phi'_{r,k})^2}{(\sin(\alpha)^2 \times \sin(\alpha - \delta_{r,k}) \times [1 + \sqrt{(\sin(\phi'_{r,k} + \delta_{r,k}) \times \sin(\phi'_{r,k} - \beta) / (\sin(\alpha - \delta_{r,k}) \times \sin(\alpha + \beta))}]^2)} = 0.413$
Passive pressure coefficient	$K_P = \frac{\sin(90 - \phi'_{b,k})^2}{(\sin(90 + \delta_{b,k}) \times [1 - \sqrt{(\sin(\phi'_{b,k} + \delta_{b,k}) \times \sin(\phi'_{b,k}) / (\sin(90 + \delta_{b,k}))}]^2)} = 2.958$

Bearing pressure check

Vertical forces on wall

Wall stem	$F_{stem} = A_{stem} \times \gamma_{stem} = 22.5 \text{ kN/m}$
Wall base	$F_{base} = A_{base} \times \gamma_{base} = 26.9 \text{ kN/m}$



Project				Job no.	
70 Lady Margaret Road				22276	
Calcs for				Start page no./Revision	
Retaining Wall A				3	
Calcs by	Calcs date	Checked by	Checked date	Approved by	Approved date
KL	22/05/2023	EB	13/03/2023		

Line loads	$F_{P_v} = P_{G1} + P_{Q1} = 69 \text{ kN/m}$
Total	$F_{total_v} = F_{stem} + F_{base} + F_{P_v} + F_{water_v} = 118.4 \text{ kN/m}$
Horizontal forces on wall	
Surcharge load	$F_{sur_h} = K_A \times \cos(\delta_{r,k}) \times \text{Surcharge}_Q \times h_{eff} = 6.6 \text{ kN/m}$
Saturated retained soil	$F_{sat_h} = K_A \times \cos(\delta_{r,k}) \times (\gamma_{sr} - \gamma_w) \times (h_{sat} + h_{base})^2 / 2 = 8.4 \text{ kN/m}$
Water	$F_{water_h} = \gamma_w \times (h_{water} + d_{cover} + h_{base})^2 / 2 = 24.8 \text{ kN/m}$
Moist retained soil	$F_{moist_h} = K_A \times \cos(\delta_{r,k}) \times \gamma_{mr} \times ((h_{eff} - h_{sat} - h_{base})^2 / 2 + (h_{eff} - h_{sat} - h_{base}) \times (h_{sat} + h_{base})) = 20.1 \text{ kN/m}$
Base soil	$F_{pass_h} = -K_P \times \cos(\delta_{b,k}) \times \gamma_b \times (d_{cover} + h_{base})^2 / 2 = -1.7 \text{ kN/m}$
Total	$F_{total_h} = F_{sur_h} + F_{sat_h} + F_{water_h} + F_{moist_h} + F_{pass_h} = 58.2 \text{ kN/m}$
Moments on wall	
Wall stem	$M_{stem} = F_{stem} \times X_{stem} = 93.4 \text{ kNm/m}$
Wall base	$M_{base} = F_{base} \times X_{base} = 57.8 \text{ kNm/m}$
Surcharge load	$M_{sur} = -F_{sur_h} \times X_{sur_h} = -10.7 \text{ kNm/m}$
Line loads	$M_P = (P_{G1} + P_{Q1}) \times p_1 = 286.4 \text{ kNm/m}$
Saturated retained soil	$M_{sat} = -F_{sat_h} \times X_{sat_h} = -6.3 \text{ kNm/m}$
Water	$M_{water} = -F_{water_h} \times X_{water_h} = -18.6 \text{ kNm/m}$
Moist retained soil	$M_{moist} = -F_{moist_h} \times X_{moist_h} = -27.9 \text{ kNm/m}$
Total	$M_{total} = M_{stem} + M_{base} + M_{sur} + M_P + M_{sat} + M_{water} + M_{moist} = 374 \text{ kNm/m}$
Check bearing pressure	
Propping force	$F_{prop_base} = F_{total_h} = 58.2 \text{ kN/m}$
Distance to reaction	$\bar{x} = M_{total} / F_{total_v} = 3159 \text{ mm}$
Eccentricity of reaction	$e = \bar{x} - l_{base} / 2 = 1009 \text{ mm}$
Loaded length of base	$l_{load} = 3 \times (l_{base} - \bar{x}) = 3423 \text{ mm}$
Bearing pressure at toe	$q_{toe} = 0 \text{ kN/m}^2$
Bearing pressure at heel	$q_{heel} = 2 \times F_{total_v} / l_{load} = 69.2 \text{ kN/m}^2$
Factor of safety	$FoS_{bp} = P_{bearing} / \max(q_{toe}, q_{heel}) = 2.169$

PASS - Allowable bearing pressure exceeds maximum applied bearing pressure

RETAINING WALL DESIGN

In accordance with EN1992-1-1:2004 incorporating Corrigendum dated January 2008 and the UK National Annex incorporating National Amendment No.1

Tedds calculation version 2.9.17

Concrete details - Table 3.1 - Strength and deformation characteristics for concrete

Concrete strength class	C30/37
Characteristic compressive cylinder strength	$f_{ck} = 30 \text{ N/mm}^2$
Characteristic compressive cube strength	$f_{ck,cube} = 37 \text{ N/mm}^2$
Mean value of compressive cylinder strength	$f_{cm} = f_{ck} + 8 \text{ N/mm}^2 = 38 \text{ N/mm}^2$
Mean value of axial tensile strength	$f_{ctm} = 0.3 \text{ N/mm}^2 \times (f_{ck} / 1 \text{ N/mm}^2)^{2/3} = 2.9 \text{ N/mm}^2$
5% fractile of axial tensile strength	$f_{ctk,0.05} = 0.7 \times f_{ctm} = 2.0 \text{ N/mm}^2$
Secant modulus of elasticity of concrete	$E_{cm} = 22 \text{ kN/mm}^2 \times (f_{cm} / 10 \text{ N/mm}^2)^{0.3} = 32837 \text{ N/mm}^2$
Partial factor for concrete - Table 2.1N	$\gamma_C = 1.50$
Compressive strength coefficient - cl.3.1.6(1)	$\alpha_{cc} = 0.85$
Design compressive concrete strength - exp.3.15	$f_{cd} = \alpha_{cc} \times f_{ck} / \gamma_C = 17.0 \text{ N/mm}^2$
Maximum aggregate size	$h_{agg} = 20 \text{ mm}$



Project 70 Lady Margaret Road				Job no. 22276	
Calcs for Retaining Wall A				Start page no./Revision 4	
Calcs by KL	Calcs date 22/05/2023	Checked by EB	Checked date 13/03/2023	Approved by	Approved date

Ultimate strain - Table 3.1

$\epsilon_{cu2} = 0.0035$

Shortening strain - Table 3.1

$\epsilon_{cu3} = 0.0035$

Effective compression zone height factor

$\lambda = 0.80$

Effective strength factor

$\eta = 1.00$

Bending coefficient k_1

$K_1 = 0.40$

Bending coefficient k_2

$K_2 = 1.00 \times (0.6 + 0.0014/\epsilon_{cu2}) = 1.00$

Bending coefficient k_3

$K_3 = 0.40$

Bending coefficient k_4

$K_4 = 1.00 \times (0.6 + 0.0014/\epsilon_{cu2}) = 1.00$

Reinforcement details

Characteristic yield strength of reinforcement

$f_{yk} = 500 \text{ N/mm}^2$

Modulus of elasticity of reinforcement

$E_s = 200000 \text{ N/mm}^2$

Partial factor for reinforcing steel - Table 2.1N

$\gamma_s = 1.15$

Design yield strength of reinforcement

$f_{yd} = f_{yk} / \gamma_s = 435 \text{ N/mm}^2$

Cover to reinforcement

Front face of stem

$C_{sf} = 40 \text{ mm}$

Rear face of stem







$C_{sr} = 50 \text{ mm}$

Top face of base

$C_{bt} = 50 \text{ mm}$

Bottom face of base

$C_{bb} = 75 \text{ mm}$

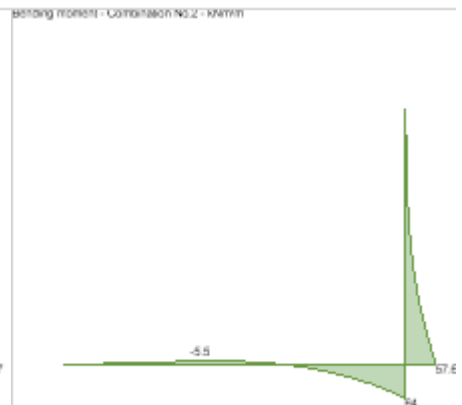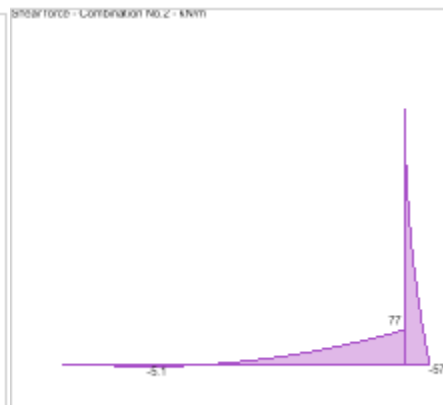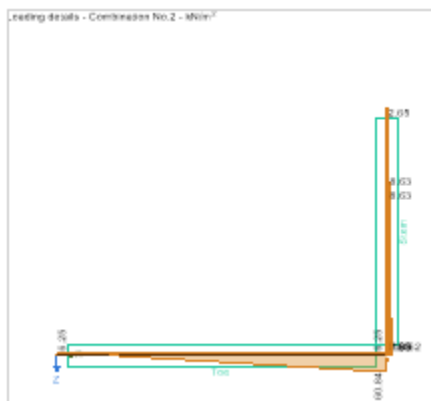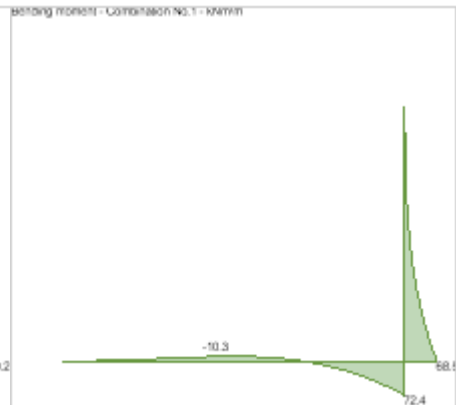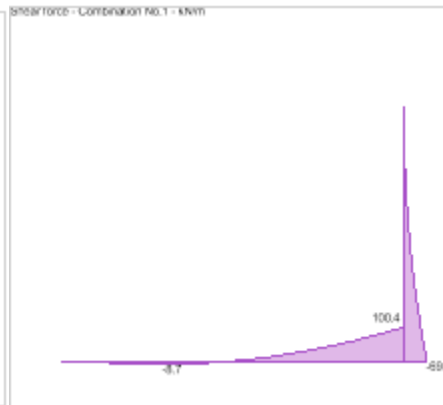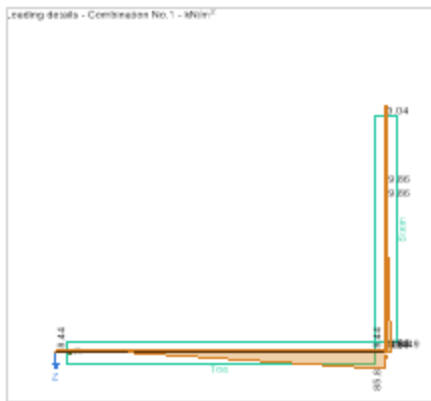

Check stem design at base of stem

Depth of section

$h = 300 \text{ mm}$



Project 70 Lady Margaret Road				Job no. 22276	
Calcs for Retaining Wall A				Start page no./Revision 5	
Calcs by KL	Calcs date 22/05/2023	Checked by EB	Checked date 13/03/2023	Approved by	Approved date

Rectangular section in flexure - Section 6.1

Design bending moment combination 1

$$M = 68.5 \text{ kNm/m}$$

Depth to tension reinforcement

$$d = h - c_{sr} - \phi_{sr} / 2 = 242 \text{ mm}$$

$$K = M / (d^2 \times f_{ck}) = 0.039$$

$$K' = (2 \times \eta \times \alpha_{cc} / \gamma_c) \times (1 - \lambda \times (\delta - K_1) / (2 \times K_2)) \times (\lambda \times (\delta - K_1) / (2 \times K_2))$$

$$K' = 0.207$$

$K' > K$ - No compression reinforcement is required

Lever arm

$$z = \min(0.5 + 0.5 \times (1 - 2 \times K / (\eta \times \alpha_{cc} / \gamma_c))^{0.5}, 0.95) \times d = 230 \text{ mm}$$

Depth of neutral axis

$$x = 2.5 \times (d - z) = 30 \text{ mm}$$

Area of tension reinforcement required

$$A_{sr.req} = M / (f_{yd} \times z) = 686 \text{ mm}^2/\text{m}$$

Tension reinforcement provided

$$16 \text{ dia. bars @ } 200 \text{ c/c}$$

Area of tension reinforcement provided

$$A_{sr.prov} = \pi \times \phi_{sr}^2 / (4 \times s_{sr}) = 1005 \text{ mm}^2/\text{m}$$

Minimum area of reinforcement - exp.9.1N

$$A_{sr.min} = \max(0.26 \times f_{ctm} / f_{yk}, 0.0013) \times d = 364 \text{ mm}^2/\text{m}$$

Maximum area of reinforcement - cl.9.2.1.1(3)

$$A_{sr.max} = 0.04 \times h = 12000 \text{ mm}^2/\text{m}$$

$$\max(A_{sr.req}, A_{sr.min}) / A_{sr.prov} = 0.682$$

PASS - Area of reinforcement provided is greater than area of reinforcement required

Library item: Rectangular single output

Deflection control - Section 7.4

Reference reinforcement ratio

$$\rho_0 = \sqrt{f_{ck} / 1 \text{ N/mm}^2} / 1000 = 0.005$$

Required tension reinforcement ratio

$$\rho = A_{sr.req} / d = 0.003$$

Required compression reinforcement ratio

$$\rho' = A_{sr.2.req} / d_2 = 0.000$$

Structural system factor - Table 7.4N

$$K_b = 0.4$$

Reinforcement factor - exp.7.17

$$K_s = \min(500 \text{ N/mm}^2 / (f_{yk} \times A_{sr.req} / A_{sr.prov}), 1.5) = 1.466$$

Limiting span to depth ratio - exp.7.16.a

$$\min(K_s \times K_b \times [11 + 1.5 \times \sqrt{f_{ck} / 1 \text{ N/mm}^2}] \times \rho_0 / \rho + 3.2 \times \sqrt{f_{ck} / 1 \text{ N/mm}^2}) \times (\rho_0 / \rho - 1)^{3/2}, 40 \times K_b) = 16$$

Actual span to depth ratio

$$h_{stem} / d = 12.4$$

PASS - Span to depth ratio is less than deflection control limit

Crack control - Section 7.3

Limiting crack width

$$w_{max} = 0.3 \text{ mm}$$

Variable load factor - EN1990 – Table A1.1

$$\psi_2 = 0.6$$

Serviceability bending moment

$$M_{sls} = 46.1 \text{ kNm/m}$$

Tensile stress in reinforcement

$$\sigma_s = M_{sls} / (A_{sr.prov} \times z) = 199.5 \text{ N/mm}^2$$

Load duration

Long term

Load duration factor

$$k_t = 0.4$$

Effective area of concrete in tension

$$A_{c.eff} = \min(2.5 \times (h - d), (h - x) / 3, h / 2)$$

$$A_{c.eff} = 89917 \text{ mm}^2/\text{m}$$

Mean value of concrete tensile strength

$$f_{ct.eff} = f_{ctm} = 2.9 \text{ N/mm}^2$$

Reinforcement ratio

$$\rho_{p.eff} = A_{sr.prov} / A_{c.eff} = 0.011$$

Modular ratio

$$\alpha_e = E_s / E_{cm} = 6.091$$

Bond property coefficient

$$k_1 = 0.8$$

Strain distribution coefficient

$$k_2 = 0.5$$

$$k_3 = 3.4$$

$$k_4 = 0.425$$

Maximum crack spacing - exp.7.11

$$s_{r.max} = k_3 \times c_{sr} + k_1 \times k_2 \times k_4 \times \phi_{sr} / \rho_{p.eff} = 413 \text{ mm}$$

Maximum crack width - exp.7.8

$$w_k = s_{r.max} \times \max(\sigma_s - k_t \times (f_{ct.eff} / \rho_{p.eff}), 0.6 \times \sigma_s) / E_s$$

$$w_k = 0.247 \text{ mm}$$



Project 70 Lady Margaret Road				Job no. 22276	
Calcs for Retaining Wall A				Start page no./Revision 6	
Calcs by KL	Calcs date 22/05/2023	Checked by EB	Checked date 13/03/2023	Approved by	Approved date

$$w_k / w_{max} = \mathbf{0.824}$$

PASS - Maximum crack width is less than limiting crack width

Rectangular section in shear - Section 6.2

Design shear force

$$V = \mathbf{69.2 \text{ kN/m}}$$

$$C_{Rd,c} = 0.18 / \gamma_c = \mathbf{0.120}$$

$$k = \min(1 + \sqrt{(200 \text{ mm} / d)}, 2) = \mathbf{1.909}$$

Longitudinal reinforcement ratio

$$\rho_l = \min(A_{sr,prov} / d, 0.02) = \mathbf{0.004}$$

$$v_{min} = 0.035 \text{ N}^{1/2}/\text{mm} \times k^{3/2} \times f_{ck}^{0.5} = \mathbf{0.506 \text{ N/mm}^2}$$

Design shear resistance - exp.6.2a & 6.2b

$$V_{Rd,c} = \max(C_{Rd,c} \times k \times (100 \text{ N}^2/\text{mm}^4 \times \rho_l \times f_{ck})^{1/3}, v_{min}) \times d$$

$$V_{Rd,c} = \mathbf{128.5 \text{ kN/m}}$$

$$V / V_{Rd,c} = \mathbf{0.539}$$

PASS - Design shear resistance exceeds design shear force

Horizontal reinforcement parallel to face of stem - Section 9.6

Minimum area of reinforcement – cl.9.6.3(1)

$$A_{sx,req} = \max(0.25 \times A_{sr,prov}, 0.001 \times t_{stem}) = \mathbf{300 \text{ mm}^2/\text{m}}$$

Maximum spacing of reinforcement – cl.9.6.3(2)

$$s_{sx,max} = \mathbf{400 \text{ mm}}$$

Transverse reinforcement provided

$$10 \text{ dia.bars @ } 200 \text{ c/c}$$

Area of transverse reinforcement provided

$$A_{sx,prov} = \pi \times \phi_{sx}^2 / (4 \times s_{sx}) = \mathbf{393 \text{ mm}^2/\text{m}}$$

PASS - Area of reinforcement provided is greater than area of reinforcement required

Check base design at toe

Depth of section

$$h = \mathbf{250 \text{ mm}}$$

Rectangular section in flexure - Section 6.1

Design bending moment combination 1

$$M = \mathbf{72.4 \text{ kNm/m}}$$

Depth to tension reinforcement

$$d = h - c_{bb} - \phi_{bb} / 2 = \mathbf{165 \text{ mm}}$$

$$K = M / (d^2 \times f_{ck}) = \mathbf{0.089}$$

$$K' = (2 \times \eta \times \alpha_{cc} / \gamma_c) \times (1 - \lambda \times (\delta - K_1) / (2 \times K_2)) \times (\lambda \times (\delta - K_1) / (2 \times K_2))$$

$$K' = \mathbf{0.207}$$

$K' > K$ - No compression reinforcement is required

Lever arm

$$z = \min(0.5 + 0.5 \times (1 - 2 \times K / (\eta \times \alpha_{cc} / \gamma_c))^{0.5}, 0.95) \times d = \mathbf{151 \text{ mm}}$$

Depth of neutral axis

$$x = 2.5 \times (d - z) = \mathbf{35 \text{ mm}}$$

Area of tension reinforcement required

$$A_{bb,req} = M / (f_{yd} \times z) = \mathbf{1103 \text{ mm}^2/\text{m}}$$

Tension reinforcement provided

$$20 \text{ dia.bars @ } 150 \text{ c/c}$$

Area of tension reinforcement provided

$$A_{bb,prov} = \pi \times \phi_{bb}^2 / (4 \times s_{bb}) = \mathbf{2094 \text{ mm}^2/\text{m}}$$

Minimum area of reinforcement - exp.9.1N

$$A_{bb,min} = \max(0.26 \times f_{ctm} / f_{yk}, 0.0013) \times d = \mathbf{249 \text{ mm}^2/\text{m}}$$

Maximum area of reinforcement - cl.9.2.1.1(3)

$$A_{bb,max} = 0.04 \times h = \mathbf{10000 \text{ mm}^2/\text{m}}$$

$$\max(A_{bb,req}, A_{bb,min}) / A_{bb,prov} = \mathbf{0.527}$$

PASS - Area of reinforcement provided is greater than area of reinforcement required

Library item: Rectangular single output

Crack control - Section 7.3

Limiting crack width

$$w_{max} = \mathbf{0.3 \text{ mm}}$$

Variable load factor - EN1990 – Table A1.1

$$\psi_2 = \mathbf{0.6}$$

Serviceability bending moment

$$M_{sls} = \mathbf{52.6 \text{ kNm/m}}$$

Tensile stress in reinforcement

$$\sigma_s = M_{sls} / (A_{bb,prov} \times z) = \mathbf{166.3 \text{ N/mm}^2}$$

Load duration

$$\text{Long term}$$

Load duration factor

$$k_t = \mathbf{0.4}$$

Effective area of concrete in tension

$$A_{c,eff} = \min(2.5 \times (h - d), (h - x) / 3, h / 2)$$

$$A_{c,eff} = \mathbf{71574 \text{ mm}^2/\text{m}}$$



Project 70 Lady Margaret Road				Job no. 22276	
Calcs for Retaining Wall A				Start page no./Revision 7	
Calcs by KL	Calcs date 22/05/2023	Checked by EB	Checked date 13/03/2023	Approved by	Approved date

Mean value of concrete tensile strength

$$f_{ct,eff} = f_{ctm} = \mathbf{2.9 \text{ N/mm}^2}$$

Reinforcement ratio

$$\rho_{p,eff} = A_{bb,prov} / A_{c,eff} = \mathbf{0.029}$$

Modular ratio

$$\alpha_e = E_s / E_{cm} = \mathbf{6.091}$$

Bond property coefficient

$$k_1 = \mathbf{0.8}$$

Strain distribution coefficient

$$k_2 = \mathbf{0.5}$$

$$k_3 = \mathbf{3.4}$$

$$k_4 = \mathbf{0.425}$$

Maximum crack spacing - exp.7.11

$$s_{r,max} = k_3 \times C_{bb} + k_1 \times k_2 \times k_4 \times \phi_{bb} / \rho_{p,eff} = \mathbf{371 \text{ mm}}$$

Maximum crack width - exp.7.8

$$w_k = s_{r,max} \times \max(\sigma_s - k_t \times (f_{ct,eff} / \rho_{p,eff}) \times (1 + \alpha_e \times \rho_{p,eff}), 0.6 \times \sigma_s) / E_s$$

$$w_k = \mathbf{0.222 \text{ mm}}$$

$$w_k / w_{max} = \mathbf{0.74}$$

PASS - Maximum crack width is less than limiting crack width

Rectangular section in shear - Section 6.2

Design shear force

$$V = \mathbf{100.4 \text{ kN/m}}$$

$$C_{Rd,c} = 0.18 / \gamma_c = \mathbf{0.120}$$

$$k = \min(1 + \sqrt{(200 \text{ mm} / d)}, 2) = \mathbf{2.000}$$

Longitudinal reinforcement ratio

$$\rho_l = \min(A_{bb,prov} / d, 0.02) = \mathbf{0.013}$$

$$v_{min} = 0.035 \text{ N}^{1/2}/\text{mm} \times k^{3/2} \times f_{ck}^{0.5} = \mathbf{0.542 \text{ N/mm}^2}$$

Design shear resistance - exp.6.2a & 6.2b

$$V_{Rd,c} = \max(C_{Rd,c} \times k \times (100 \text{ N}^2/\text{mm}^4 \times \rho_l \times f_{ck})^{1/3}, v_{min}) \times d$$

$$V_{Rd,c} = \mathbf{133.2 \text{ kN/m}}$$

$$V / V_{Rd,c} = \mathbf{0.754}$$

PASS - Design shear resistance exceeds design shear force

Check base design at toe

Depth of section

$$h = \mathbf{250 \text{ mm}}$$

Rectangular section in flexure - Section 6.1

Design bending moment combination 1

$$M = \mathbf{10.3 \text{ kNm/m}}$$

Depth to tension reinforcement

$$d = h - c_{bt} - \phi_{bt} / 2 = \mathbf{195 \text{ mm}}$$

$$K = M / (d^2 \times f_{ck}) = \mathbf{0.009}$$

$$K' = (2 \times \eta \times \alpha_{cc} / \gamma_c) \times (1 - \lambda \times (\delta - K_1) / (2 \times K_2)) \times (\lambda \times (\delta - K_1) / (2 \times K_2))$$

$$K' = \mathbf{0.207}$$

$K' > K$ - No compression reinforcement is required

Lever arm

$$z = \min(0.5 + 0.5 \times (1 - 2 \times K / (\eta \times \alpha_{cc} / \gamma_c))^{0.5}, 0.95) \times d = \mathbf{185 \text{ mm}}$$

Depth of neutral axis

$$x = 2.5 \times (d - z) = \mathbf{24 \text{ mm}}$$

Area of tension reinforcement required

$$A_{bt,req} = M / (f_{yd} \times z) = \mathbf{128 \text{ mm}^2/\text{m}}$$

Tension reinforcement provided

$$10 \text{ dia. bars @ } 150 \text{ c/c}$$

Area of tension reinforcement provided

$$A_{bt,prov} = \pi \times \phi_{bt}^2 / (4 \times s_{bt}) = \mathbf{524 \text{ mm}^2/\text{m}}$$

Minimum area of reinforcement - exp.9.1N

$$A_{bt,min} = \max(0.26 \times f_{ctm} / f_{yk}, 0.0013) \times d = \mathbf{294 \text{ mm}^2/\text{m}}$$

Maximum area of reinforcement - cl.9.2.1.1(3)

$$A_{bt,max} = 0.04 \times h = \mathbf{10000 \text{ mm}^2/\text{m}}$$

$$\max(A_{bt,req}, A_{bt,min}) / A_{bt,prov} = \mathbf{0.561}$$

PASS - Area of reinforcement provided is greater than area of reinforcement required

Library item: Rectangular single output

Crack control - Section 7.3

Limiting crack width

$$w_{max} = \mathbf{0.3 \text{ mm}}$$

Variable load factor - EN1990 – Table A1.1

$$\psi_2 = \mathbf{0.6}$$

Serviceability bending moment

$$M_{sis} = \mathbf{0 \text{ kNm/m}}$$

Tensile stress in reinforcement

$$\sigma_s = M_{sis} / (A_{bt,prov} \times z) = \mathbf{0 \text{ N/mm}^2}$$



Project 70 Lady Margaret Road				Job no. 22276	
Calcs for Retaining Wall A				Start page no./Revision 8	
Calcs by KL	Calcs date 22/05/2023	Checked by EB	Checked date 13/03/2023	Approved by	Approved date


Load duration	Long term
Load duration factor	$k_t = 0.4$
Effective area of concrete in tension	$A_{c,eff} = \min(2.5 \times (h - d), (h - x) / 3, h / 2)$ $A_{c,eff} = 75208 \text{ mm}^2/\text{m}$
Mean value of concrete tensile strength	$f_{ct,eff} = f_{ctm} = 2.9 \text{ N/mm}^2$
Reinforcement ratio	$\rho_{p,eff} = A_{bt,prov} / A_{c,eff} = 0.007$
Modular ratio	$\alpha_e = E_s / E_{cm} = 6.091$
Bond property coefficient	$k_1 = 0.8$
Strain distribution coefficient	$k_2 = 0.5$ $k_3 = 3.4$ $k_4 = 0.425$
Maximum crack spacing - exp.7.11	$S_{r,max} = k_3 \times C_{bt} + k_1 \times k_2 \times k_4 \times \phi_{bt} / \rho_{p,eff} = 414 \text{ mm}$
Maximum crack width - exp.7.8	$W_k = S_{r,max} \times \max(\sigma_s - k_t \times (f_{ct,eff} / \rho_{p,eff}) \times (1 + \alpha_e \times \rho_{p,eff}), 0.6 \times \sigma_s) / E_s$ $W_k = 0 \text{ mm}$ $W_k / W_{max} = 0$

PASS - Maximum crack width is less than limiting crack width

Secondary transverse reinforcement to base - Section 9.3

Minimum area of reinforcement – cl.9.3.1.1(2)	$A_{bx,req} = 0.2 \times A_{bb,prov} = 419 \text{ mm}^2/\text{m}$
Maximum spacing of reinforcement – cl.9.3.1.1(3)	$S_{bx,max} = 450 \text{ mm}$
Transverse reinforcement provided	10 dia.bars @ 150 c/c
Area of transverse reinforcement provided	$A_{bx,prov} = \pi \times \phi_{bx}^2 / (4 \times S_{bx}) = 524 \text{ mm}^2/\text{m}$

PASS - Area of reinforcement provided is greater than area of reinforcement required

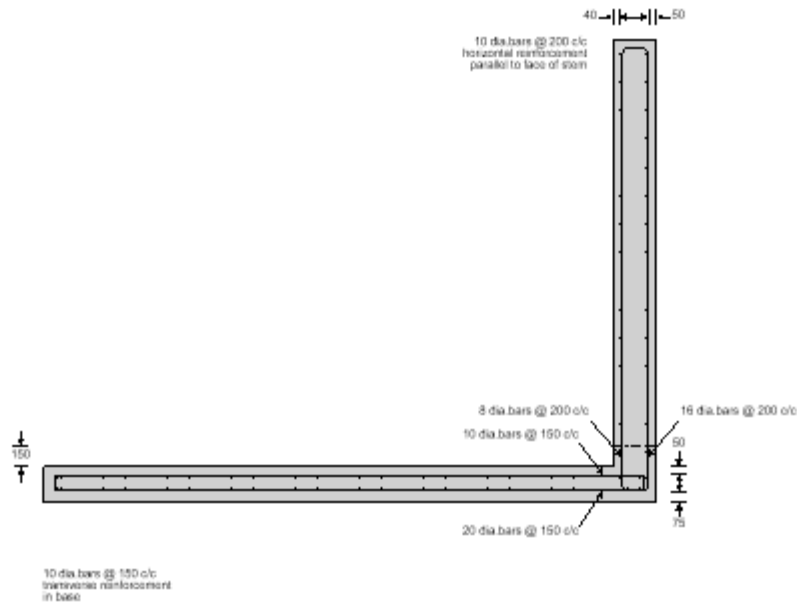

Reinforcement details



SYMMETRYS
STRUCTURAL / CIVIL ENGINEERS

Symmetry's Limited

Unit 6, The Courtyard
Lynton Road

Project		70 Lady Margaret Road		Job no.		22276	
Calcs for		Retaining Wall A		Start page no./Revision		9	
Calcs by	Calcs date	Checked by	Checked date	Approved by	Approved date		
KL	22/05/2023	EB	13/03/2023				

Large empty rectangular area for drawing or content.

