
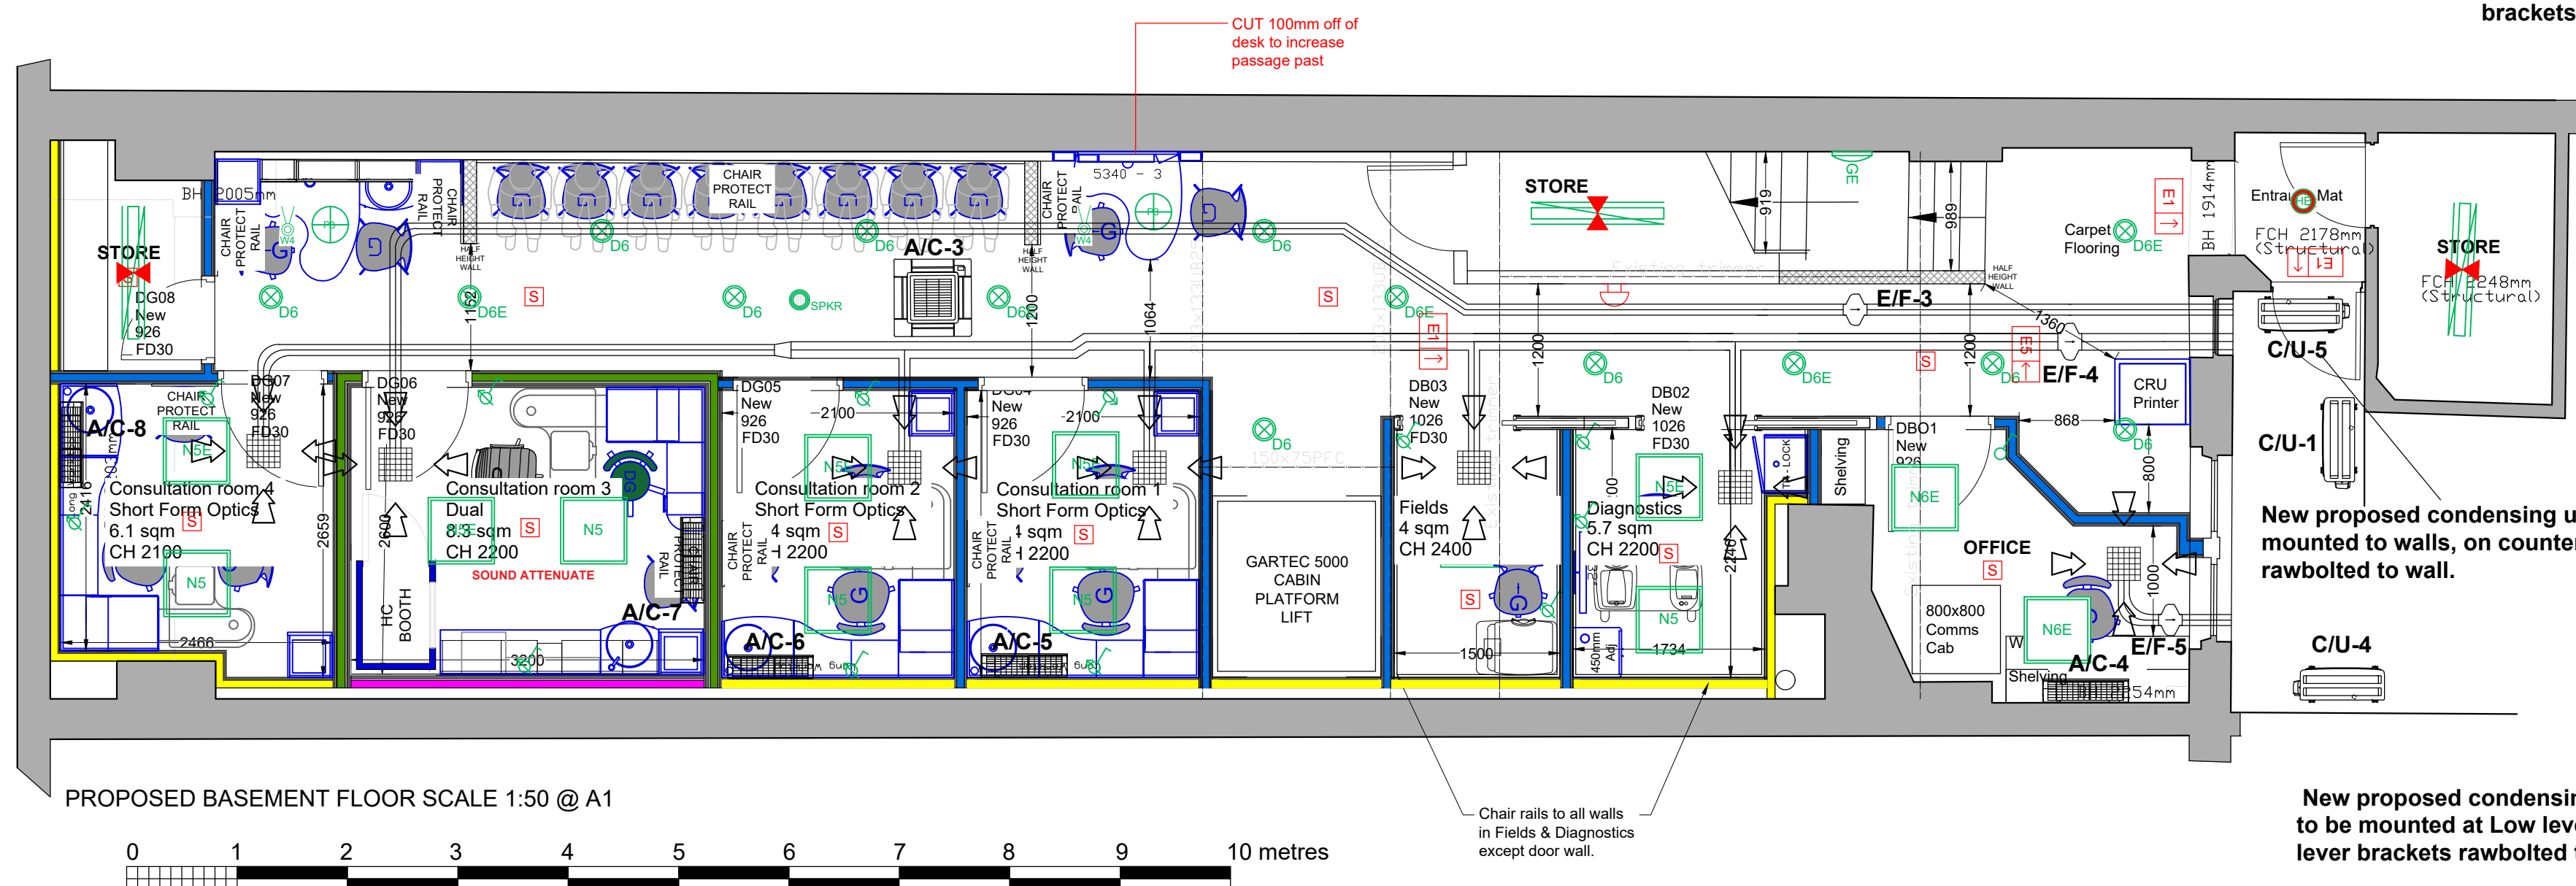


New Proposed Air Conditioning Schedule	
Daikin	Daikin
A/C-1 FCAG-100	A/C-3 FFA-60
Dimensions H246 x W840 x D840	Dimensions H260 x W575 x D575
Weight 34kg	Weight 17kg
C/U-1 RZASG-100	C/U-3 RXM-60
Dimensions H990 x W940 x D320	Dimensions H735 x W825 x D300
Weight 81kg	Weight 47kg
Max Fuse 32amp	Max Fuse 16amp
Sound Pressure 53dba max	Sound Pressure 48dba max
Daikin	Daikin
A/C-2.4 FTXM-25	A/C-5.6,7,8, FTXM-20
Dimensions H289 x W780 x D215	Dimensions H289 x W780 x D215
Weight 8kg	Weight 8kg
C/U-2.4 RXM-25	C/U-5 4MXM80
Dimensions H550 x W765 x D285	Dimensions H550 x W765 x D285
Weight 39kg	Weight 39kg
Max Fuse 10amp	Max Fuse 20amp
Sound Pressure 46dba max	Sound Pressure 46dba max

New proposed condensing units
C/U-2&3 to be mounted at High level
below window, on counter lever
brackets rawbolted to wall.



PHOTO - AS Existing

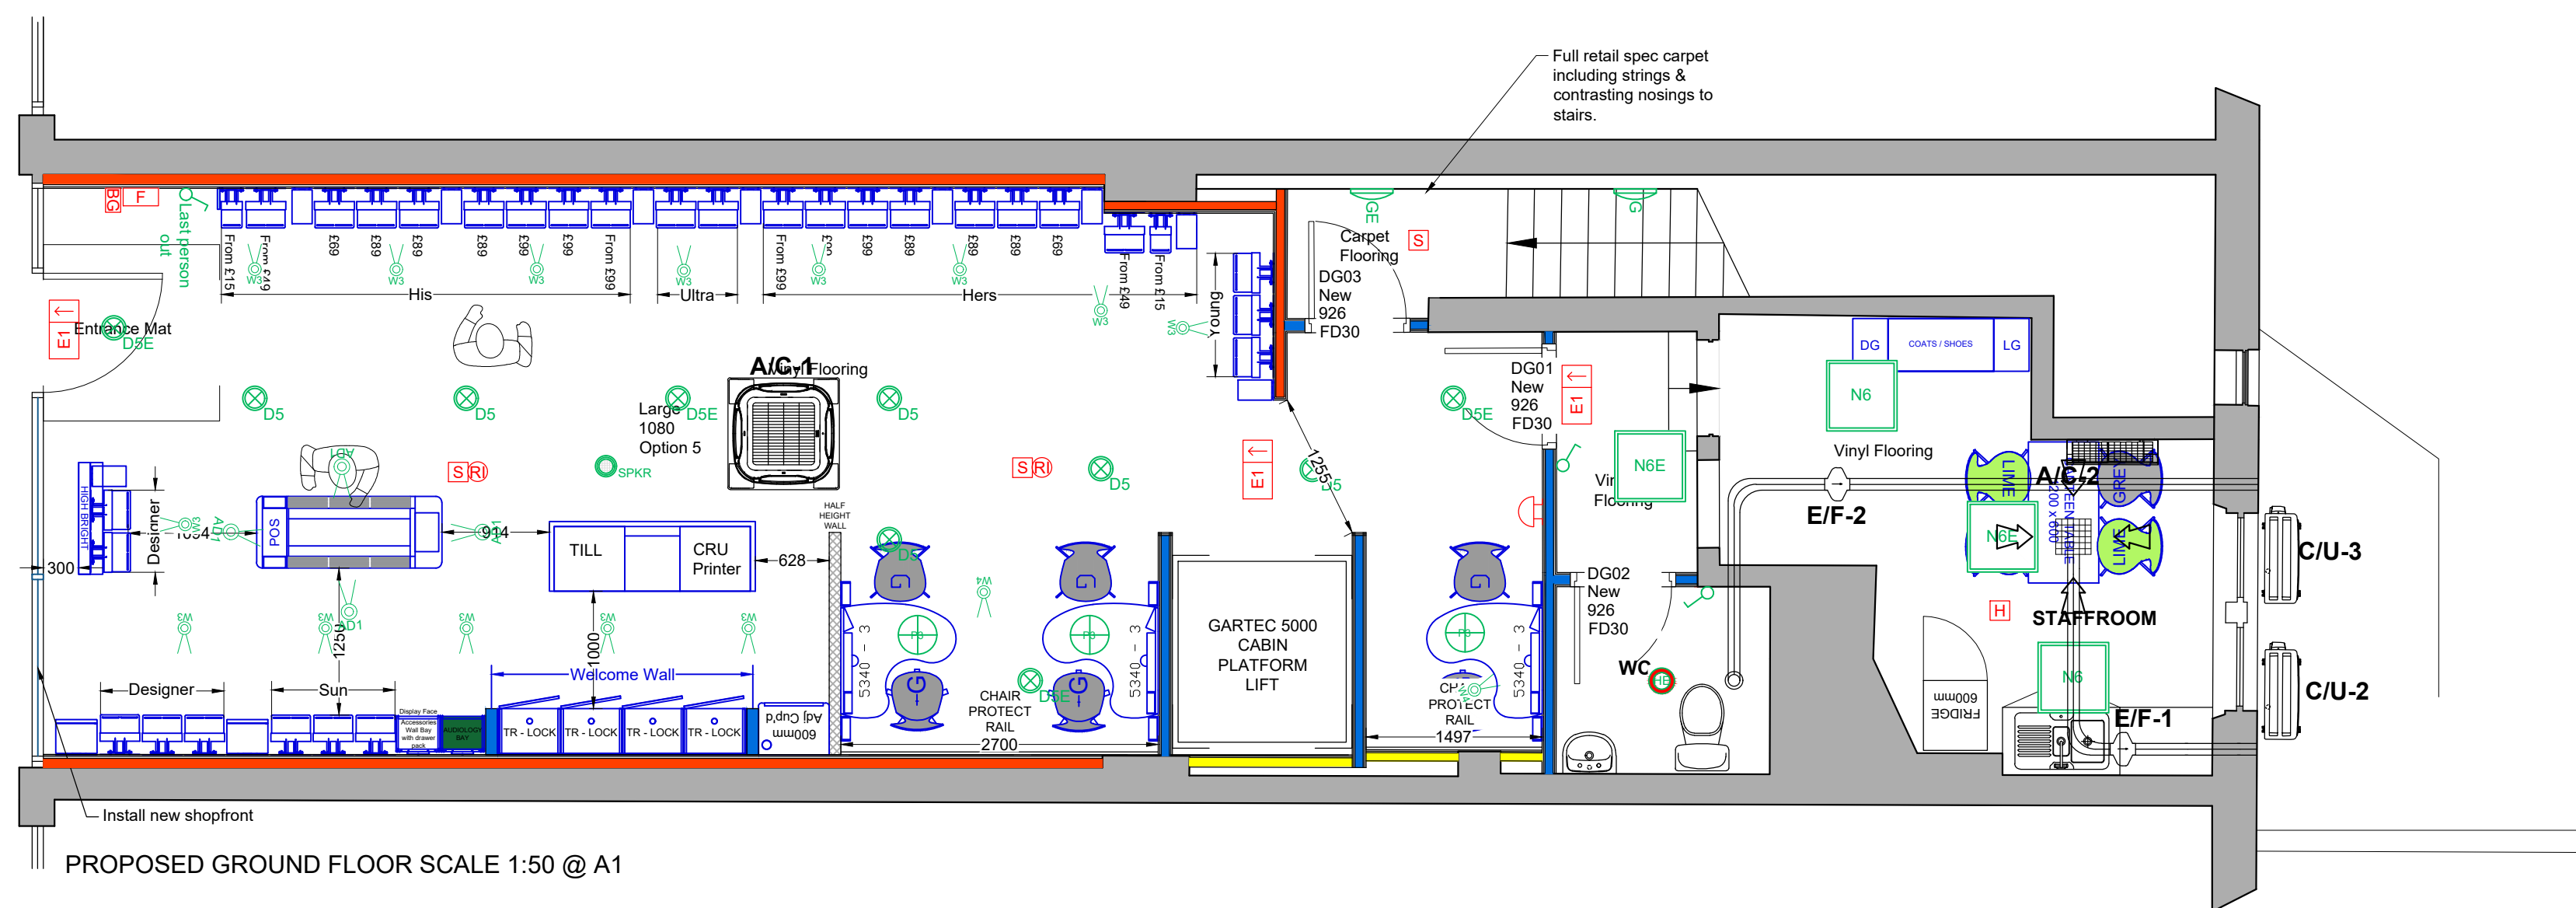

**New proposed condensing units
C/U-2&3 to be mounted at High level
below window, on counter lever
brackets rawbolted to wall.**

New proposed condensing units C/U-1&5 to be mounted to walls, on counter lever brackets rawbolted to wall.

New proposed condensing units C/U-4 to be mounted at Low level, on counter lever brackets rawbolted to wall. Under Staircase

C/U-1 C/U-4 & C/U-5 are located down steps below ground level (see photo) so are not visible from street level. There were previous AC Condenser units located here (X3 Units) but were removed when the previous tenant vacated

[illegible]

NOTES

E/F-1 100mm Fan General Extract
E/F-2 100mm Fan WC Extract
E/F-3 100mm Fan General Extract
E/F-4 150mm Fan General Extract
E/F-5 100mm Fan General Extract



Acorn House, 1 Old Taunton Road,
Bridgwater Somerset TA6 3NY
T 01278 426601 F 01278 426602
www.slairconditioning.co.uk

HEAT PUMPS & VENTILATION
OFFICES,SHOPS & RESTURANTS
DESIGN & INSTALLATION
SERVICE & MAINTENANCE

CLIENT	Specsavers Optical Superstores Cirrus House 10 Experian Way Nottingham NG2 1EP
--------	---

JOB TITLE
Specsavers Optical
194 West End Lane
West Hampstead
London
NW6 1SG

DRAWING TITLE

Proposed Air Conditioning & Ventilation

	DRAWN	SCALE	DATE
INITIAL	P.K	A11:50	23/05/23

DRAWING NUMBER
Q-3896

REV
A