


A.8.5 NOISE CRITERIA CURVES


A.8.5.1 R32 type

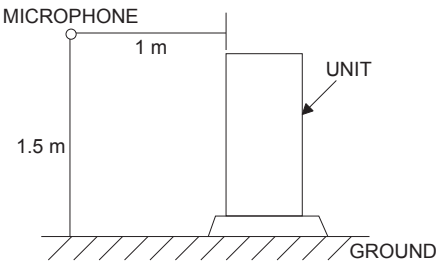

- <Notes>
- 1) Sound data is taken when the system is running stably.
 - 2) Relatively large noise could be heard transiently in the case 4-way valve, or LEV operates.


PUZ-ZM35VKA
PUZ-ZM50VKA

MODE	SPL(dB)	LINE
COOLING	44	○—○
HEATING	46	●—●

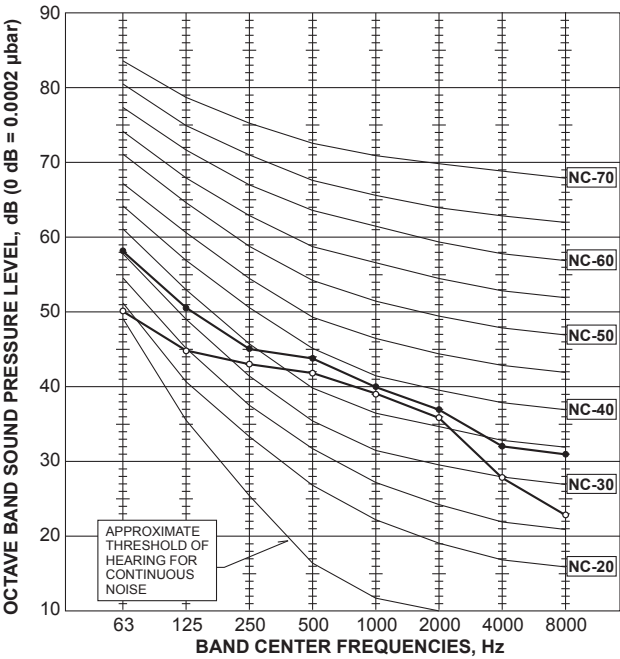


PUZ-ZM60VHA
PUZ-ZM71VHA

MODE	SPL(dB)	LINE
COOLING	47	○—○
HEATING	49	●—●

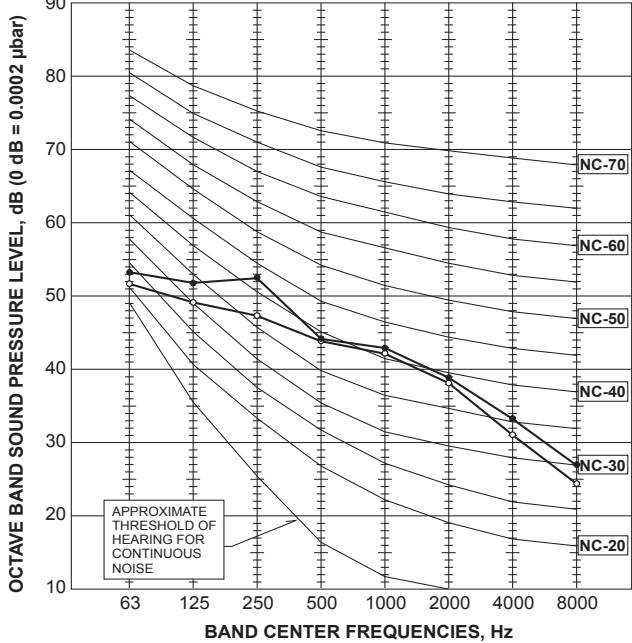

PUZ-ZM100VKA
PUZ-ZM100YKA

MODE	SPL(dB)	LINE
COOLING	49	○—○
HEATING	51	●—●

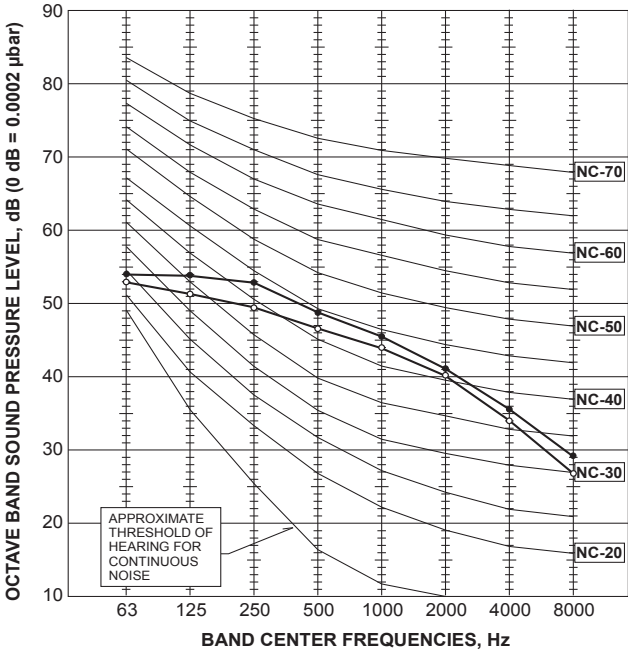

PUZ-ZM125VKA
PUZ-ZM140VKA
PUZ-ZM125YKA
PUZ-ZM140YKA

MODE	SPL(dB)	LINE
COOLING	50	○—○
HEATING	52	●—●

