
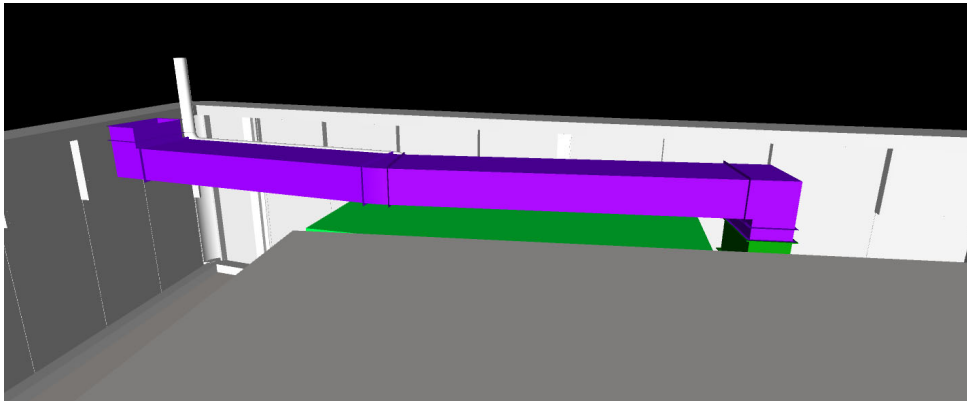


- Generator Flue to terminate 1m above Plantscreen/parapet
- AHU RF.01-WC-East exhaust ductwork relocated – now alongside generator flue
- AHU RF.01-WC-East intake ductwork relocated to maintain 10m separation from exhaust positions
- Suitable cowl/mesh detail shall be provided to intake/exhaust openings during detailed design

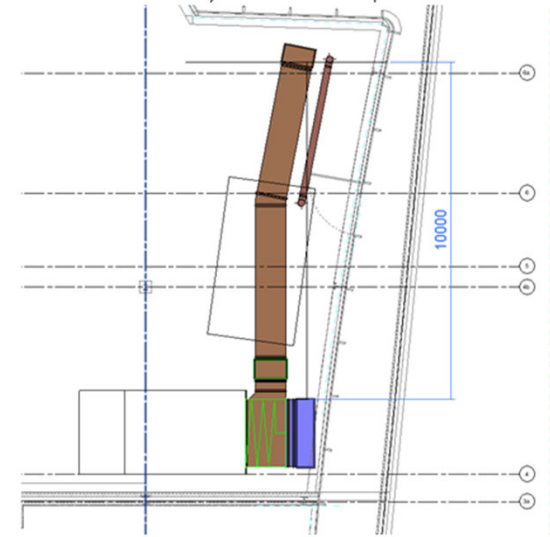

The Network Building  
Level 08 Plant Area – Generator Flue positioning  
ESG/SKE/010823