

Cross Section 2769719

1. The position of the apparatus shown on this drawing is believed to be correct but the original landmarks may have been altered since the apparatus was installed.
2. The exact position of the apparatus should be verified - use approved cable avoidance tools prior to excavation using suitable hand tools.
3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact location of all the cables have been determined.
4. It must be assumed that there is a service cable into each property, lamp column and street sign, etc.
5. All cables must be treated as being live unless proved otherwise by UK Power Networks.
6. The information proved must be given to all people working near UK Power Networks plant and equipment. Do not use plans more than 3 months after the issue date for excavation purposes.
7. Please be aware that electric cables/lines belonging to other owners of licensed electricity distribution systems may be present and it is your responsibility to identify their location.

may

1. UK Power Networks does not warrant that the information provided to you is correct.

You rely upon it at your own risk.

You rely upon it at your own risk.

2. UK Power Networks does not exclude or limit its liability if it causes the death of any persons or causes personal injury to a person.

3. Subject to paragraph 2 UK Power Networks has no liability to you in contract, in tort (including negligence), for breach of statutory duty or otherwise for any loss, damage, cost, claims, demands, or expenses that you or any timf party may suffer or incur as a result of using the information provided whether for physical damage to property or for any economic loss (including without limitation loss of profit, loss of opportunity, loss of savings, loss of goodwill, loss of business, loss of use) or any special or consequential loss or damage whatsoever.

4. This plan has been provided to you on the basis of the terms of use set out in the covering letter that accompanies this plan. If you do not accept and/or do not understand the terms of use set out in the covering letter you must not use the plan and must return it to the sender of the letter.


5. You are responsible for the security of the information provided to you. It must not we give the plan and available upon payment of a fee to a third party.

IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY



ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6

wheps produced at 1:7500 scale are Geo-Schematics which show LV mains cables and overhead lines (in some cases all voltages). Prior to carrying out excavelions you must refer to the 1:500 records to determine the location of all known underground plant and equipment.

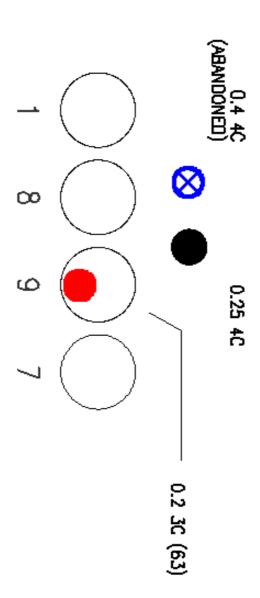

1. The position of the apparatus shown on this drawing is believed to be correct but the original landmarks may have been altered since the apparatus was installed.

2. The exact position of the apparatus should be verified - use approved cable avoidance tools prior to excavation using suitable hand tools.

3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact location of all the cables have been determined.

4. It must be assumed that there is a service cable into each property, lamp column and street sign, etc.

5. All cables must be treated as being live unless proved otherwise by UIK Power Networks.

6. The information proved must be given to all people working near UK Power Networks plant and equipment. Do not use plans more than 3 months after the issue date for excavation purposes.

7. Please be aware that electric cables/lines belonging to other owners of licensed electricity distribution systems may be present and it is your responsibility to identify their location.

Luk rewards worked to you is correct.

You rely upon it always on risk.

2. UK Power Nayworks near no leading or limit its liability if it causes the death of any persons or causes general near the person.

3. Subject to pare again to the rower Networks has no liability to you in contract, in tort income the persons of causes general near the person.

3. Subject to pare again to the rower Networks has no liability to you in contract, in tort persons of persons the persons of the persons of


IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY



ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6

wheps produced at 1:7500 scale are Geo-Schematics which show LV mains cables and overhead lines (in some cases all voltages). Prior to carrying out excavelions you must refer to the 1:500 records to determine the location of all known underground plant and equipment.

Reproduced by permission of Ordnance Survey on behalf of HMSD. © Crown copyright and database rights 2017. All rights reserved. Ordnance Survey licence numbers 100019826, 100019826 and 100019430. Data has been added to the Ordnance Survey base map; all proprietary rights in such additional data are and shall remain the exclusive property of © London Power Networks pic or Eastern Power Networks pic each being a distribution licensee under section 6(1)(c) of the Electricity Act 1889 for the relevant distribution services area as that term is defined in such licensee sistribution license. All rights in such data research of the second of the

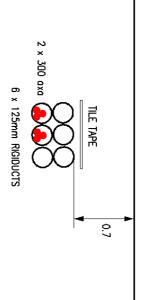

Cross Section 8373329

1. The position of the apparatus shown on this drawing is believed to be correct but the original landmarks may have been altered since the apparatus was installed.
2. The exact position of the apparatus should be verified - use approved cable avoidance tools prior to excavation using suitable hand tools.
3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact location of all the cables have been determined.
4. It must be assumed that there is a service cable into each property, lamp column and street sign, etc.
5. All cables must be treated as being live unless proved otherwise by UK Power Networks.
6. The information proved must be given to all people working near UK Power Networks plant and equipment. Do not use plans more than 3 months after the issue date for excavation purposes.
7. Please be aware that electric cables/lines belonging to other owners of licensed electricity distribution systems may be present and it is your responsibility to identify their location.

may

1. UK Power Networks does not warrant that the information provided to you is correct.

You rely upon it at your own risk.

You rely upon it at your own risk.

2. UK Power Networks does not exclude or limit its liability if it causes the death of any persons or causes personal injury to a person.


3. Subject to paragraph 2 UK Power Networks has no liability to you in contract, in tort (including negligence), for breach of statutory duty or otherwise for any loss, damage, cost, claims, demands, or expenses that you or any timf party may suffer or incur as a result of using the information provided whether for physical damage to property or for any economic loss (including without limitation loss of profit, loss of opportunity, loss of savings, loss of goodwill, loss of business, loss of use) or any special or consequential loss or damage whatsoever.

4. This plan has been provided to you on the basis of the terms of use set out in the covering letter that accompanies this plan. If you do not accept and/or do not understand the terms of use set out in the covering letter you must not use the plan and must return it to the sender of the letter.

5. You are responsible for the security of the information provided to you. It must not we give the plan and available upon payment of a fee to a third party.

IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY Power Networks -

ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6

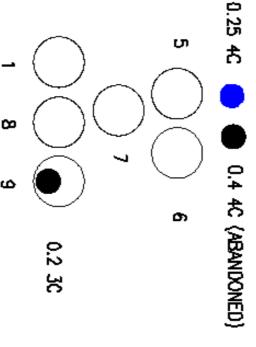

1. The position of the apparatus shown on this drawing is believed to be correct but the original landmarks may have been altered since the apparatus was installed.

2. The exact position of the apparatus should be verified - use approved cable avoidance tools prior to excavation using suitable hand tools.

3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact location of all the cables have been determined.

4. It must be assumed that there is a service cable into each property, lamp column and street sign, etc.

5. All cables must be treated as being live unless proved otherwise by UIK Power Networks.

6. The information proved must be given to all people working near UK Power Networks plant and equipment. Do not use plans more than 3 months after the issue date for excavation purposes.

7. Please be aware that electric cables/lines belonging to other owners of licensed electricity distribution systems may be present and it is your responsibility to identify their location.

. Un power viewers does not wanted at the information provided to you is correct.

ation 2. UK Fower regions to the person.

Subject to paragraph 2 UK Fower helworks has no liability if it causes the death of any persons or causes a personal muly unaperson.

Subject to paragraph 2 UK Fower helworks has no liability to you in contract, in tort including negligence), for breach of statutory duty or otherwise for any loss, damage, cost, claims, demands, or expenses that you or any third party may suffer or incur as a result of using the information provided whether for physical damage to property or for any economic loss (including without limitation loss of physical damage to property or for any economic loss including without limitation loss of physical damage to property or for savings, loss of goodwill, loss of business, loss of use) or any special or consequential terms. One seem provided to you on the basis of the terms of use set out in the covering letter that accompanies this plan. If you do not accept and/or do not understand the terms of use set out in the covering letter you must not use the plan and must return it to the sender of the letter.


So you are responsible for the security of the information provided to you. It must not we give the plan and available upon payment of a fee to a third party.

IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY



ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6

wheps produced at 1:7500 scale are Geo-Schematics which show LV mains cables and overhead lines (in some cases all voltages). Prior to carrying out excavelions you must refer to the 1:500 records to determine the location of all known underground plant and equipment.

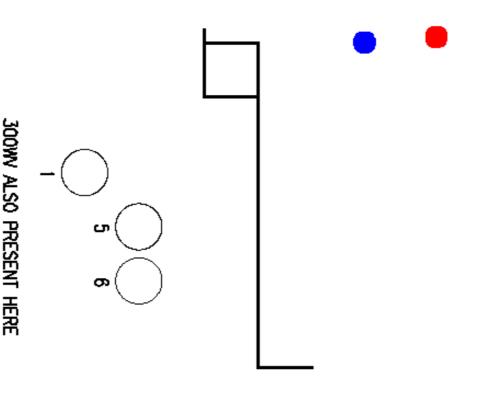

1. The position of the apparatus shown on this drawing is believed to be correct but the original landmarks may have been altered since the apparatus was installed.

2. The exact position of the apparatus should be verified - use approved cable avoidance tools prior to excavation using suitable hand tools.

3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact location of all the cables have been determined.

4. It must be assumed that there is a service cable into each property, lamp collumn and street sign, etc.

5. All cables must be treated as being live unless proved otherwise by UK Power Networks.

6. The information proved must be given to all people working near UK Power Networks plant and equipment. Do not use plans more than 3 months after the issue date for excavation purposes.

7. Please be aware that electric cables/lines belonging to other owners of licensed electricity distribution systems may be present and it is your responsibility to identify their location.

may 1. UK Power Networks between twa-tract traction provided to you is correct.

If you rely upon it atyou councils.

You rely upon it atyou councils.

Our rely upon it atyou councils.

If you do not access the death of any persons or causes personal mile you have not liability to you in contract, in tort in your councils.

If you do not access for any loss, damage, you could not greatly any suffer or incur as a cost, claims, demands, or expenses that you or any third party may suffer or incur as a result of using the information provided whether for physical damage to property of for any economic loss (including without limitation loss of profit, loss of opportunity, loss of any economic loss of including without limitation loss of profit, loss of opportunity, loss of any economic loss (including without limitation loss of profit, loss of opportunity, loss of any economic loss of goodwill, loss of business, loss of use for any special or consequential loss or damage whatsoever.

4. This plan has been provided to you on the basis of the terms of use set out in the covering letter that accompanies this plan. If you do not accept and/or do not understand the terms of use set out in the covering letter you must not use the plan and must return it to the sender of the letter.


5. You are responsible for the security of the information provided to you. It must not were given and available upon payment of a fee to a third party.

IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY



ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6

wheps produced at 1:7500 scale are Geo-Schematics which show LV mains cables and overhead lines (in some cases all voltages). Prior to carrying out excavelions you must refer to the 1:500 records to determine the location of all known underground plant and equipment.

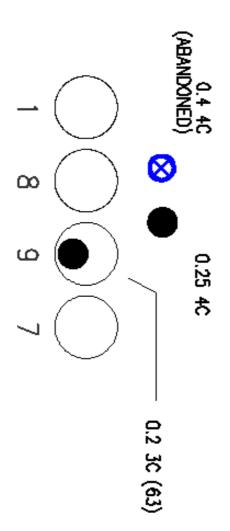

1. The position of the apparatus shown on this drawing is believed to be correct but the original landmarks may have been altered since the apparatus was installed.

2. The exact position of the apparatus should be verified - use approved cable avoidance tools prior to excavation using suitable hand tools.

3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact location of all the cables have been determined.

4. It must be assumed that there is a service cable into each property, lamp column and street sign, etc.

5. All cables must be treated as being live unless proved otherwise by UIK Power Networks.

6. The information proved must be given to all people working near UK Power Networks plant and equipment. Do not use plans more than 3 months after the issue date for excavation purposes.

7. Please be aware that electric cables/lines belonging to other owners of licensed electricity distribution systems may be present and it is your responsibility to identify their location.

Luk Personation provided to you is correct.

You rely upon it always or six.

2. UK Power Nayworks near not be close or limit its liability if it causes the death of any persons or causes general near the person.

3. Subject to pare again 2 the rower Networks has no liability to you in contract, in tort income on the persons of causes general near the person.

3. Subject to pare again 2 the rower Networks has no liability to you in contract, in tort persons of persons of the person


IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY



ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6



wheps produced at 1:7500 scale are Geo-Schematics which show LV mains cables and overhead lines (in some cases all voltages). Prior to carrying out excavelions you must refer to the 1:500 records to determine the location of all known underground plant and equipment.



1. The position of the apparatus shown on this drawing is believed to be correct but the original landmarks may have been altered since the apparatus was installed.
2. The exact position of the apparatus should be verified - use approved cable avoidance tools prior to excavation using suitable hand tools.
3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact location of all the cables have been determined.
4. It must be assumed that there is a service cable into each property, lamp column and street sign, etc.
5. All cables must be treated as being live unless proved otherwise by UK Power Networks.
6. The information proved must be given to all people working near UK Power Networks plant and equipment. Do not use plans more than 3 months after the issue date for excavation purposes.
7. Please be aware that electric cables/lines belonging to other owners of licensed electricity distribution systems may be present and it is your responsibility to identify their location.

may

1. UK Power Networks does not warrant that the information provided to you is correct.

You rely upon it at your own risk.

You rely upon it at your own risk.

2. UK Power Networks does not exclude or limit its liability if it causes the death of any persons or causes personal injury to a person.

3. Subject to paragraph 2 UK Power Networks has no liability to you in contract, in tort (including negligence), for breach of statutory duty or otherwise for any loss, damage, cost, claims, demands, or expenses that you or any timf party may suffer or incur as a result of using the information provided whether for physical damage to property or for any economic loss (including without limitation loss of profit, loss of opportunity, loss of savings, loss of goodwill, loss of business, loss of use) or any special or consequential loss or damage whatsoever.


4. This plan has been provided to you on the basis of the terms of use set out in the covering letter that accompanies this plan. If you do not accept and/or do not understand the terms of use set out in the covering letter you must not use the plan and must return it to the sender of the letter.

5. You are responsible for the security of the information provided to you. It must not we give the plan and available upon payment of a fee to a third party.

IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY



ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6



1. The position of the apparatus shown on this drawing is believed to be correct but the original landmarks may have been altered since the apparatus was installed.
2. The exact position of the apparatus should be verified - use approved cable avoidance tools prior to excavation using suitable hand tools.
3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact location of all the cables have been determined.
4. It must be assumed that there is a service cable into each property, lamp column and street sign, etc.
5. All cables must be treated as being live unless proved otherwise by UK Power Networks.
6. The information proved must be given to all people working near UK Power Networks plant and equipment. Do not use plans more than 3 months after the issue date for excavation purposes.
7. Please be aware that electric cables/lines belonging to other owners of licensed electricity distribution systems may be present and it is your responsibility to identify their location.

. UK Power Networks does not warrant that the information provided to you is correct.

ation 2. UK Power Networks does not exclude or limit its liability if it causes the death of any persons or causes personal injury to a person.

3. Subject to paragraph 2 UK Power Networks has no liability to you in contract, in tort including negligence), for breach of statutory duty or or therewise for any loss, damage, cost, claims, demands, or expenses that you or any third party may suffer or incur as a result of using the information provided whether for physical damage to property or for any economic loss (including without limitation loss of physical damage to property or for any economic loss including without limitation loss of physical damage to property or for savings, loss of goodwill, loss of business, loss of use) or any special or consequential terms. Oss of reprovided to you on the basis of the terms of use set out in the covering letter that accompanies this plan. If you do not accept and/or do not understand the terms of use set out in the covering letter to the sender of the letter.

5. You are responsible for the security of the information provided to you. It must not we give the plan and available upon payment of a fee to a third party.

IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY



ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6



1. The position of the apparatus shown on this drawing is believed to be correct but the original landmarks may have been altered since the apparatus was installed.
2. The exact position of the apparatus should be verified - use approved cable avoidance tools prior to excavation using suitable hand tools.
3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact location of all the cables have been determined.
4. It must be assumed that there is a service cable into each property, lamp column and street sign, etc.
5. All cables must be treated as being live unless proved otherwise by UK Power Networks.
6. The information proved must be given to all people working near UK Power Networks plant and equipment. Do not use plans more than 3 months after the issue date for excavation purposes.
7. Please be aware that electric cables/lines belonging to other owners of licensed electricity distribution systems may be present and it is your responsibility to identify their location.

1. UK Power Networks does not warrant that the information provided to you is correct.

You rely upon it at your own risk.

2. UK Power Networks does not exclude or limit its liability if it causes the death of any persons of the provided to a person.

3. Subject to paragraph 2 UK Power Networks has no liability to you in contract, in tort including negligence), for breach of statutory duty or otherwise for any loss, damage, cost, claims, demands, or expenses that you or any third party may suffer or incur as a result of using the information provided whether for physical damage to property or for any economic loss (including without limitation loss of profit, loss of opportunity, loss of savings, loss of goodwill, loss of business, loss of orany special or consequential loss or damage whatsoever.

4. This plan has been provided to you on the basis of the terms of use set out in the covering letter that accompanies this plan. If you do not accept and/or do not understand the terms of use set out in the covering letter that accompanies his plan. If you do not accept and/or do not understand the terms of use set out in the security of the information provided to you. It must not were given, sold or made available upon payment of a fee to a third party.


**Photograph 2 UK Power Networks has no liability to you in contract, in tort of the letter.

5. You are responsible for the security of the information provided to you. It must not were given and available upon payment of a fee to a third party.

IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY



ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6



1. The position of the apparatus shown on this drawing is believed to be correct but the original landmarks may have been altered since the apparatus was installed.
2. The exact position of the apparatus should be verified - use approved cable avoidance tools prior to excavation using suitable hand tools.
3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact location of all the cables have been determined.
4. It must be assumed that there is a service cable into each property, lamp column and street sign, etc.
5. All cables must be treated as being live unless proved otherwise by UK Power Networks.
6. The information proved must be given to all people working near UK Power Networks plant and equipment. Do not use plans more than 3 months after the issue date for excavation purposes.
7. Please be aware that electric cables/lines belonging to other owners of licensed electricity distribution systems may be present and it is your responsibility to identify their location.

may

1. UK Power Networks does not warrant that the information provided to you is correct.

You rely upon it at your own risk.

You rely upon it at your own risk.

2. UK Power Networks does not exclude or limit its liability if it causes the death of any persons or causes personal injury to a person.

3. Subject to paragraph 2 UK Power Networks has no liability to you in contract, in tort (including negligence), for breach of statutory duty or otherwise for any loss, damage, cost, claims, demands, or expenses that you or any timf party may suffer or incur as a result of using the information provided whether for physical damage to property or for any economic loss (including without limitation loss of profit, loss of opportunity, loss of savings, loss of goodwill, loss of business, loss of use) or any special or consequential loss or damage whatsoever.

4. This plan has been provided to you on the basis of the terms of use set out in the covering letter that accompanies this plan. If you do not accept and/or do not understand the terms of use set out in the covering letter you must not use the plan and must return it to the sender of the letter.


5. You are responsible for the security of the information provided to you. It must not we give the plan and available upon payment of a fee to a third party.

IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY



ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6

wheps produced at 1:7500 scale are Geo-Schematics which show LV mains cables and overhead lines (in some cases all voltages). Prior to carrying out excavelions you must refer to the 1:500 records to determine the location of all known underground plant and equipment.



1. UK Power Networks does not warrant that the information provided to you is correct.

You rely upon it at your own risk.

2. UK Power Networks does not exclude or limit its liability if it causes the death of any persons.

Between the works does not exclude or limit its liability to you in contract, in tert finduling negligence; not exclude or statutory duty or otherwise for any loss, damage, cost, claims, demands, or expenses that you or any timp party may suffer or incur as a result or using the information provided whether for physical damage to property or for any economic loss (including without limitation loss of profit, loss of opportunity, loss of savings, loss of goodwill, loss of business, loss of use) or any special or consequential loss or damage whatsoever, loss of use of the terms of use set out in the covering letter that accompanies this plan. If you do not accept and/or do not understand the terms of use set out in the security of the information provided to you. It must not we given, sold or made available upon payment of a fee to a third party.

**Market Country of the information provided to you. It must not we give the control of the security of the information provided to you. It was to we give the control of the terms of use and must return it to the sender of the letter.

**Subject to paragraph 2 UK Power Networks has not liability to you in control of the letter.

**Subject to paragraph 2 UK Power Networks has not liability to you in control or any provided to you in control or any provided to you in control or any provided to you on the basis of the terms of use set out in the covering letter that accompanies this plan. If you do not accept and/or do not understand the terms of use set out in the security of the information provided to you. It must not we will be given, sold or made available upon payment of a fee to a third party.


IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY



ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6

wheps produced at 1:7500 scale are Geo-Schematics which show LV mains cables and overhead lines (in some cases all voltages). Prior to carrying out excavelions you must refer to the 1:500 records to determine the location of all known underground plant and equipment.

^{1.} The position of the apparatus shown on this drawing is believed to be correct but the original landmarks may have been altered since the apparatus was installed.
2. The exact position of the apparatus should be verified - use approved cable avoidance tools prior to excavation using suitable hand tools.
3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact location of all the cables have been determined.
4. It must be assumed that there is a service cable into each property, lamp column and street sign, etc.
5. All cables must be treated as being live unless proved otherwise by UK Power Networks.
6. The information proved must be given to all people working near UK Power Networks plant and equipment. Do not use plans more than 3 months after the issue date for excavation purposes.
7. Please be aware that electric cables/lines belonging to other owners of licensed electricity distribution systems may be present and it is your responsibility to identify their location.

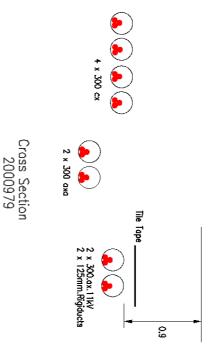

1. The position of the apparatus shown on this drawing is believed to be correct but the original landmarks may have been altered since the apparatus was installed.
2. The exact position of the apparatus should be verified - use approved cable avoidance tools prior to excavation using suitable hand tools.
3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact location of all the cables have been determined.
4. It must be assumed that there is a service cable into each property, lamp column and street sign, etc.
5. All cables must be treated as being live unless proved otherwise by UK Power Networks.
6. The information proved must be given to all people working near UK Power Networks plant and equipment. Do not use plans more than 3 months after the issue date for excavation purposes.
7. Please be aware that electric cables/lines belonging to other owners of licensed electricity distribution systems may be present and it is your responsibility to identify their location.

1. UK Power Networks does not warrant that the information provided to you is correct.

You rely upon it at your own risk.

2. UK Power Networks does not exclude or limit its liability if it causes the death of any persons.

Between the works does not exclude or limit its liability to you in contract, in tert finduling negligence; not exclude or statutory duty or otherwise for any loss, damage, cost, claims, demands, or expenses that you or any timp party may suffer or incur as a result or using the information provided whether for physical damage to property or for any economic loss (including without limitation loss of profit, loss of opportunity, loss of savings, loss of goodwill, loss of business, loss of use) or any special or consequential loss or damage whatsoever, loss of use of the terms of use set out in the covering letter that accompanies this plan. If you do not accept and/or do not understand the terms of use set out in the security of the information provided to you. It must not we given, sold or made available upon payment of a fee to a third party.

**Market Country of the information provided to you. It must not we give the control of the security of the information provided to you. It was to we give the control of the terms of use and must return it to the sender of the letter.

**Subject to paragraph 2 UK Power Networks has not liability to you in control of the letter.


**Subject to paragraph 2 UK Power Networks has not liability to you in control or any provided to you in control or any provided to you in control or any provided to you on the basis of the terms of use set out in the covering letter that accompanies this plan. If you do not accept and/or do not understand the terms of use set out in the security of the information provided to you. It must not we will be given, sold or made available upon payment of a fee to a third party.

IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY



ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6

wheps produced at 1:7500 scale are Geo-Schematics which show LV mains cables and overhead lines (in some cases all voltages). Prior to carrying out excavelions you must refer to the 1:500 records to determine the location of all known underground plant and equipment.

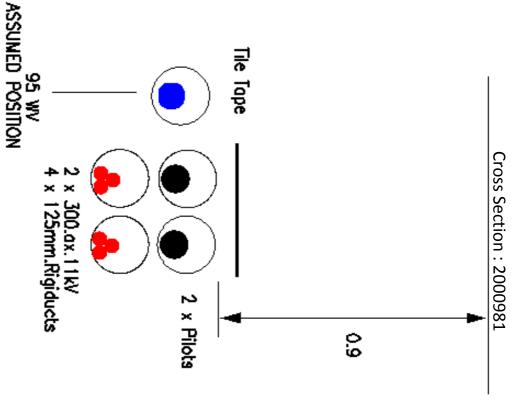

1. The position of the apparatus shown on this drawing is believed to be correct but the original landmarks have been altered since the apparatus was installed.

2. The exact position of the apparatus should be verified - use approved cable avoidance tools prior to excavation that their information provided to you is correct.

3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact position of all the cables have been determined.

3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact position of all the cables have been determined.

3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact position of all the cables have been determined.

3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact position of the exact You rely upon it atyour own risk.

It is the provided the protest of the lability if it causes the death of any promise of the provided by a person.

It is the provided by a person of the provided by a person of the provided by a person.

Including negligencel, for breach of statubury duty or otherwise for any loss, damage, cost, claims, demands, or expenses that you or any third party may suffer or incur as a result of using the information provided whether for physical damage to property or for any economic loss (including without limitation loss of profit, loss of opportunity, loss of any economic loss of including without limitation loss of profit, loss of opportunity, loss of any economic loss of including without limitation loss of profit, loss of opportunity, loss of any economic loss of goodwill, loss of business, loss of use or any special or consequential loss or damage whatsoever.


4. This plan has been provided to you on the basis of the terms of use set out in the covering letter that accompanies this plan. If you do not accept and/or do not understand the terms of use set out in the covering letter that accompanies this plan. If you do not accept and/or do not understand the terms of use set out in the covering letter than the security of the information provided to you. It must not we may be a provided to you must not you must not you are responsible for the security of the information provided to you. It must not we give the plan and available upon payment of a fee to a third party.

IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY



ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6

wheps produced at 1:7500 scale are Geo-Schematics which show LV mains cables and overhead lines (in some cases all voltages). Prior to carrying out excavelions you must refer to the 1:500 records to determine the location of all known underground plant and equipment.

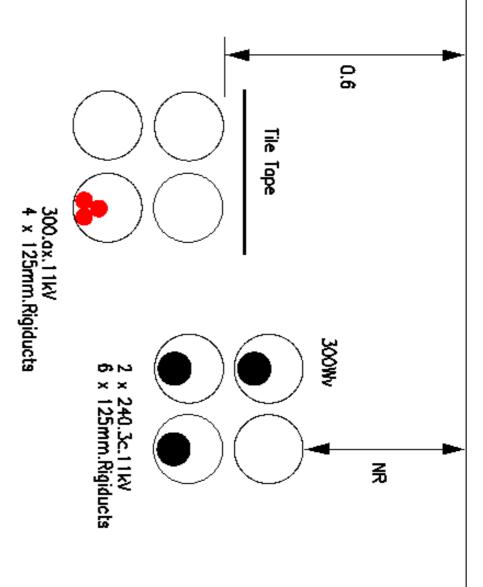


1. The position of the apparatus shown on this drawing is believed to be correct but the original landmarks real have been altered since the apparatus was installed.
2. The exact position of the apparatus should be verified - use approved cable avoidance tools prior to excavature.
3. It is essential that this holes are carefully made avoiding the use of mechanical tools or picks until the exact line cables have been determined.
4. It must be assumed that there is a service cable into each property, lamp column and street sign, etc.
5. All cables must be the table assumed that there is a service cable into each property, lamp column and street sign, etc.
6. The information proved must be given to all people working near UK Power Networks plant and equipment. Do avoided whether for physical damage to property or for or savings, loss of groowill, loss of business, loss of profit, loss of profit loss (including without initiation provided to you do not accept and/or do not under stand the terms

IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY



ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6

wheps produced at 1.7500 scale are Geo-Schematics which show LV mains cables and overhead lines (in some cases all voltages). Prior to carrying out excavelions you must refer to the 1.500 records to determine the location of all known underground plant and equipment.

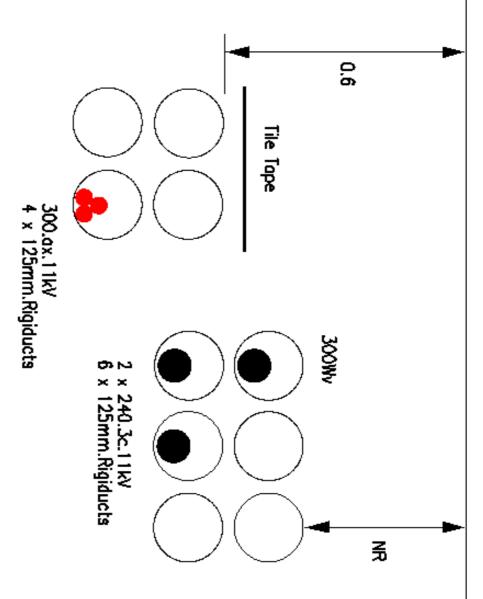

1. The position of the apparatus shown on this drawing is believed to be correct but the original landmarks may have been altered since the apparatus was installed.

2. The exact position of the apparatus was installed.

3. It is essential that the paratus should be verified - use approved cable avoidance tools prior to excavation of all the cables have been determined.

3. It is essential that there is a service cable into each property, lamp column and street sign, etc.

4. It must be assumed that there is a service cable into each property, lamp column and street sign, etc.

5. All cables must be treated as being live unless proved otherwise by UK Power Networks. Plant and equipment. Do not use plans more than 3 months after the issue date for excavation purposes.

7. Please be aware that electric cables? lines belonging to other owners of licensed electricity distribution systems.

8. The position of the apparatus should be verified - use approved cable avoidance tools prior to excavation for the excavation for the exact line that there is a service cable into each property, lamp column and street sign, etc.

6. The information proved must be given to all people working near UK Power Networks plant and equipment. Do savings, loss of goodwill, loss of profit, loss of poportunity, loss of surface and it is your responsibility to identify their location.

8. It is essential that the exact likely to you in contract, in the covering letter you must not use the attribution systems of use set out in the covering letter you must not use the plan and must feature.

9. This poportunity is a paparatus does not was person.

9. Subject to paragaph 2 UK Power Networks has no liability to you in contract, in the cases personal injury to a person.

9. Subject to paragaph 2 UK Power Networks has no liability to you in contract, in the cases personal injury to a person.

9. Subject to paragaph 2 UK Power Networks has no liability to you in contract, in the cases personal injury to a person.


9. Subject to paragaph 2 UK Power

IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY



ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6

wheps produced at 1.7500 scale are Geo-Schematics which show LV mains cables and overhead lines (in some cases all voltages). Prior to carrying out excavelions you must refer to the 1.500 records to determine the location of all known underground plant and equipment.

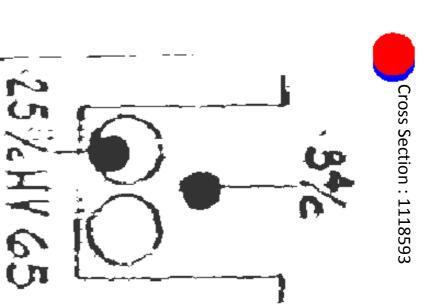

1. The position of the apparatus shown on this drawing is believed to be correct but the original landmarks may have been altered since the apparatus was installed.

2. The exact position of the apparatus should be verified - use approved cable avoidance tools prior to excavation using suitable hand tools.

3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact location of all the cables have been determined.

4. It must be assumed that there is a service cable into each property, lamp collumn and street sign, etc.

5. All cables must be treated as being live unless proved otherwise by UK Power Networks.

6. The information proved must be given to all people working near UK Power Networks plant and equipment. Do not use plans more than 3 months after the issue date for excavation purposes.

7. Please be aware that electric cables/lines belonging to other owners of licensed electricity distribution systems may be present and it is your responsibility to identify their location.

1. ex Pooler was a correct. The information provided to you is correct.

You rely upon it atyour warrisk

To urely upon it atyour warrisk

2. UK Powerl Networks die agrit would en rimit its liability to you in contract, in tert
persons or dauss person. In the person.

3. Subject to paragraph by the person.

3. Subject to paragraph by the person of the p


IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY



ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6

wheps produced at 1.7500 scale are Geo-Schematics which show LV mains cables and overhead lines (in some cases all voltages). Prior to carrying out excavelions you must refer to the 1.500 records to determine the location of all known underground plant and equipment.

Reproduced by permission of Ordnance Survey on behalf of HWSO. © Crown copyright and database rights 2017. All rights reserved. Ordnance Survey licence numbers 100019826, 100019826 and 100019450. Data has been added to the Ordnance Survey base map; all proprietary rights in such additional data are and shall remain the exclusive property of © London Power Networks pic or Eastern Power Networks pic or South Eastern Power Networks pic or South Eastern Power Networks pic each being a distribution licensee under sections (1)(c) of the Electricity Act 1889 for the relevant distribution services area as that term is defined in such licensee 3 distribution licensee. All rights in such data research of the second o

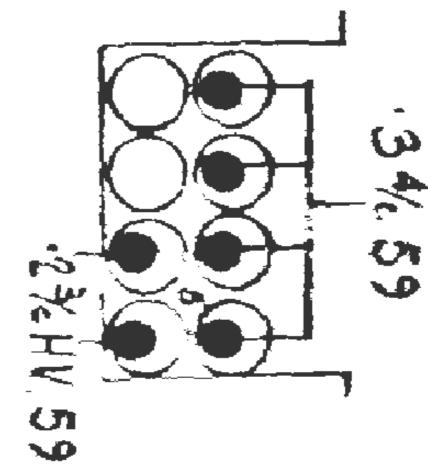

1. The position of the apparatus shown on this drawing is believed to be correct but the original landmarks may have been altered since the apparatus was installed.
2. The exact position of the apparatus should be verified - use approved cable avoidance tools prior to excavation using suitable hand tools.
3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact location of all the cables have been determined.
4. It must be assumed that there is a service cable into each property, lamp column and street sign, etc.
5. All cables must be treated as being live unless proved otherwise by UK Power Networks.
5. All cables must be treated as being live unless proved otherwise by UK Power Networks plant and equipment. Do not use plans more than 3 months after the issue date for excavation purposes.
7. Please be aware that electric cables/lines belonging to other owners of licensed electricity distribution systems may be present and it is your responsibility to identify their location.

You rely upon it at your own ri 2. UK Power Networks due no THE POWER NEW YORK AND THE THAT THAT THE INFORMATION Provided to you is correct.

You rely upon it at you channed.

2. UK Powerl Network Strille and the person.

2. UK Powerl Network Strille and the person.

Bersons or cluses person in the person.

3. Subject to paragraph 2 or Power Networks has no liability to you in contract, in tort including negligence), for breach of statutory duty or otherwise for any loss, damage, cost, claims, demands, or expenses that you or any third party may suffer or incur as a result or using the information provided whether for physical damage to property or for result of using the information provided whether for physical damage who property or for savings, loss of goodwill, loss of business, loss of use or any special or consequential loss or damage whatsoever.

4. This plan has been provided to you on the basis of the terms of use set out in the covering letter that accompanies this plan. If you do not accept and/or do not understand the terms of use set out in the security of the information provided to you. It must not set to be given, sold or made available upon payment of a fee to a third party.

**Mathematical Companies of the information provided to you. It must not well be given, sold or made available upon payment of a fee to a third party.


IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY



ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6

wheps produced at 1.2500 scale are Geo-Schematics which show LiV mains cables and overthead lines (in some cases all solitages). Prior to carrying out excave tions you must refer to the 1.500 records to determine the location of all known underground plant and equipment.

Reproduced by permission of Ordnance Survey on behalf of HWSO. © Crown copyright and database rights 2017. All rights reserved. Ordnance Survey licence numbers 100019826, 100019826 and 100019450. Data has been added to the Ordnance Survey base map; all proprietary rights in such additional data are and shall remain the exclusive property of © London Power Networks pic or Eastern Power Networks pic or South Eastern Power Networks pic or South Eastern Power Networks pic each being a distribution licensee under sections (1)(c) of the Electricity Act 1889 for the relevant distribution services area as that term is defined in such licensee 3 distribution licensee. All rights in such data research of the second o

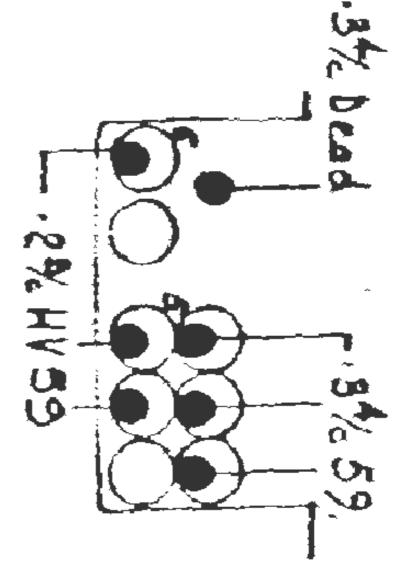

1. The position of the apparatus shown on this drawing is believed to be correct but the original landmarks may have been altered since the apparatus was installed.
2. The exact position of the apparatus should be verified - use approved cable avoidance tools prior to excavation using suitable hand tools.
3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact location of all the cables have been determined.
4. It must be assumed that there is a service cable into each property, lamp column and street sign, etc.
5. All cables must be treated as being live unless proved otherwise by UK Power Networks.
6. The information proved must be given to all people working near UK Power Networks plant and equipment. Do not use plans more than 3 months after the issue date for excavation purposes.
7. Please be aware that electric cables/lines belonging to other owners of licensed electricity distribution systems may be present and it is your responsibility to identify their location.

THE POWER NEW YORK AND THE THAT THAT THE INFORMATION Provided to you is correct.

Tour rety upon that you might be a covering letter than the security of the letter.

You're by when the works the first person.

2. UK Power Networks the promition of the persons or clauses person in the prison.

3. Subject to paragraph 2 are Power Networks has no liability to you in contract, in tort including negligence), for breach of statutory duty or otherwise for any loss, damage, cost, claims, demands, or expenses that you or any timfo party may suffer or incur as a result of using the information provided whether for physical damage to property or for any economic loss (including without limitation loss of profit, loss of opportunity, loss of savings, loss of goodwill, loss of business, loss of profit, loss of opportunity, loss of savings, loss of goodwill, loss of business, loss of opportunity, loss of savings, loss of profit, loss of opportunity, loss of savings, loss of savings, loss of profit, loss of opportunity, loss of savings, loss of profit, loss of opportunity, loss of savings, loss of profit, loss of opportunity, loss of savings, loss of profit, loss of opportunity, loss of savings, loss of profit, loss of opportunity, loss of savings, loss of profit, loss of opportunity, loss of savings, loss of profit, loss of opportunity, loss of savings, loss of profit, loss of opportunity, loss of savings, loss of profit, loss of opportunity, loss of savings, loss of profit, loss of opportunity, loss of savings, loss of profit, loss of opportunity, loss of savings, loss of profit, loss of opportunity, loss of profit, loss of opportu 2. UK Power Net

IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY




ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6



Maps produced at 1.2500 scale are Geo-Schematics which show LV mains cables and overthead lines (in some cases all soltages). Prior to carrying out excaveitors wu must refer to the 1:500 records to determine the location of all known underground plant and equipment.

Reproduced by permission of Ordnance Survey on behalf of HWSO. © Crown copyright and database rights 2017. All rights reserved. Ordnance Survey licence numbers 100019826, 100019826 and 100019450. Data has been added to the Ordnance Survey base map; all proprietary rights in such additional data are and shall remain the exclusive property of © London Power Networks pic or Eastern Power Networks pic or South Eastern Power Networks pic or South Eastern Power Networks pic each being a distribution licensee under sections (1)(c) of the Electricity Act 1889 for the relevant distribution services area as that term is defined in such licensee 3 distribution licensee. All rights in such data research of the second o

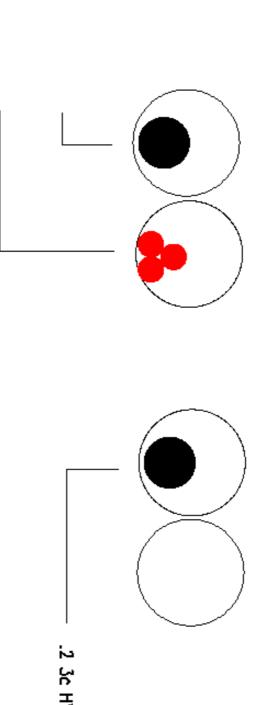

.25 36 ⊞

& &

Cross Section

1. The position of the apparatus shown on this drawing is believed to be correct but the original landmarks may have been altered since the apparatus was installed.

2. The exact position of the apparatus should be verified - use approved cable avoidance tools prior to excavation using suitable hand tools.

3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact location of all the cables have been determined.

4. It must be assumed that there is a service cable into each property, lamp column and street sign, etc.

5. All cables must be treated as being live unless proved otherwise by UIK Power Networks.

6. The information proved must be given to all people working near UK Power Networks plant and equipment. Do not use plans more than 3 months after the issue date for excavation purposes.

7. Please be aware that electric cables/lines belonging to other owners of licensed electricity distribution systems may be present and it is your responsibility to identify their location.

1. UK Power Law of its one-job variant that the information provided to you is correct.
You rely upon tayout which is the provided to you can be death of any 2. UK Power New Yorks deep not exclude or limit its liability if it causes the death of any ant that the information provided to you is correct.

Subject to paragraph 2 UK Power Networks has no liability to you in contract, in tort (including negligence), for breach of statutory duty or otherwise for any loss, damage, cost, claims, demands, or expenses that you or any third party may suffer or incur as a result of using the information provided whether for physical damage to property or for any secondaric loss (including without limitation loss of profit), loss of opportunity, loss of savings, loss of goodwill, loss of business, loss of use of or any special or consequential loss or damage whatsoever.

4. This plan has been provided to you on the basis of the terms of use set out in the covering letter that accompanies this plan. If you do not accept and/or do not understand the terms of use set out in the covering letter that accompanies this plan. If you do not accept and/or do not understand the terms of use set out in the covering letter you must not use the plan and must return it to the sender of the letter.

5. You are responsible for the security of the information provided to you. It must not be given, sold or made available upon payment of a fee to a third party. persons 3. Subje


IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY



ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6

wheps produced at 1.2500 scale are Geo-Schematics which show LiV mains cables and overthead lines (in some cases all solitages). Prior to carrying out excave tions you must refer to the 1.500 records to determine the location of all known underground plant and equipment.

Reproduced by permission of Ordnance Survey on behalf of HMSD. © Crown copyright and database rights 2017. All rights reserved. Ordnance Survey licence numbers 100019826, 100019826 and 100019430. Data has been added to the Ordnance Survey base map; all proprietary rights in such additional data are and shall remain the exclusive property of © London Power Networks pic or Eastern Power Networks pic each being a distribution licensee under section 6(1)(c) of the Electricity Act 1889 for the relevant distribution services area as that term is defined in such licensee sistribution license. All rights in such data research of the second of the

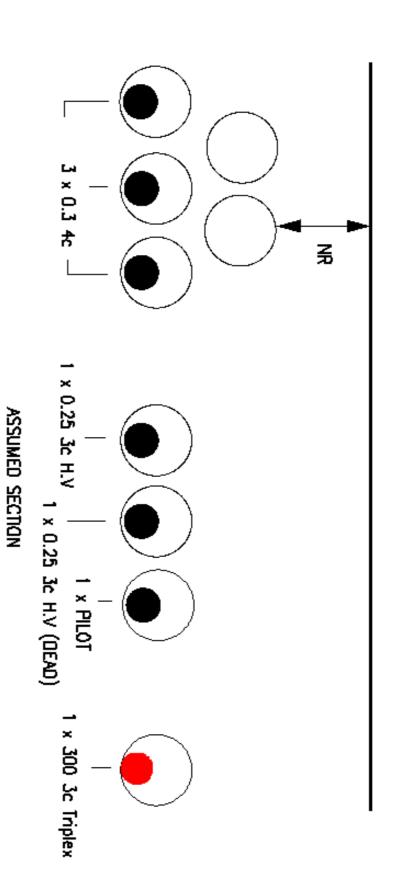

1. The position of the apparatus shown on this drawing is believed to be correct but the original landmarks may have been altered since the apparatus was installed.
2. The exact position of the apparatus should be verified - use approved cable avoidance tools prior to excavation using suitable hand tools.
3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact location of all the cables have been determined.
4. It must be assumed that there is a service cable into each property, lamp column and street sign, etc.
5. All cables must be treated as being live unless proved otherwise by UK Power Networks.
6. The information proved must be given to all people working near UK Power Networks plant and equipment. Do not use plans more than 3 months after the issue date for excavation purposes.
7. Please be aware that electric cables/lines belonging to other owners of licensed electricity distribution systems may be present and it is your responsibility to identify their location.

you rely upon it at your rowin risk.

You rely upon it at your rowin risk.

You rely upon it at your rowin risk.

We have relatively a personal mount and person.

Subject to paragraph 2 UK Power Networks has no liability to you in contract, in tort including negligence, for breach of statutory duty or otherwise for any loss, damage, cost, claims, demands, or expenses that you or any third party may suffer or incur as a result of using the information provided whether for physical damage to property or for any economic loss (including without limitation loss of profit, loss of opportunity, loss of any economic loss (including without limitation loss of profit, loss of opportunity, loss of any economic loss (including without limitation loss of profit, loss of opportunity, loss of any economic loss (including without limitation loss of from special or consequential loss or damage whatsoever.

4. This plan has been provided to you on the basis of the terms of use set out in the covering letter that accompanies this plan. If you do not accept and/or do not understaturn it to the sender of the letter.


5. You are responsible for the security of the information provided to you. It must not we given, sold or made available upon payment of a fee to a third party. 1. UK Power Networks does not warrant that the information provided to you is correct.

IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY




ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6

wheps produced at 1.2500 scale are Geo-Schematics which show LiV mains cables and overthead lines (in some cases all solitages). Prior to carrying out excave tions you must refer to the 1.500 records to determine the location of all known underground plant and equipment.

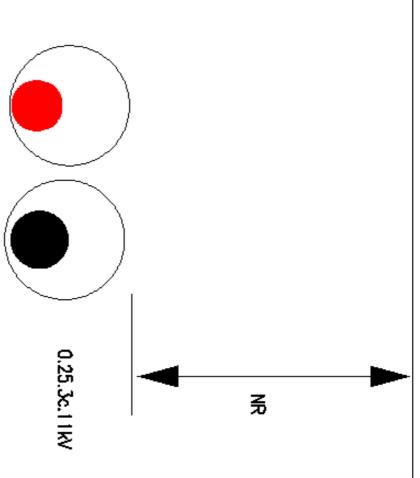

0.2.3c.11kV



1. The position of the apparatus shown on this drawing is believed to be correct but the original landmarks may have been altered since the apparatus was installed.

2. The exact position of the apparatus should be verified - use approved cable avoidance tools prior to excavation using suitable hand tools.

3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact location of all the cables have been determined.

4. It must be assumed that there is a service cable into each property, lamp column and street sign, etc.

5. All cables must be treated as being live unless proved otherwise by UIK Power Networks.

6. The information proved must be given to all people working near UK Power Networks plant and equipment. Do not use plans more than 3 months after the issue date for excavation purposes.

7. Please be aware that electric cables/lines belonging to other owners of licensed electricity distribution systems may be present and it is your responsibility to identify their location.

I LUK Power Networks does not warrant that the information provided to you is correct. You rely upon it at all Jawa had not a considerable to the death of any persons or cause personal injury the person.

3. Subject to paragraph 2 UK Power Networks has no liability to you in contract, in tort including negligence, for breach of statutory duty or otherwise for any loss, damage, cost, claims, demands, or expenses that you or any third party may suffer or incur as a result of using the information provided whether for physical damage to property or for any economic loss (including without limitation loss of profit, loss of opportunity, loss of savings, loss of goodwill, loss of business, loss of use jor any special or consequential loss of damage whatsoever, loss of damage whatsoever, loss of damage whatsoever, loss of damage what accompanies this plan, If you do not accept and/or do not understand in the terms of use set out in the covering letter that accompanies this plan, If you do not accept and/or do not understaturn it to the sender of the letter.

5. You are responsible for the security of the information provided to you. It must not were provided to available upon payment of a fee to a third party.

IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY




ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6

wheps produced at 1.7500 scale are Geo-Schematics which show LV mains cables and overhead lines (in some cases all voltages). Prior to carrying out excavelions you must refer to the 1.500 records to determine the location of all known underground plant and equipment.

Reproduced by permission of Ordnance Survey on behalf of HMSD. © Crown copyright and database rights 2017. All rights reserved. Ordnance Survey licence numbers 100019826, 100019826 and 100019430. Data has been added to the Ordnance Survey base map; all proprietary rights in such additional data are and shall remain the exclusive property of © London Power Networks pic or Eastern Power Networks pic each being a distribution licensee under section 6(1)(c) of the Electricity Act 1889 for the relevant distribution services area as that term is defined in such licensee sistribution license. All rights in such data research of the second of the

GASSIGNED ISEC FLORIS653

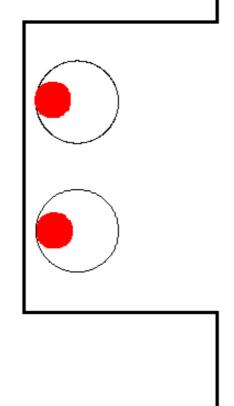

2 × 240 3× FV

- 1. The position of the apparatus shown on this drawing is believed to be correct but the original landmarks may have been altered since the apparatus was installed.
 2. The exact position of the apparatus should be verified use approved cable avoidance tools prior to excavation using suitable hand tools.
 3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact location of all the cables have been determined.
 4. It must be assumed that there is a service cable into each property, lamp column and street sign, etc.
 5. All cables must be treated as being live unless proved otherwise by UK Power Networks.
 6. The information proved must be given to all people working near UK Power Networks plant and equipment. Do not use plans more than 3 months after the issue date for excavation purposes.
 7. Please be aware that electric cables/lines belonging to other owners of licensed electricity distribution systems may be present and it is your responsibility to identify their location.

1. UK Power Newtorks describe warrant that the information provided to you is correct.

ation 2. UK Fower Networks are considered to think its liability if it causes the death of any persons or clustes (elegan) in UNITO persons.

3. Subject to paragraph 2 by Fower Networks has no liability to you in contract, in tort (including negligence), for breach of statutory duty or or therewise for any loss, damage, cost, claims, definands, or expenses that you or any third party may suffer or incur as a result of using the information provided whether for physical damage to property or for any economic loss (including without limitation loss of profit, loss of opportunity, loss of savings, loss of goodwill, loss of business, loss of profit, loss of opportunity, loss of savings, loss of goodwill, loss of business, loss of opportunity, loss of savings, loss of goodwill, loss of business, loss of opportunity, loss of savings, loss of goodwill, loss of business, loss of opportunity, loss of savings, loss of goodwill, loss of business, loss of opportunity, loss of savings, loss of goodwill, loss of business, loss of opportunity, loss of consequential terms.

4. This plan has been provided to you on the basis of the terms of use set out in the covering letter that accompanies this plan. If you do not accept and/or do not understand the terms of use set out in the covering letter you must not use the plan and must return it to the sender of the letter.

5. You are responsible for the security of the information provided to you. It must not we give the plan and available upon payment of a fee to a third party.


IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY



ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6

wheps produced at 1.7500 scale are Geo-Schematics which show LV mains cables and overhead lines (in some cases all voltages). Prior to carrying out excavelions you must refer to the 1.500 records to determine the location of all known underground plant and equipment.

Reproduced by permission of Ordnance Survey on behalf of HW6D. © Crown copyright and database rights 2017. All rights reserved. Ordnance Survey licence numbers 100019826, 100019826 and 10001990. Data has been added to the Ordnance Survey base map; all proprietary rights in such database rights 2017. All rights reserved. Ordnance Survey licence numbers 100019826, 100019826 and 100019826. Data has been added to the Ordnance Survey base map; all proprietary rights in such database rights 2017. All rights reserved. Ordnance Survey licence numbers 100019826, 100019826 and 100019826. Data has been added to the Ordnance Survey base map; all proprietary rights in such database rights 2017. All rights reserved. Ordnance Survey licence numbers 100019826, 100019826 and 100019826. Data has been added to the Ordnance Survey base map; all proprietary rights in such additional data are and shall remain the ordnance Survey base map; all proprietary rights in such additional data are and shall remain the ordnance Survey base map; all proprietary rights in such additional data are and shall remain the ordnance Survey base map; all proprietary rights in such database rights 2017. All rights reserved. Ordnance Survey base map; all proprietary rights and survey base map; all proprietary rights and survey base map; all proprietary rights are survey base map; all proprietary rights and survey base map; all proprietary rights are survey.

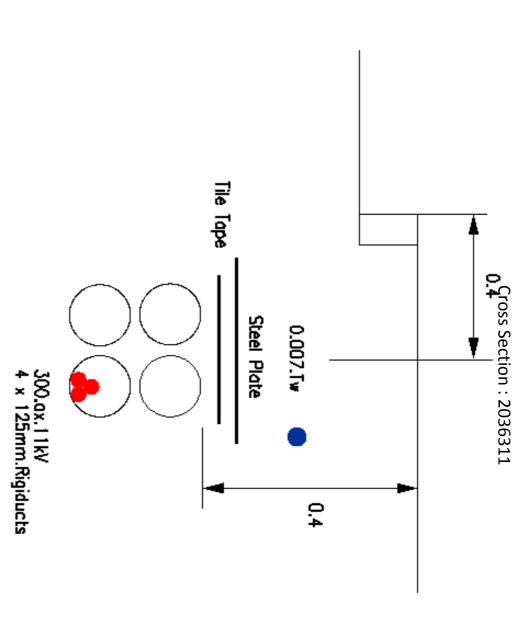

1. The position of the apparatus shown on this drawing is believed to be correct but the original landments may have been altered since the apparatus was installed.

2. The exact position of the apparatus should be verified - use approved cable avoidance tools prior to excavation using suitable hand tools.

3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact location of all the cables have been determined.

4. It must be assumed that there is a service cable into each property, lamp column and street sign, etc.

5. All cables must be treated as being live unless proved otherwise by UK Power Networks.

6. The information proved must be given to all people working near the two orks plant and equipment. Do not use plans more than amonths after the issue date for excavation proposes.

7. Please be aware that electric cables/ lines belonging to other owners of licensed electricity distribution systems may be present and it is your responsibility to identify their location.

AFISER remetals would does not warrant that the information provided to you is correct.

you celly upon that, vour own risk.

All the fore the third risk does not exclude or limit its liability to you in contract, in term the son of parties and injury to a person.

Son feet to parties and 2 UK Power Networks has no liability to you in contract, in tert including negligence), for breach of statutory duty or otherwise for any loss, damage, cost, claims, demands, or expenses that you or any third party may suffer or incur as a result of using the information provided whether for physical damage to property or for any economic loss (including without limitation loss of profit, loss of opportunity, loss of awings, loss of goodwilt, loss of business, loss of use or any special or consequential loss or damage whatsoever.


4. This plan has been provided to you on the basis of the terms of use set out in the covering letter that accompanies this plan. If you do not accept and/or do not understand in the terms of use set out in the covering letter that accompanies this plan. If you do not accept and/or do not understand in the security of the information provided to you. It must not we given, sold or made available upon payment of a fee to a third party.

IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY



ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6

wheps produced at 1.7500 scale are Geo-Schematics which show LV mains cables and overhead lines (in some cases all voltages). Prior to carrying out excavelions you must refer to the 1.500 records to determine the location of all known underground plant and equipment.

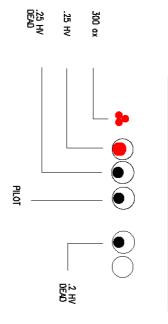

ASSUMED SECTION

Cross Section 2031651

1. The position of the apparatus shown on this drawing is believed to be correct but the original landmarks may have been altered since the apparatus was installed.
2. The exact position of the apparatus should be verified - use approved cable avoidance tools prior to excavation using suitable hand tools.
3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact location of all the cables have been determined.
4. It must be assumed that there is a service cable into each property, lamp column and street sign, etc.
5. All cables must be treated as being live unless proved otherwise by UK Power Networks.
6. The information proved must be given to all people working near UK Power Networks plant and equipment. Do not use plans more than 3 months after the issue date for excavation purposes.
7. Please be aware that electric cables/lines belonging to other owners of licensed electricity distribution systems may be present and it is your responsibility to identify their location.

1. UK Power Networks does not warrant that the information provided to you is correct.

You rely upon it at your own risk.

2. UK Power Networks does not exclude or limit its liability if it causes the death of any persons.

Between the works does not exclude or limit its liability to you in contract, in tert finduling negligence; not exclude or statutory duty or otherwise for any loss, damage, cost, claims, demands, or expenses that you or any timp party may suffer or incur as a result or using the information provided whether for physical damage to property or for any economic loss (including without limitation loss of profit, loss of opportunity, loss of savings, loss of goodwill, loss of business, loss of use) or any special or consequential loss or damage whatsoever, loss of use of the terms of use set out in the covering letter that accompanies this plan. If you do not accept and/or do not understand the terms of use set out in the security of the information provided to you. It must not we given, sold or made available upon payment of a fee to a third party.

**Market Country of the information provided to you. It must not we give the control of the security of the information provided to you. It was to we give the control of the terms of use and must return it to the sender of the letter.

**Subject to paragraph 2 UK Power Networks has not liability to you in control of the letter.


**Subject to paragraph 2 UK Power Networks has not liability to you in control or any provided to you in control or any provided to you in control or any provided to you on the basis of the terms of use set out in the covering letter that accompanies this plan. If you do not accept and/or do not understand the terms of use set out in the security of the information provided to you. It must not we will be given, sold or made available upon payment of a fee to a third party.

IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY



ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6

wheps produced at 1.7500 scale are Geo-Schematics which show LV mains cables and overhead lines (in some cases all voltages). Prior to carrying out excavelions you must refer to the 1.500 records to determine the location of all known underground plant and equipment.

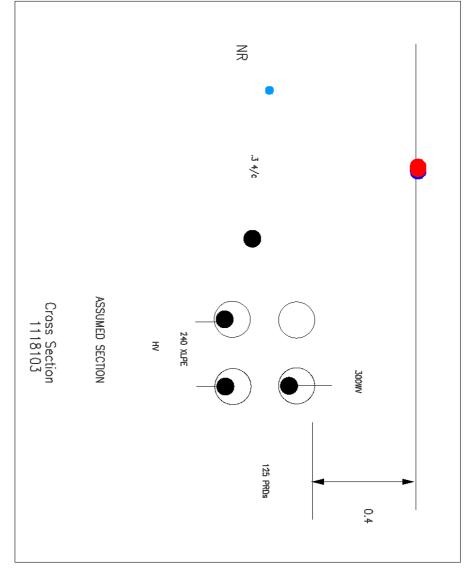

may

1. UK Power Networks does not warrant that the information provided to you is correct.

You rely upon it at your own risk.

You rely upon it at your own risk.

2. UK Power Networks does not exclude or limit its liability if it causes the death of any persons or causes personal injury to a person.

3. Subject to paragraph 2 UK Power Networks has no liability to you in contract, in tort (including negligence), for breach of statutory duty or otherwise for any loss, damage, cost, claims, demands, or expenses that you or any timf party may suffer or incur as a result of using the information provided whether for physical damage to property or for any economic loss (including without limitation loss of profit, loss of opportunity, loss of savings, loss of goodwill, loss of business, loss of use) or any special or consequential loss or damage whatsoever.

4. This plan has been provided to you on the basis of the terms of use set out in the covering letter that accompanies this plan. If you do not accept and/or do not understand the terms of use set out in the covering letter you must not use the plan and must return it to the sender of the letter.

5. You are responsible for the security of the information provided to you. It must not we give the plan and available upon payment of a fee to a third party.

IF IN DOUBT - ASK! PHONE
0800 056 5866
EMERGENCY - If you damage
a cable or line
Phone 0800 783 88 38 (24hrs)
URGENTLY




ALWAYS LOOK UP BEFORE YOU START WORK Refer to HSE Guidance note GS6

wheps produced at 1.2500 scale are Geo-Schematics which show LiV mains cables and overthead lines (in some cases all solitages). Prior to carrying out excave tions you must refer to the 1.500 records to determine the location of all known underground plant and equipment.

Reproduced by permission of Ordnance Survey on behalf of HMSD. © Crown copyright and database rights 2017. All rights reserved. Ordnance Survey licence numbers 100019826, 100019826 and 100019430. Data has been added to the Ordnance Survey base map; all proprietary rights in such additional data are and shall remain the exclusive property of © London Power Networks pic or Eastern Power Networks pic each being a distribution licensee under section 6(1)(c) of the Electricity Act 1889 for the relevant distribution services area as that term is defined in such licensee sistribution license. All rights in such data research of the second of the

^{1.} The position of the apparatus shown on this drawing is believed to be correct but the original landmarks may have been altered since the apparatus was installed.
2. The exact position of the apparatus should be verified - use approved cable avoidance tools prior to excavation using suitable hand tools.
3. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact location of all the cables have been determined.
4. It must be assumed that there is a service cable into each property, lamp column and street sign, etc.
5. All cables must be treated as being live unless proved otherwise by UK Power Networks.
6. The information proved must be given to all people working near UK Power Networks plant and equipment. Do not use plans more than 3 months after the issue date for excavation purposes.
7. Please be aware that electric cables/lines belonging to other owners of licensed electricity distribution systems may be present and it is your responsibility to identify their location.

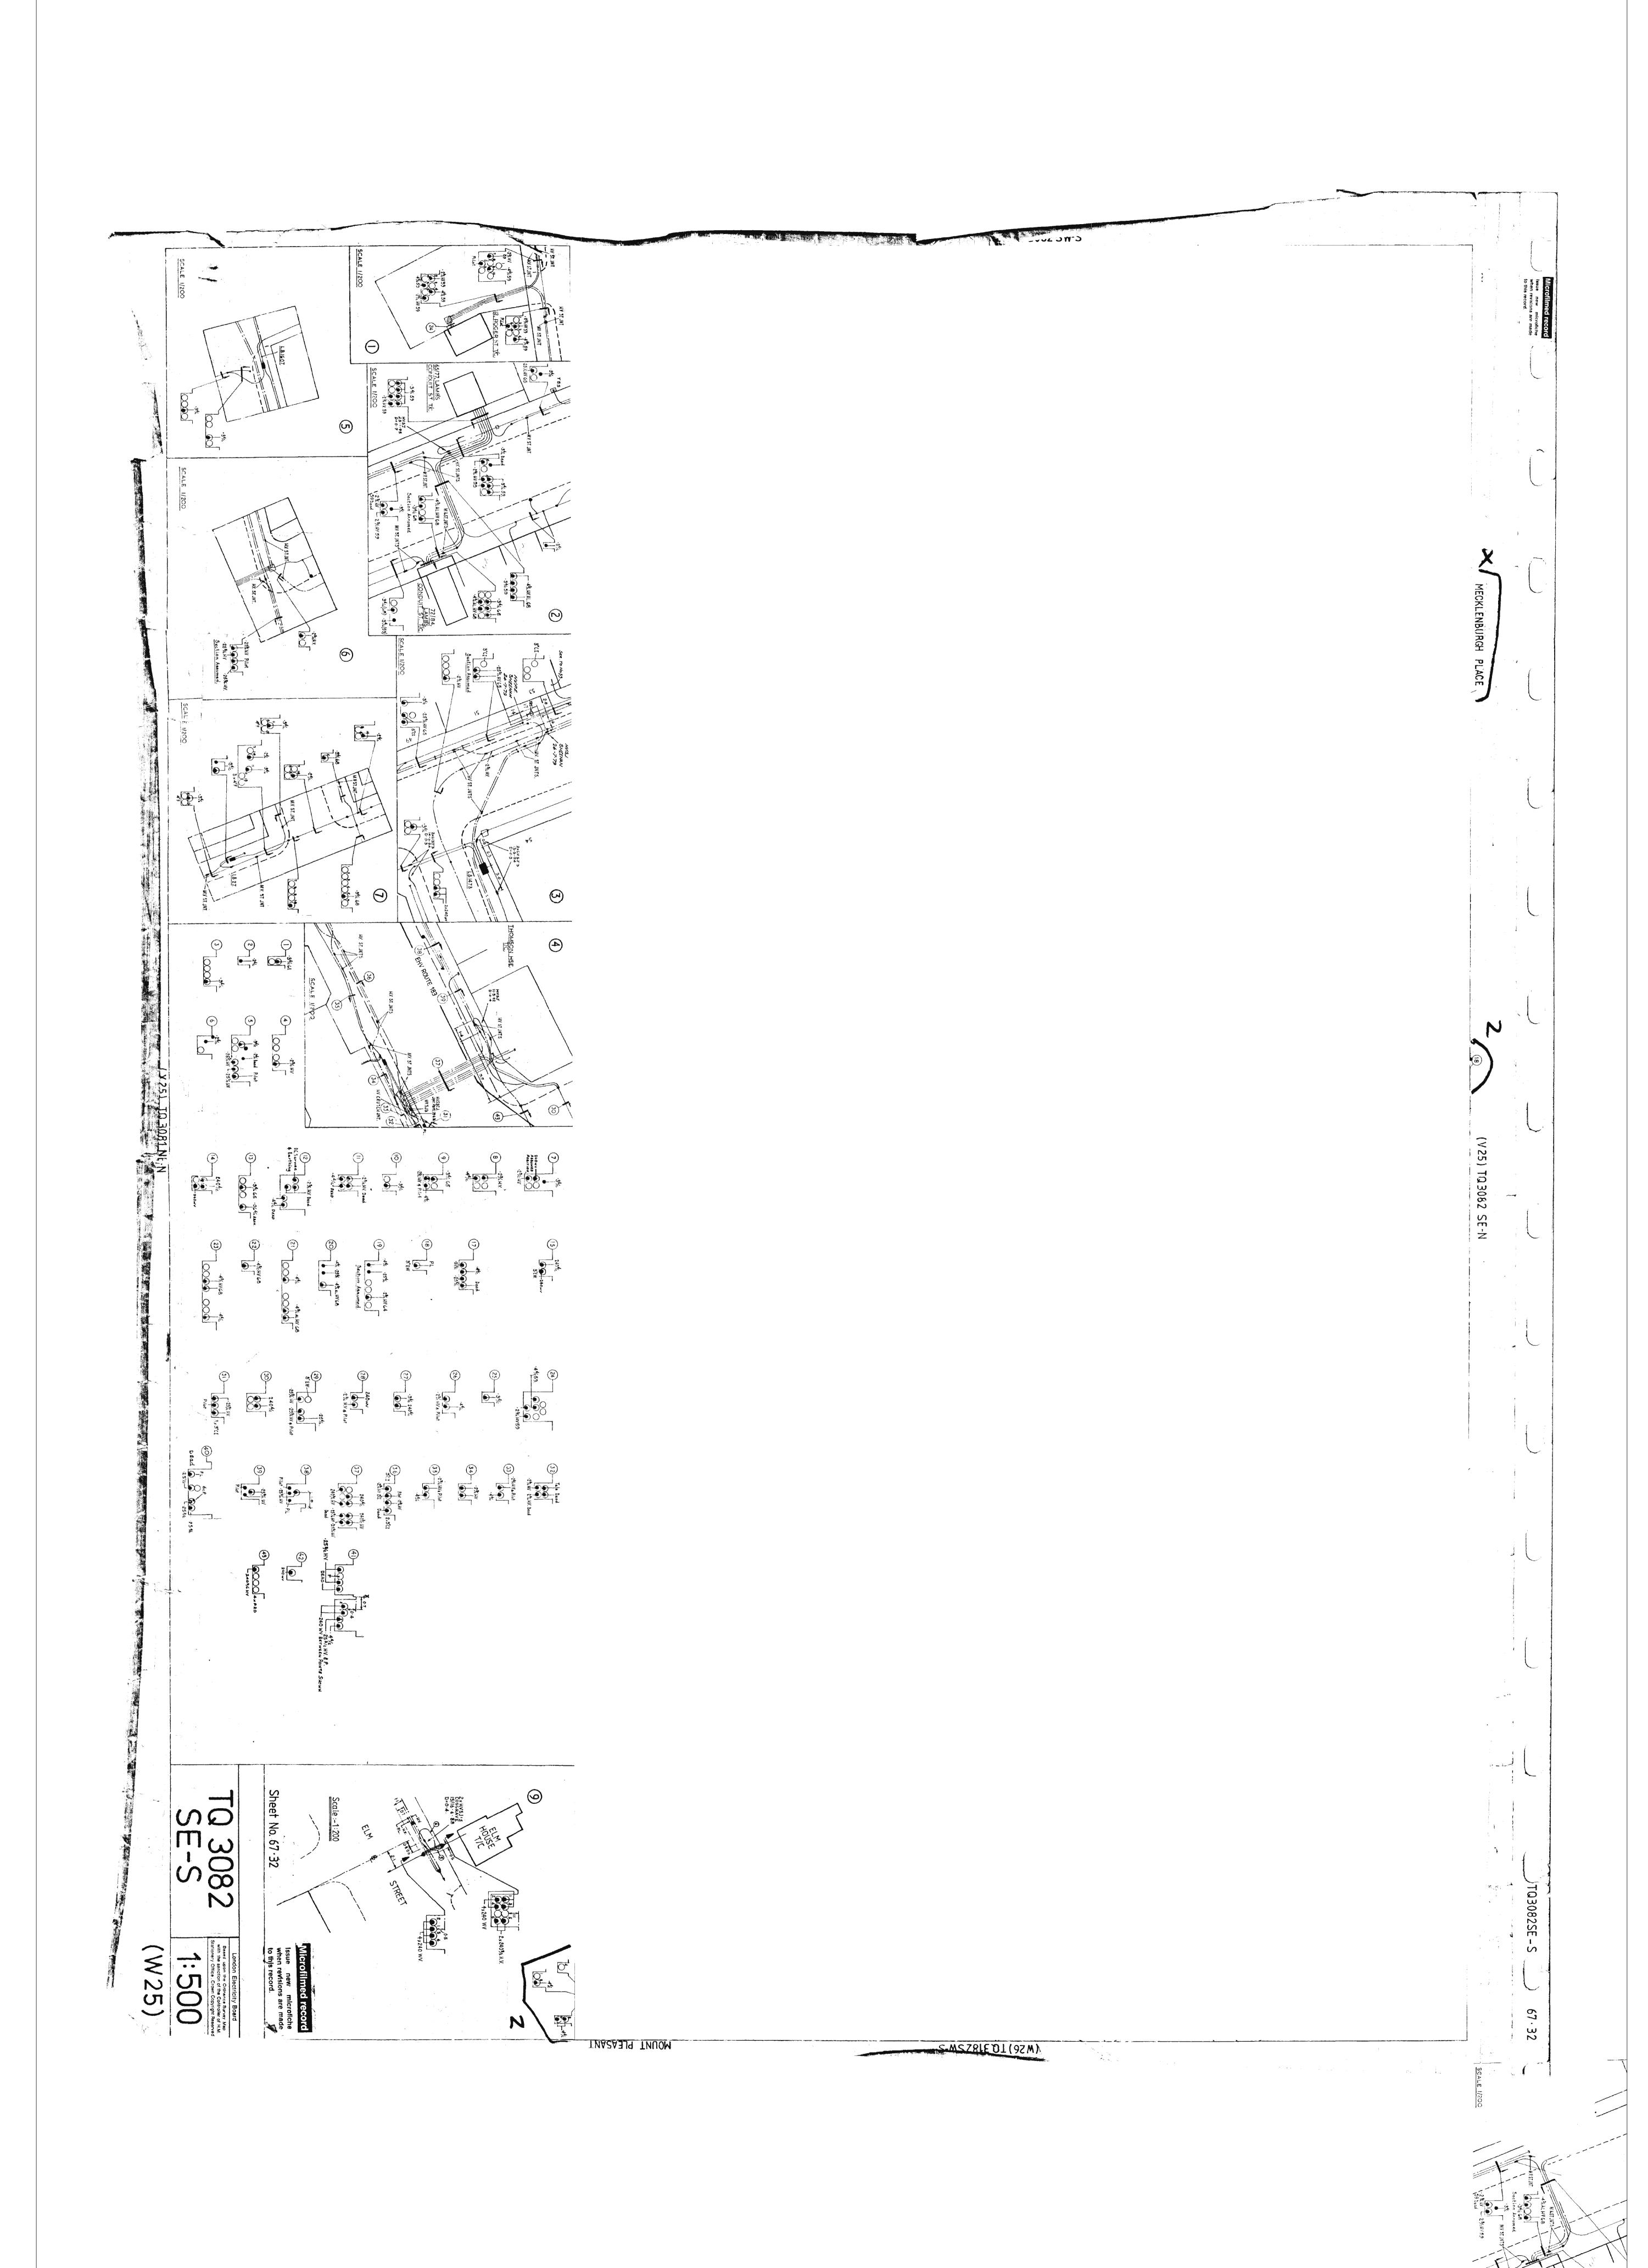

GUIL KORO

© 0 % A

