
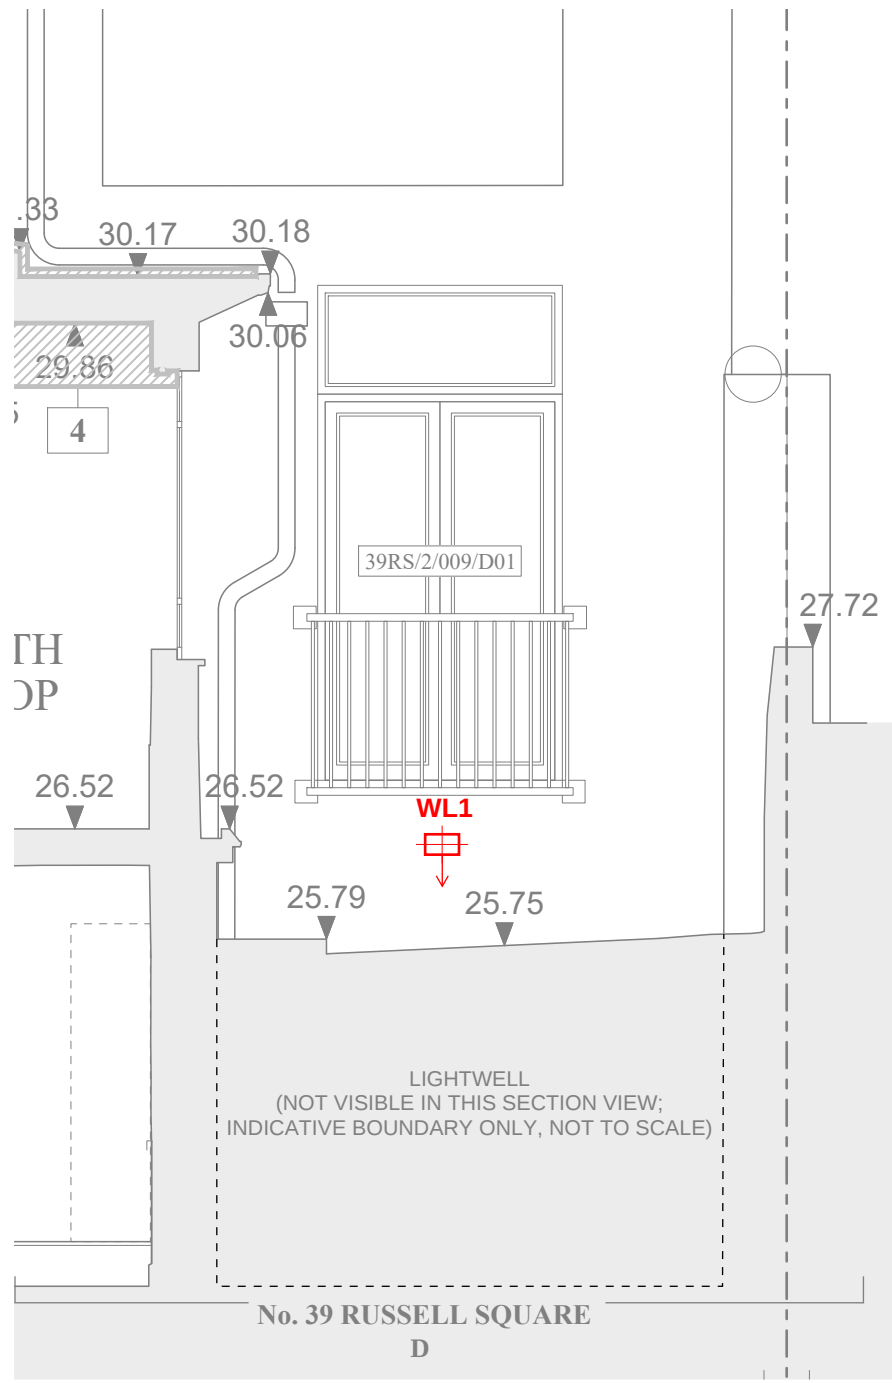
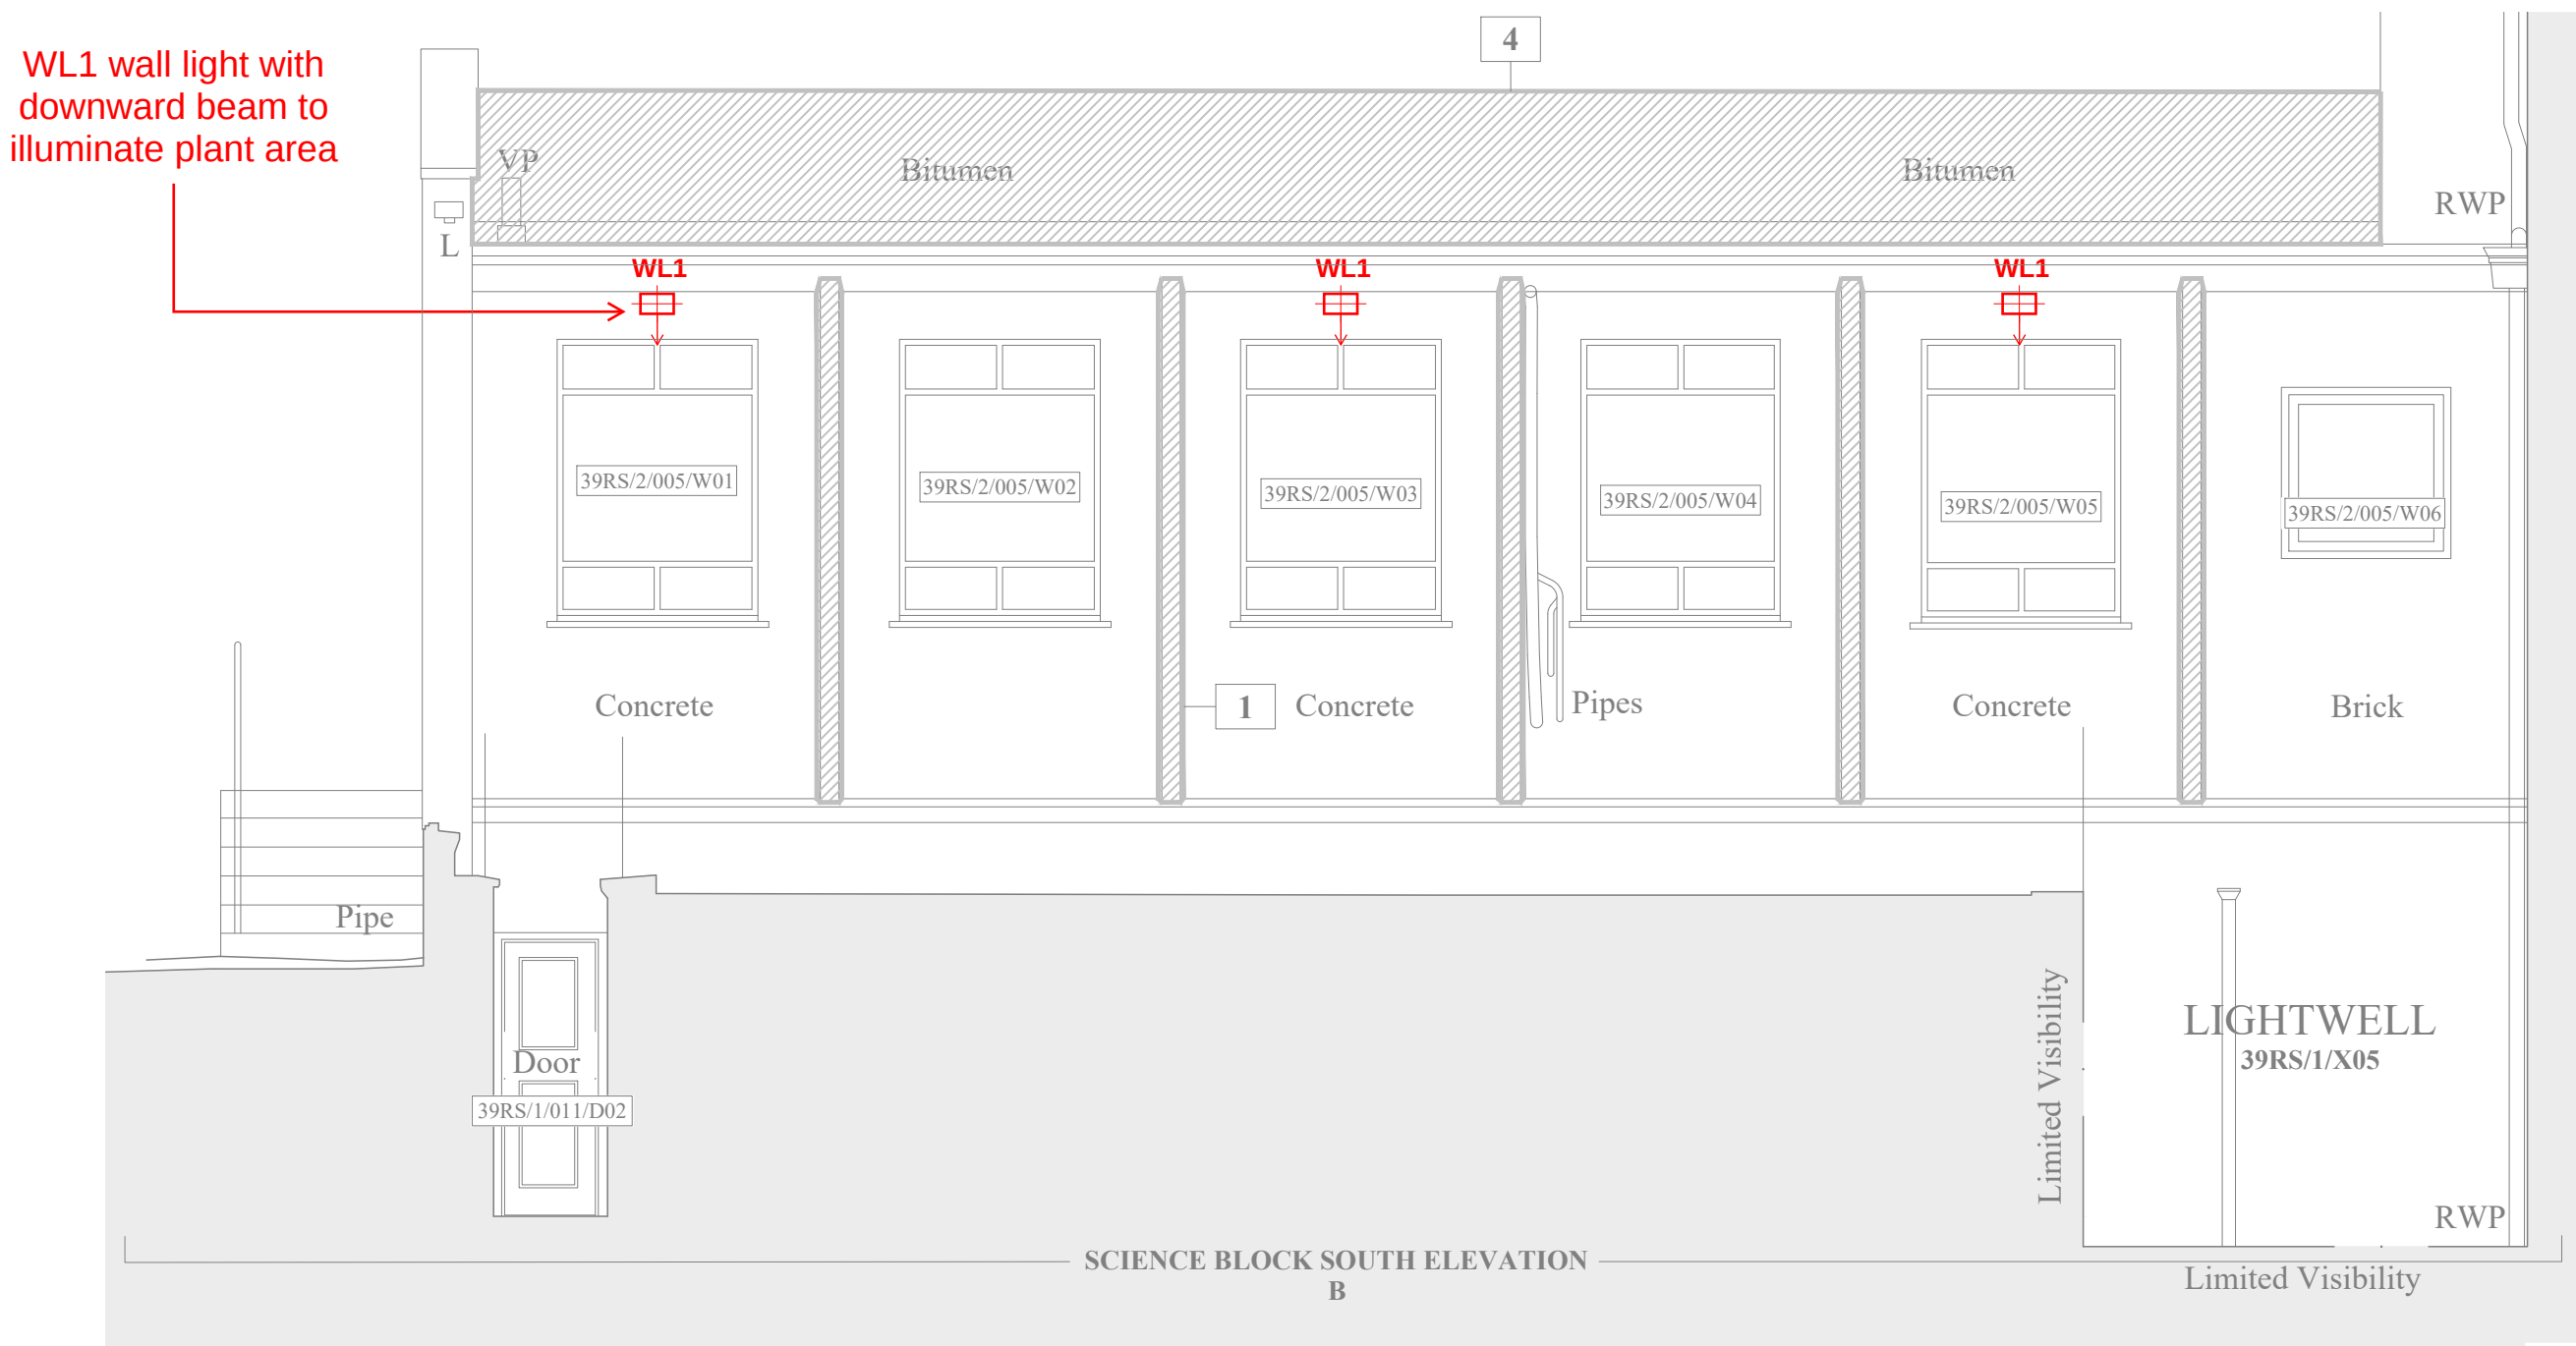
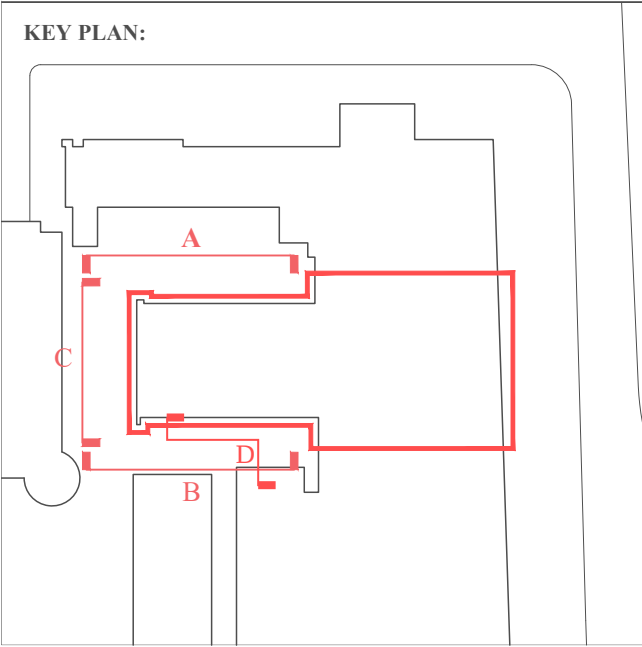
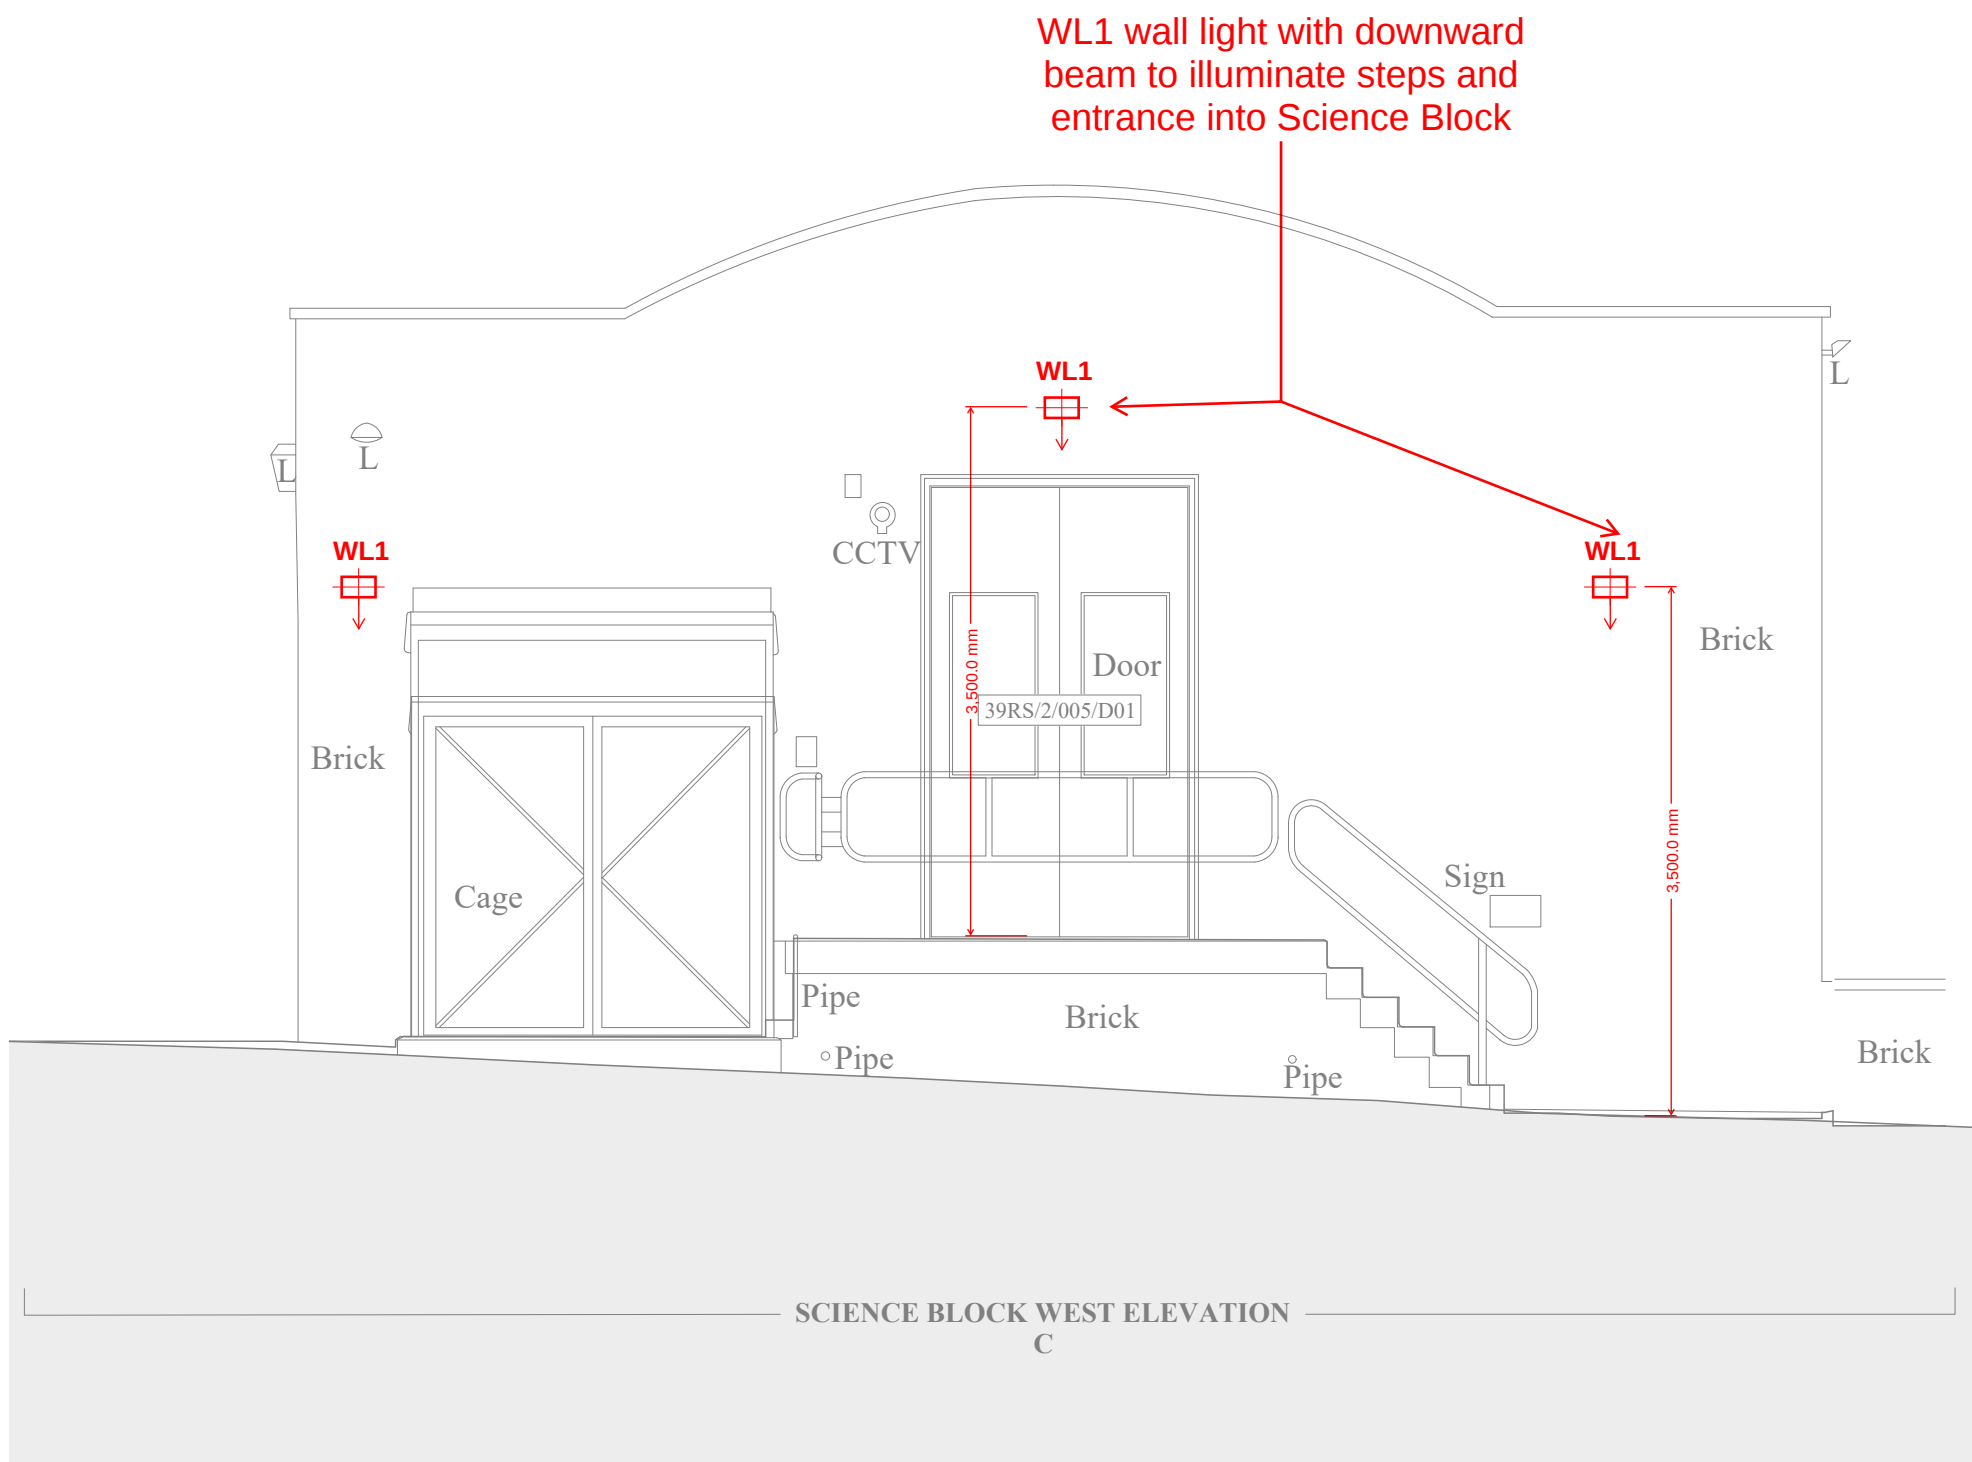


NOTES

- EXTERNAL LIGHTING TO BE CONTROLLED BY TIME-CLOCK WITH PHOTOCELL OVERRIDE
- EMERGENCY LIGHTING TO BE TESTED BY TEST KEY SWITCH

LUMINAIRE LEGEND

WL1 - WALL-MOUNTED LUMINAIRE WITH DOWNWARD BEAM

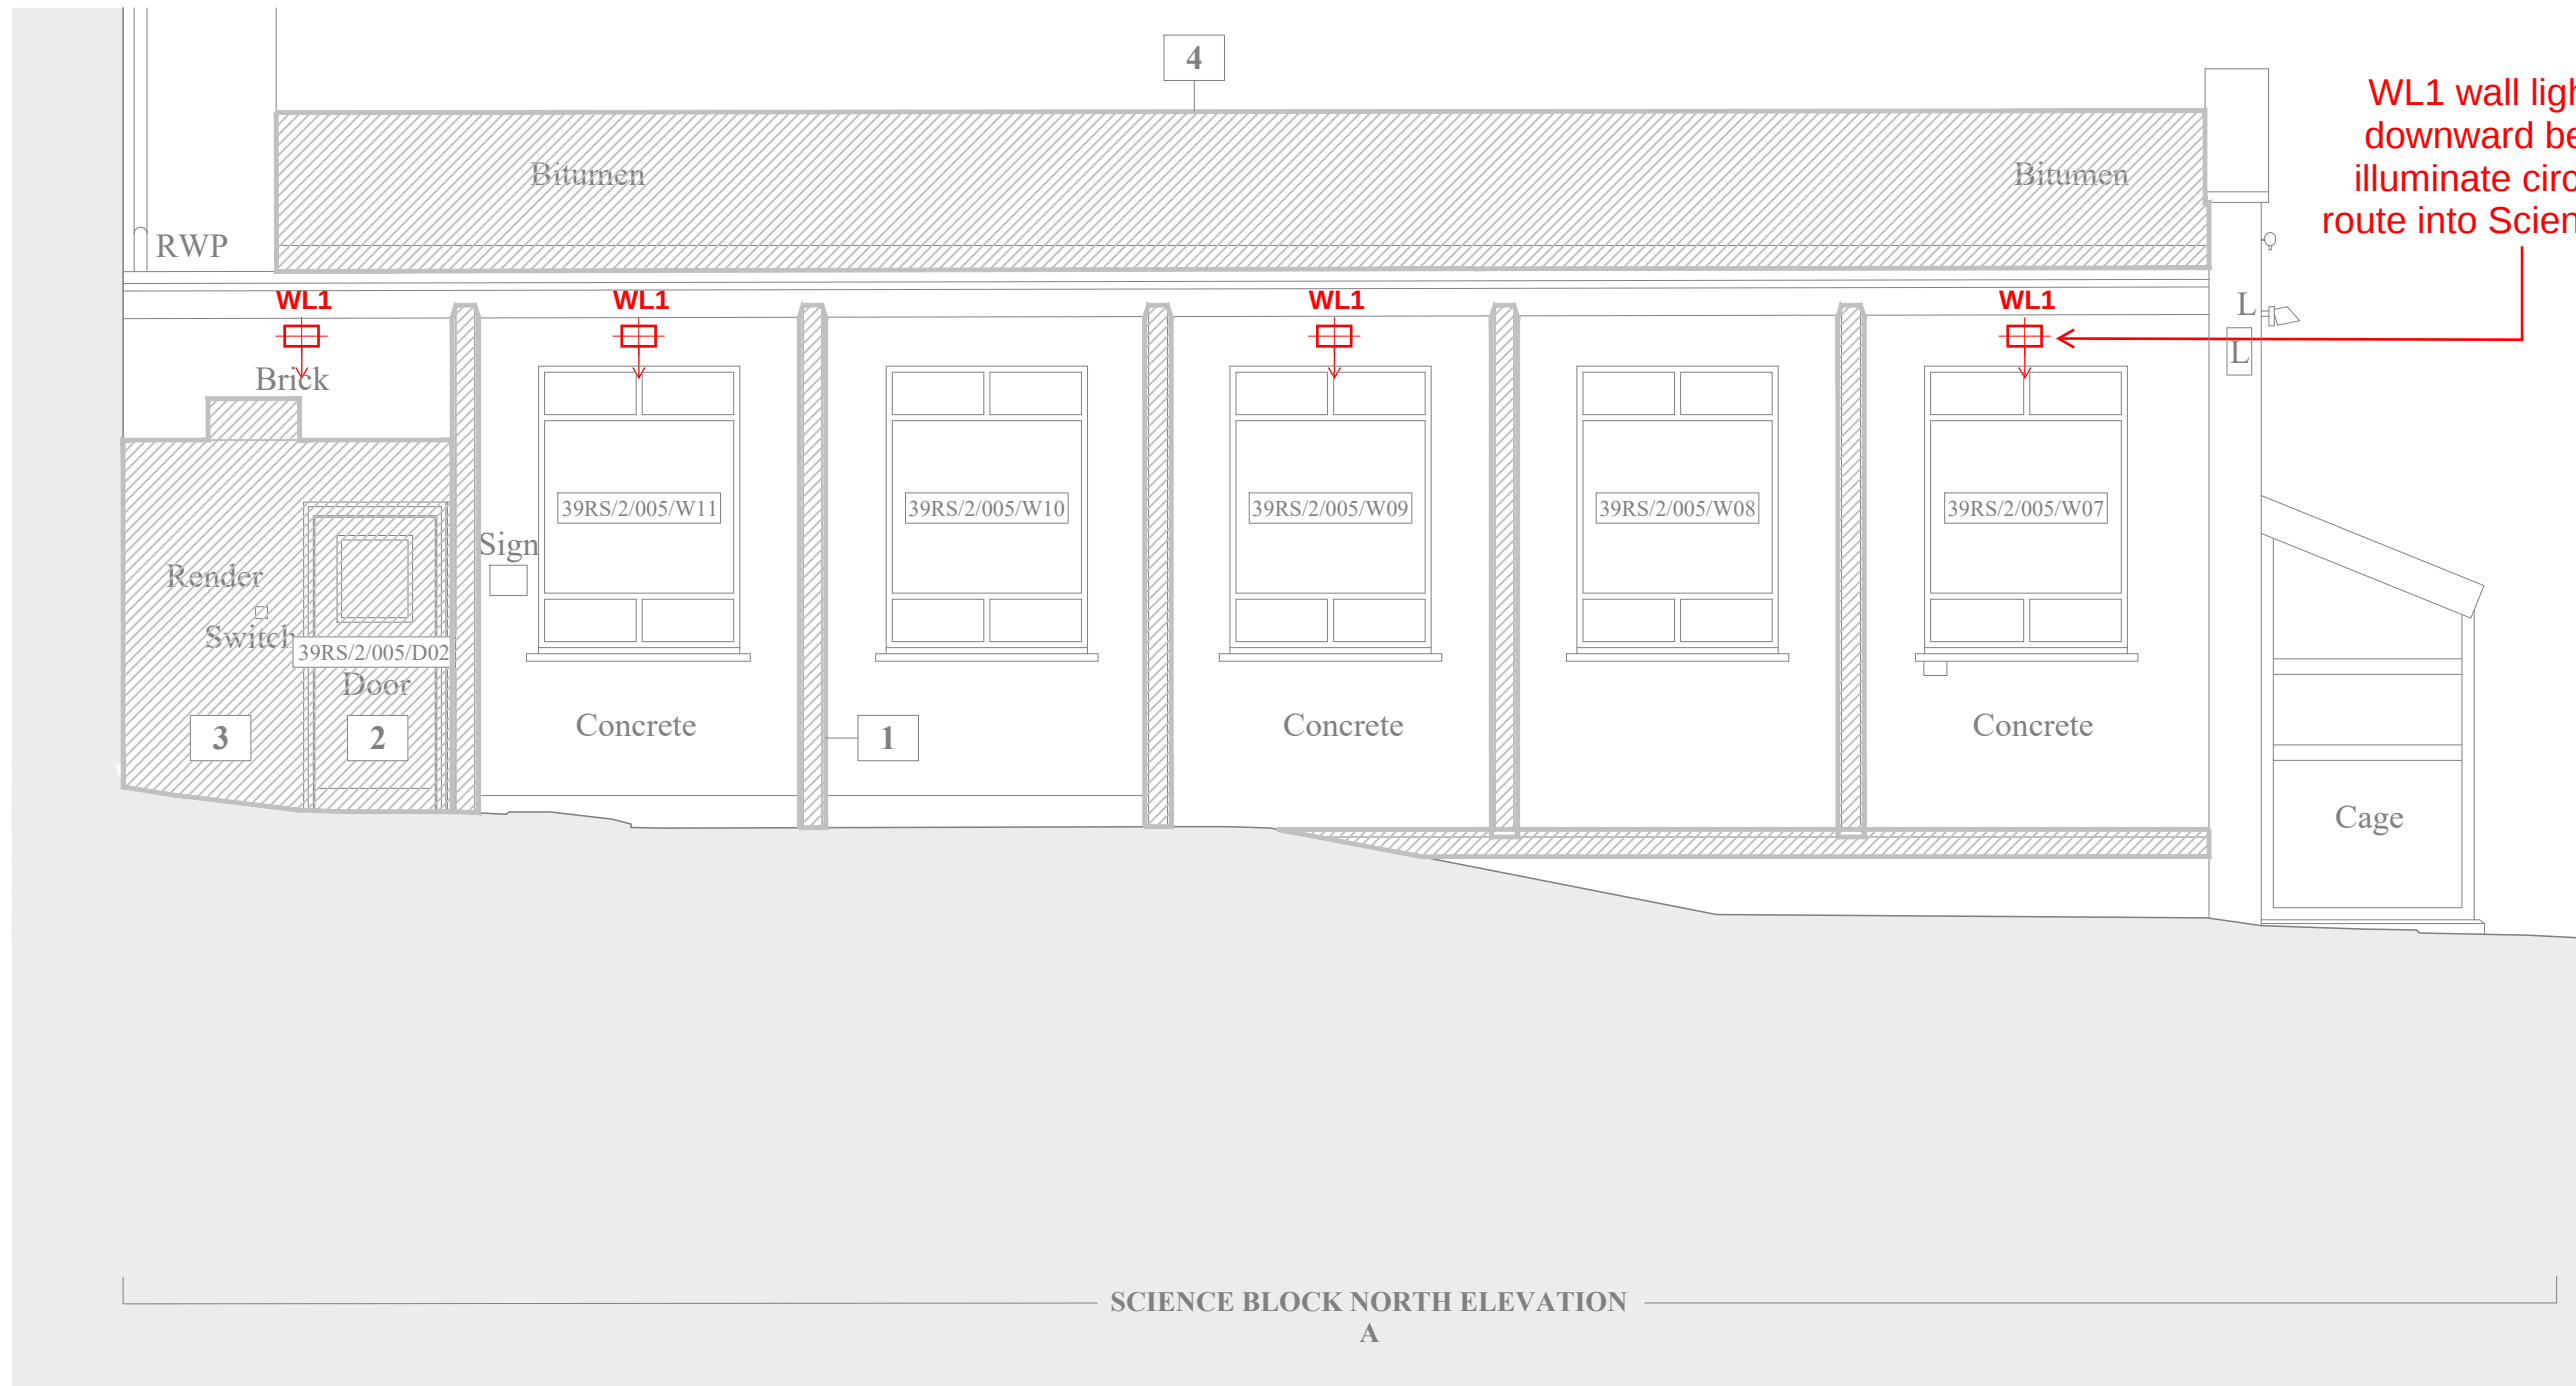

DESIGNED UNDER QUALITY SYSTEM CERTIFIED AS COMPLYING WITH ISO 9001 BY AN ACCREDITED CERTIFICATION BODY

© Copyright. This Document and Design remains the copyright of Steensen Varming (Australia) Pty Ltd and cannot be reproduced in any way without prior consent. The contractor shall verify all dimensions and levels on site as this is not a workshop drawing. The contractor shall refer any discrepancies to the engineer before proceeding with the work. This drawing shall be read in conjunction with other contract documents, drawings and project specifications. This file has been checked by an antivirus program with the latest update. However new viruses are discovered everyday we recommend that this file is rescanmed upon receipt

FOR INFORMATION

AMENDMENTS		
REV	DESCRIPTION	DATE
01	STAGE 3 ISSUE	14/07/23
02	STAGE 3 ISSUE	27/07/23

NOTES

Copenhagen
London
Sydney
Hong Kong
New York

4th floor, 3 Soho Square, London
W1D 3HD, United Kingdom
CRN 08 63 62 80
t: +44 20 7734 1255
e : info@steensenvarming.com

STEENSEN VARMING

PROJECT
BRITISH MUSEUM 39 RUSSEL SQUARE AND SCIENCE BLOCK
39 RUSSEL SQUARE, LONDON WC1B 3QQ

DRAWING TITLE
PROPOSED LIGHTING SERVICES
EXTERIOR LAYOUT

CREATED	DRAWN	DESIGNED	CHECKED	APPROVED	SCALE
JUL'23	SSR	SSR	SSR		1:50
NORTHPOINT		PROJECT No.		DRAWING No.	
		224016-BM-SV-39RS-EX-DR-E-3000		02	

A1