
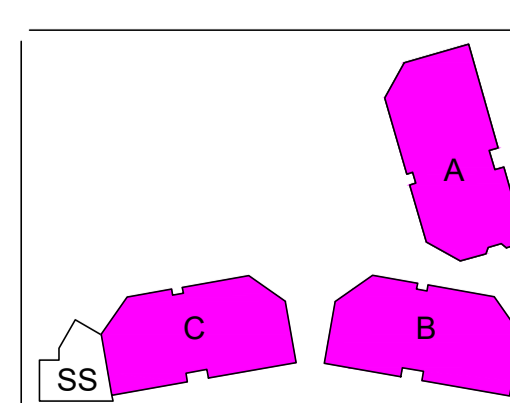
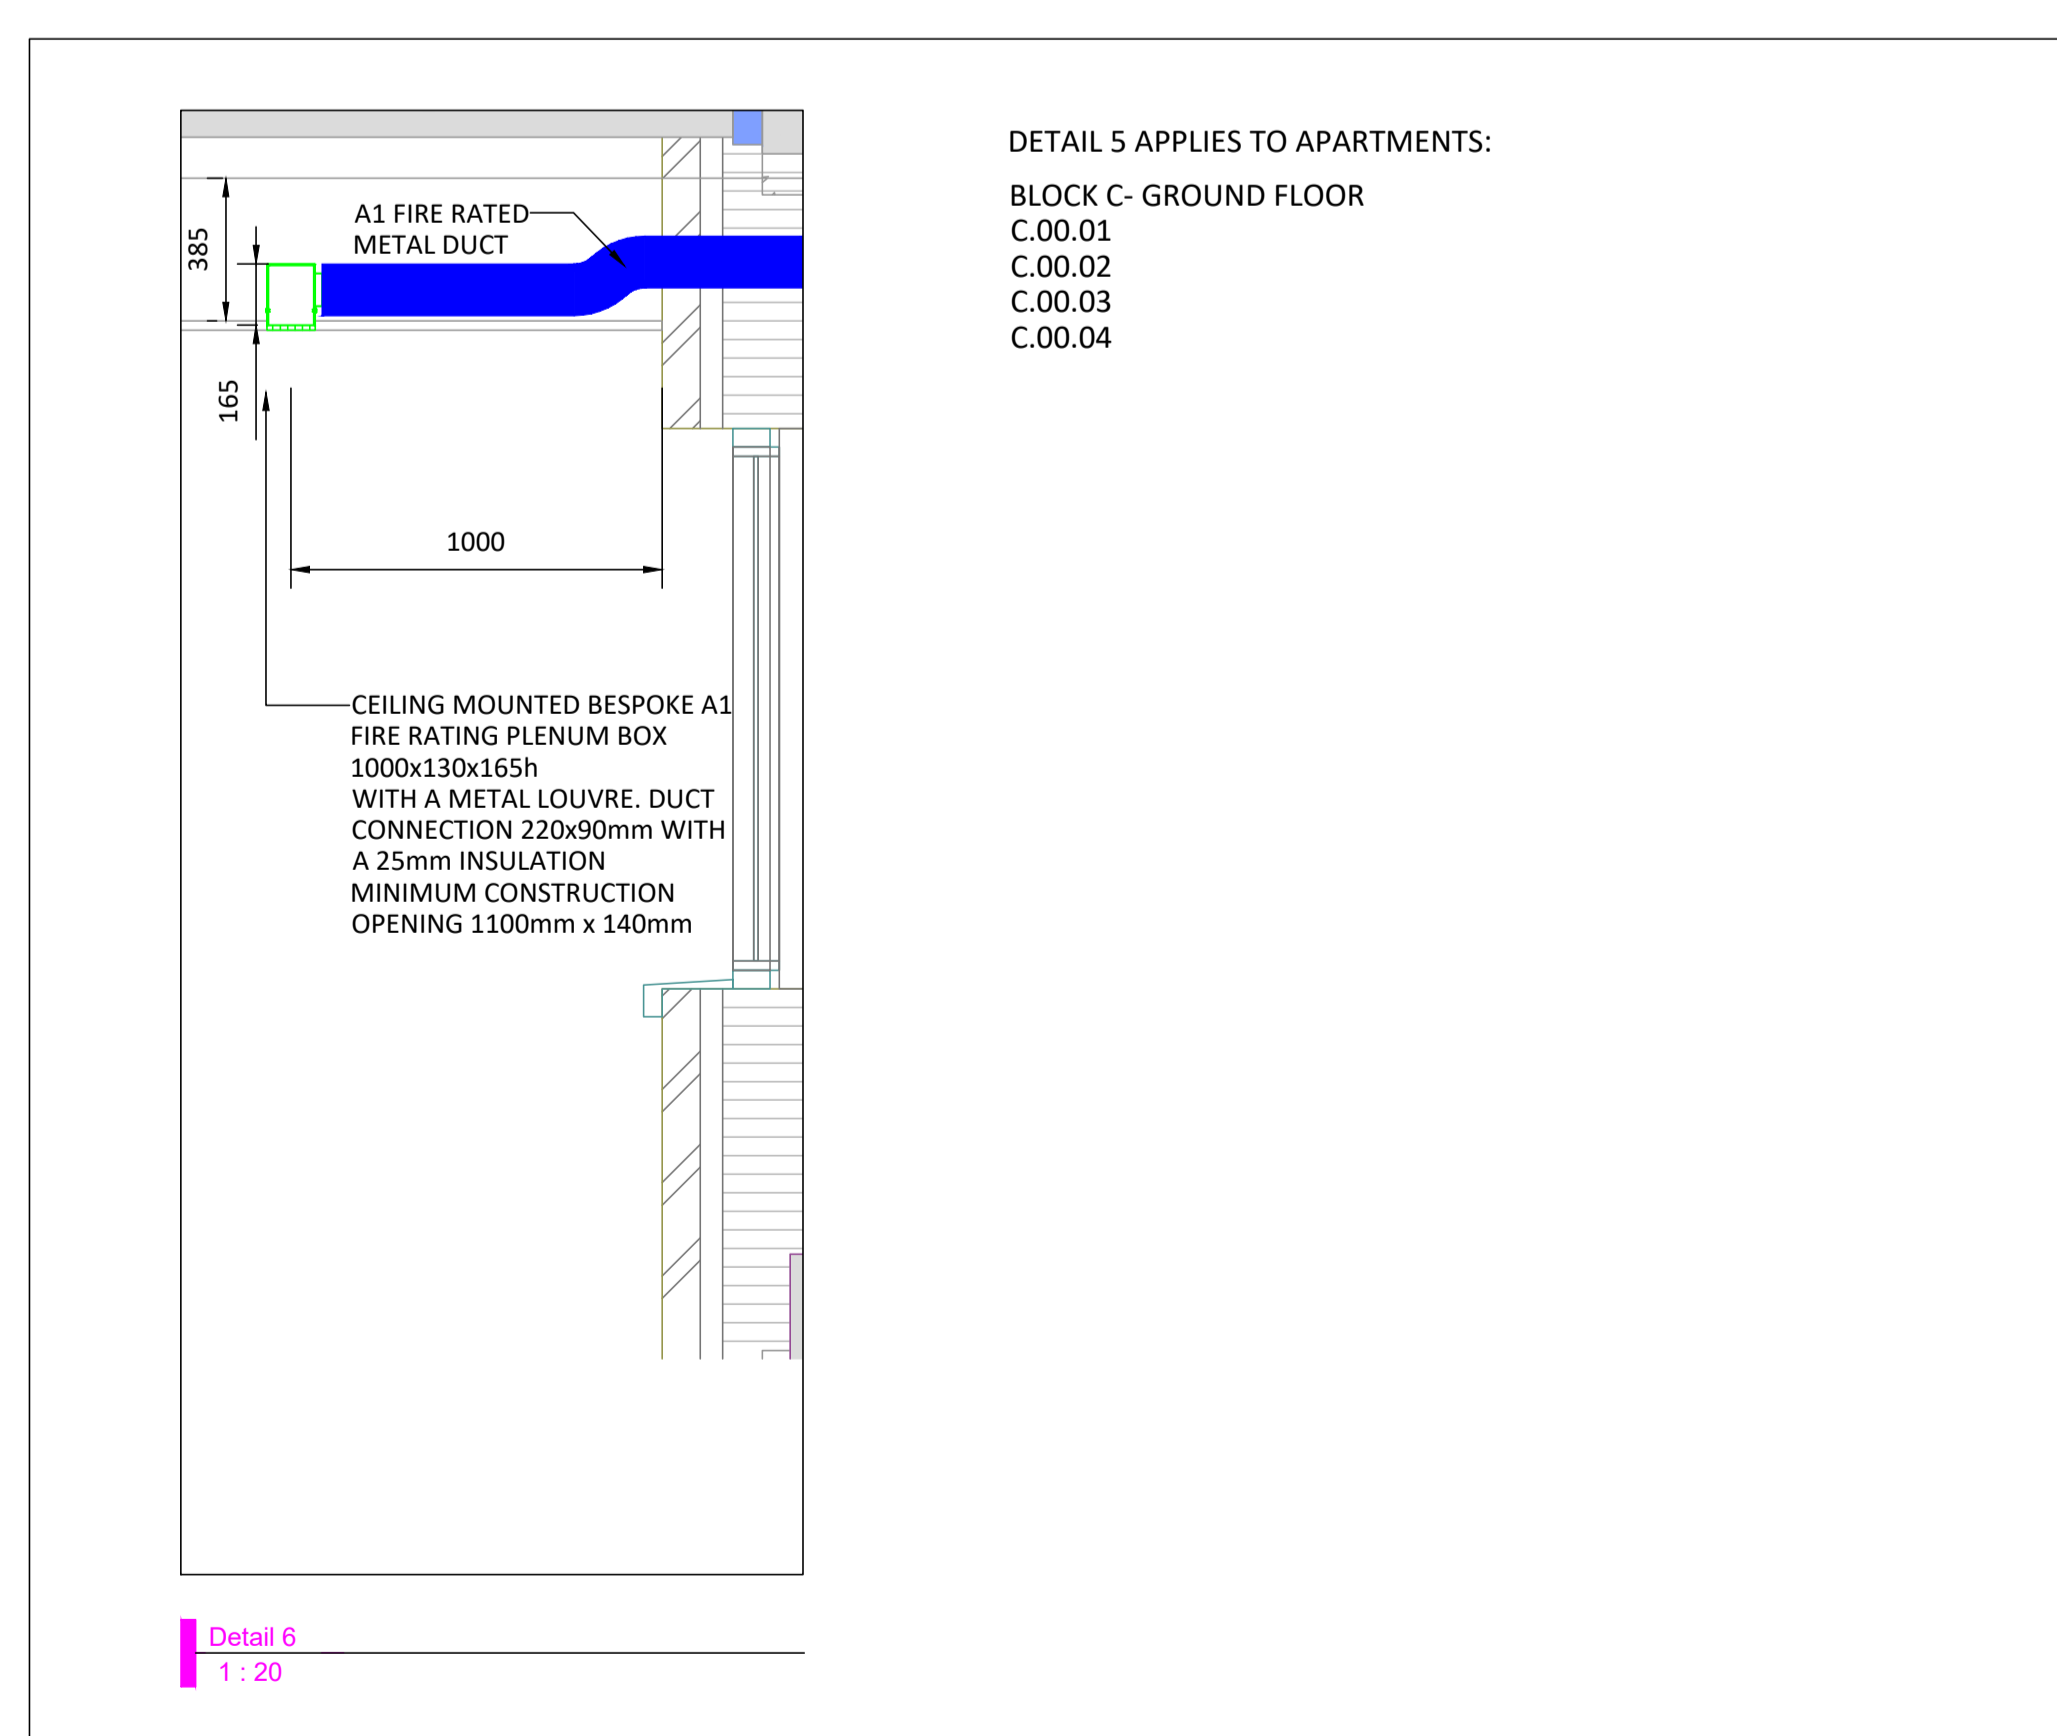
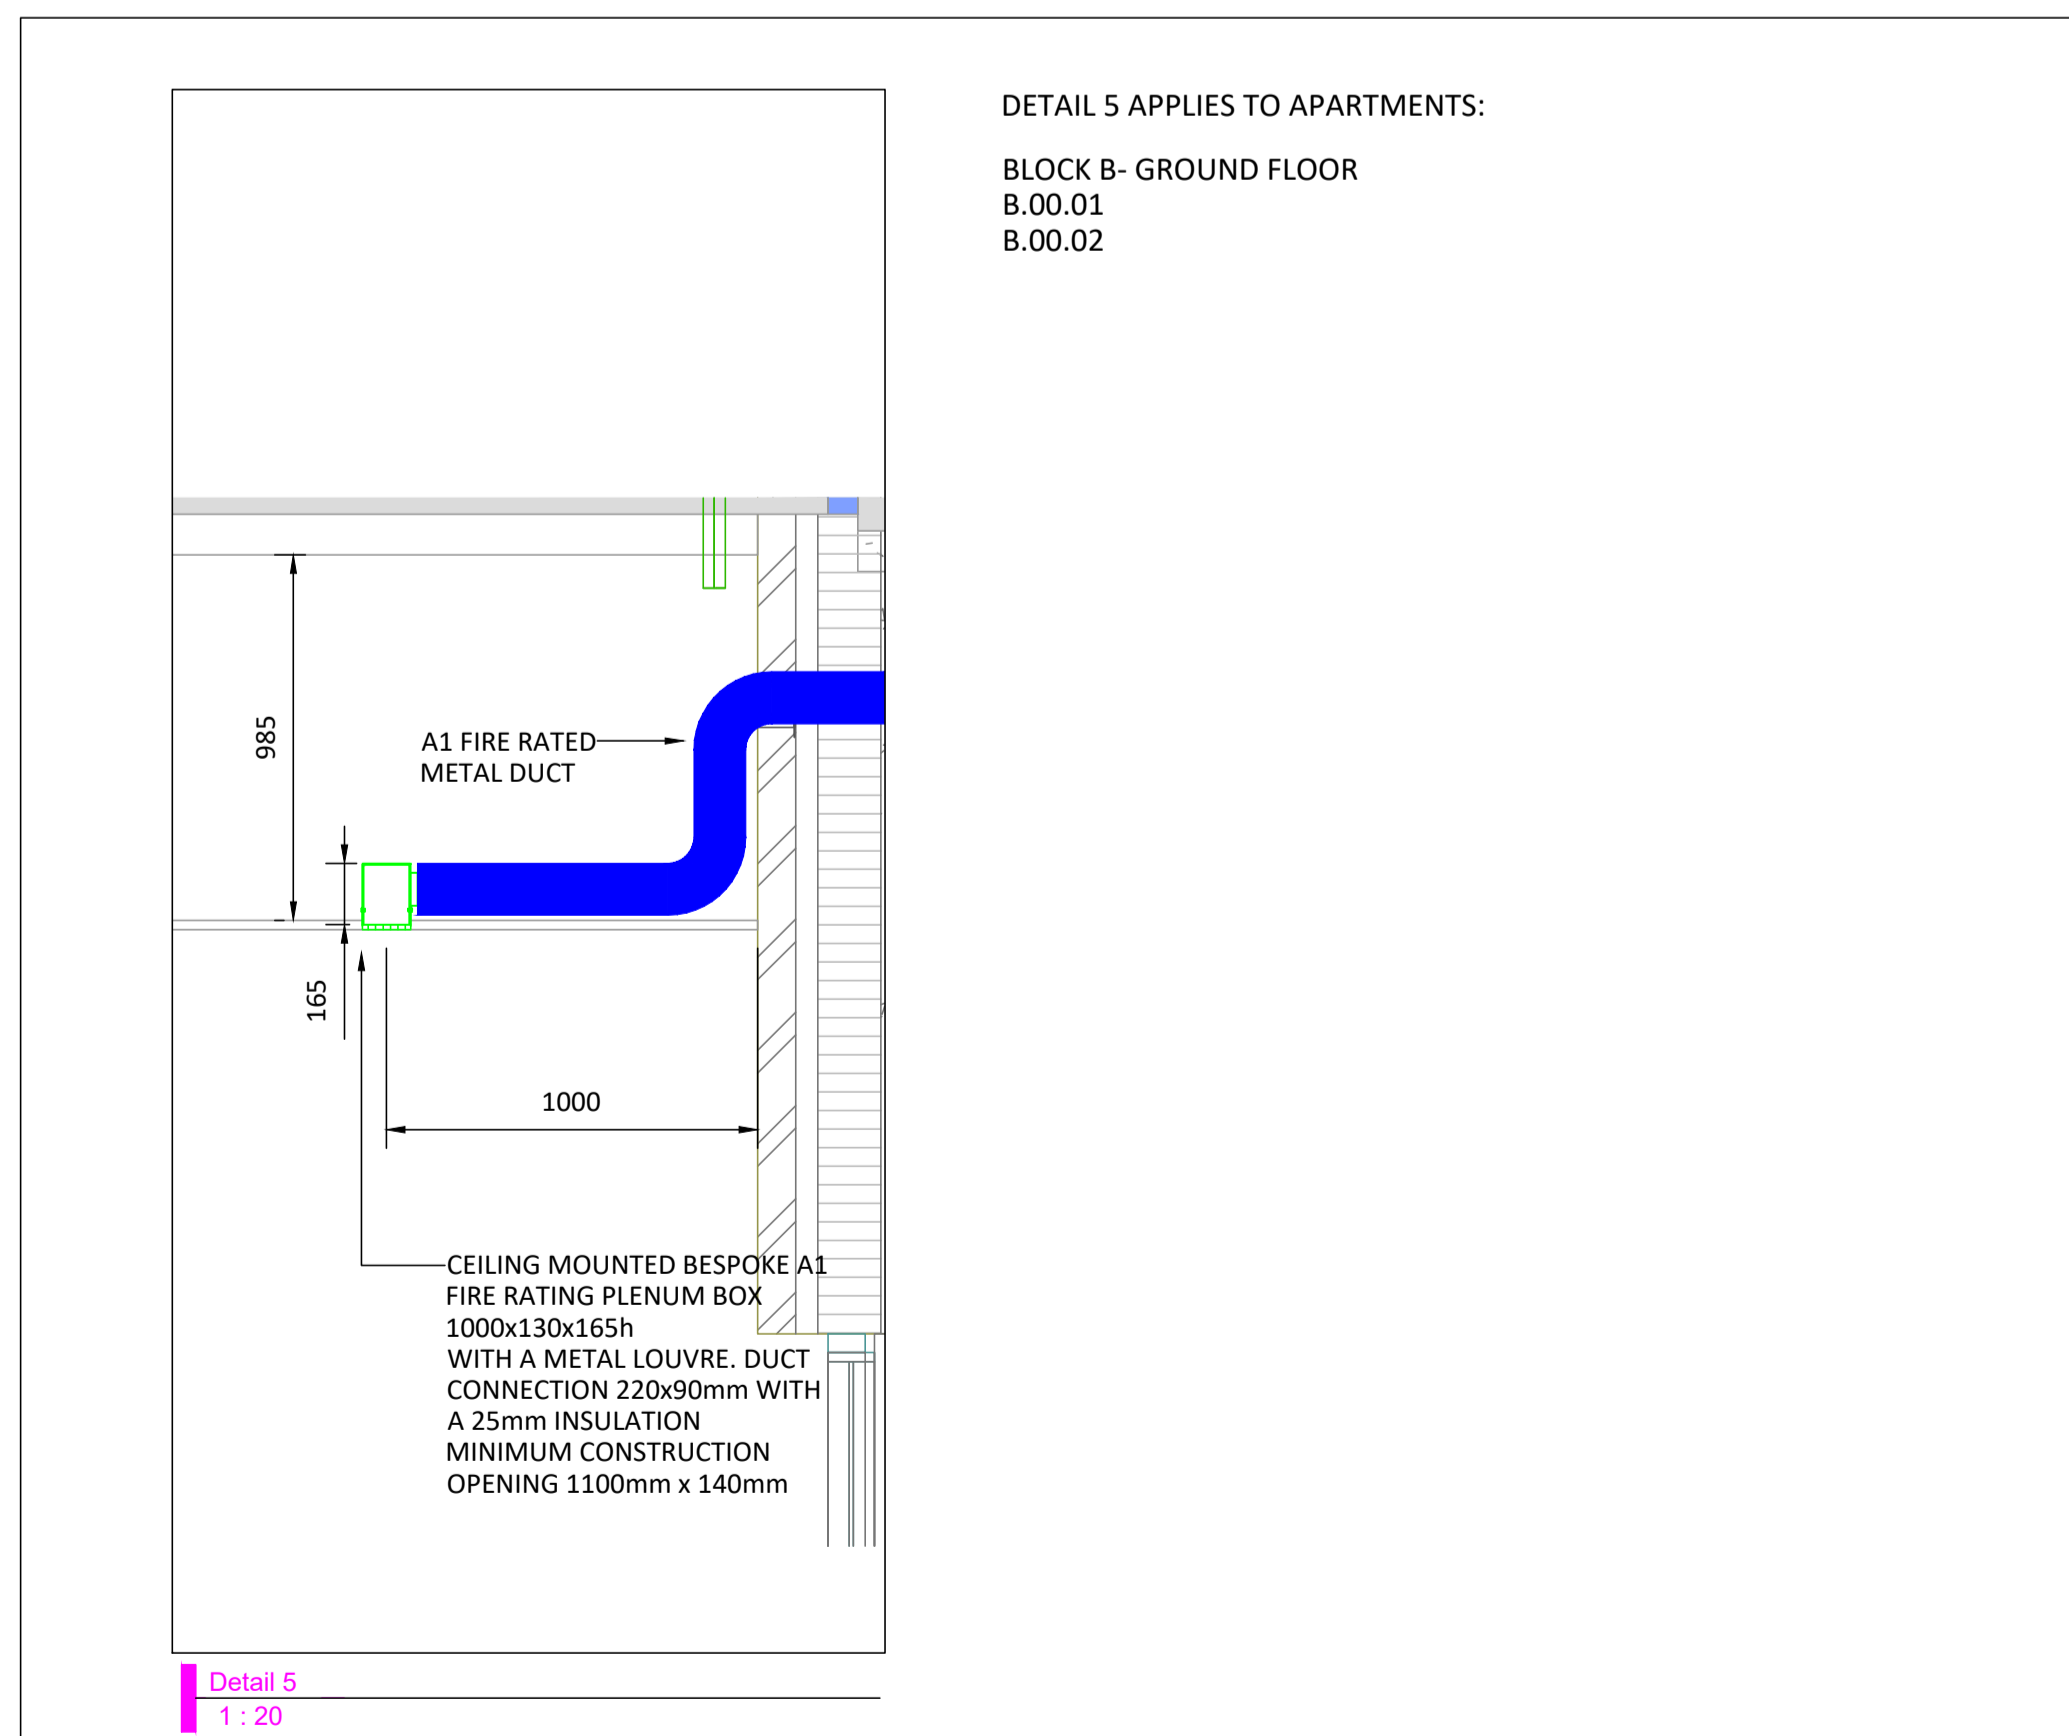
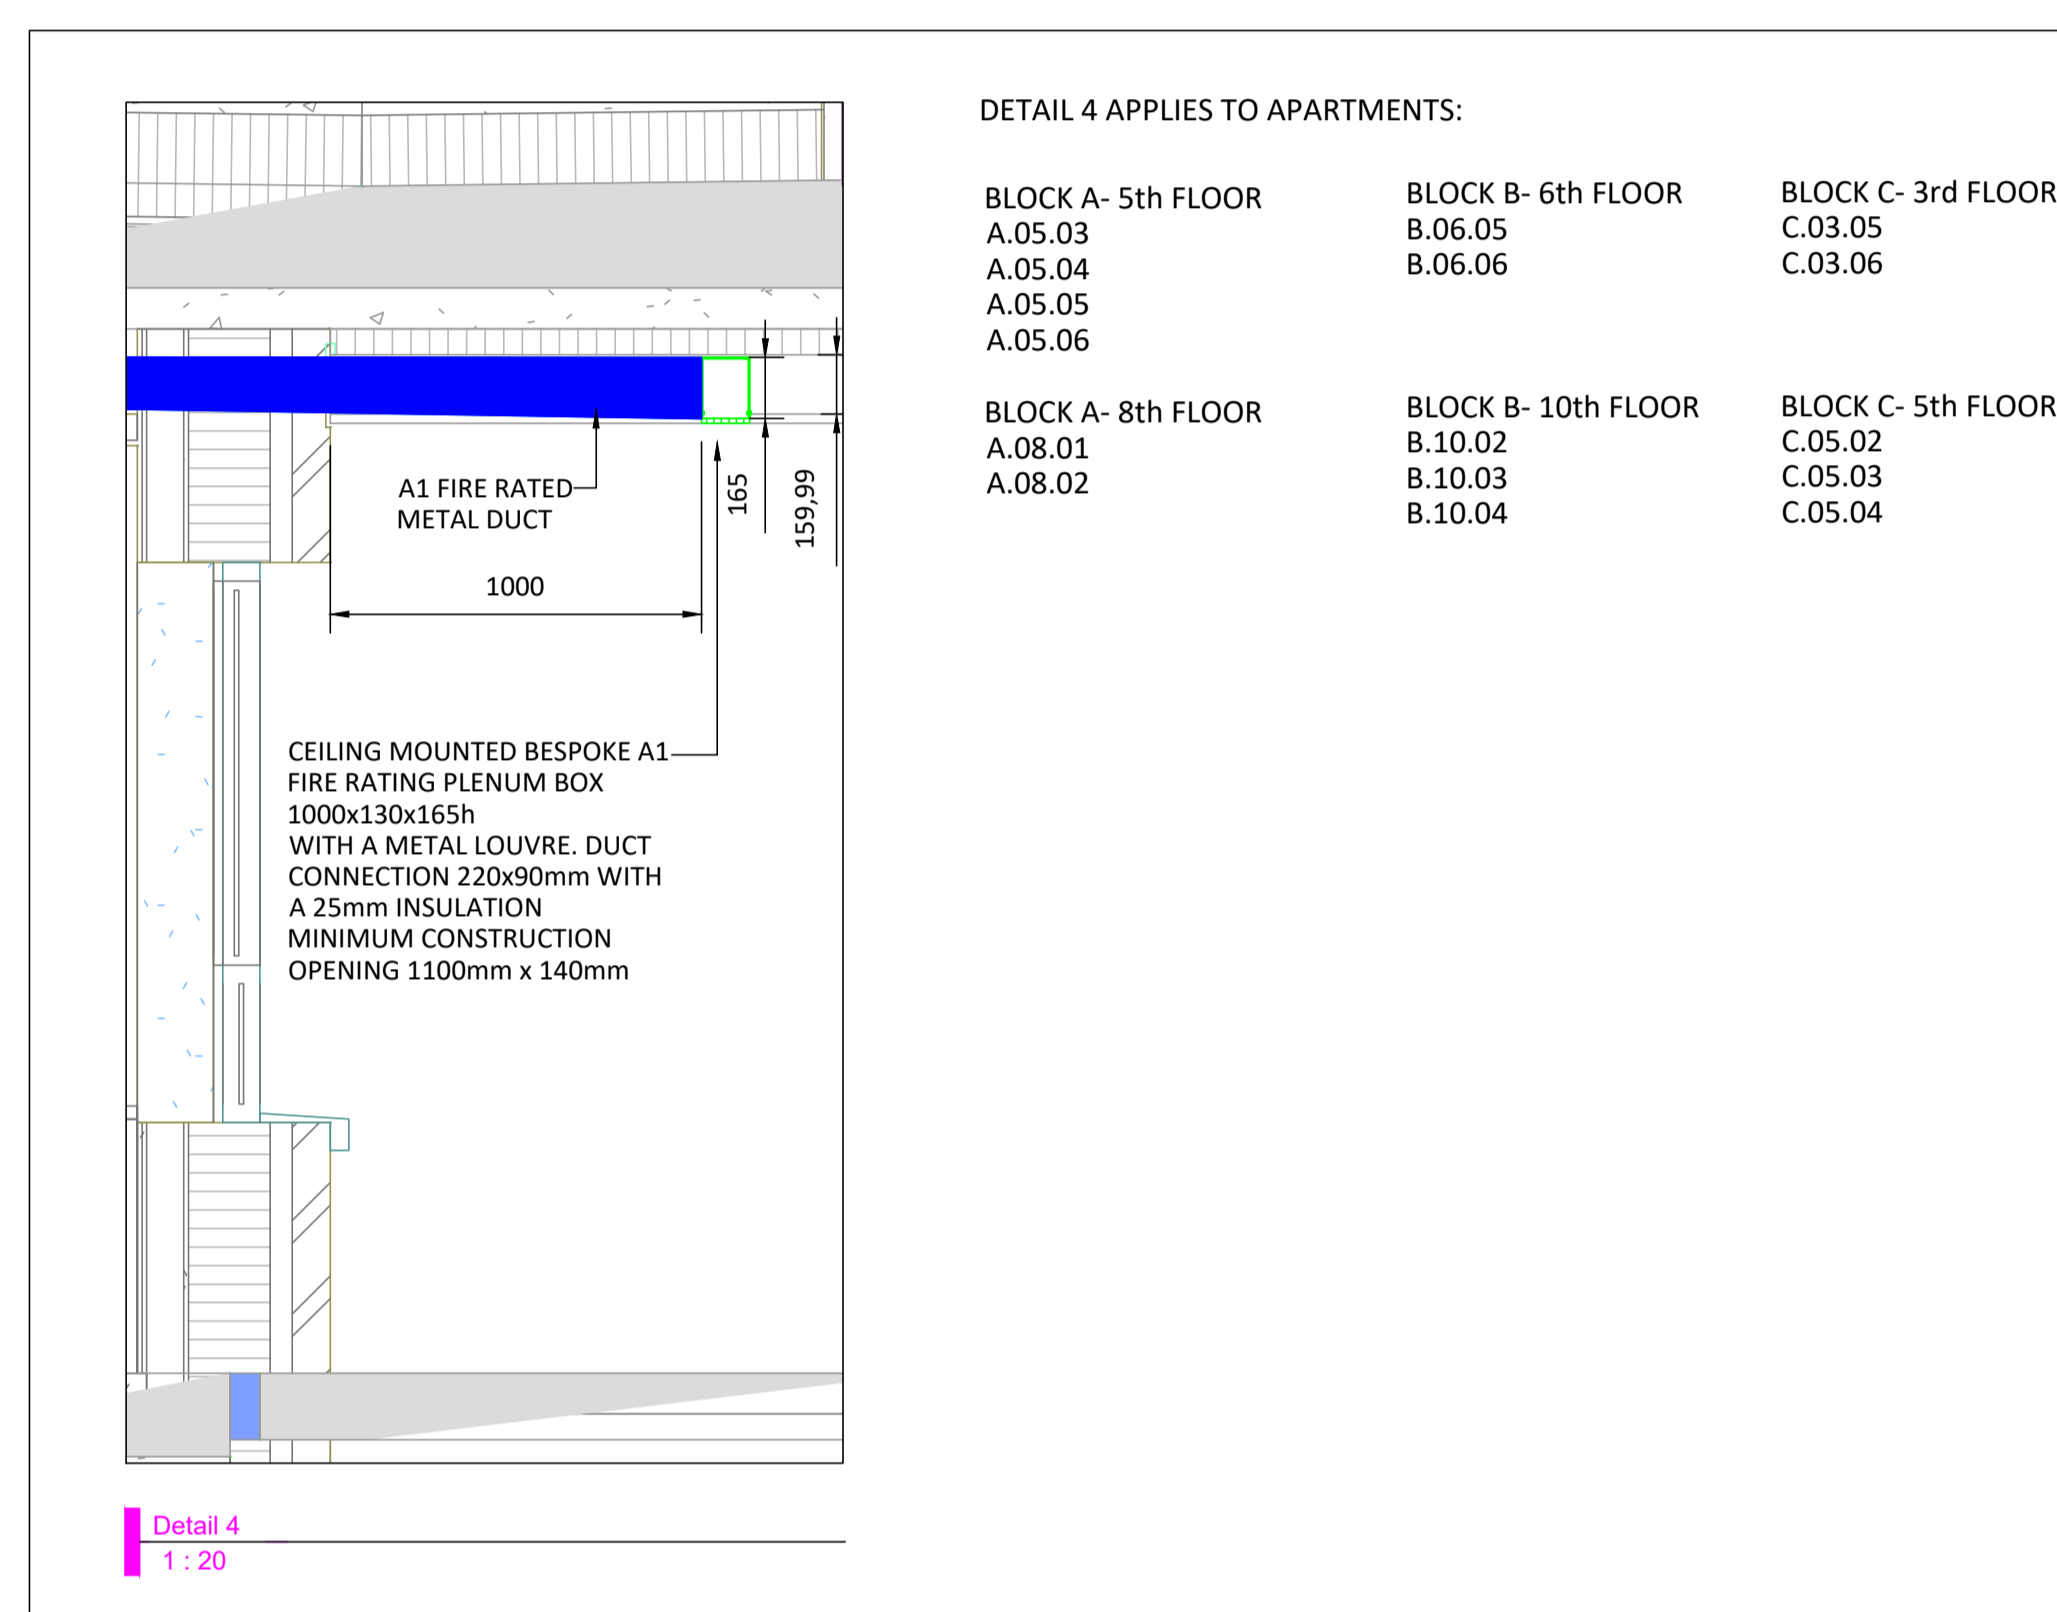
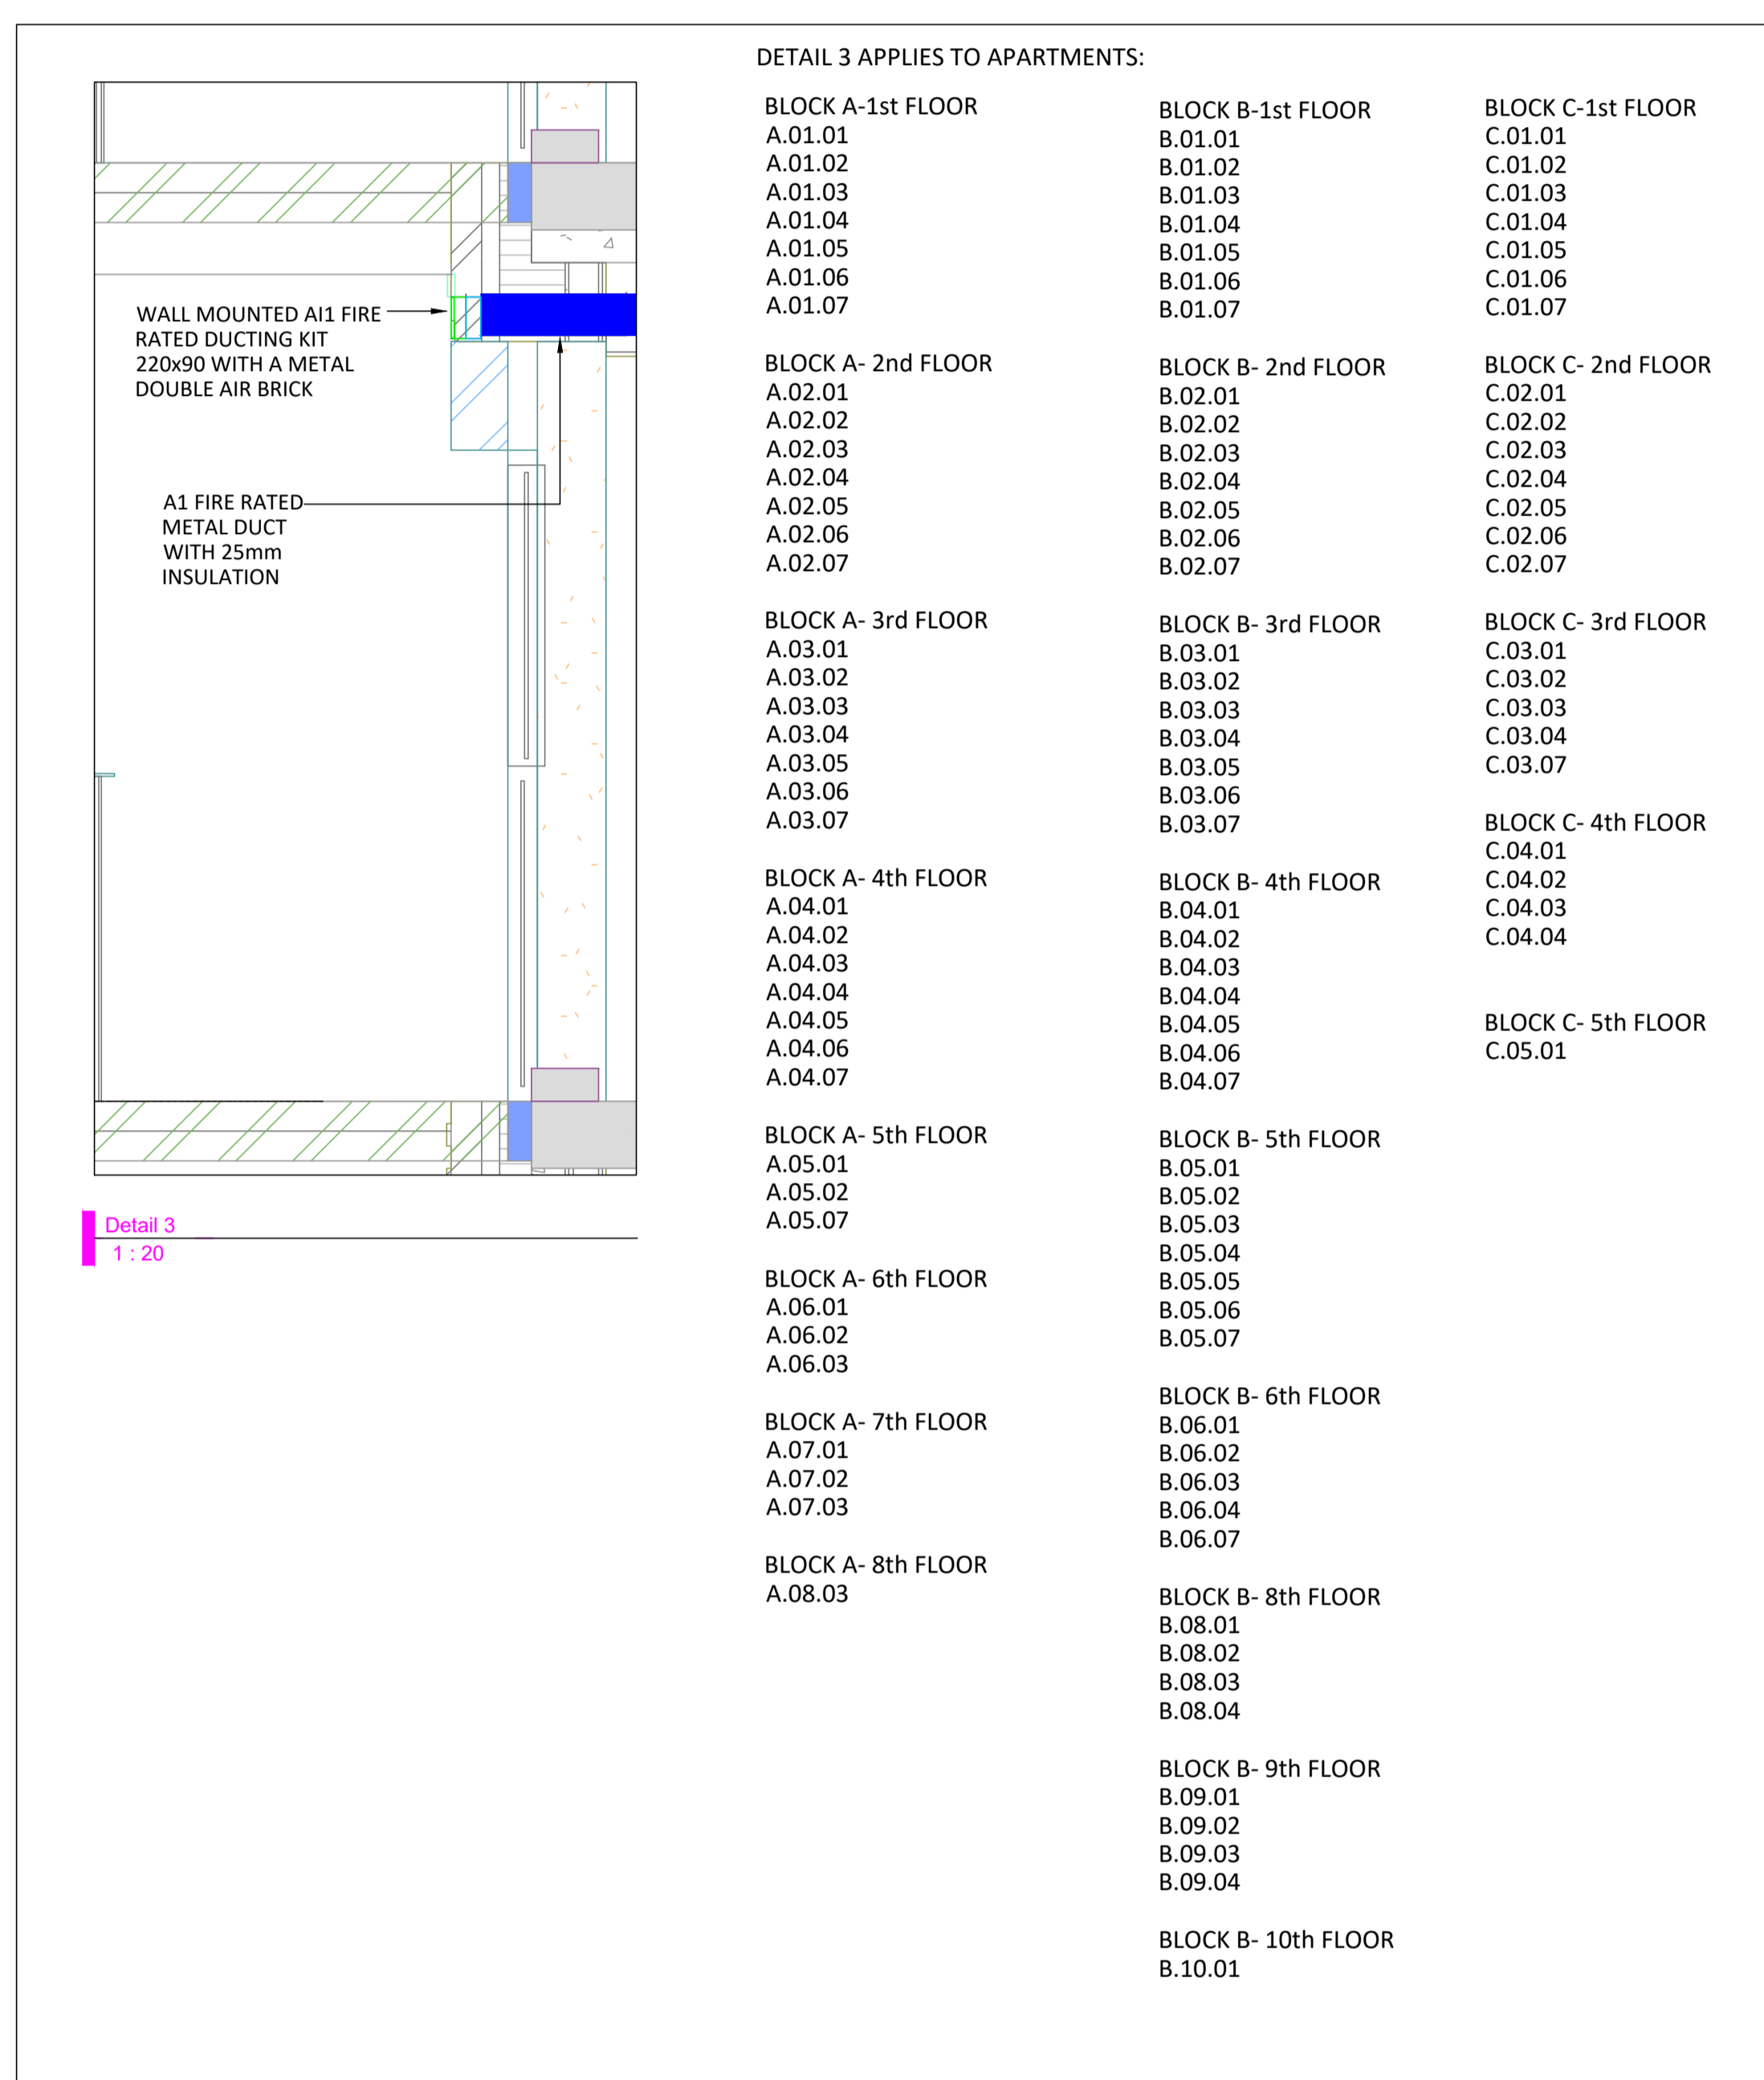
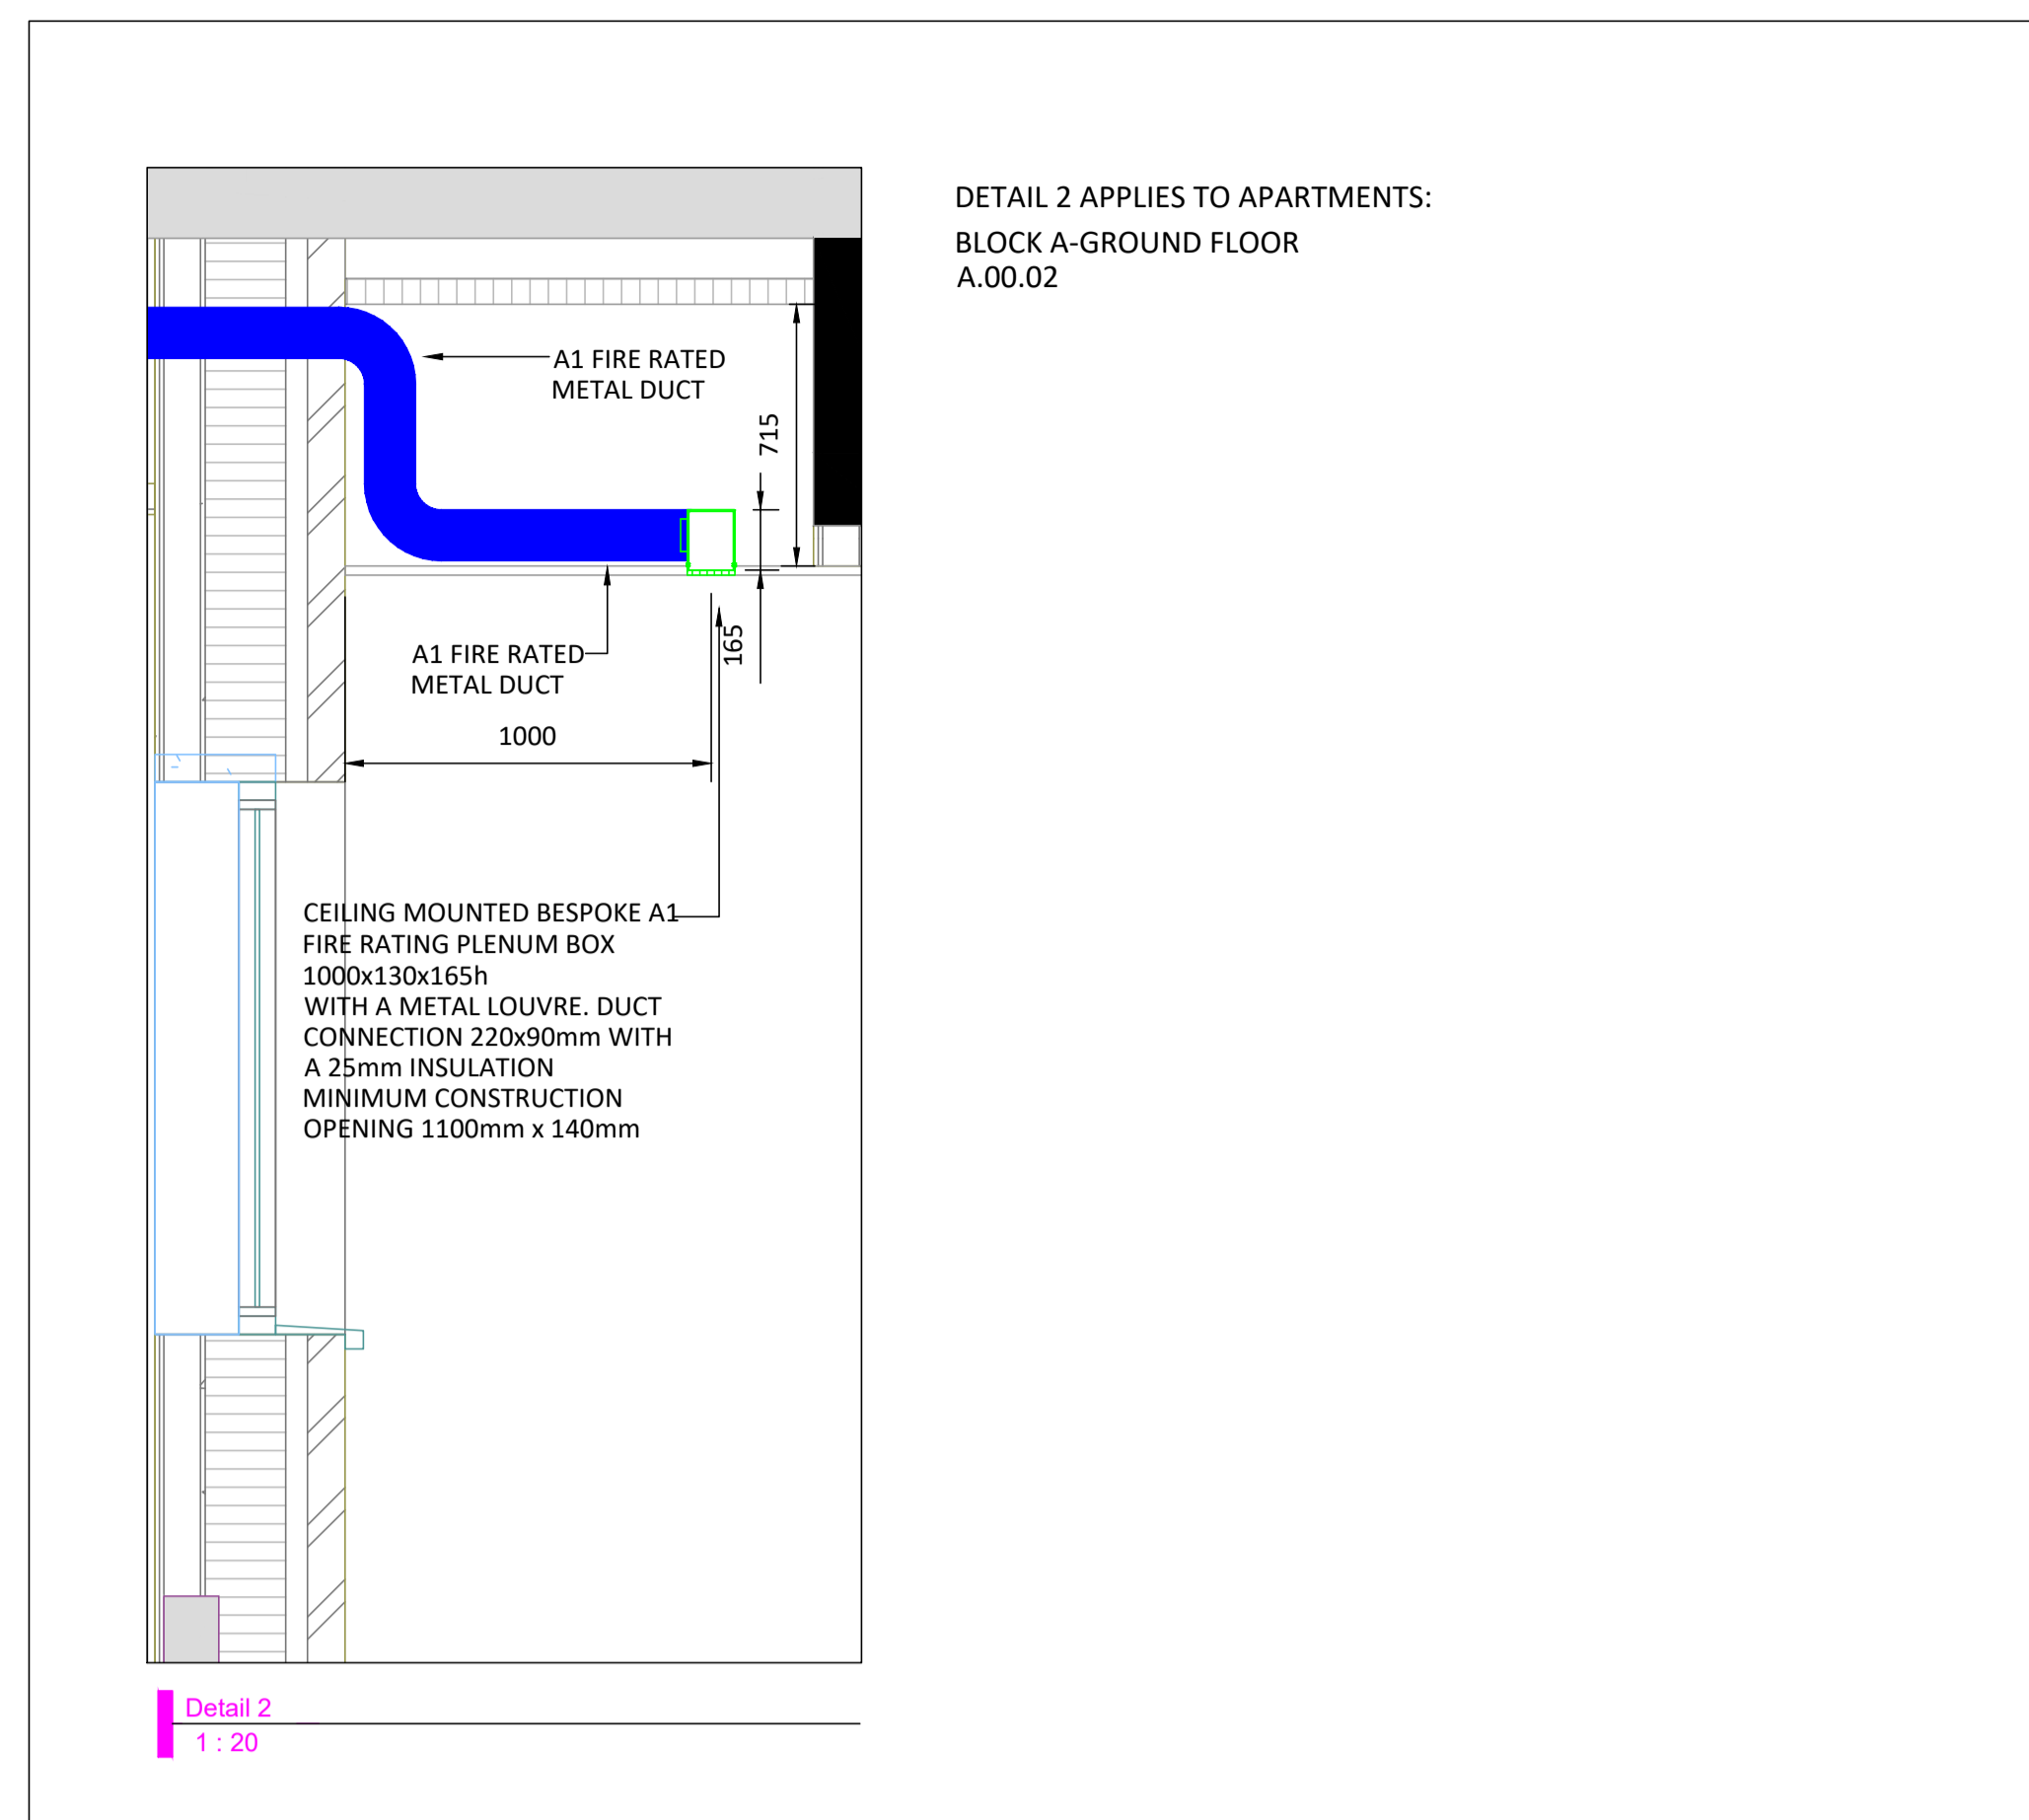


GENERAL NOTES:

1. ALL DUCTWORK TERMINATIONS SHALL BE METAL 220x90 A1 FIRE RATED WITH A 25mm INSULATION.
2. ALL PLENUM BOXES SHALL BE METAL A1 FIRE RATED.
3. BESPOKE METAL PLENUM BOXES AND METAL LOUVRE SHALL BE CONFIRMED BY SPECIALIST.
4. DOUBLE AIR BRICKS AND BESPOKE LOUVRES SHALL BE METAL.
5. DUCTING KITS SHALL BE ALLOWED BY THE MECHANICAL CONTRACTOR.
6. MINIMUM DISTANCE FROM OPENINGS SHALL BE 1000mm.
7. MINIMUM DISTANCE FROM FRESH AIR EXHAUST AIR LOUVER/BRICK SHALL BE 1500mm (CENTER TO CENTER).

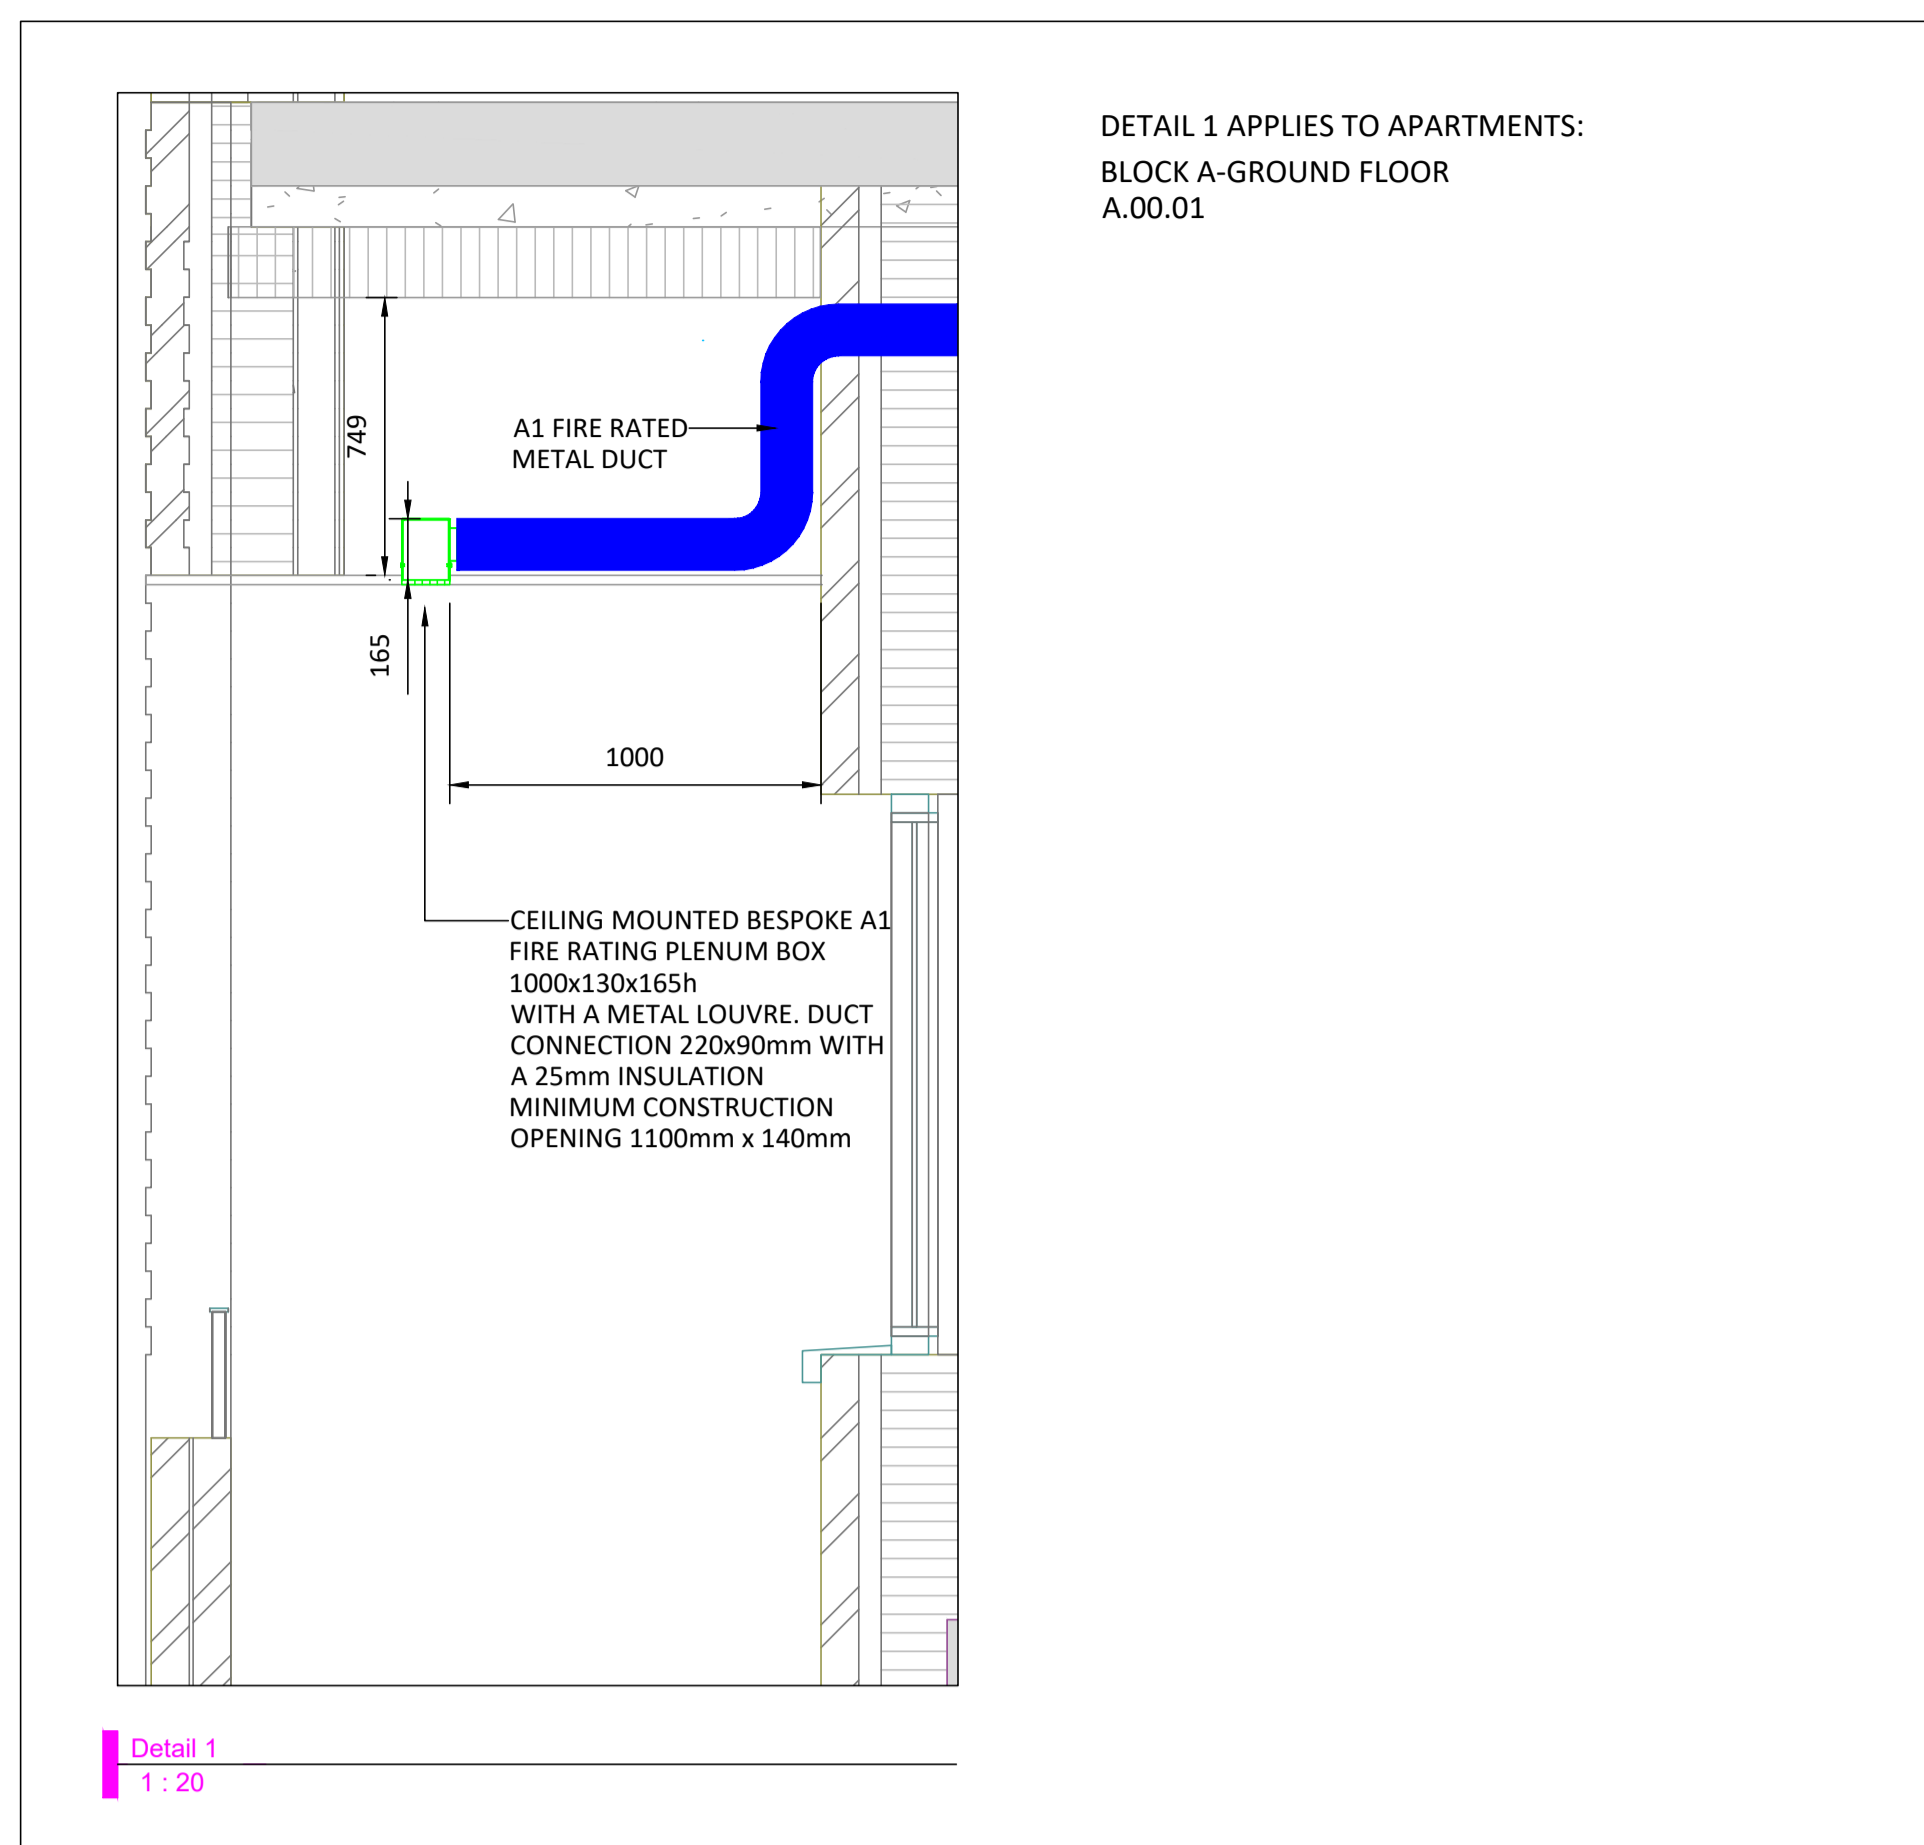

THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DESIGN TEAM DRAWINGS AND SPECIFICATIONS.

FOR SETTING OUT REFER TO ARCHITECT'S DRAWINGS. DO NOT SCALE THIS DRAWING. USE FIGURED DIMENSIONS ONLY.

NO PART OF THIS DOCUMENT MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR STORED IN ANY RETRIEVAL SYSTEM OF ANY NATURE WITHOUT THE WRITTEN PERMISSION OF O'CONNOR SUTTON CRONIN AS COPYRIGHT HOLDER EXCEPT AS AGREED FOR USE ON THE PROJECT FOR WHICH THE DOCUMENT WAS ORIGINALLY ISSUED.

Rev No.	1	Date	07.08.23	Revision Note	SUITABLE FOR COMMENT	Drn by	C.C.	Chkd by	C.K.
---------	---	------	----------	---------------	----------------------	--------	------	---------	------

