
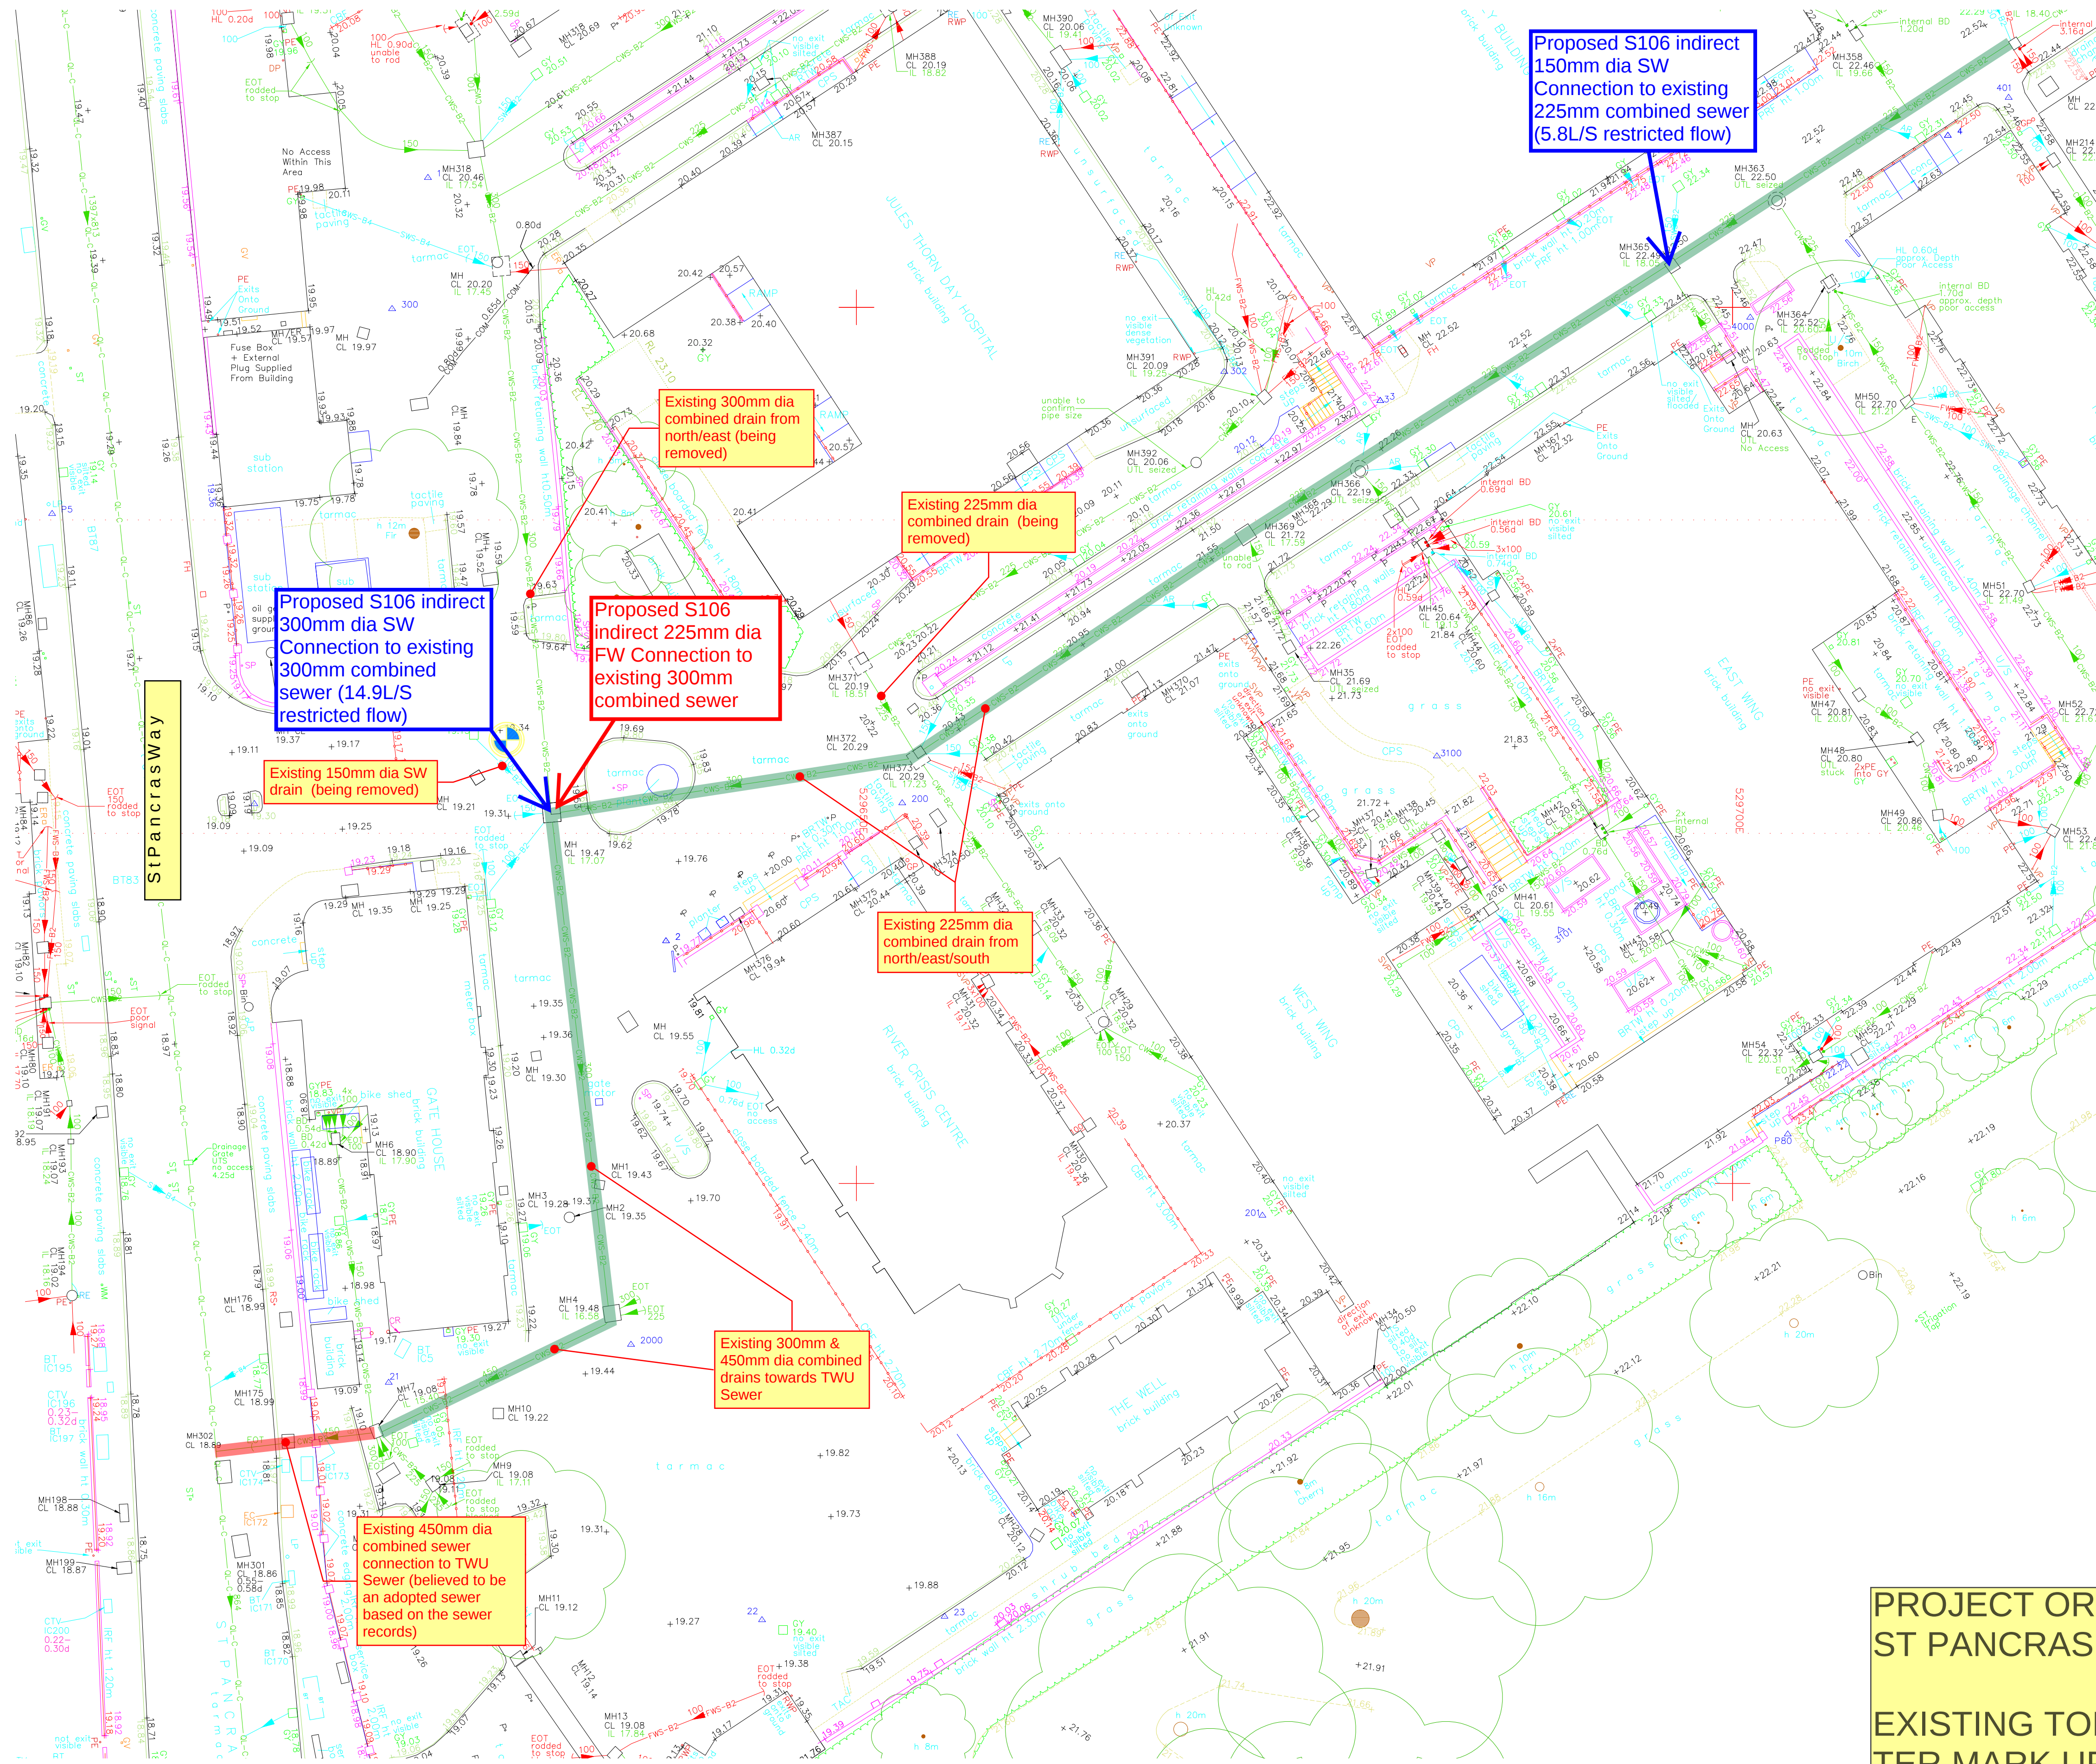


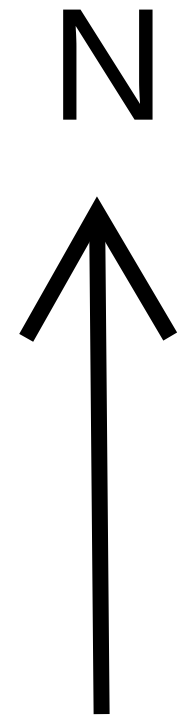

Total SW flow to existing combined sewer is $14.9 + 5.8 = 20.7\text{L/S}$ which is in line with the approved Pre Planning Capacity check flow of 20.8L/S (Ref DS6081542 dated 26.02.21)

PROJECT ORIEL ST PANCRAS HOSPITAL

EXISTING TOPO /UTILITIES SURVEY.
TER MARK UP TO SHOW LOCATIONS
OF NEW INDIRECT CONNECTIONS.

1:200@ A1 08.06.23