

<u>LEGEND</u>

- CLOSED CIRCUIT TELEVISION CAMERA - ALL REPLACED (IN SAME LOCATION)

- RECORDING DEVICE - REPLACED (IN SAME LOCATION)

IAP - INTRUDER ALARM CONTROL PANEL - REPLACED (IN SAME LOCATION)

KP - INTRUDER ALARM KEYPAD - REPLACED (IN SAME LOCATION)

PB - INTRUDER ALARM PUSH PANIC BUTTON - ALL REPLACED (IN SAME LOCATION)


— – INTRUDER ALARM SIREN – ALL REPLACED (IN SAME LOCATION)

D - INTRUDER DETECTOR (DIRECTIONAL) - ALL REPLACED (IN SAME LOCATION)

DOOR OPEN ALARM CONTACT - ALL REPLACED (IN SAME LOCATION)

CCT REF. - INTRUDER ALARM CIRCUIT NO. DETAILS - SEE NOTE 5



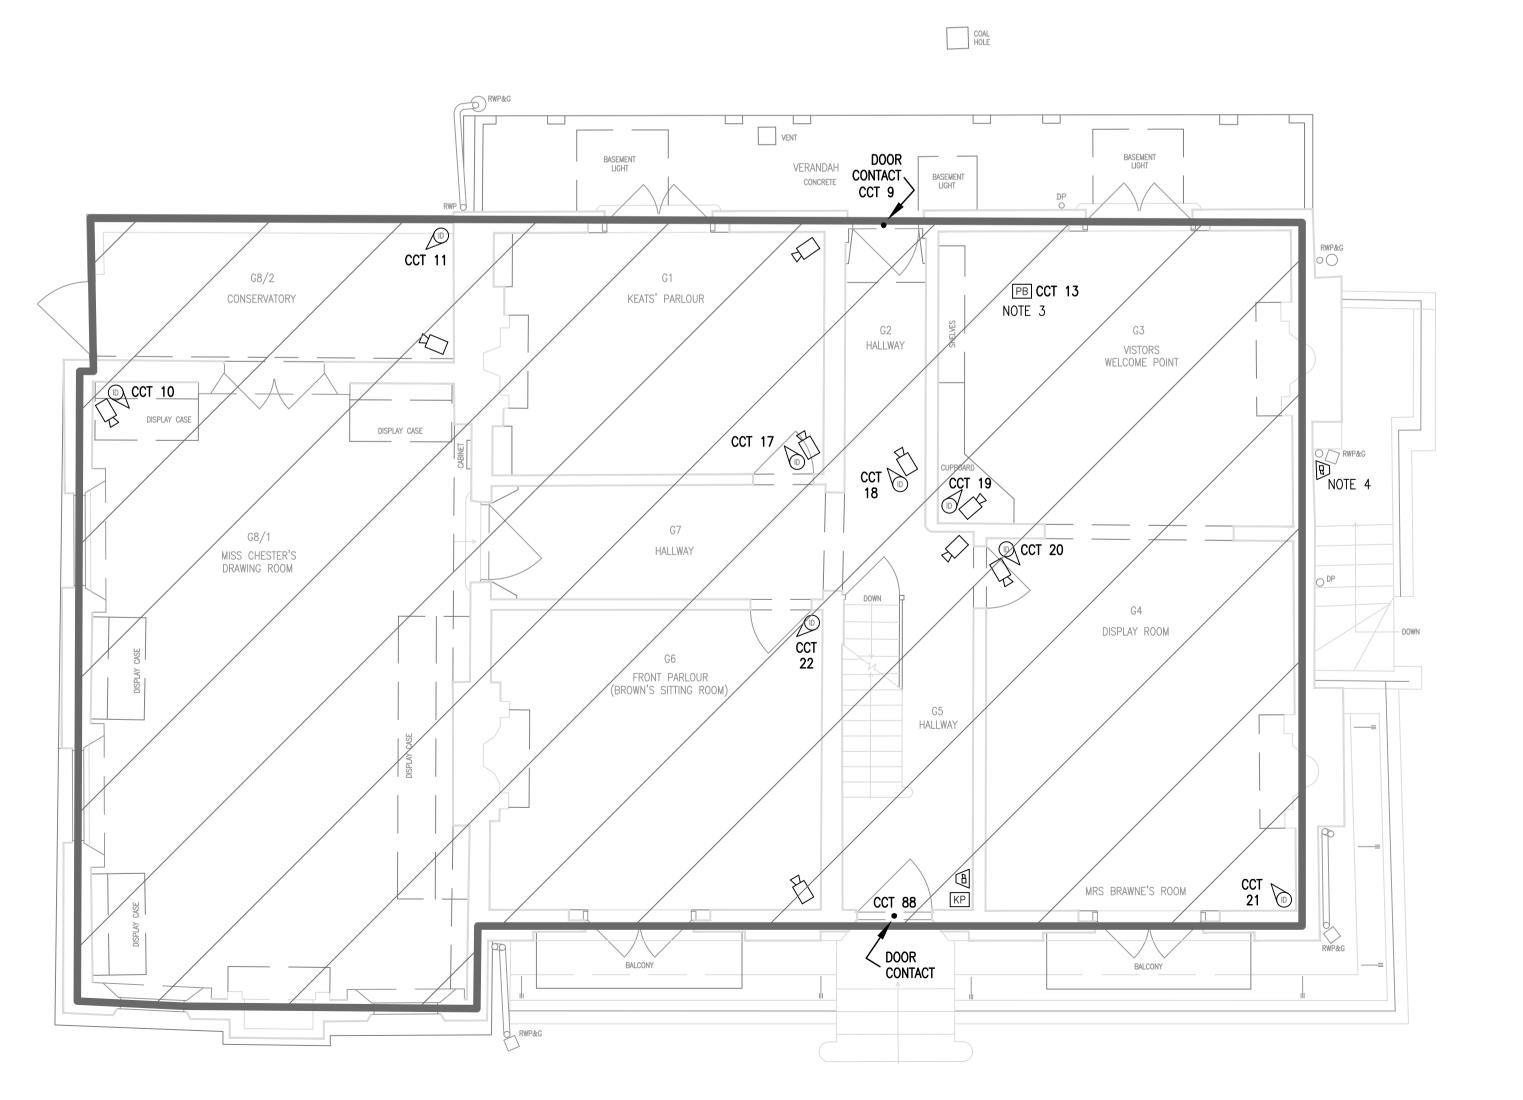

not

THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE CONTRACT SPECIFICATION AND ALL OTHER CONTRACT DRAWINGS

2. ALL SERVICES ROUTES ARE APPROXIMATE, THE CONTRACTOR SHALL BE RESPONSIBLE FOR DETERMINING THE EXACT ROUTES AND POSITIONS OF ALL INSTALLED SERVICES AND EQUIPMENT.

3. THE EXACT POSITION OF ALL SERVICES AND EQUIPMENT SHALL BE AGREED ON SITE WITH THE ENGINEER.

4. THE CONTRACTOR SHALL BE RESPONSIBLE FOR FULLY CO—ORDINATING ALL SERVICES INSTALLED BY HIM WITH THE BUILDING FABRIC AND ANY SERVICES TO BE INSTALLED BY OTHER.

EXISTING NON-FUSED CONNECTION UNITS
ARE TO BE REATAINED TO SUPPLY THE
NEW INTRUDER ALARM AND CCTV
SYSTEMS. HOWEVER, IT IS UNKNOWN
WHAT TYPE OF CABLE HAS BEEN
UTILISED AND HOW IT IS SUPPLIED
FROM THE HOUSES' DISTRIBUTION BOARD.

THE CONTRACTOR SHALL INVESTIGATE AND IF FOUND TO BE UNSUITABLE NEW CABLES ARE TO BE INSTALLED AND THE INDIVIDUAL CIRCUITS ARE TO BE DEDICATED TO EITHER THE INTRUDER ALARM OR CCTV SYSTEMS.

THE CABLE AND INSTALLATION METHOD SHOULD 'MARRY' WITH THE EXISTING WITH THE DEDICATED CIRCUIT DERIVED FROM THE LIBRARIES DISTRIBUTION BOARD.

6. LOCATION OF DNO TP&N SERVICE HEAD & METER ALONG WITH THE HOUSES DISTRIBUTION HEAD.

7. INTRUDER SIRENS NOT ALL SHOWN. ALL TO BE REPLACED IN THE SAME LOCATION.

8. WHERE PRACTICAL AND IT DOES NOT IMPAIR ITS OPERATION, ALL NEW & EXISTING DEVICES/EQUIPMENT ARE TO BE PAINTED (EVENLY & WITHOUT RUNS) SO AS TO MATCH THE SURROUNDING WALL/CEILING SURFACE TO WHICH IT IS FIXED.

9. ALL REDUNDANT CABLING IS TO BE REMOVED AND ANY SURFACES MADE GOOD.

Not	tes					
Dο	not	scale	ΔII	dimensions	to	he

_	 	 	 	 	 ecked fficer.	on	site.

С	SYMBOLS REDUCED IN SIZE AND NOTES 8 & 9 ADDED.	S.M.C.	17.07.23	
В	AMENDED TO REV. B FOR ISSUING PURPOSES.	S.M.C.	15.12.22	

A INCORPORATING ARCHITECTS COMMENTS. S.M.C. 09.11.22

Rev Drawn Date



P.G.Wilkinson BSc MSc MRICS City Surveyor

CITY SURVEYOR'S DEPARTMENT Corporate Property Group: Plans & Research Section

Project:
KEATS HOUSE
10 KEATS GROVE
LONDON NW3 2RR

Drawing :

BASEMENT & GRD FLR PROPOSED INT. ALARM & CCTV SYSTEMS LAYOUTS

Drawing No: COL/KH/68/20

Revision C