

GENERAL NOTES.

- THE CONTRACTOR WILL FULLY COMPLY WITH ALL RELEVANT BRITISH STANDARDS, REGULATIONS, STANDARD CODES OF PRACTICE, METHODS OF WORKING, AND GOOD PRACTICE.
- THE MECHANICAL CONTRACTOR IS RESPONSIBLE FOR FINAL CO-ORDINATION AND INSTALLATION OF ALL MECHANICAL SERVICES WITH ALL OTHER SERVICES AND THE BUILDING STRUCTURE.
- ALL SERVICES WILL BE IDENTIFIED IN ACCORDANCE WITH BS 1710 AND GOOD ENGINEERING PRACTICE. PIPEWORK TO BE RAL 6003.
- ALL PIPEWORK TO BE PRESSURE TESTED PRIOR TO APPLICATION OF INSULATION.
- ALL PIPEWORK IN PLANTROOM, RISERS, RECESSED AREAS, BOXING IN OR CEILING VOIDS SHALL BE THERMALLY INSULATED THROUGHOUT USING THE MATERIALS IN ACCORDANCE WITH THE M&E SPECIFICATION.
- DRAIN COCKS SHALL BE PROVIDED TO ALL LOW POINTS ON THE SYSTEM.
- AUTOMATIC AIR VENTS SHALL BE PROVIDED TO ALL HIGH POINTS ON THE SYSTEM.
- THE MECHANICAL CONTRACTOR SHALL ALLOW ALL ANCILLARIES NECESSARY TO DEAL WITH EXPANSION/CONTRACTION.
- THE CONTRACTOR SHALL ENSURE ALL PIPEWORK PENETRATING A CAVITY BARRIER OR FIRE COMPARTMENT WALL/SLAB SHALL BE FIRE STOPPED AT THE POINT OF PENETRATION IN ORDER TO MAINTAIN THE INTEGRITY AND REQUIRED FIRE RESISTANCE OF THE FIRE COMPARTMENT.

NOTES

- ALL PIPEWORK ROUTES SHOWN ARE INDICATIVE & SUBJECT TO VALIDATION BY THE CONTRACTOR.
- FOR PIPE SIZES REFER TO DWG No. 522223-FCG-MB-SC-DR-M-5000 & 522223-FCG-MB-SC-DR-M-5600

LEGEND:

- PIPE DROPPING TO BELOW
- PIPE RISING TO ABOVE
- PIPEWORK BELOW FLOOR
- PIPEWORK AT LOW LEVEL
- PIPEWORK AT HIGH LEVEL
- PIPEWORK WITHIN CEILING VOID SPACE
- PROPOSED RADIATOR
- ROOM THERMOSTAT

ABBREVIATIONS:

- HTG-F - HEATING FLOW
- HTG-R - HEATING RETURN
- F.A. - FROM ABOVE
- F.B. - FROM BELOW
- T.A. - TO ABOVE
- T.B. - TO BELOW
- DTLL - DROP TO LOW LEVEL
- H/L - HIGH LEVEL
- L/L - LOW LEVEL
- C/V - CEILING VOID

CO1	29.11.22	DJ	AM	BP	Tender Issue
PO1	27.10.22	DJ	AM	BP	Preliminary Issue
Rev	Date	By	Chk	App	Comment

BRINGING IDEAS TO LIFE



FRANKHAM

Frankham Consultancy Group Limited

E: [enquire@frankham.com](mailto:enquire@frankham.com)

www.frankham.com

<b>SIDCUP OFFICE</b> Irene House Five Arches Business Park Medstone Road Sidcup, Kent DA14 5AE T: 020 8309 7777	<b>OXFORD OFFICE</b> Wootton Business Park Beesleigh Road Wootton, Abingdon Oxfordshire OX13 6FD T: 01865 322500
<b>LONDON OFFICE</b> Third Floor Baird House 15-17 St Cross Street London EC1N 8UW T: 020 7653 0790	<b>STEVENAGE OFFICE</b> Suite 127, Second Floor Kings Court Business Centre London Road, Stevenage Hertfordshire SG1 2NG T: 020 3748 7063

Client:

LFB

LONDON FIRE BRIGADE

Project Title:

Euston Fire Station

Drawing Title:

Basement Level  
Mechanical Services  
Proposed Heating Layout

Status:


TENDER ISSUE

Drawn By: DK	Designed By: DJ	Checked By: AM	Approved By: BP
-----------------	--------------------	-------------------	--------------------

Original Issue Date: 27/10/2022	Scale @ A1: 1:50
------------------------------------	---------------------

Job No/ File Ref 522223	Originator FCG	Zone MB	Level B1	
Type DR	Discipline M	Number 5601	Suitability D2	Revision C01



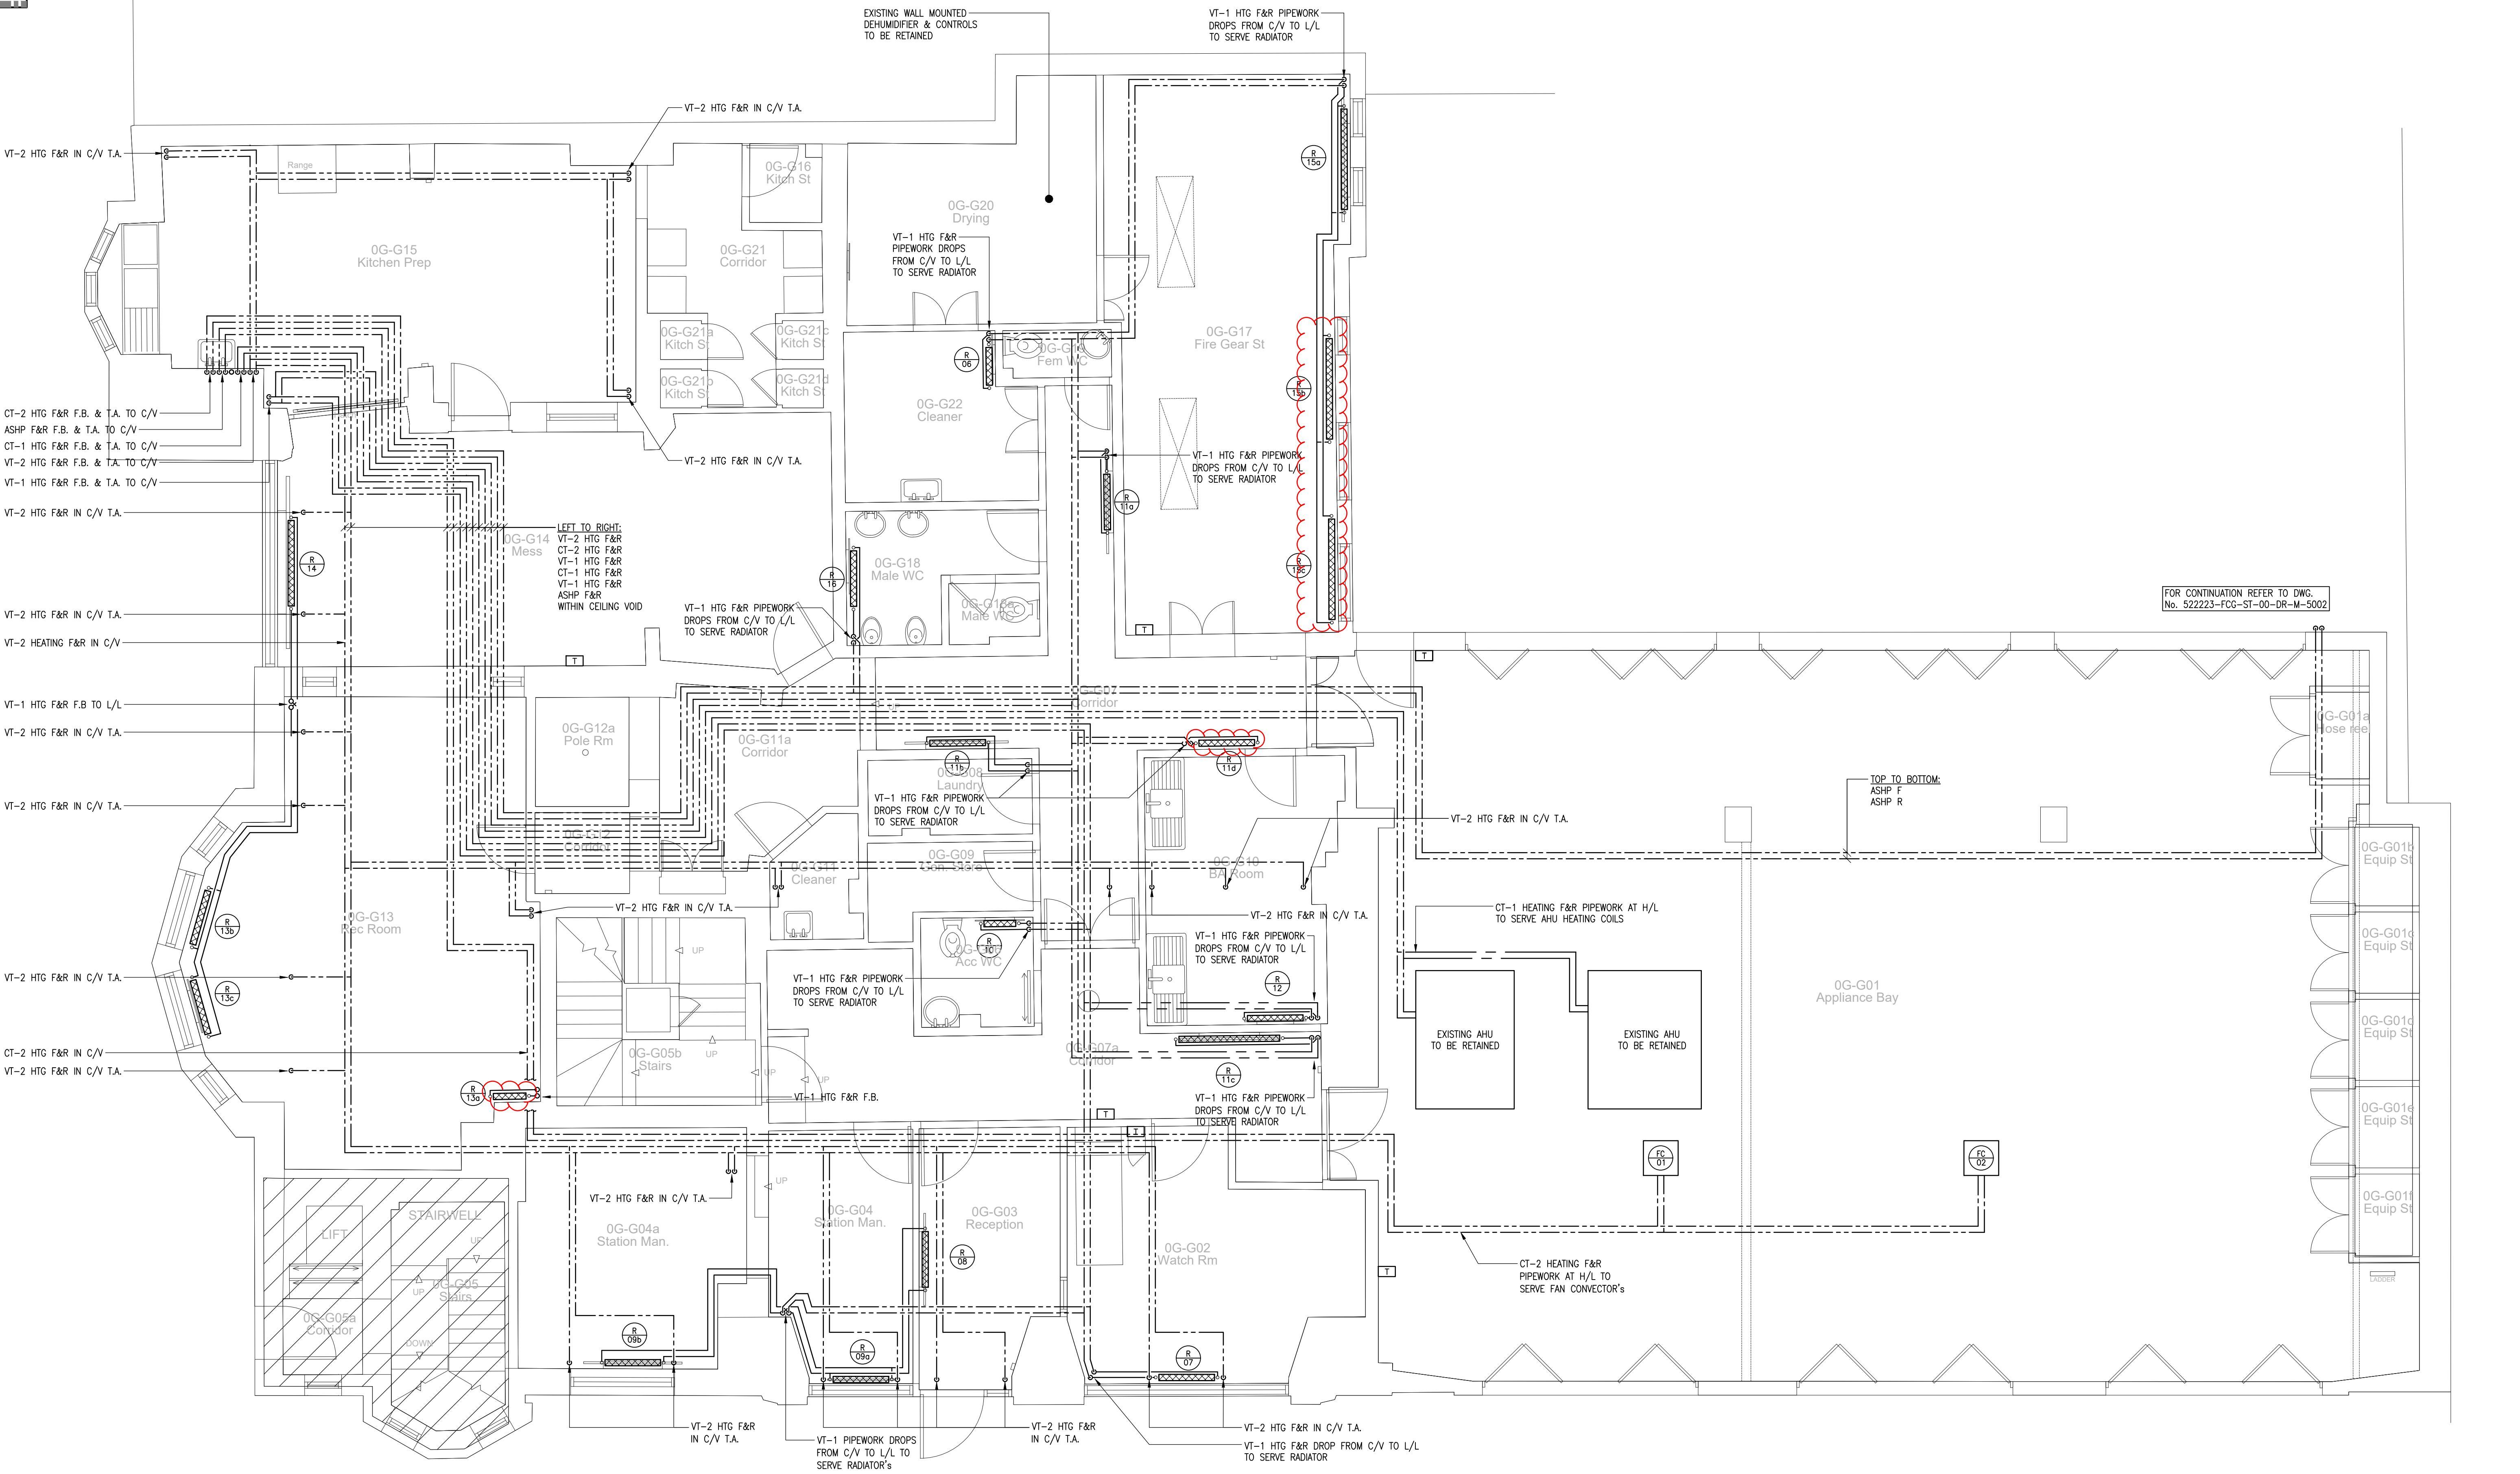

NOTES

1. ALL PIPEWORK ROUTES SHOWN ARE INDICATIVE & SUBJECT TO VALIDATION BY THE CONTRACTOR.

2. FOR PIPE SIZES REFER TO DWG No. 522223-FCG-MB-SC-DR-M-5000 & 522223-FCG-MB-SC-DR-M-5600

GENERAL NOTES.

- THE CONTRACTOR WILL FULLY COMPLY WITH ALL RELEVANT BRITISH STANDARDS, REGULATIONS, STANDARD CODES OF PRACTICE, METHODS OF WORKING, AND GOOD PRACTICE.
- THE MECHANICAL CONTRACTOR IS RESPONSIBLE FOR FINAL CO-ORDINATION AND INSTALLATION OF ALL MECHANICAL SERVICES WITH ALL OTHER SERVICES AND THE BUILDING STRUCTURE.
- ALL SERVICES WILL BE IDENTIFIED IN ACCORDANCE WITH BS 1710 AND GOOD ENGINEERING PRACTICE. PIPEWORK TO BE RAL 6003.

- ALL PIPEWORK TO BE PRESSURE TESTED PRIOR TO APPLICATION OF INSULATION.
- ALL PIPEWORK IN PLANTROOM, RISERS, RECESSED AREAS, BOXING IN OR CEILING VOIDS SHALL BE THERMALLY INSULATED THROUGHOUT USING THE MATERIALS IN ACCORDANCE WITH THE M&E SPECIFICATION.
- DRAIN COCKS SHALL BE PROVIDED TO ALL LOW POINTS ON THE SYSTEM.
- AUTOMATIC AIR VENTS SHALL BE PROVIDED TO ALL HIGH POINTS ON THE SYSTEM.

- THE MECHANICAL CONTRACTOR SHALL ALLOW ALL ANCILLARIES NECESSARY TO DEAL WITH EXPANSION/CONTRACTION.
- THE CONTRACTOR SHALL ENSURE ALL PIPEWORK PENETRATING A CAVITY BARRIER OR FIRE COMPARTMENT WALL/SLAB SHALL BE FIRE STOPPED AT THE POINT OF PENETRATION IN ORDER TO MAINTAIN THE INTEGRITY AND REQUIRED FIRE RESISTANCE OF THE FIRE COMPARTMENT.

LEGEND:

— PIPE DROPPING TO BELOW

— PIPE RISING TO ABOVE

--- PIPEWORK BELOW FLOOR

--- PIPEWORK AT LOW LEVEL

--- PIPEWORK AT HIGH LEVEL

--- PIPEWORK WITHIN CEILING VOID SPACE

--- PROPOSED RADIATOR

T ROOM THERMOSTAT

ABBREVIATIONS:

HTG-F - HEATING FLOW

HTG-R - HEATING RETURN

F.A. - FROM ABOVE

F.B. - FROM BELOW

T.A. - TO ABOVE

T.B. - TO BELOW

DTLL - DROP TO LOW LEVEL

H/L - HIGH LEVEL

L/L - LOW LEVEL

C/V - CEILING VOID

ALL DIMENSIONS, LEVELS AND CLEARANCES TO BE CHECKED ON SITE PRIOR TO WORKS COMMENCING

THIS DRAWING SHOULD BE READ IN CONJUNCTION WITH ALL OTHER PROJECT RELATED DRAWINGS, SPECIFICATIONS AND DOCUMENTS AS PART OF A SINGLE PROJECT PACKAGE.

ANY DISCREPANCY BETWEEN THIS DRAWING, OTHER DRAWINGS FORMING PART OF THIS CONTRACT, OR THE SPECIFICATION / BILLS OF QUANTITIES MUST BE CLARIFIED BEFORE COMMENCEMENT OF ANY WORK OR ORDERING OF ANY MATERIALS.

PLEASE CONSULT THE AUTHOR OR PROJECT MANAGER SHOULD THE READER REQUIRE CLARIFICATION ON ANY PART OF THIS DRAWING.

THE COPYRIGHT OF THE DRAWING AND DESIGN IS THE PROPERTY OF THE COMPANY. THIS INFORMATION HAS BEEN ISSUED UNDER SPECIFIC TERMS FOR THIS PROJECT AND MAY ONLY BE USED AND REPRODUCED ACCORDINGLY.

Rev	Date	By	Chk	Appr	Comment
C01	29.11.22	DJ	AM	BP	Tender Issue
P01	27.10.22	DJ	AM	BP	Preliminary Issue

BRINGING IDEAS TO LIFE

**FRANKHAM**

**Frankham Consultancy Group Limited**

E: enquire@frankham.com  
www.frankham.com

**SIDCUP OFFICE**  
Five Arches Business Park  
Maidstone Road  
Sidcup, Kent DA14 5AE  
T: 020 8309 7777

**IRENE HOUSE**  
Baird House  
15-17 St Cross Street  
London EC1N 8UW  
T: 020 7651 0790

**OXFORD OFFICE**  
Wootton Business Park  
Beesleysleigh Road  
Wootton, Abingdon  
Oxfordshire OX13 9FD  
T: 01865 322500

**STEVENAGE OFFICE**  
Suite 237, Second Floor  
Kings Court Business Centre  
London Road, Stevenage  
Hertfordshire SG2 2NG  
T: 020 3714 7063

**LONDON OFFICE**

Project Title:

Euston Fire Station

Drawing Title:

Ground Floor Mechanical Services Proposed Heating Layout

Job No/ File Ref

522223

Originator

FCG

Zone

MB

Level

00

Type

DR

Discipline

M

Number

5602

Suitability

D2

Revision

C01

Client:

**LFB**

LONDON FIRE BRIGADE

Drawn By: DK

Designed By: DJ

Checked By: AM

Approved By: BP

Original Issue Date:

27/10/2022


Scale @ A1:

1:50

Status:

**TENDER ISSUE**



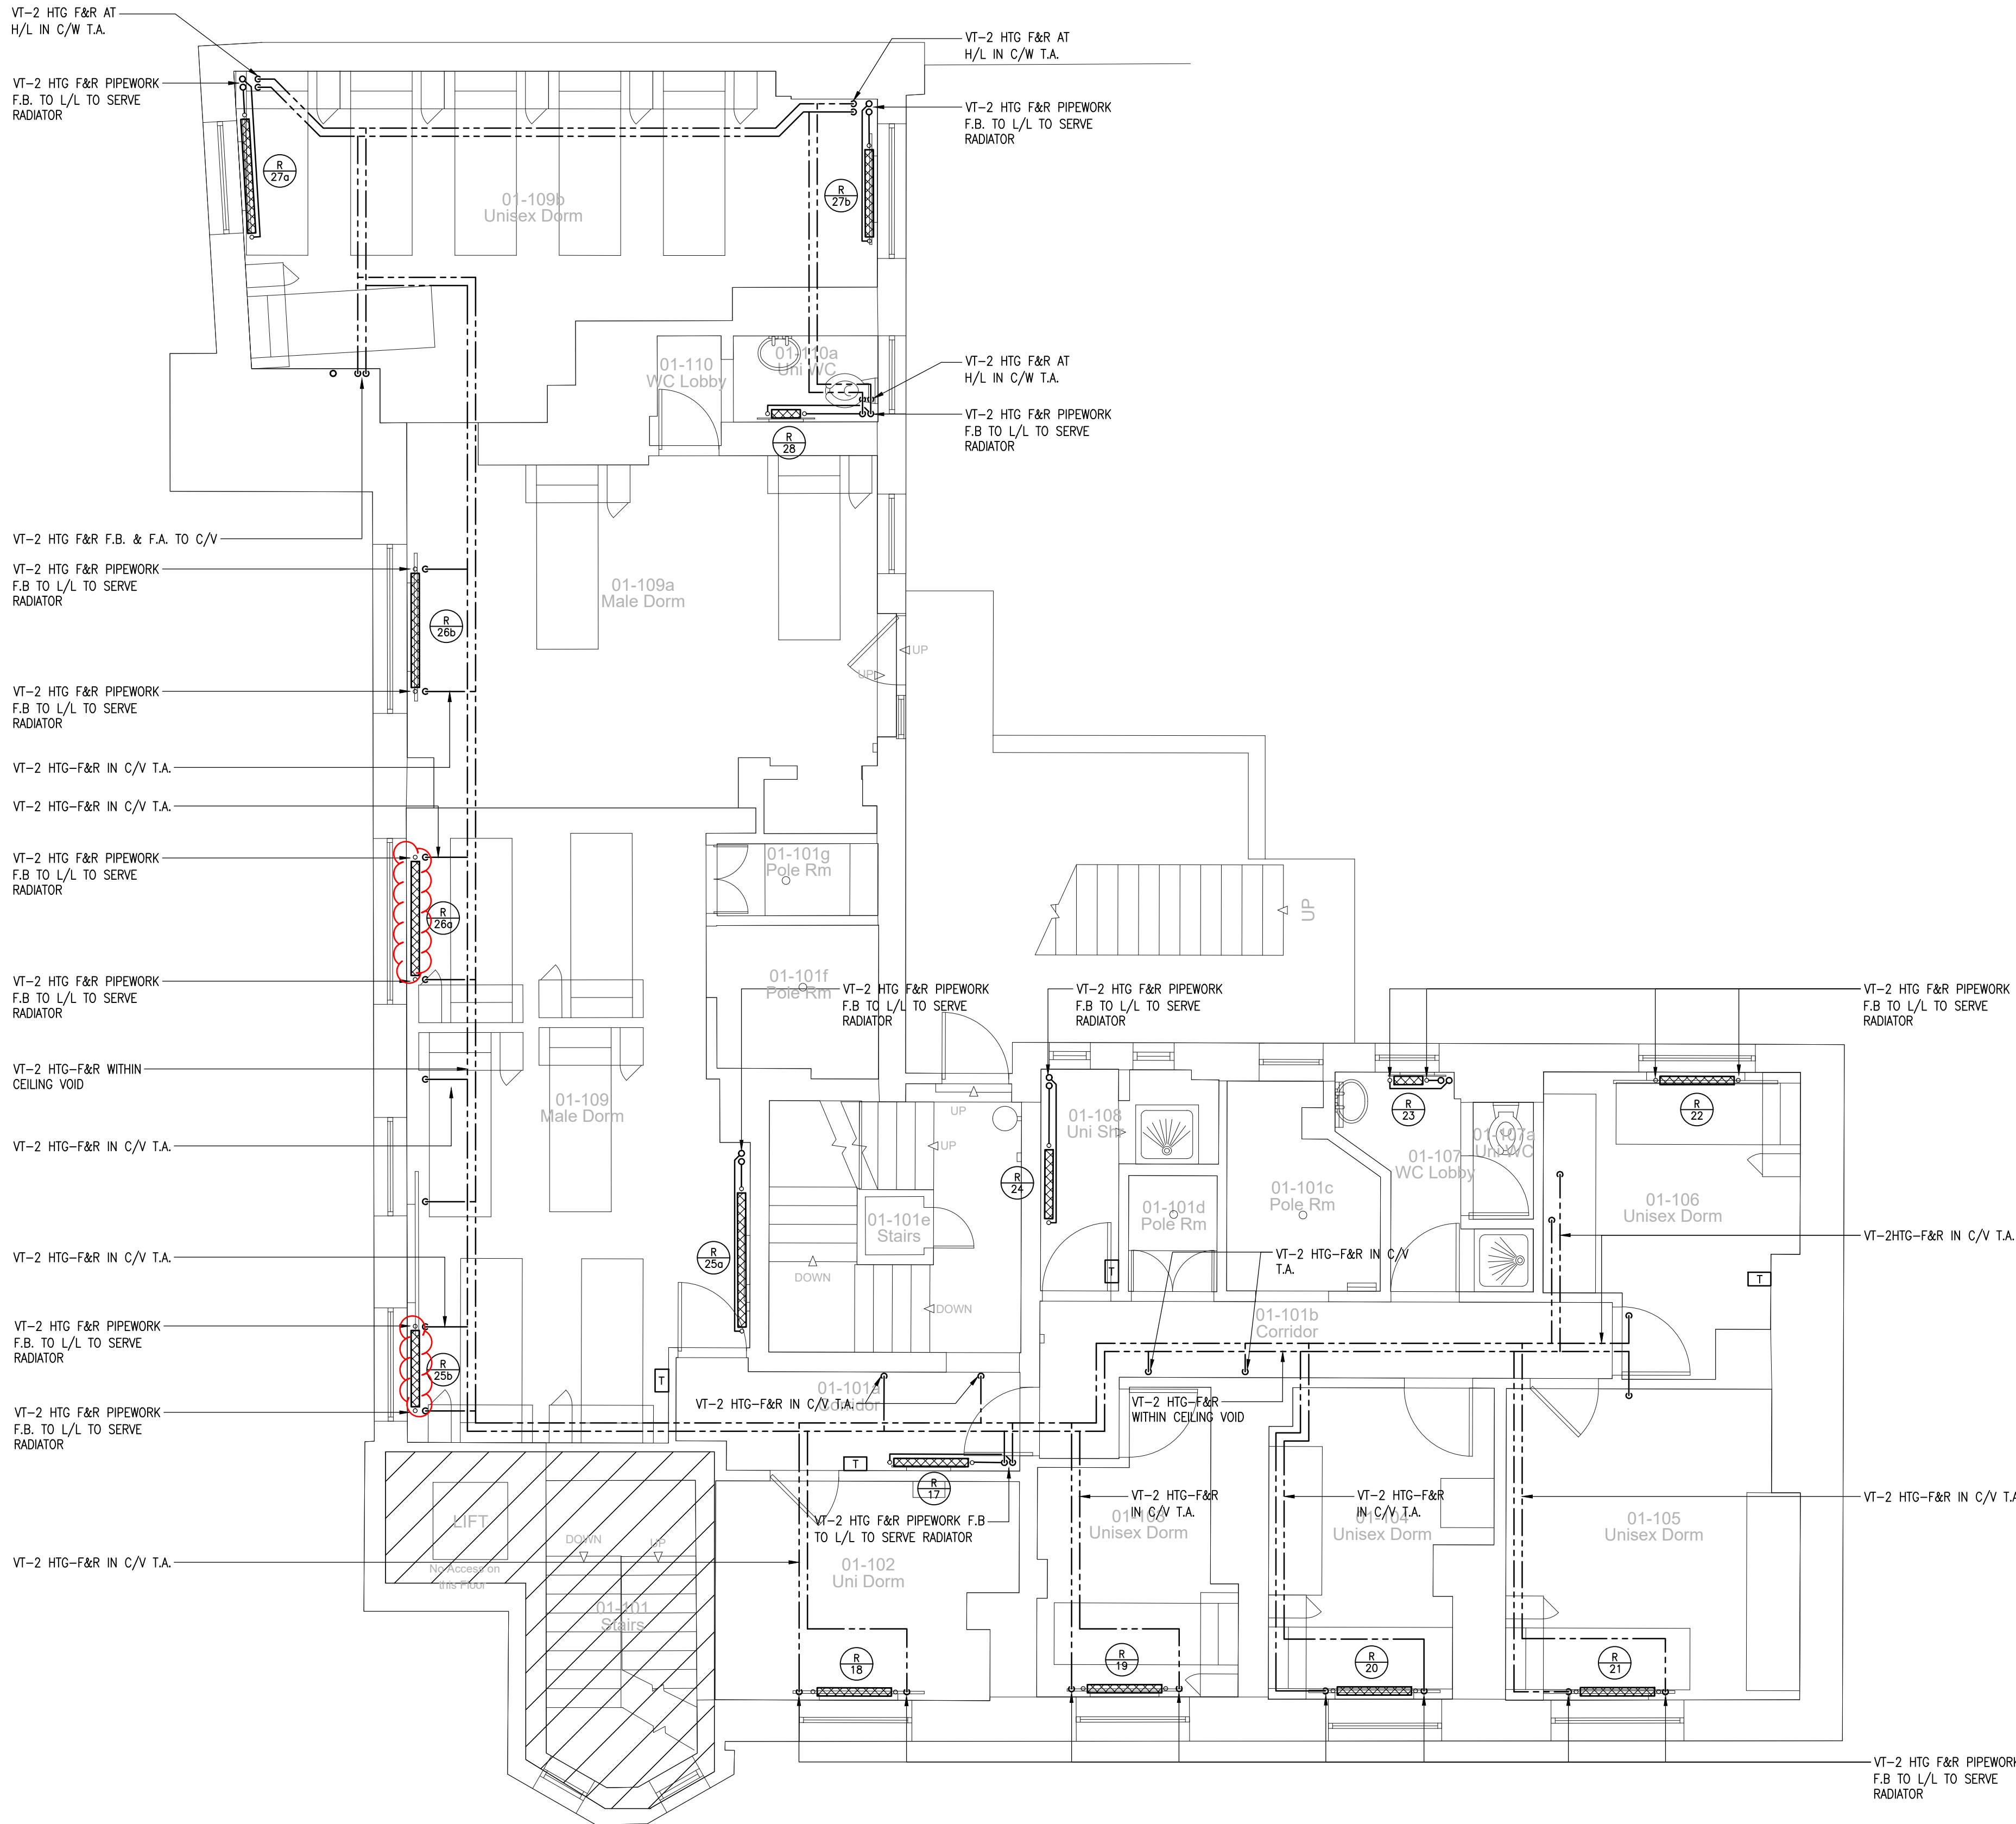

GENERAL NOTES.

- THE CONTRACTOR WILL FULLY COMPLY WITH ALL RELEVANT BRITISH STANDARDS, REGULATIONS, STANDARD CODES OF PRACTICE, METHODS OF WORKING, AND GOOD PRACTICE.
- THE MECHANICAL CONTRACTOR IS RESPONSIBLE FOR FINAL CO-ORDINATION AND INSTALLATION OF ALL MECHANICAL SERVICES WITH ALL OTHER SERVICES AND THE BUILDING STRUCTURE.
- ALL SERVICES WILL BE IDENTIFIED IN ACCORDANCE WITH BS 1710 AND GOOD ENGINEERING PRACTICE. PIPEWORK TO BE RAL 6003.
- ALL PIPEWORK TO BE PRESSURE TESTED PRIOR TO APPLICATION OF INSULATION.
- ALL PIPEWORK IN PLANTROOM, RISERS, RECESSED AREAS, BOXING IN OR CEILING VOIDS SHALL BE THERMALLY INSULATED THROUGHOUT USING THE MATERIALS IN ACCORDANCE WITH THE M&E SPECIFICATION.
- DRAIN COCKS SHALL BE PROVIDED TO ALL LOW POINTS ON THE SYSTEM.
- AUTOMATIC AIR VENTS SHALL BE PROVIDED TO ALL HIGH POINTS ON THE SYSTEM.
- THE MECHANICAL CONTRACTOR SHALL ALLOW ALL ANCILLARIES NECESSARY TO DEAL WITH EXPANSION/CONTRACTION.
- THE CONTRACTOR SHALL ENSURE ALL PIPEWORK PENETRATING A CAVITY BARRIER OR FIRE COMPARTMENT WALL/SLAB SHALL BE FIRE STOPPED AT THE POINT OF PENETRATION IN ORDER TO MAINTAIN THE INTEGRITY AND REQUIRED FIRE RESISTANCE OF THE FIRE COMPARTMENT.

NOTES

- ALL PIPEWORK ROUTES SHOWN ARE INDICATIVE & SUBJECT TO VALIDATION BY THE CONTRACTOR.
- FOR PIPE SIZES REFER TO DWG No. 522223-FCG-MB-SC-DR-M-5000 & 522223-FCG-MB-SC-DR-M-5600

LEGEND:


- PIPE DROPPING TO BELOW
- PIPE RISING TO ABOVE
- PIPEWORK BELOW FLOOR
- PIPEWORK AT LOW LEVEL
- PIPEWORK AT HIGH LEVEL
- PIPEWORK WITHIN CEILING VOID SPACE
- PROPOSED RADIATOR
- ROOM THERMOSTAT

ABBREVIATIONS:

- HTG-F - HEATING FLOW
- HTG-R - HEATING RETURN
- F.A. - FROM ABOVE
- F.B. - FROM BELOW
- T.A. - TO ABOVE
- T.B. - TO BELOW
- DTLL - DROP TO LOW LEVEL
- H/L - HIGH LEVEL
- L/L - LOW LEVEL
- C/V - CEILING VOID

C01	29.11.22	DJ	AM	BP	Tender Issue
P01	27.10.22	DJ	AM	BP	Preliminary Issue
Rev	Date	By	Chk	App	Comment

BRIDGING IDEAS TO LIFE



FRANKHAM

Frankham Consultancy Group Limited

E: enquire@frankham.com  
www.frankham.com

SIDCUP OFFICE	Irene House Five Arches Business Park Huddersfield Road Sedgley, Kent DA14 5AE T: 020 8309 7777	OXFORD OFFICE	Woodton Business Park Besselsleigh Road Woodton, Abingdon Oxfordshire OX13 6FD T: 01865 322500
LONDON OFFICE	Third Floor Baird House 15-17 St Cross Street London EC1N 8JW T: 020 7653 0790	STEVENAGE OFFICE	Suite 127, Second Floor Kings Court Business Centre London Road, Stevenage Hertfordshire SG1 2NG T: 020 3714 7063

Client:

L

F

B

LONDON FIRE BRIGADE

Project Title:

Euston Fire Station

Drawing Title:

First Floor  
Mechanical Services  
Proposed Heating Layout

Status:


TENDER ISSUE

Drawn By:	Designed By:	Checked By:	Approved By:
DK	DJ	AM	BP
Original Issue Date:	Scale @ A1:		
27/10/2022	1:50		

Job No/ File Ref	Originator	Zone	Level	
522223	FCG	MB	01	
Type	Discipline	Number	Suitability	Revision
DR	M	5603	D2	C01

X:\500000\522223 - LFB - Euston Fire Station - Heating & Domestic\06-Published Info Exchange\04-MEP\2022-11-29 - Tender Package\DWG's\Mech\522223-FCG-MB-01-DR-M-5603-D2-C01.dwg

29/11/2022 09:06:53

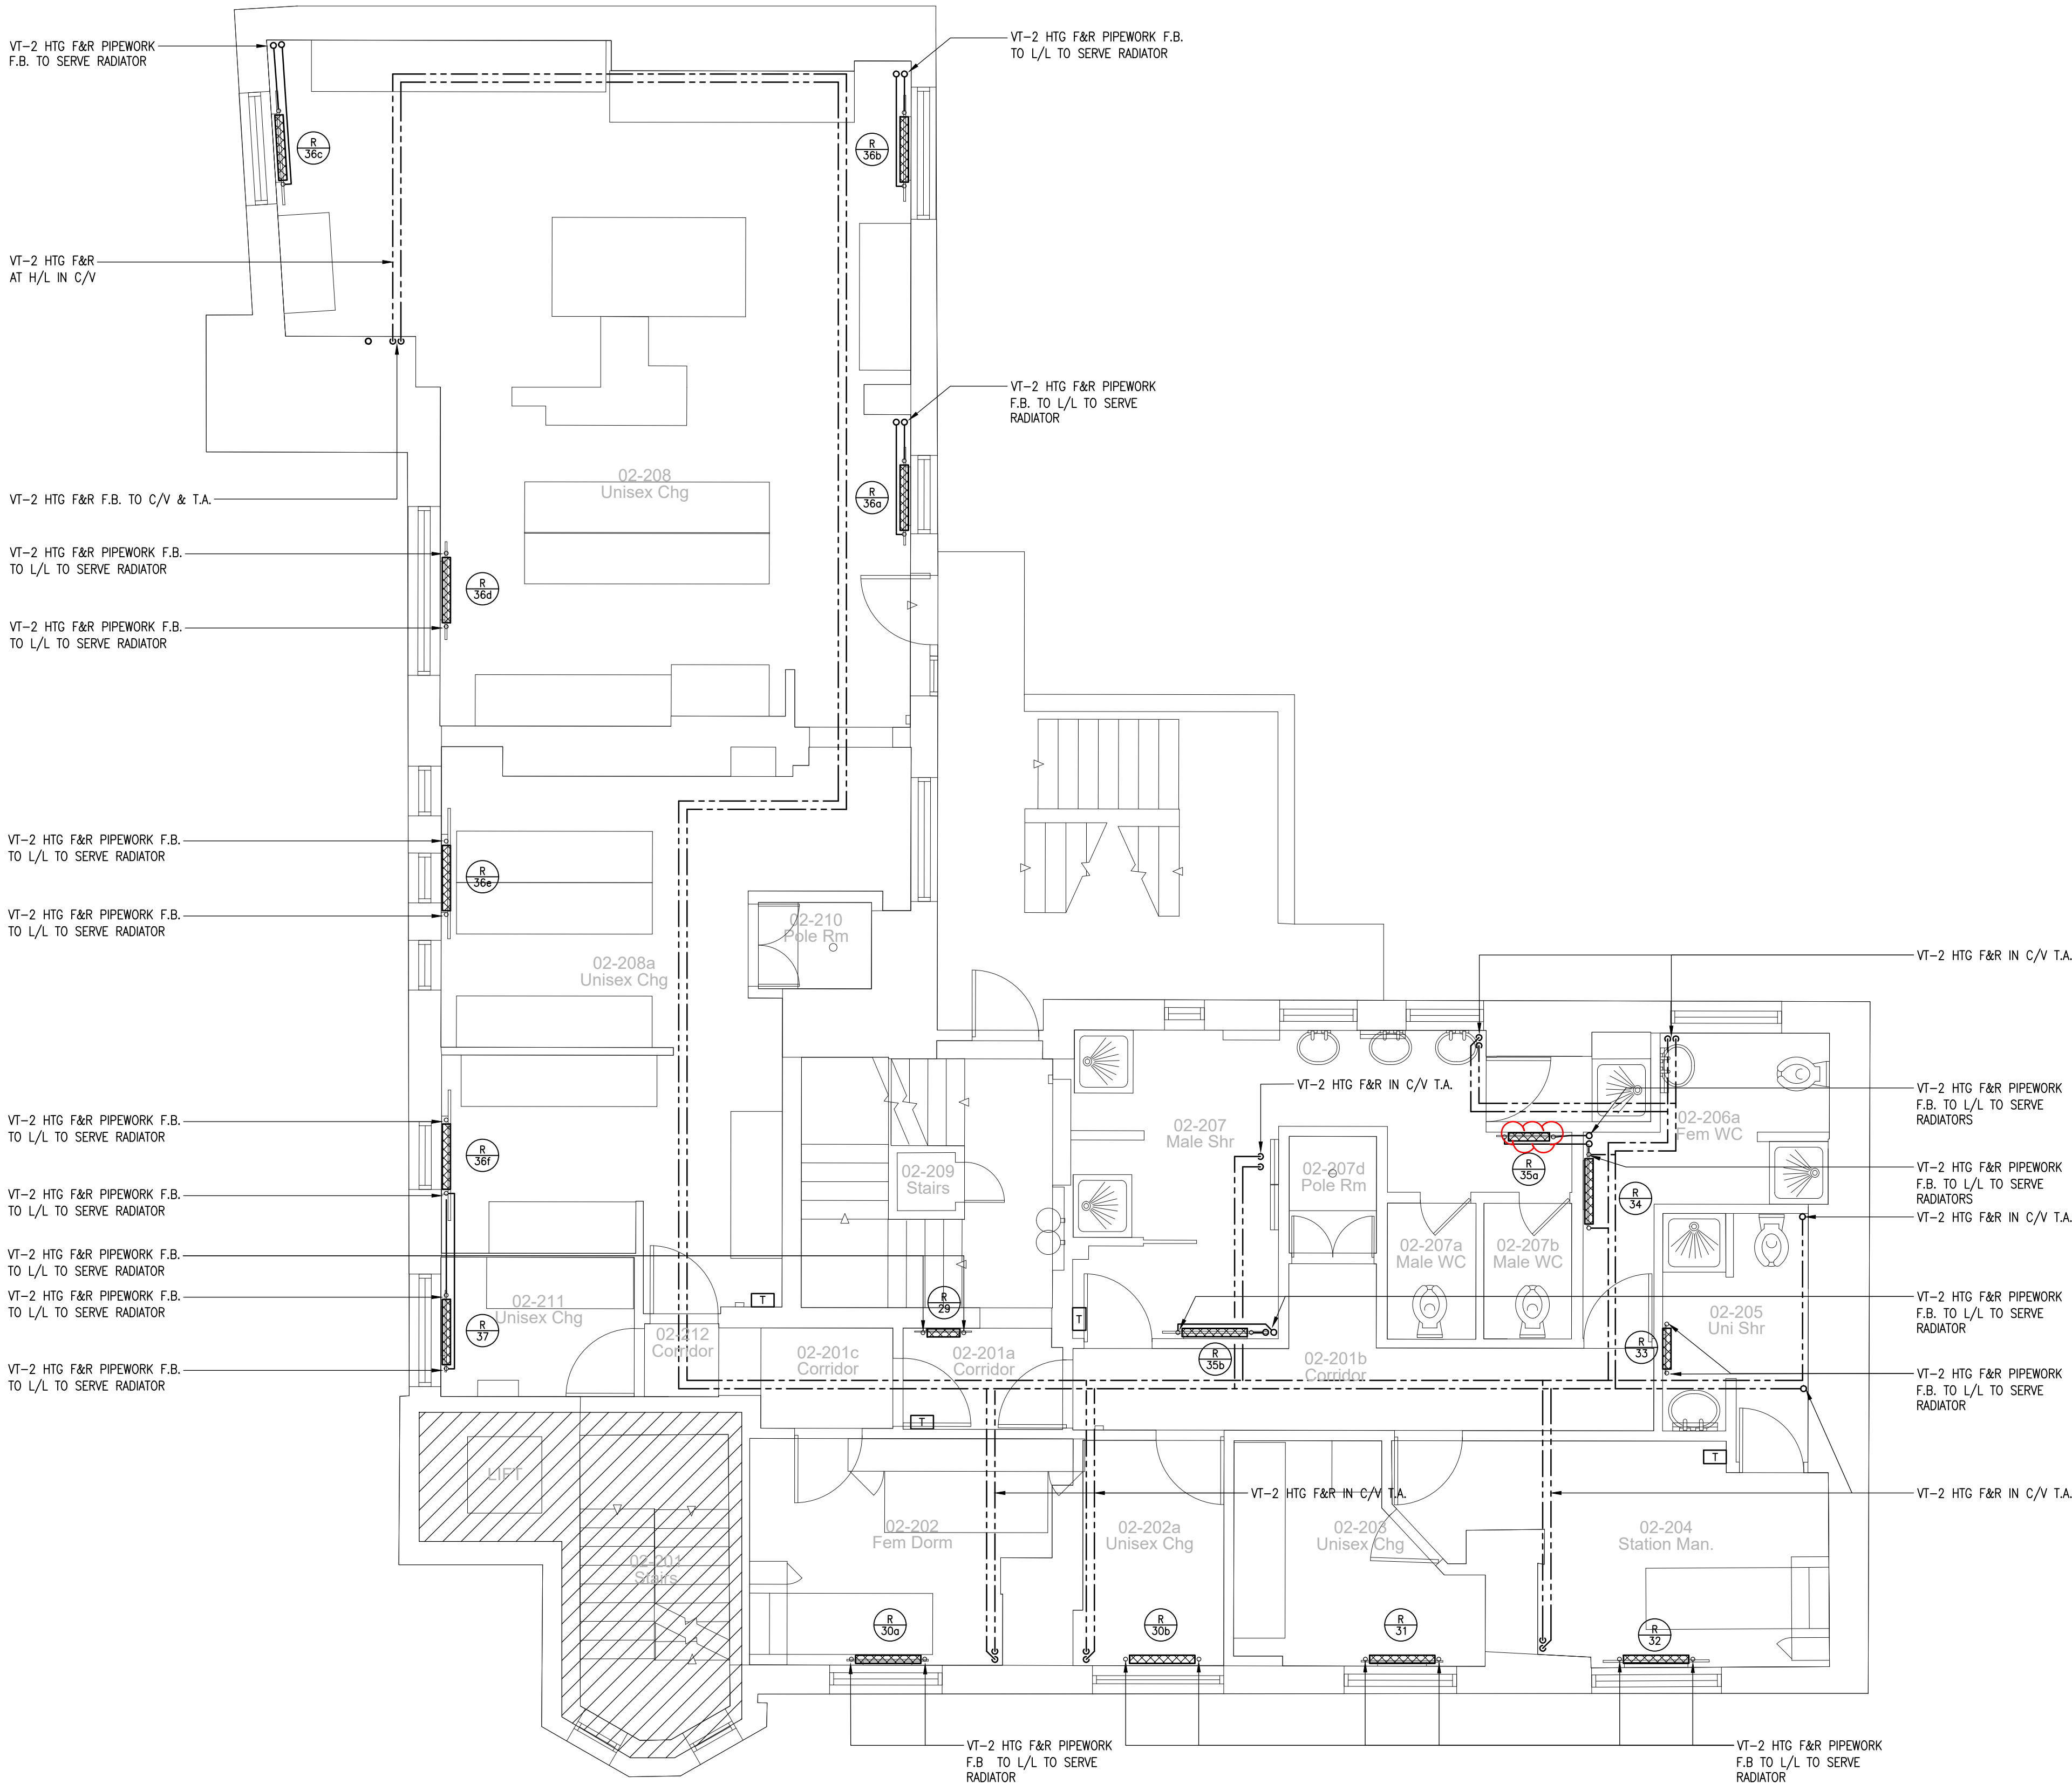

GENERAL NOTES.

- THE CONTRACTOR WILL FULLY COMPLY WITH ALL RELEVANT BRITISH STANDARDS, REGULATIONS, STANDARD CODES OF PRACTICE, METHODS OF WORKING, AND GOOD PRACTICE.
- THE MECHANICAL CONTRACTOR IS RESPONSIBLE FOR FINAL CO-ORDINATION AND INSTALLATION OF ALL MECHANICAL SERVICES WITH ALL OTHER SERVICES AND THE BUILDING STRUCTURE.
- ALL SERVICES WILL BE IDENTIFIED IN ACCORDANCE WITH BS 1710 AND GOOD ENGINEERING PRACTICE. PIPEWORK TO BE RAL 6003.
- ALL PIPEWORK TO BE PRESSURE TESTED PRIOR TO APPLICATION OF INSULATION.
- ALL PIPEWORK IN PLANTROOM, RISERS, RECESSED AREAS, BOXING IN OR CEILING VOIDS SHALL BE THERMALLY INSULATED THROUGHOUT USING THE MATERIALS IN ACCORDANCE WITH THE M&E SPECIFICATION.
- DRAIN COCKS SHALL BE PROVIDED TO ALL LOW POINTS ON THE SYSTEM.
- AUTOMATIC AIR VENTS SHALL BE PROVIDED TO ALL HIGH POINTS ON THE SYSTEM.
- THE MECHANICAL CONTRACTOR SHALL ALLOW ALL ANCILLARIES NECESSARY TO DEAL WITH EXPANSION/CONTRACTION.
- THE CONTRACTOR SHALL ENSURE ALL PIPEWORK PENETRATING A CAVITY BARRIER OR FIRE COMPARTMENT WALL/SLAB SHALL BE FIRE STOPPED AT THE POINT OF PENETRATION IN ORDER TO MAINTAIN THE INTEGRITY AND REQUIRED FIRE RESISTANCE OF THE FIRE COMPARTMENT.

NOTES

- ALL PIPEWORK ROUTES SHOWN ARE INDICATIVE & SUBJECT TO VALIDATION BY THE CONTRACTOR.
- FOR PIPE SIZES REFER TO DWG No. 522223-FCG-MB-SC-DR-M-5000 & 522223-FCG-MB-SC-DR-M-5600

LEGEND:

- PIPE DROPPING TO BELOW
- PIPE RISING TO ABOVE
- PIPEWORK BELOW FLOOR
- PIPEWORK AT LOW LEVEL
- PIPEWORK AT HIGH LEVEL
- PIPEWORK WITHIN CEILING VOID SPACE
- PROPOSED RADIATOR
- ROOM THERMOSTAT

ABBREVIATIONS:

- HTG-F - HEATING FLOW
- HTG-R - HEATING RETURN
- F.A. - FROM ABOVE
- F.B. - FROM BELOW
- T.A. - TO ABOVE
- T.B. - TO BELOW
- DTLL - DROP TO LOW LEVEL
- H/L - HIGH LEVEL
- L/L - LOW LEVEL
- C/V - CEILING VOID

C01	29.11.22	DJ	AM	BP	Tender Issue
P01	27.10.22	DJ	AM	BP	Preliminary Issue
Rev	Date	By	Chk	App	Comment

BIDDING IDEAS TO LIFE	
FRANKHAM	
Frankham Consultancy Group Limited E: enquire@frankham.com www.frankham.com	
SIDCUP OFFICE Irene House Five Arches Business Park Hedstone Road Sidcup, Kent DA14 5AE T: 020 8309 7777	OXFORD OFFICE Woodton Business Park Beesdale Road Woodton, Abingdon Oxfordshire OX13 6FD T: 01865 322500
LONDON OFFICE Third Floor Baird House 15-17 St Cross Street London EC1N 8JW T: 020 7651 0790	STEVENAGE OFFICE Suite 127, Second Floor Kings Court Business Centre London Road, Stevenage Hertfordshire SG1 2NG T: 020 374 7063

Client:



Project Title:

Euston Fire Station

Drawing Title:

Second Floor  
Mechanical Services  
Proposed Heating Layout

Status:


TENDER ISSUE

Drawn By:	Designed By:	Checked By:	Approved By:
DK	DJ	AM	BP

Original Issue Date:	Scale @ A1:
27/10/2022	1:50

Job No/ File Ref		Originator	Zone	Level
522223		FCG	MB	02
Type	Discipline	Number	Suitability	Revision
DR	M	5604	D2	C01



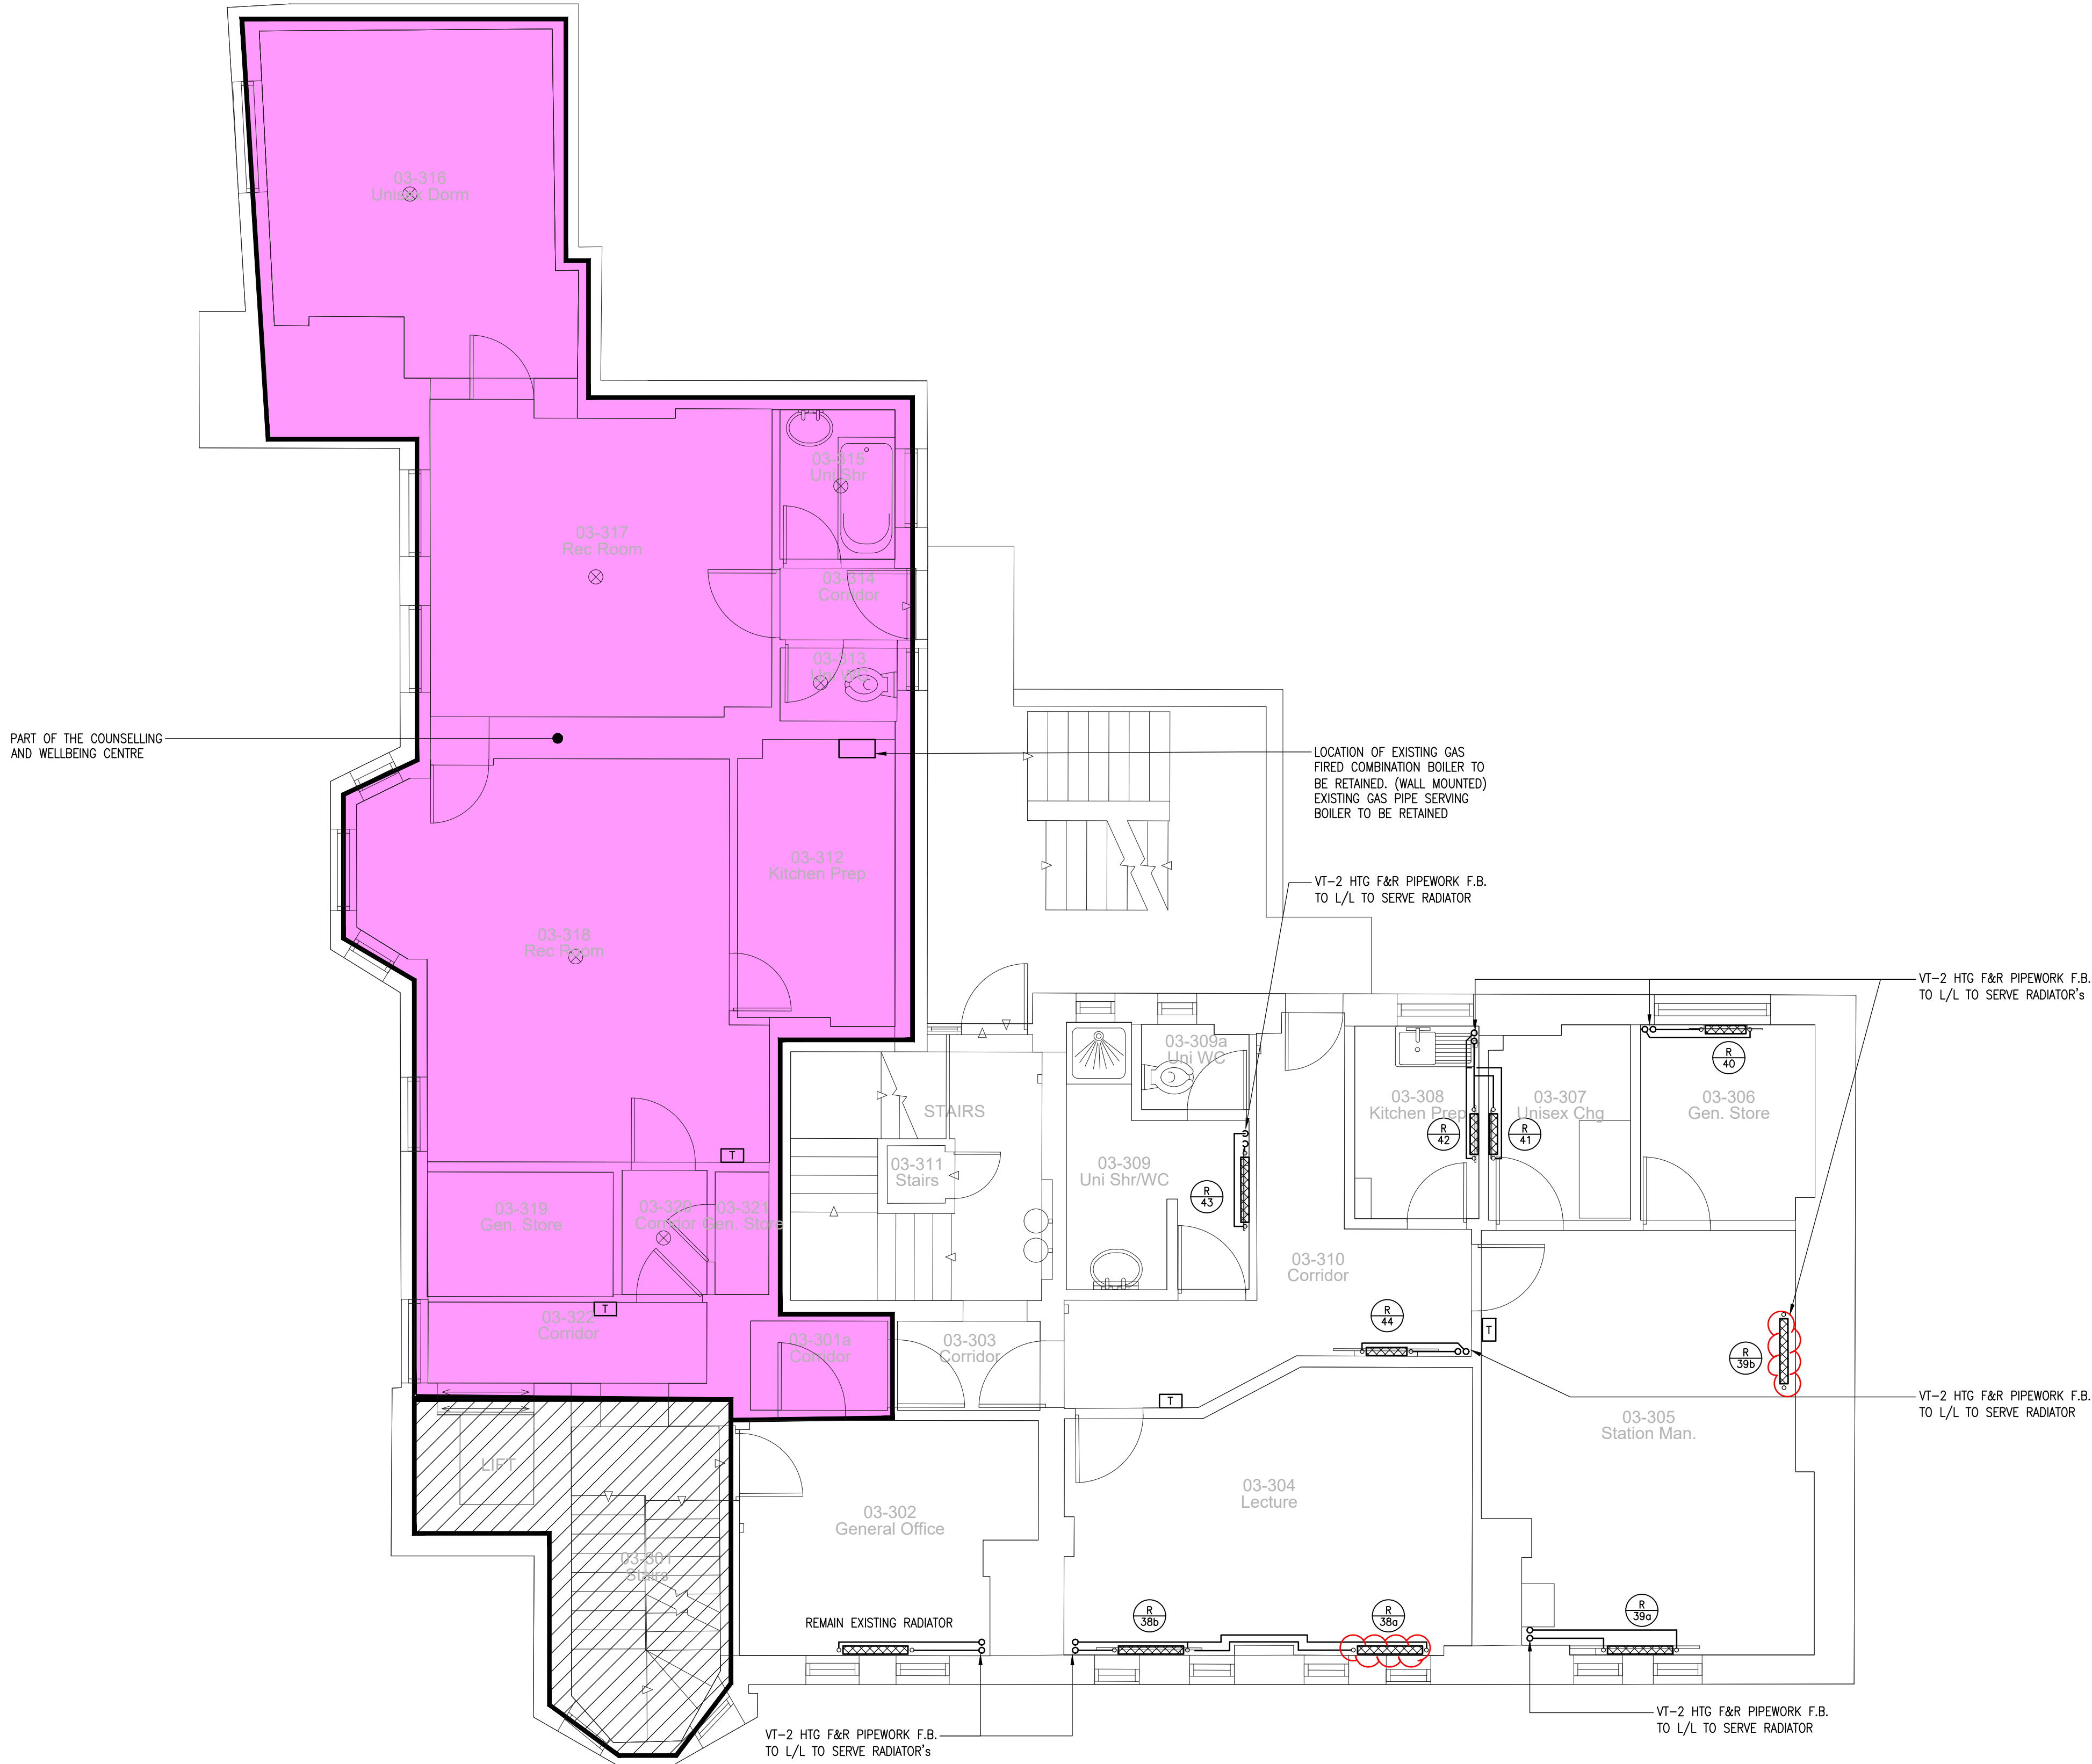

GENERAL NOTES.

- THE CONTRACTOR WILL FULLY COMPLY WITH ALL RELEVANT BRITISH STANDARDS, REGULATIONS, STANDARD CODES OF PRACTICE, METHODS OF WORKING, AND GOOD PRACTICE.
- THE MECHANICAL CONTRACTOR IS RESPONSIBLE FOR FINAL CO-ORDINATION AND INSTALLATION OF ALL MECHANICAL SERVICES WITH ALL OTHER SERVICES AND THE BUILDING STRUCTURE.
- ALL SERVICES WILL BE IDENTIFIED IN ACCORDANCE WITH BS 1710 AND GOOD ENGINEERING PRACTICE. PIPEWORK TO BE RAL 6003.
- ALL PIPEWORK TO BE PRESSURE TESTED PRIOR TO APPLICATION OF INSULATION.
- ALL PIPEWORK IN PLANTROOM, RISERS, RECESSED AREAS, BOXING IN OR CEILING VOIDS SHALL BE THERMALLY INSULATED THROUGHOUT USING THE MATERIALS IN ACCORDANCE WITH THE M&E SPECIFICATION.
- DRAIN COCKS SHALL BE PROVIDED TO ALL LOW POINTS ON THE SYSTEM.
- AUTOMATIC AIR VENTS SHALL BE PROVIDED TO ALL HIGH POINTS ON THE SYSTEM.
- THE MECHANICAL CONTRACTOR SHALL ALLOW ALL ANCILLARIES NECESSARY TO DEAL WITH EXPANSION/CONTRACTION.
- THE CONTRACTOR SHALL ENSURE ALL PIPEWORK PENETRATING A CAVITY BARRIER OR FIRE COMPARTMENT WALL/SLAB SHALL BE FIRE STOPPED AT THE POINT OF PENETRATION IN ORDER TO MAINTAIN THE INTEGRITY AND REQUIRED FIRE RESISTANCE OF THE FIRE COMPARTMENT.

NOTES

- ALL PIPEWORK ROUTES SHOWN ARE INDICATIVE & SUBJECT TO VALIDATION BY THE CONTRACTOR.
- FOR PIPE SIZES REFER TO DWG No. 522223-FCG-MB-SC-DR-M-5000 & 522223-FCG-MB-SC-DR-M-5600

LEGEND:


- PIPE DROPPING TO BELOW
- PIPE RISING TO ABOVE
- PIPEWORK BELOW FLOOR
- PIPEWORK AT LOW LEVEL
- PIPEWORK AT HIGH LEVEL
- PIPEWORK WITHIN CEILING VOID SPACE
- PROPOSED RADIATOR
- ROOM THERMOSTAT
- EXTEND OF 3rd FLOOR SERVED VIA SEPARATE HEATING SYSTEM

ABBREVIATIONS:

- HTG-F - HEATING FLOW
- HTG-R - HEATING RETURN
- F.A. - FROM ABOVE
- F.B. - FROM BELOW
- T.A. - TO ABOVE
- T.B. - TO BELOW
- DTLL - DROP TO LOW LEVEL
- H/L - HIGH LEVEL
- L/L - LOW LEVEL
- C/V - CEILING VOID

C01	29.11.22	DJ	AM	BP	Tender Issue
P01	27.10.22	DJ	AM	BP	Preliminary Issue
Rev	Date	By	Chk	App	Comment

BRADING IDEAS TO LIFE



FRANKHAM

Frankham Consultancy Group Limited

E: enquire@frankham.com  
www.frankham.com

SIDCUP OFFICE

Irene House  
Five Arches Business Park  
Medstone Road  
Sidcup, Kent DA14 5AE  
T: 020 8309 7777

OXFORD OFFICE

Wootton Business Park  
Beesdale Road  
Wootton, Abingdon  
Oxfordshire OX13 6FD  
T: 01865 322500

LONDON OFFICE

Third Floor  
Baird House  
15-17 St Cross Street  
London EC1N 8JW  
T: 020 7653 0790

STEVENAGE OFFICE

Suite 127, Second Floor  
Kings Court Business Centre  
London Road, Stevenage  
Hertfordshire SG1 2NG  
T: 020 374 7063

Client:

LFB

LONDON FIRE BRIGADE

Project Title:

Euston Fire Station

Drawing Title:

Third Floor  
Mechanical Services  
Proposed Heating Layout

Status:

TENDER ISSUE

Drawn By: DK

Designed By: DJ

Checked By: AM

Approved By: BP

Original Issue Date:

27/10/2022

Scale @ A1:

1:50

Job No/ File Ref	Originator	Zone	Level
522223	FCG	MB	03
Type	Discipline	Number	Suitability
DR	M	5605	D2
			Revision
			C01


X:\500000\522223 - LFB - Euston Fire Station - Heating & Domestic\06-Published Info Exchange\04-MEP\2022-11-29 - Tender Package\DWG's\Mech\522223-FCG-MB-03-DR-M-5605-D2-C01.dwg

29/11/2022 09:06:15

## NOTES

1. ALL PIPEWORK ROUTES SHOWN ARE INDICATIVE & SUBJECT TO VALIDATION BY THE CONTRACTOR.
2. FOR PIPE SIZES REFER TO DWG No. 522223-FCG-MB-SC-DR-M-5000 & 522223-FCG-MB-SC-DR-M-5600

**LEGEND:**

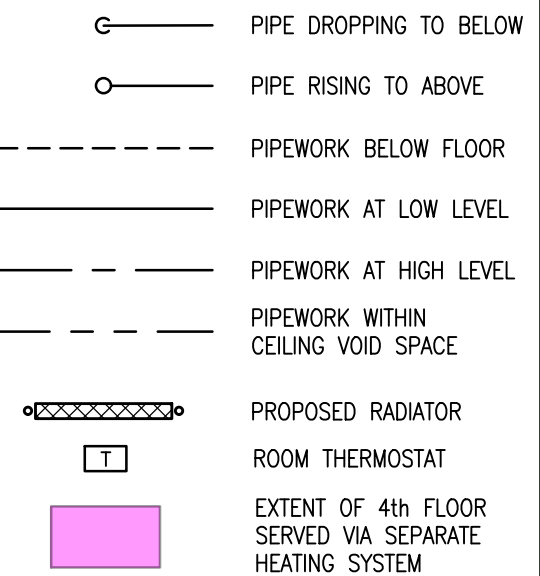

ABBREVIATIONS:

HTG-F	- HEATING FLOW
HTG-R	- HEATING RETURN
F.A.	- FROM ABOVE
F.B.	- FROM BELOW
T.A.	- TO ABOVE
T.B.	- TO BELOW
DTLL	- DROP TO LOW LEVEL
H/L	- HIGH LEVEL
/L	- LOW LEVEL
C/V	- CEILING VOID

1	29.11.22	DJ	AM	BP	Tender Issue	
1	27.10.22	DJ	AM	BP	Preliminary Issue	
v	Date	By	Chk	Apr	Comment	



**FRANKHAM**  
**Frankham Consultancy Group Limited**  
 E: [enquire@frankham.com](mailto:enquire@frankham.com)  
[www.frankham.com](http://www.frankham.com)

<p><b>LONDON OFFICE</b></p> <p>                     Irene House                      Five Archers Business Park                      Maidstone Road                      Sidcup, Kent DA14 5AE                      T: 020 839 7777                 </p>	<p><b>OXFORD OFFICE</b></p> <p>                     Wootton Business Park                      Beasleigh Road                      Wotton, Abingdon                      Oxfordshire OX13 6FD                      T: 01865 322500                 </p>
<p><b>LONDON OFFICE</b></p> <p>                     Third Floor                      Bank House                      15-17 St Cross Street                      London EC3N 8BW                      T: 020 7651 0750                 </p>	<p><b>STEVENAGE OFFICE</b></p> <p>                     Suite 237, Second Floor                      Kings Court Business Centre                      London Road, Stevenage                      Hertfordshire SG1 2NG                      T: 020 7314 7063                 </p>

**Client:**



Project Title:

## Euston Fire Station

Drawing Title:

Fourth Floor  
Mechanical Services  
Proposed Heating Layout

Status:

## TENDER ISSUE

Drawn By: DK	Designed By: DJ	Checked By: AM	Approved By: BP
-----------------	--------------------	-------------------	--------------------

Original Issue Date: 27/10/2022	Scale @ A1: 1:50
------------------------------------	---------------------

Job No/ File Ref 522223		Originator FCG	Zone MB	Level 04
Type DR	Discipline M	Number 5606	Suitability D2	Revision C01

