
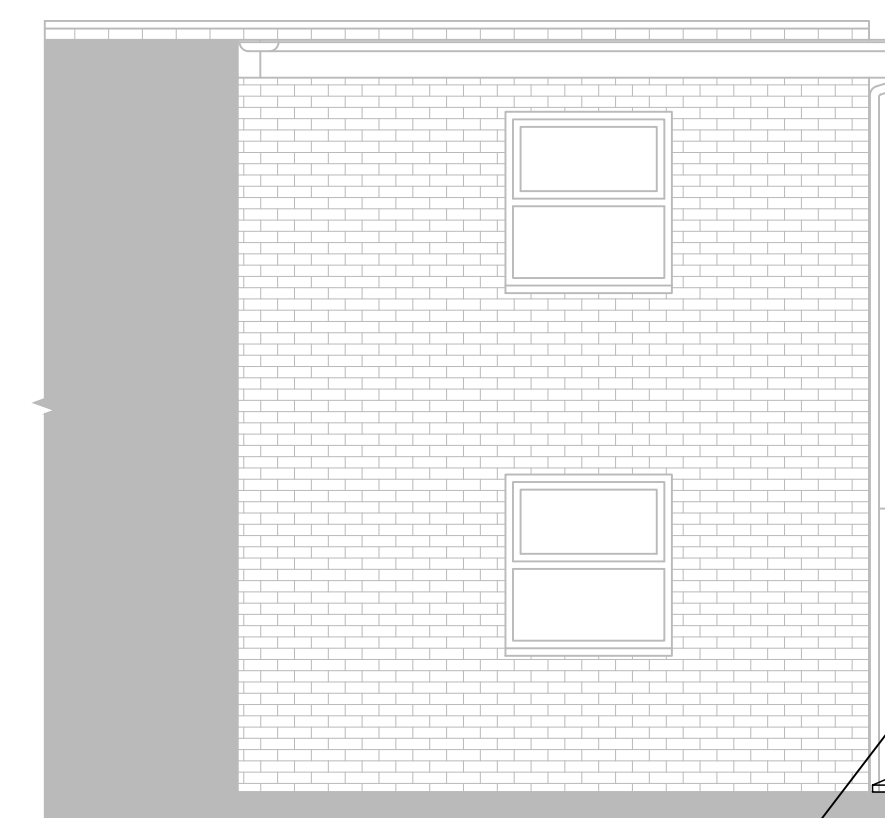
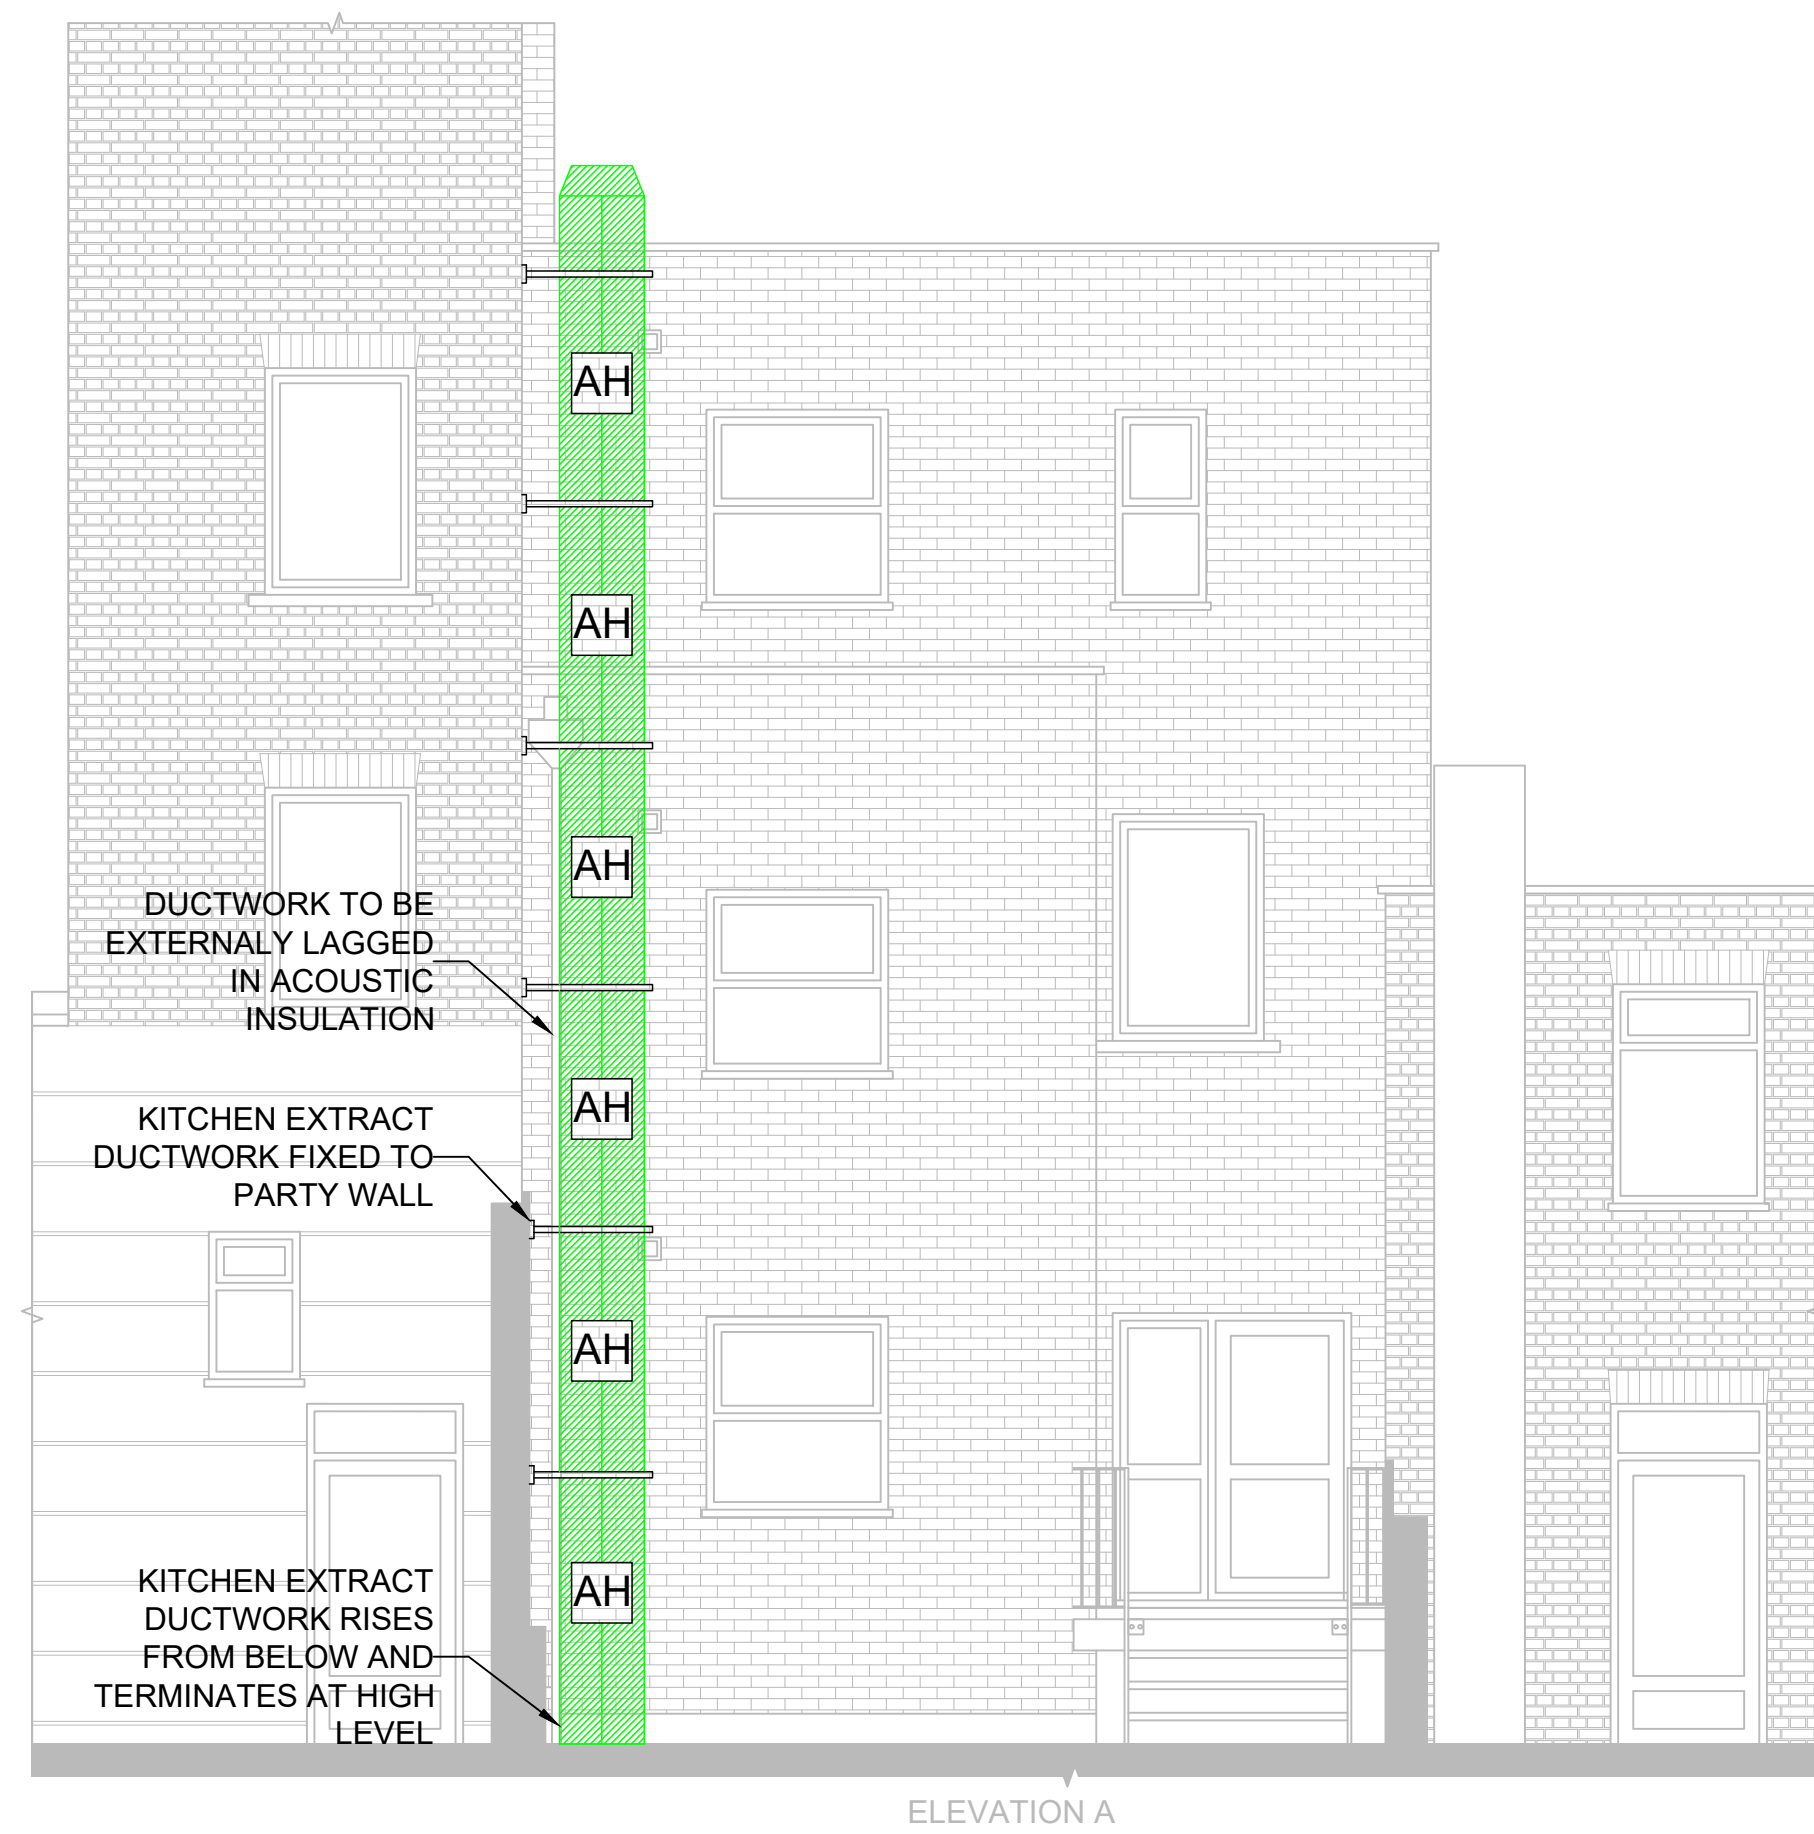


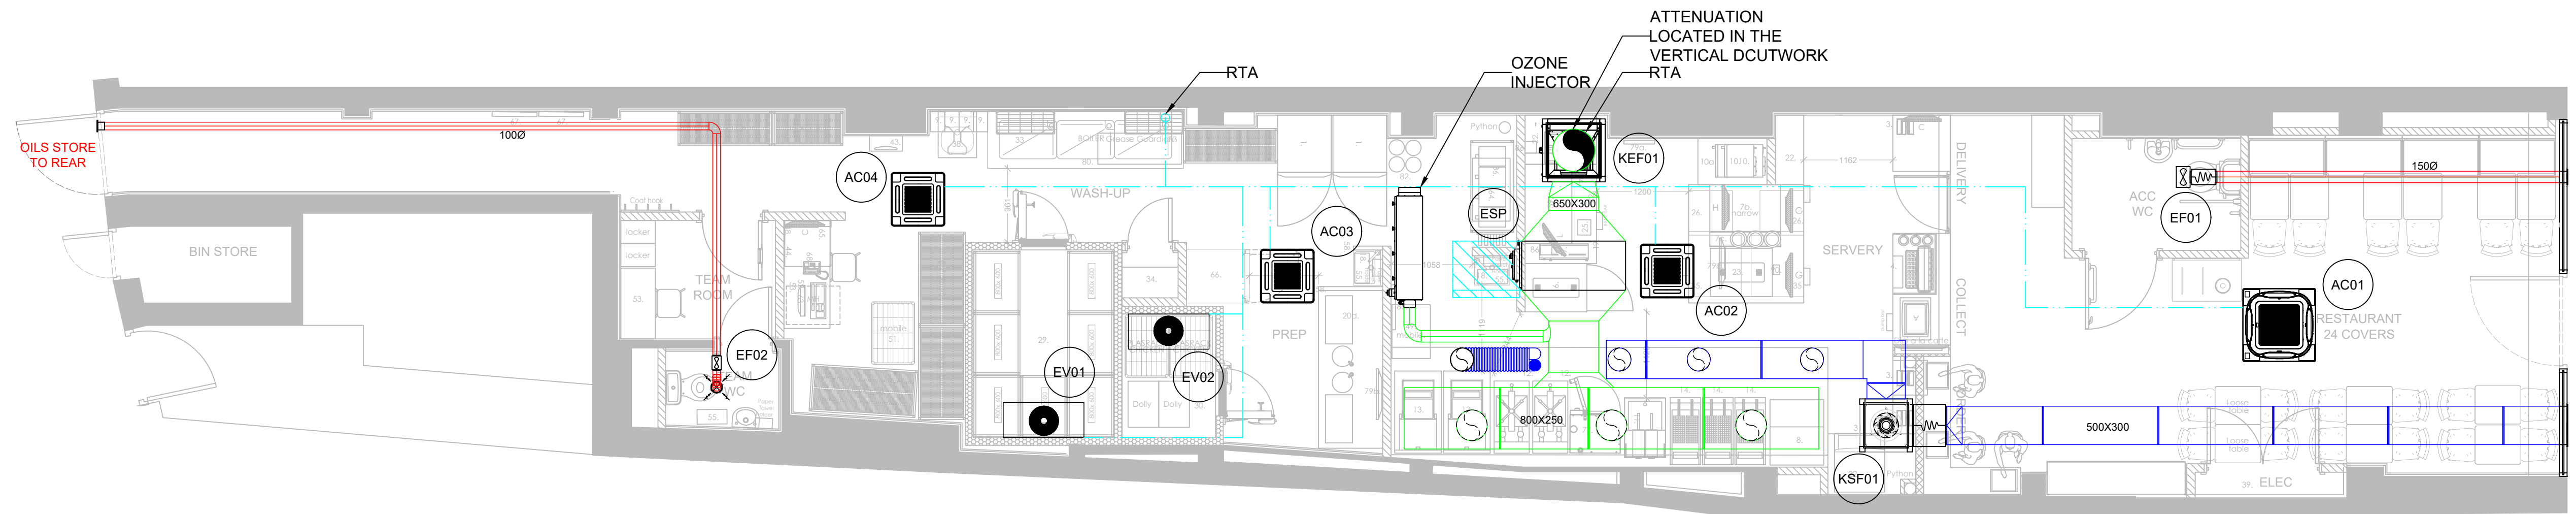

	Indoor Ref	Manufacturer	Model	Power Supply Required	Outdoor Ref	Manufacturer	Model	Power Supply Required
Restaurant	AC01	Daikin	FCAG50B		CU01	Daikin	RXM50R	1x 16A 1Ph
Kitchen	AC02	Daikin	FFA50A9		CU02	Daikin	RZASG125MV1	1x 32A 1Ph
Kitchen	AC03	Daikin	FFA50A9		CU03			
Kitchen	AC04	Daikin	FFA50A9		CU04			
Freezer	EV01	By Refrigeration Contractor			CU03	By Refrigeration Contractor		
Chicken Chiller	EV02	By Refrigeration Contractor			CU04	By Refrigeration Contractor		
Customer WCs	EF01	Systemair	1500 Ceiling Fan	on light supply for toilet				
Staff WCs	EF02	Systemair	K100	on light supply for toilet				
Back Of House	KEF01	Systemair	MUBT560	1x 20A 3ph				
Back Of House	KSF01	Systemair	MUB500	1x 20A 1ph				
Back Of House	ESP	Purified Air	4500	1x 10A 1ph				
Back Of House	OZONE	Purified Air	UV-O 1000	1x 10A 1ph				

GENERAL NOTES:

AirFlow
Cooling

CLIENT: TAHIR GROUP DRAWING BY: AC CHECKED BY: TS
TITLE: PROPOSED AIR CONDITIONING & VENTILATION
DATE: 03/11/23 SCALE: 1:50 PAPER SIZE: A1
DRAWING NO. REV
QI02147-TG-ZZ-DR-01 3

1:50
0 1m 2m 3m 4m 5m