



------


-----


Existing ground floor plan - Scale 1:100

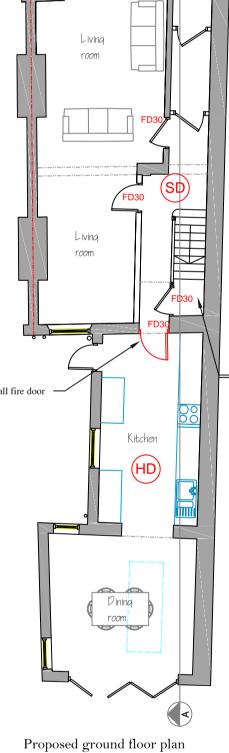


- Scale 1:100

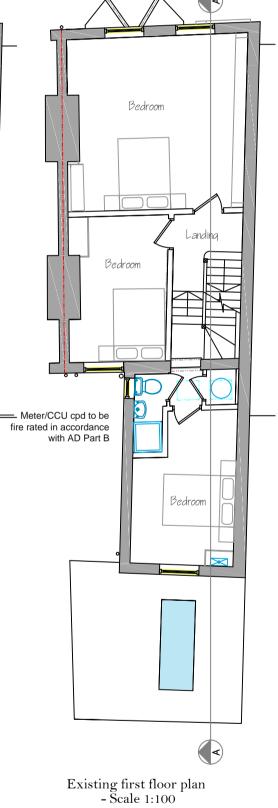


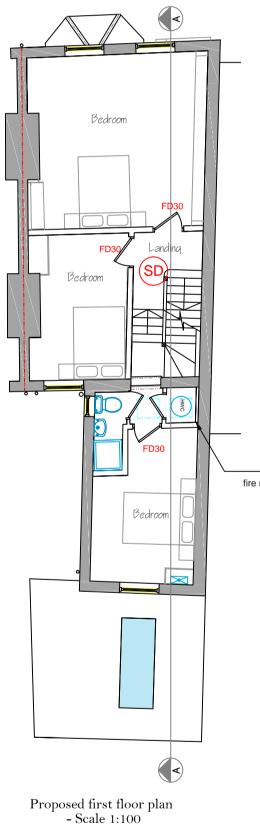


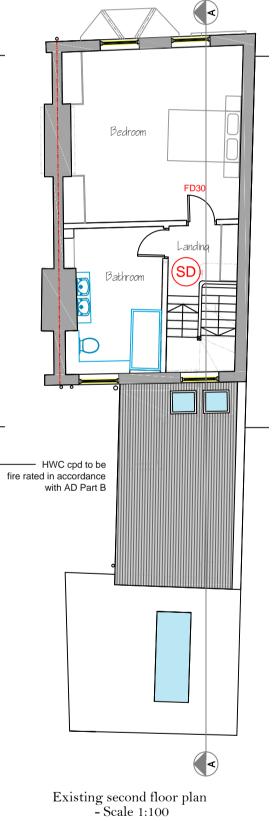




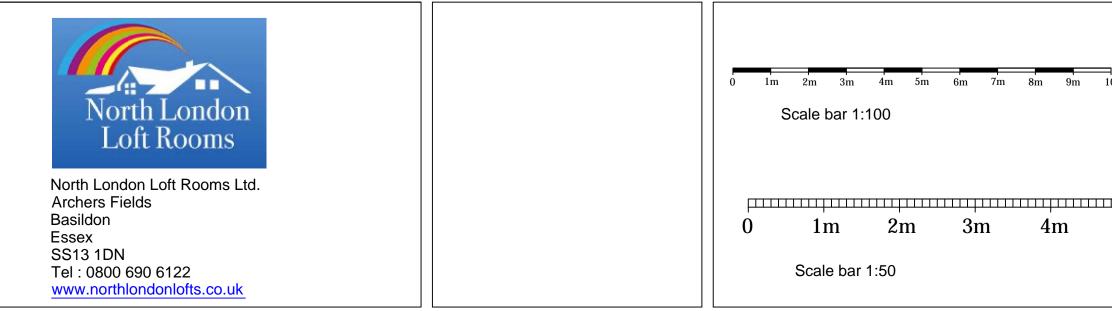

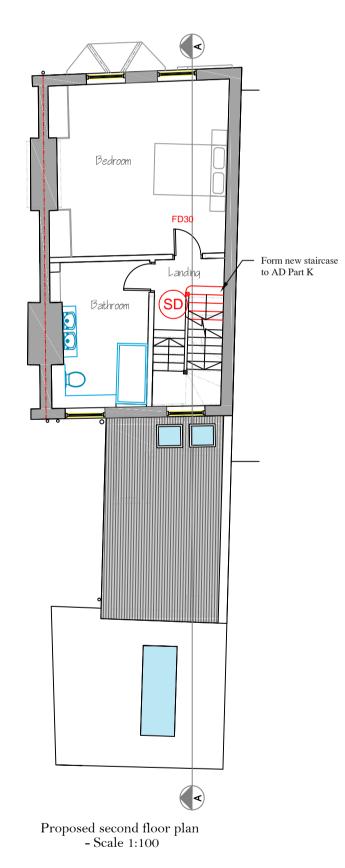

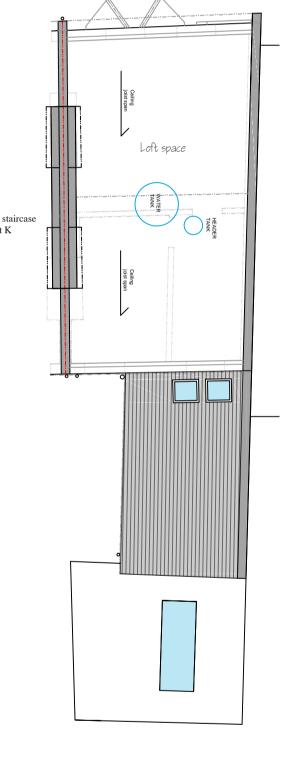

Existing loft plan - Scale 1:100

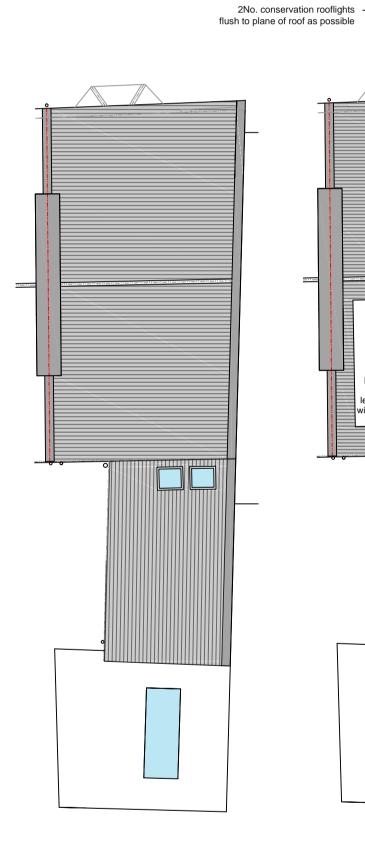

Existing roof plan - Scale 1:100 Proposed roof plan - Scale 1:100

Dormer Code 5

lead lined with roll top

 10m	Note:	Minimum 30min rating fire doors with FD30 smoke seals to top and sides of door or frame. Steel hinges, Any glazing to be factory fitted with minimum 30min rating.	Existin fo (For p
□□□□□ 5m		Mains interlinked smoke detection and sounder to BS 5839-6:2004 Grade D and at least LD3 Std. To be connected to regularly used local lighting circuit so that it cannot be disconnected for a pronlonged period of time (To be provided throughout all floors within the escape route stairwell)	Scale Revision 7 01-02-24

