










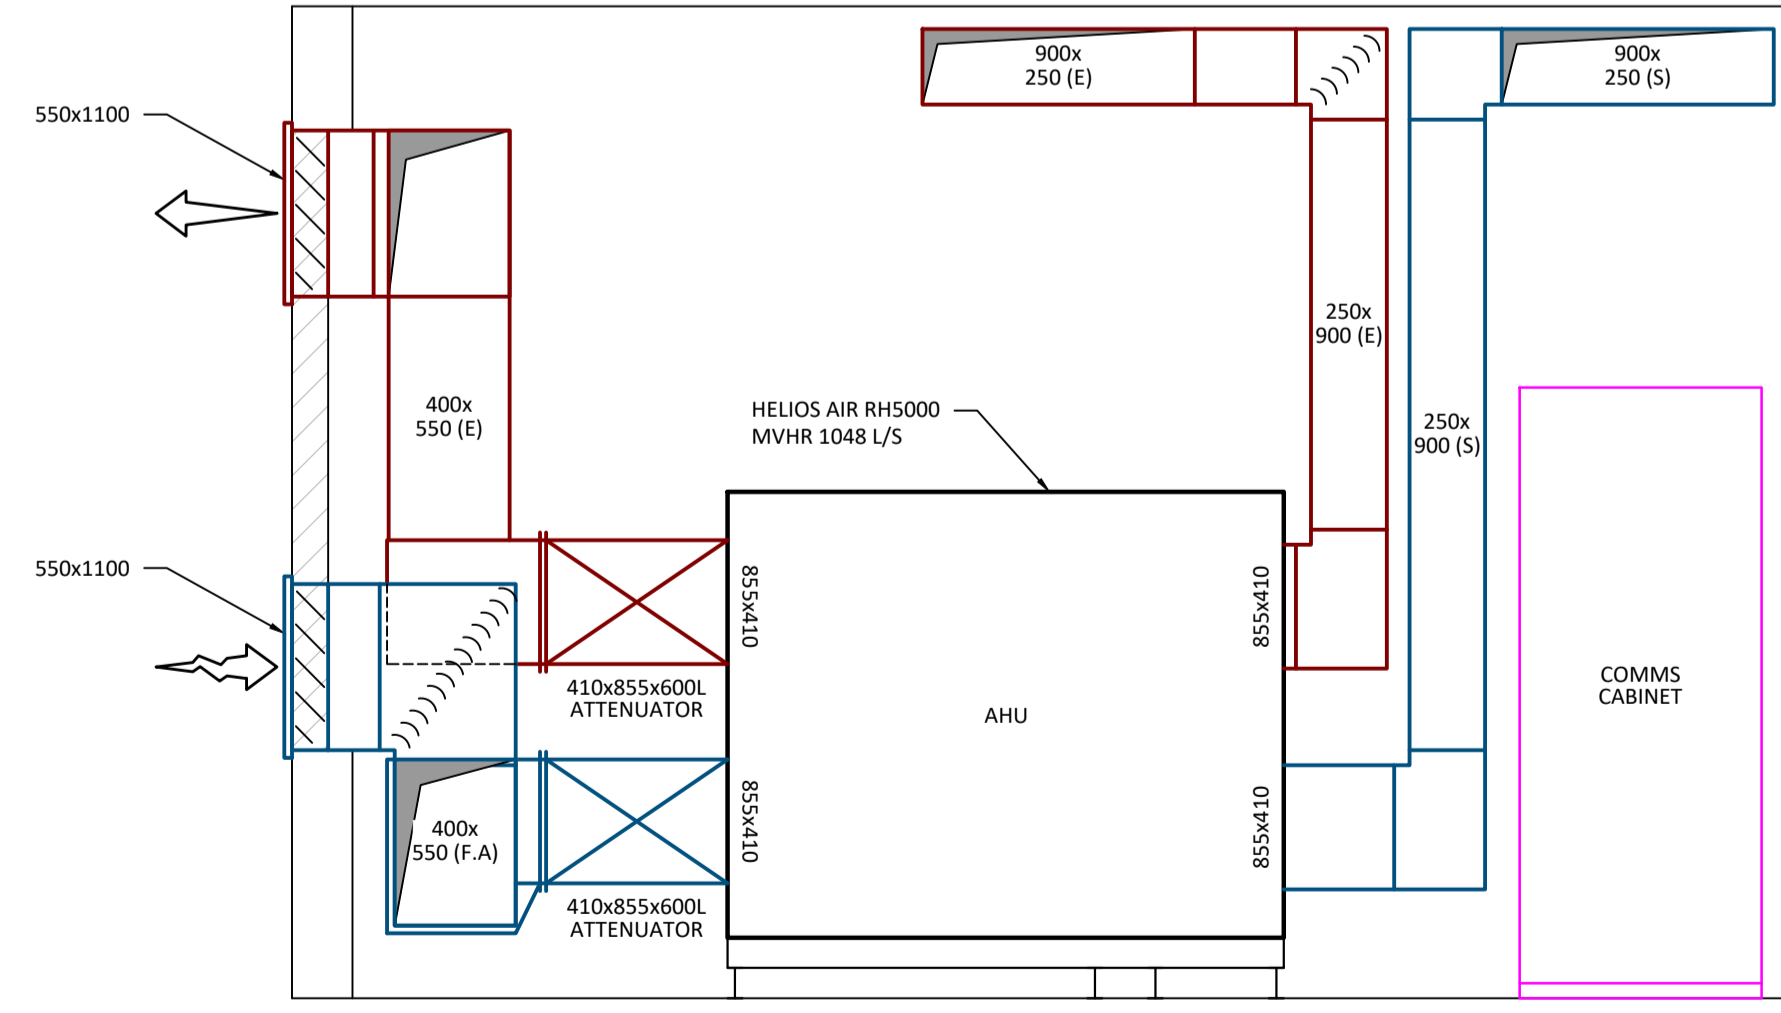
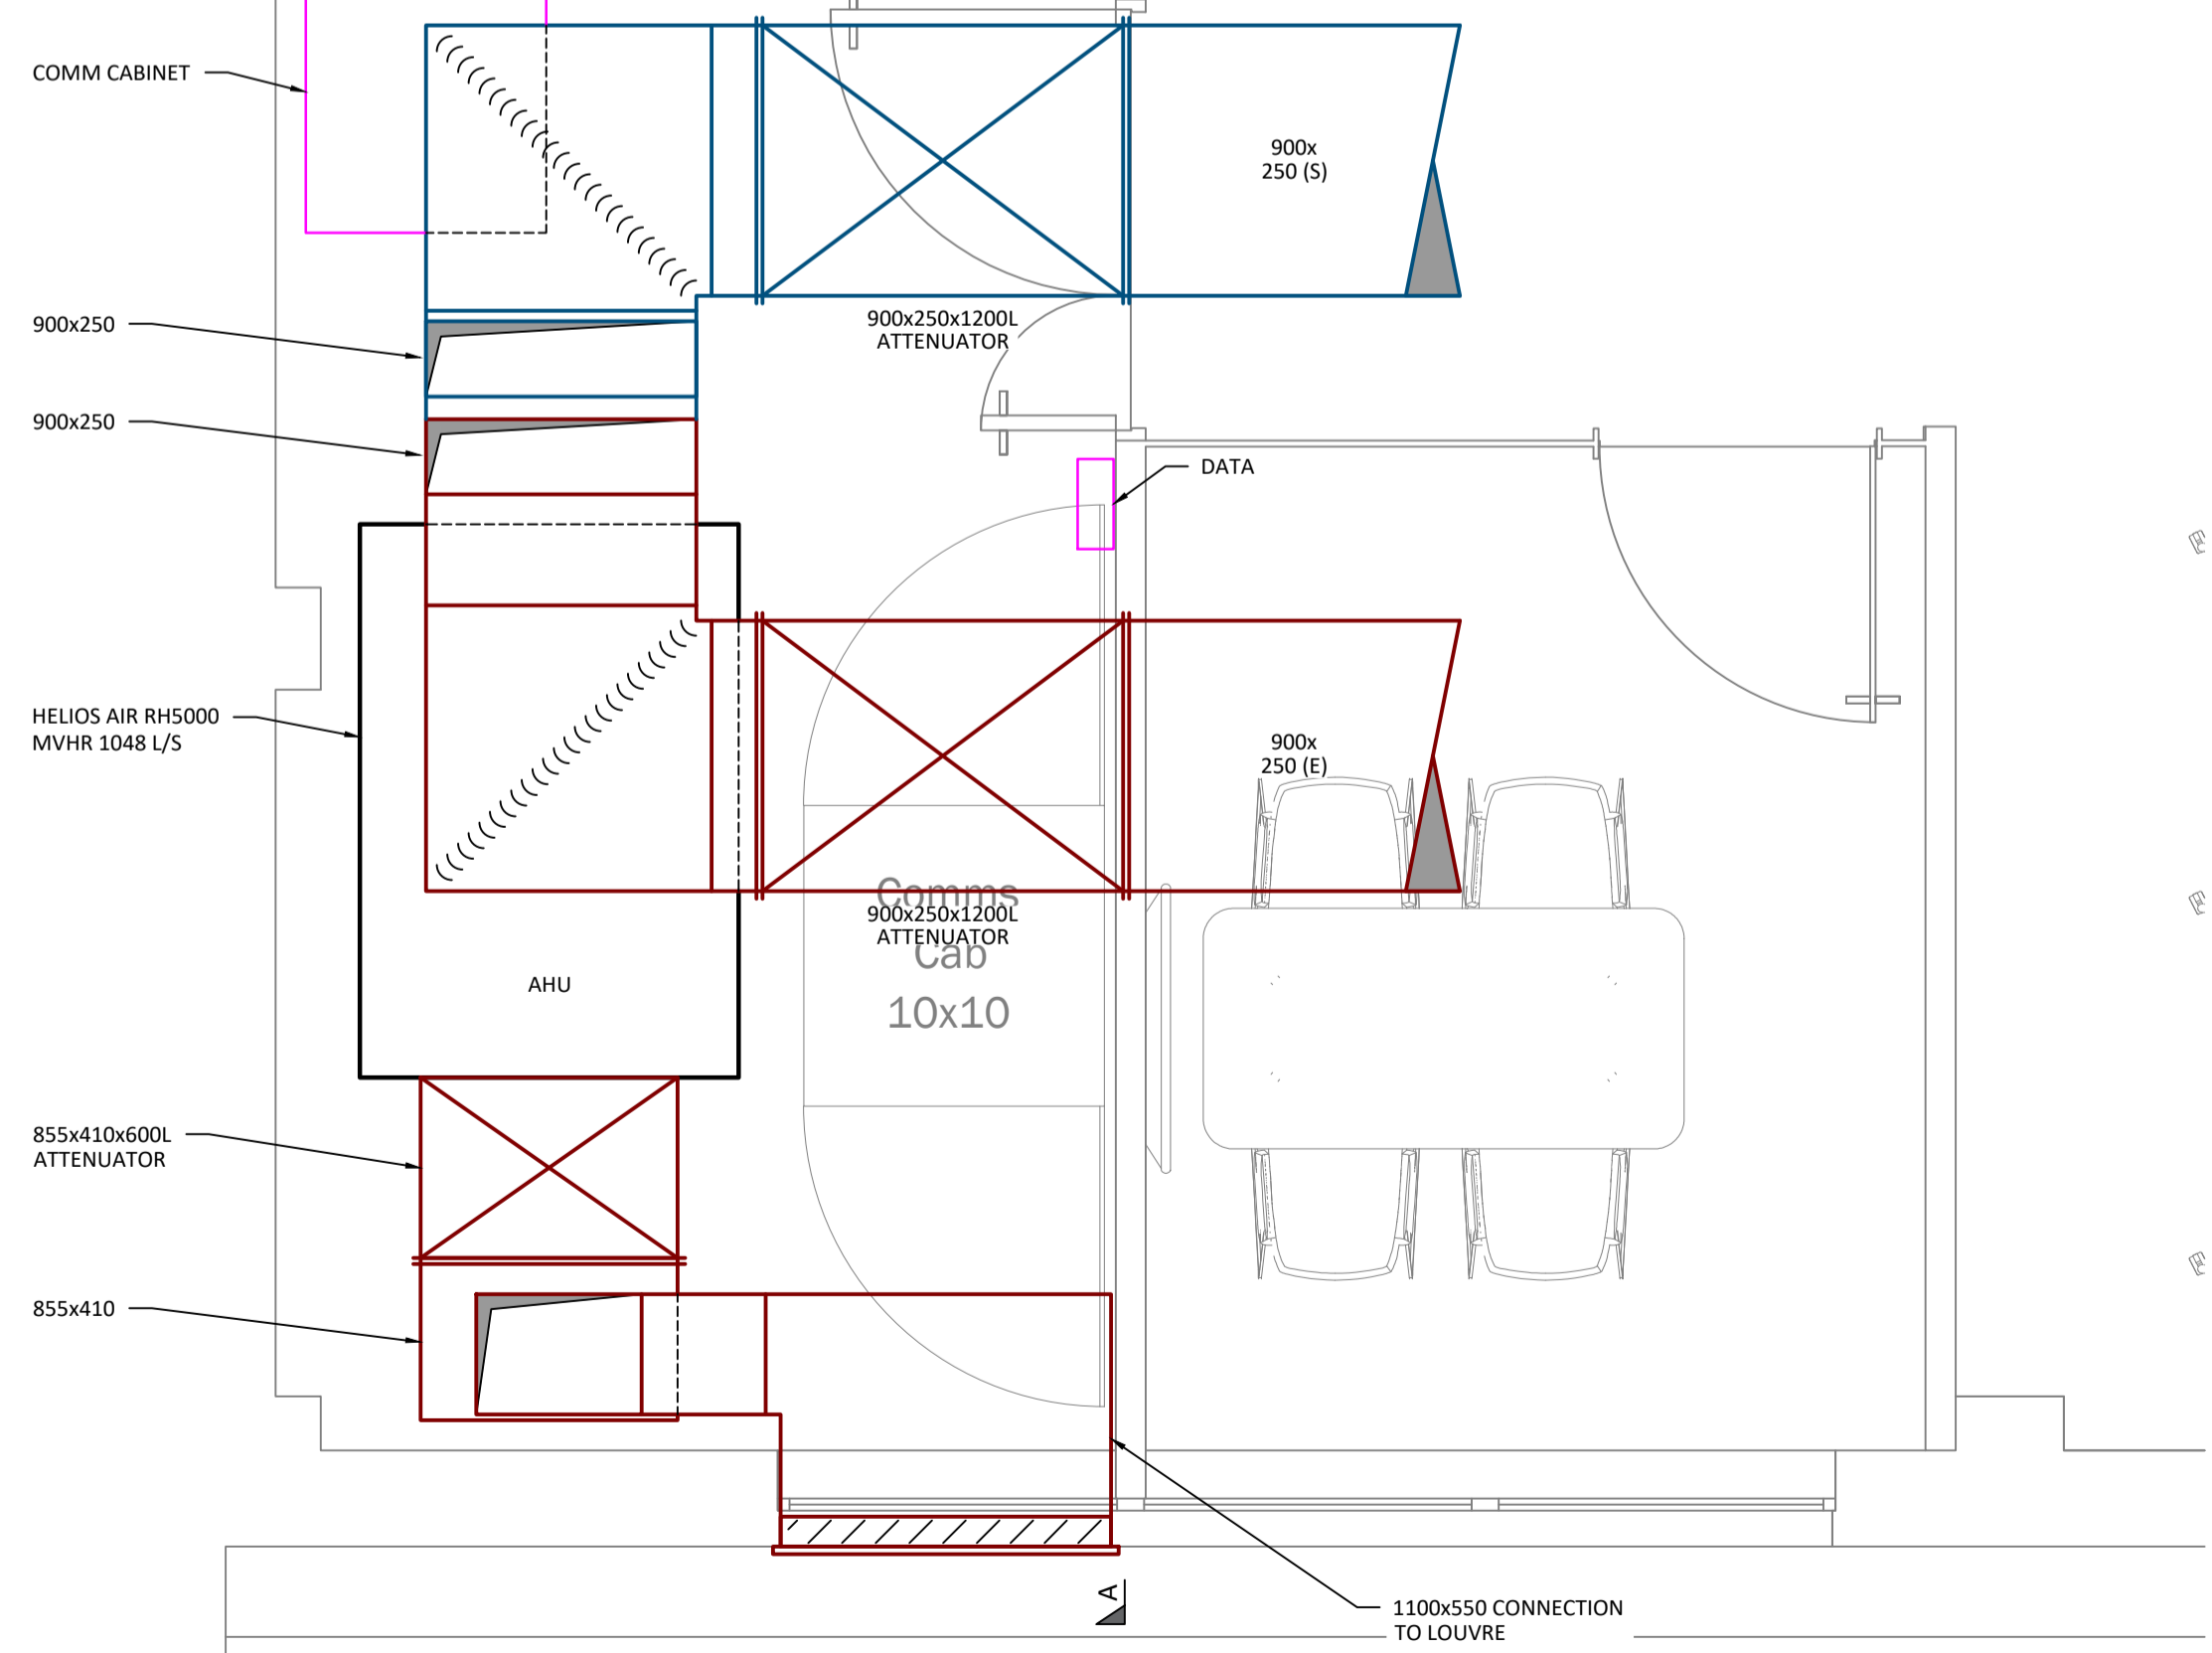
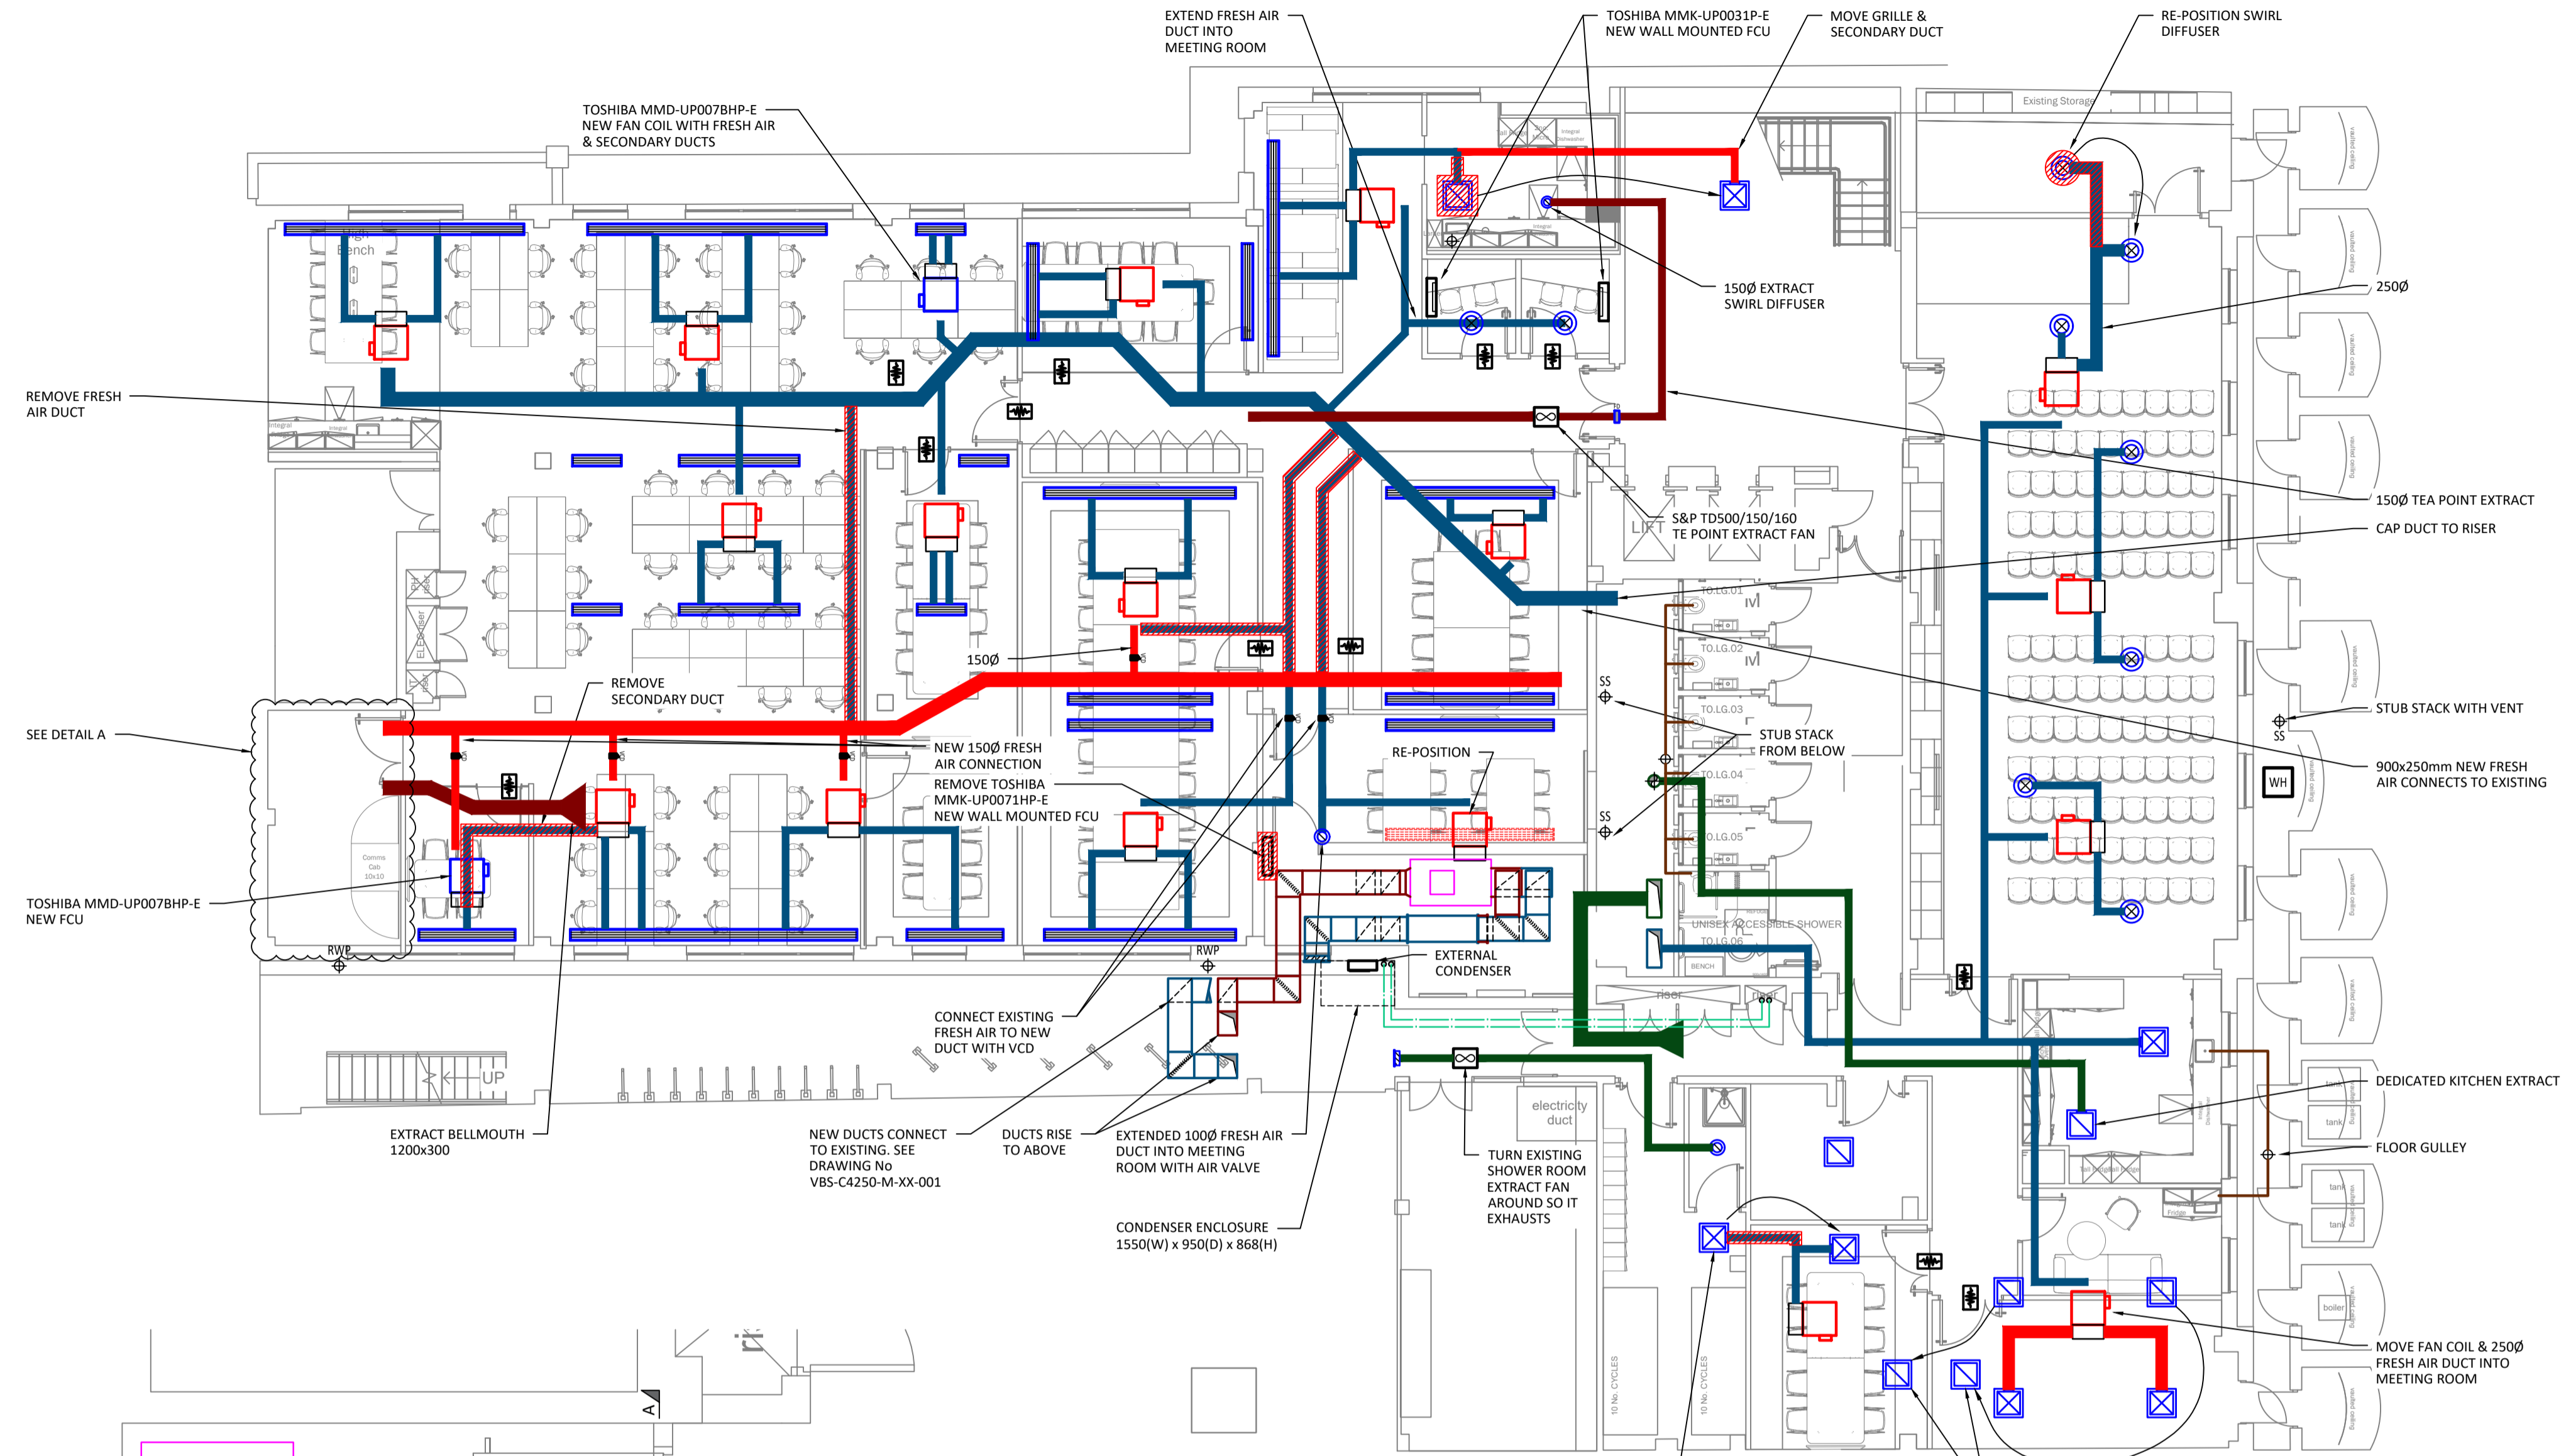


NOTES

- DO NOT SCALE FROM THIS DRAWING.
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE MECHANICAL SPECIFICATION.

LEGEND

-  NEW FAN COIL UNIT
-  EXISTING FAN COIL UNIT
-  SWIRL DIFFUSER
-  RETURN AIR GRILLE
-  SQUARE DIFFUSER
-  CROSS TALK ATTENUATOR (1500)
-  EXISTING EXTRACT DUCT
-  EXISTING SUPPLY DUCT
-  NEW SUPPLY DUCT
-  NEW EXTRACT DUCT
-  VOLUME CONTROL DAMPER



CONSTRUCTION

REV	DESCRIPTION	DATE	CHKD
C03	AHU ENLARGEMENT ADDED	27/02/24	PD
C02	GENERAL REVISIONS	17/07/23	PD
C01	CONSTRUCTION ISSUE	26/06/23	MQ

VBS
Building Services Engineers
Part of the  Surrey

70 Angel Hill, Sutton
Surrey, SM1 3EW
Tel: 020 8644 9203
Fax: 020 8644 9235
Email: post@vbs-td.co.uk
Web: www.vbs-td.co.uk

CLIENT: INTERACTION

PROJECT: 24-28 BLOOMSBURY WAY WC1A 2SN

TITLE: LOWER GROUND FLOOR MECHANICAL SERVICES LAYOUT

SCALE	PAGE SIZE	DATE
1:100 @ A1	A1	MAY 2023
DRAWN	ENGINEER	CHECKED
RCI	PD	PD

DRAWING No.	REVISION
VBS-C4250-M-LG-001	C03