
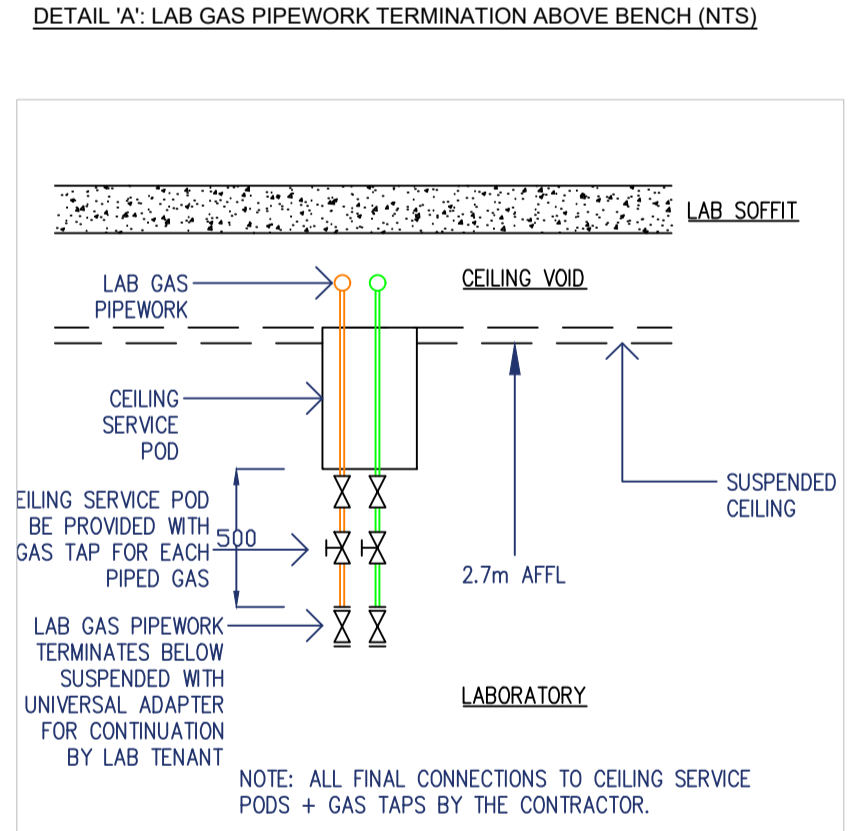
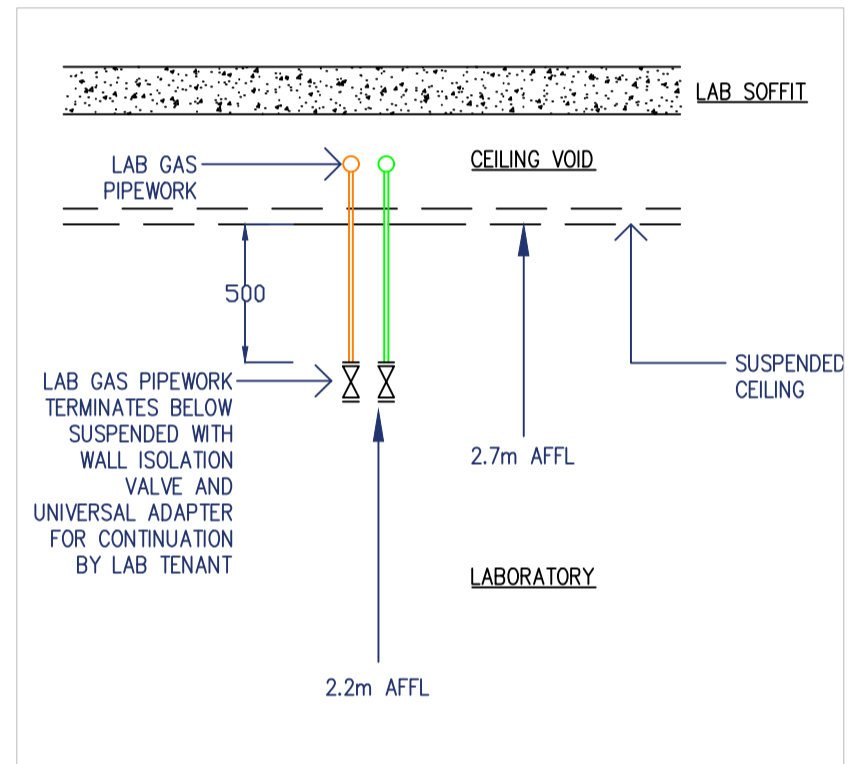


- NOTES:**
- DO NOT SCALE FROM THIS DRAWING
 - ALL LAB GAS SERVICES ARE CONTRACTOR DESIGN PORTION (CDP). IN THE ABSENCE OF ANY LAB EQUIPMENT DETAILS THE GAS DESIGN SHALL BE BASED ON THE FOLLOWING FLOW TO EACH/EVERY CSP
 - COMPRESSED AIR: 60-80 LITRES/MIN.
 - NITROGEN: 8-10 LITRES/MIN.
 - OXYGEN: 8-10 LITRES/MIN.
 - CARBON-DIOXIDE: 8-10 LITRES/MIN.
 - FOR LAB GAS PIPEWORK SIZING, 50% DIVERSITY CAN BE APPLIED WHERE APPROPRIATE.
 - THE CONTRACTOR MUST APPOINT AN APPROPRIATELY QUALIFIED SPECIALIST TO UNDERTAKE THE DESIGN.
 - ANY LAB GASES SYSTEM STORED INTERNALLY MUST BE HOUSED WITH PROPRIETARY FIRE-RATED ENCLOSURES
 - 2 NO. GAS DETECTION CONTROL PANELS SHALL BE PROVIDED FOR EACH FLOOR, ONE FOR THE NORTH DEMISE AND ANOTHER FOR THE SOUTH DEMISE.
 - EACH LABORATORY WILL HAVE A BEACON SOUNDER AT THE ENTRANCE TO AND WITHIN THE LABORATORY AREA ALONG WITH OXYGEN AND CARBON DIOXIDE SENSORS. IN THE EVENT OF SENSORS REACH AMBER OR RED SET POINTS, THE BEACON SOUNDRERS WILL BE ACTIVATED AND THE GAS SUPPLY AT THE MANIFOLD WILL BE AUTOMATICALLY ISOLATED.
 - EACH GAS BOTTLE STORE WILL HAVE A BEACON SOUNDER AT THE ENTRANCE TO AND WITHIN THE LABORATORY AREA ALONG WITH OXYGEN AND CARBON DIOXIDE SENSORS. IN THE EVENT OF SENSORS REACH AMBER OR RED SET POINTS, THE BEACON SOUNDRERS WILL BE ACTIVATED AND THE GAS SUPPLY AT THE MANIFOLD WILL BE AUTOMATICALLY ISOLATED.
 - ALL GAS DETECTION WIRING WILL BE UNDERTAKEN BY THE LAB GAS SPECIALIST

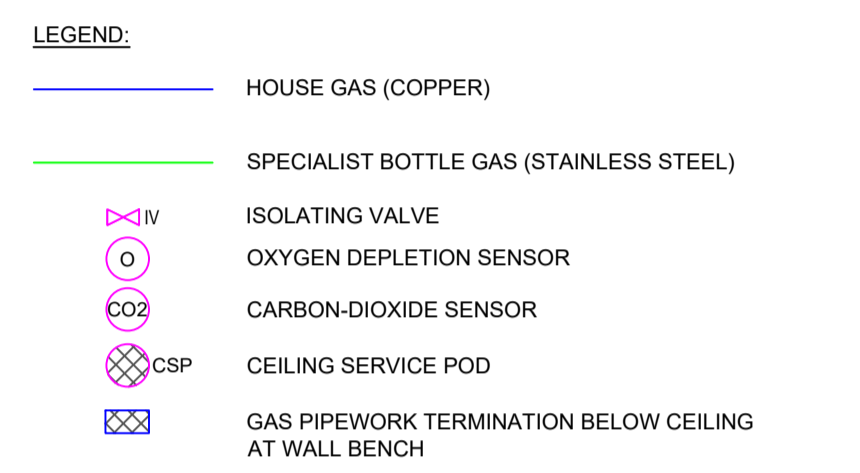

S4 - P01	14/02/2024	STAGE 3 CAT-B ISSUE	GON	AG
SUIT-REV	DATE	DESCRIPTION	DRN	CHK
STATUS				

STAGE 3

THIS DRAWING IS COPYRIGHT. DO NOT SCALE FROM DRAWING. THE CONTRACTOR AND THEIR SUB-CONTRACTORS ARE TO VERIFY ALL DIMENSIONS ON SITE BEFORE MAKING SHOP DRAWINGS OR COMMENCING MANUFACTURE.

KJ TAIT
ENGINEERS

1 Fitzroy Square
London W1T 3HF
T +44 (0) 207 588 0952
E london@kjtaill.com
W www.kjtaill.com

PROJECT INFORMATION			
CLIENT	OXFORD VICTORIA HOUSE DEVELOPMENT LTD		
PROJECT	LONDON, WC1B 4DA		
DRAWING INFORMATION			
DRAWING TITLE	MECHANICAL SERVICES FIFTH FLOOR CAT-B LAB GAS LAYOUT		
DESIGNED BY	AG	DATE	Jan. 2024
DRAWN BY	AG	KJT JOB No.	
SCALE	1:100 @ A1		L3221
JOB CODE	ORIGIN-VOL-LEVEL-TYPE-ROLE-CLASS NUMBER	SUIT-REV	
L3221	KJT-02-05-DR-M-5410	S4-P01	