


**NOTES:**

DO NOT SCALE FROM THIS DRAWING.

- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE MECHANICAL SPECIFICATION, THE ARCHITECTS DIMENSIONED LAYOUTS AND ALL OTHER RELEVANT CONTRACT DOCUMENTATION.
- ALL MECHANICAL VENTILATION DUCTWORK SHALL BE GALVANISED SHEET METAL DUCTWORK SUPPLIED AND INSTALLED IN ACCORDANCE WITH HVCA DW/144
- ANY DUCTWORK PENETRATING A FIRE RATED BARRIER OR STRUCTURE SHALL INCORPORATE A SUITABLY RATED FIRE DAMPER
- ALL FIRE DAMPERS TO BE FULLY ACCESSIBLE. THIS ACCESS WILL REQUIRE DUCT ACCESS DOORS AND WHERE REQUIRED REMOVABLE CEILING SECTIONS
- THE CONTRACTOR SHALL ALLOW FOR TESTING, COMMISSIONING AND SETTING TO WORK ALL VENTILATION SYSTEMS IN ACCORDANCE WITH THE CIBSE COMMISSIONING CODE 'A' AND THE RELEVANT BSRIA APPLICATION GUIDES
- THE MECHANICAL CONTRACTOR SHALL BE RESPONSIBLE FOR THE CO-ORDINATION OF THEIR WORKS WITH ALL OTHER TRADES

**LEGEND:**

- FRESH AIR DUCTWORK
- EXHAUST AIR DUCTWORK
- SUPPLY AIR DUCTWORK
- EXTRACT AIR DUCTWORK
- FUME EXHAUST AIR DUCTWORK
- - - - - TENANT FIT-OUT DUCTWORK
- ⊠ DUCT ACCESS DOOR
- ⊠ VAV VAV BOX
- ⊠ CAV CAV BOX
- FD FIRE DAMPER
- SD SMOKE DAMPER
- ⊠ DUCT ATTENUATOR
- ⊠ CROSSTALK ATTENUATOR
- ⊠ VOLUME CONTROL DAMPER
- ⊠ BOOSTER FAN
- ⊠ RETURN AIR GRILLE
- ⊠ FUME CUPBOARD/BSC

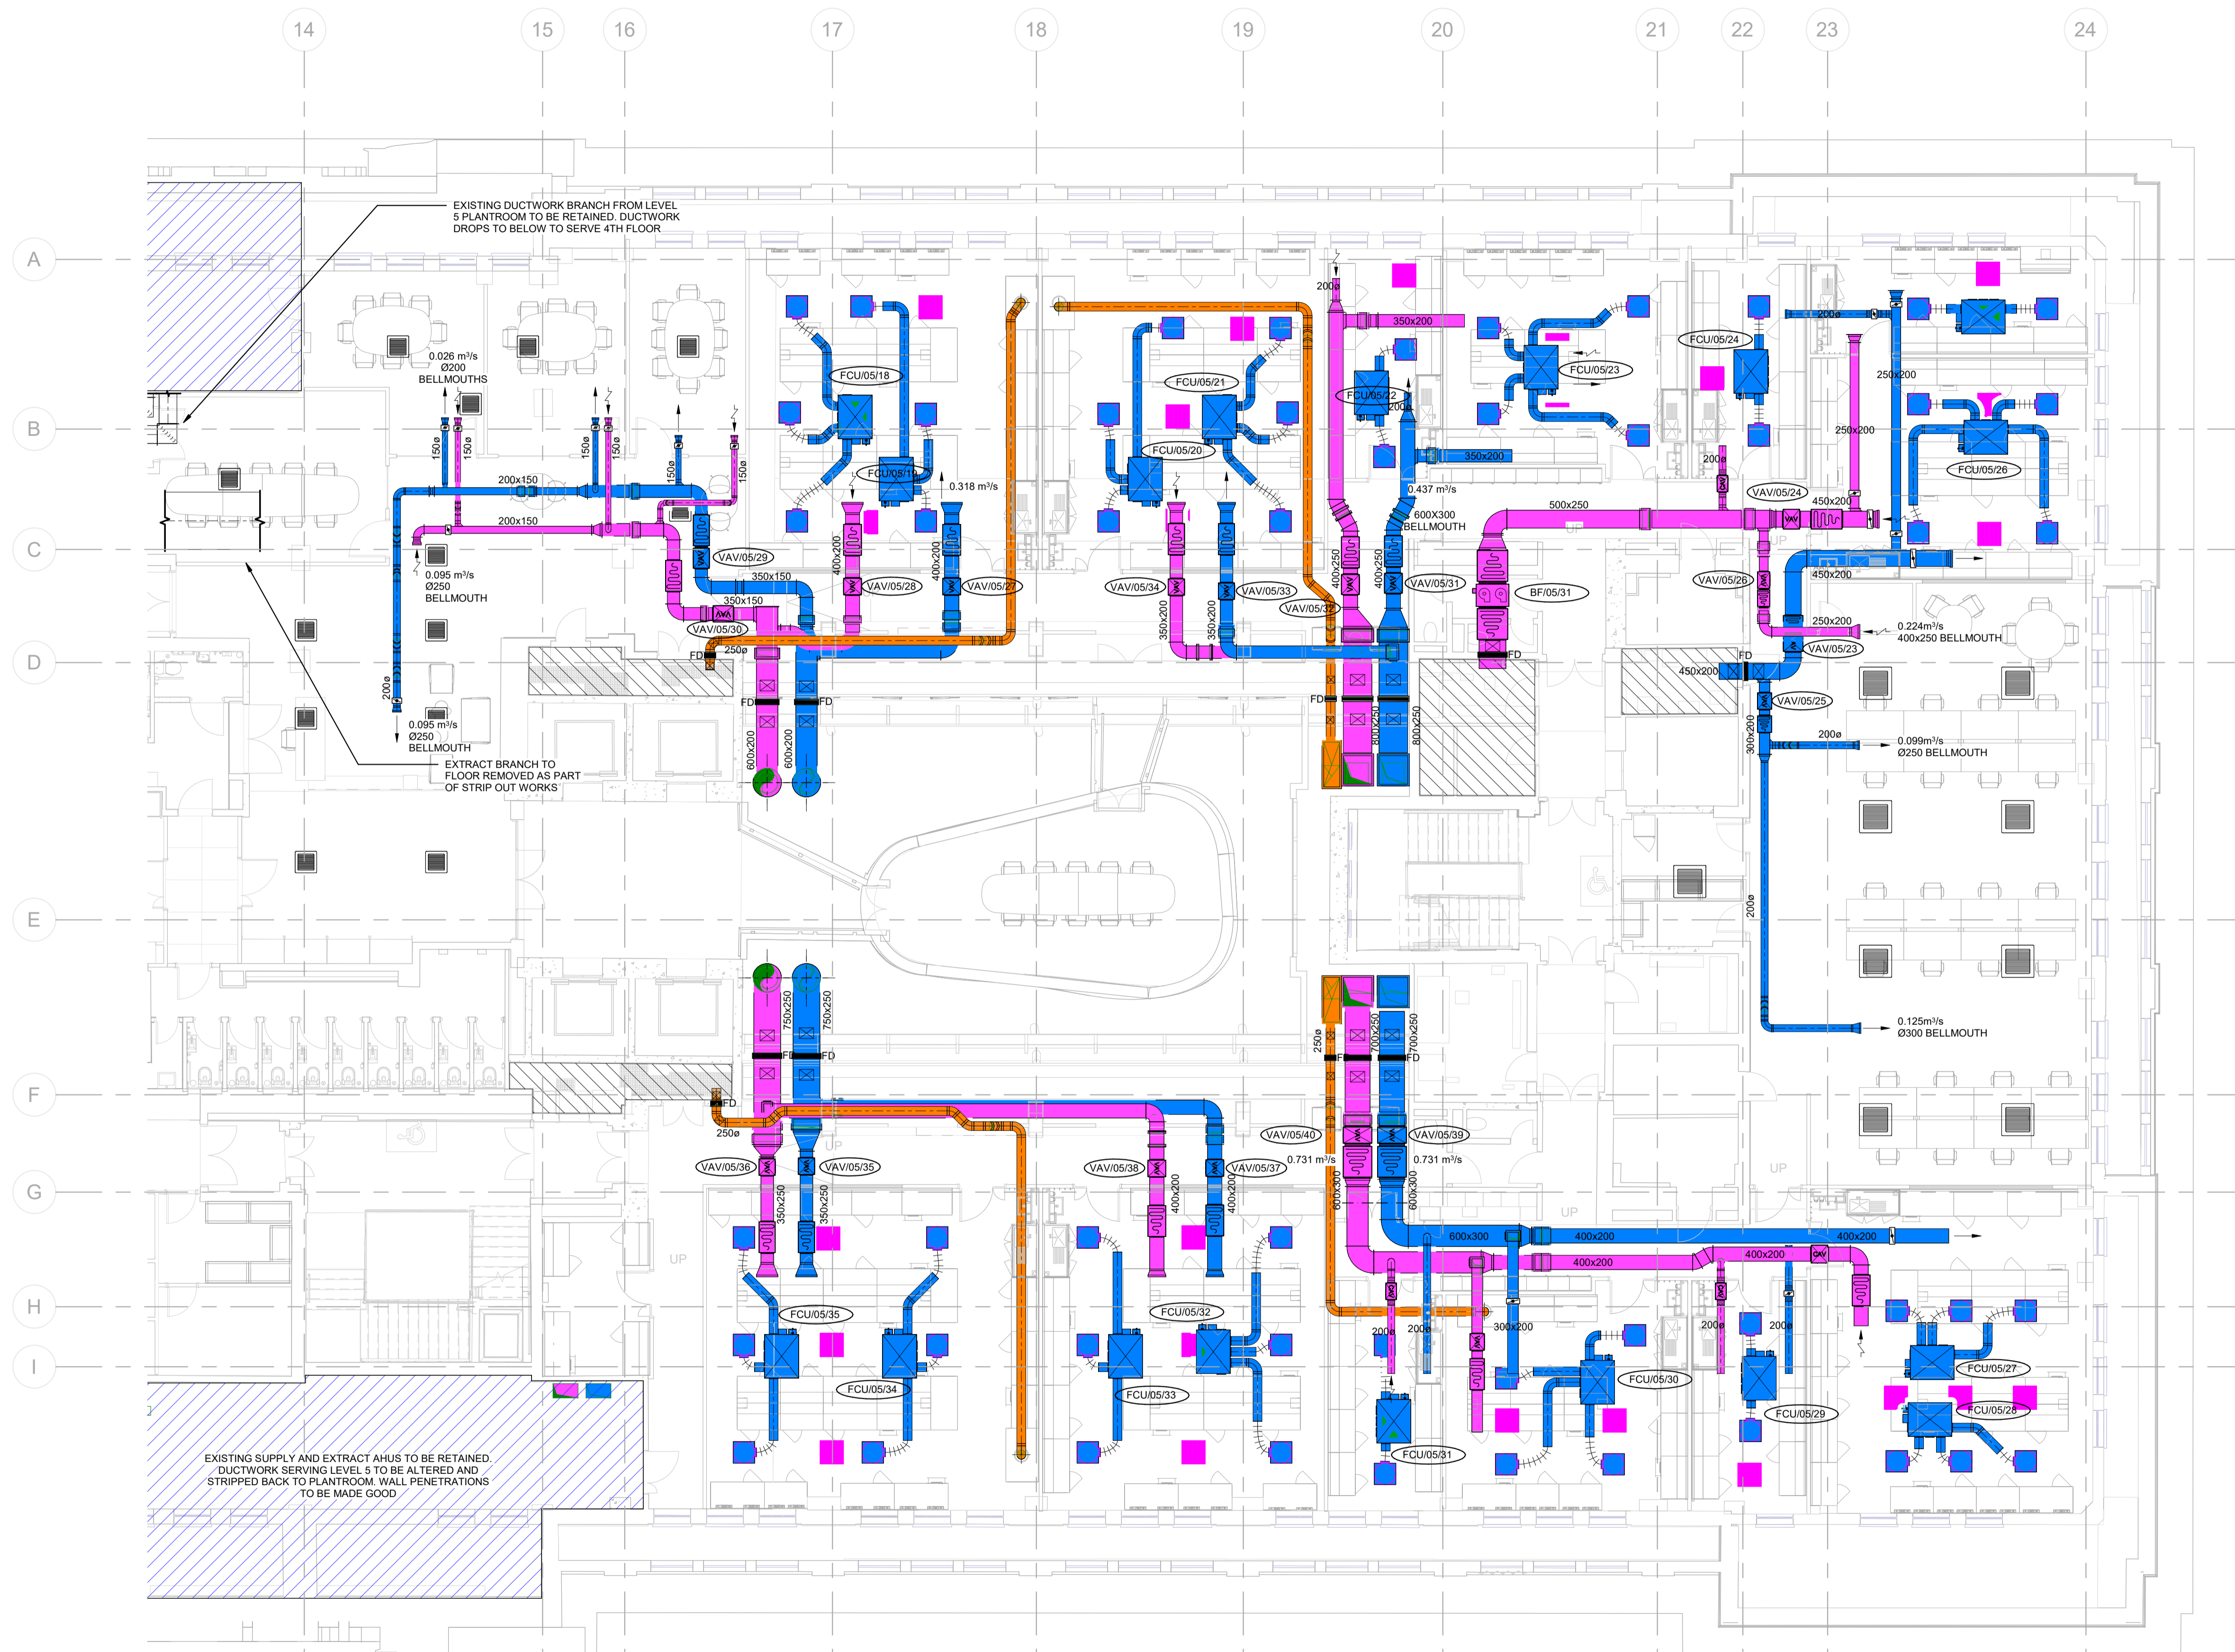

S4-P01	26/01/2024	STAGE 3 CAT-B ISSUE	TE	AG
SUIT-REV	DATE	DESCRIPTION	DRN	CHK
STATUS				

**STAGE 3**

THIS DRAWING IS COPYRIGHT. DO NOT SCALE FROM DRAWING. THE CONTRACTOR AND THEIR SUB-CONTRACTORS ARE TO VERIFY ALL DIMENSIONS ON SITE BEFORE MAKING SHOP DRAWINGS OR COMMENCING MANUFACTURE.

**KJ TAIT**  
ENGINEERS

1 Fitzroy Square  
London W1T 5HF  
T +44 (0) 207 388 0952  
E london@kjtait.com  
W www.kjtait.com

PROJECT INFORMATION			
CLIENT	OXFORD VICTORIA HOUSE DEVELOPMENT LTD LONDON, WC1B 4DA		
PROJECT	MECHANICAL SERVICES 5TH FLOOR VENTILATION LAYOUT SHEET 2 of 2		
DRAWING INFORMATION			
DESIGNED BY	TE	DATE	JAN 2024
DRAWN BY	MZ	KJT JOB No.	
SCALE	1 : 100 @ A1	L3221	
JOB CODE	ORIGIN-VOL-LEVEL-TYPE-ROLE-CLASS NUMBER	SUIT-REV	
L3221	KJT-02-05-DR-M-5710	S4 - P01	