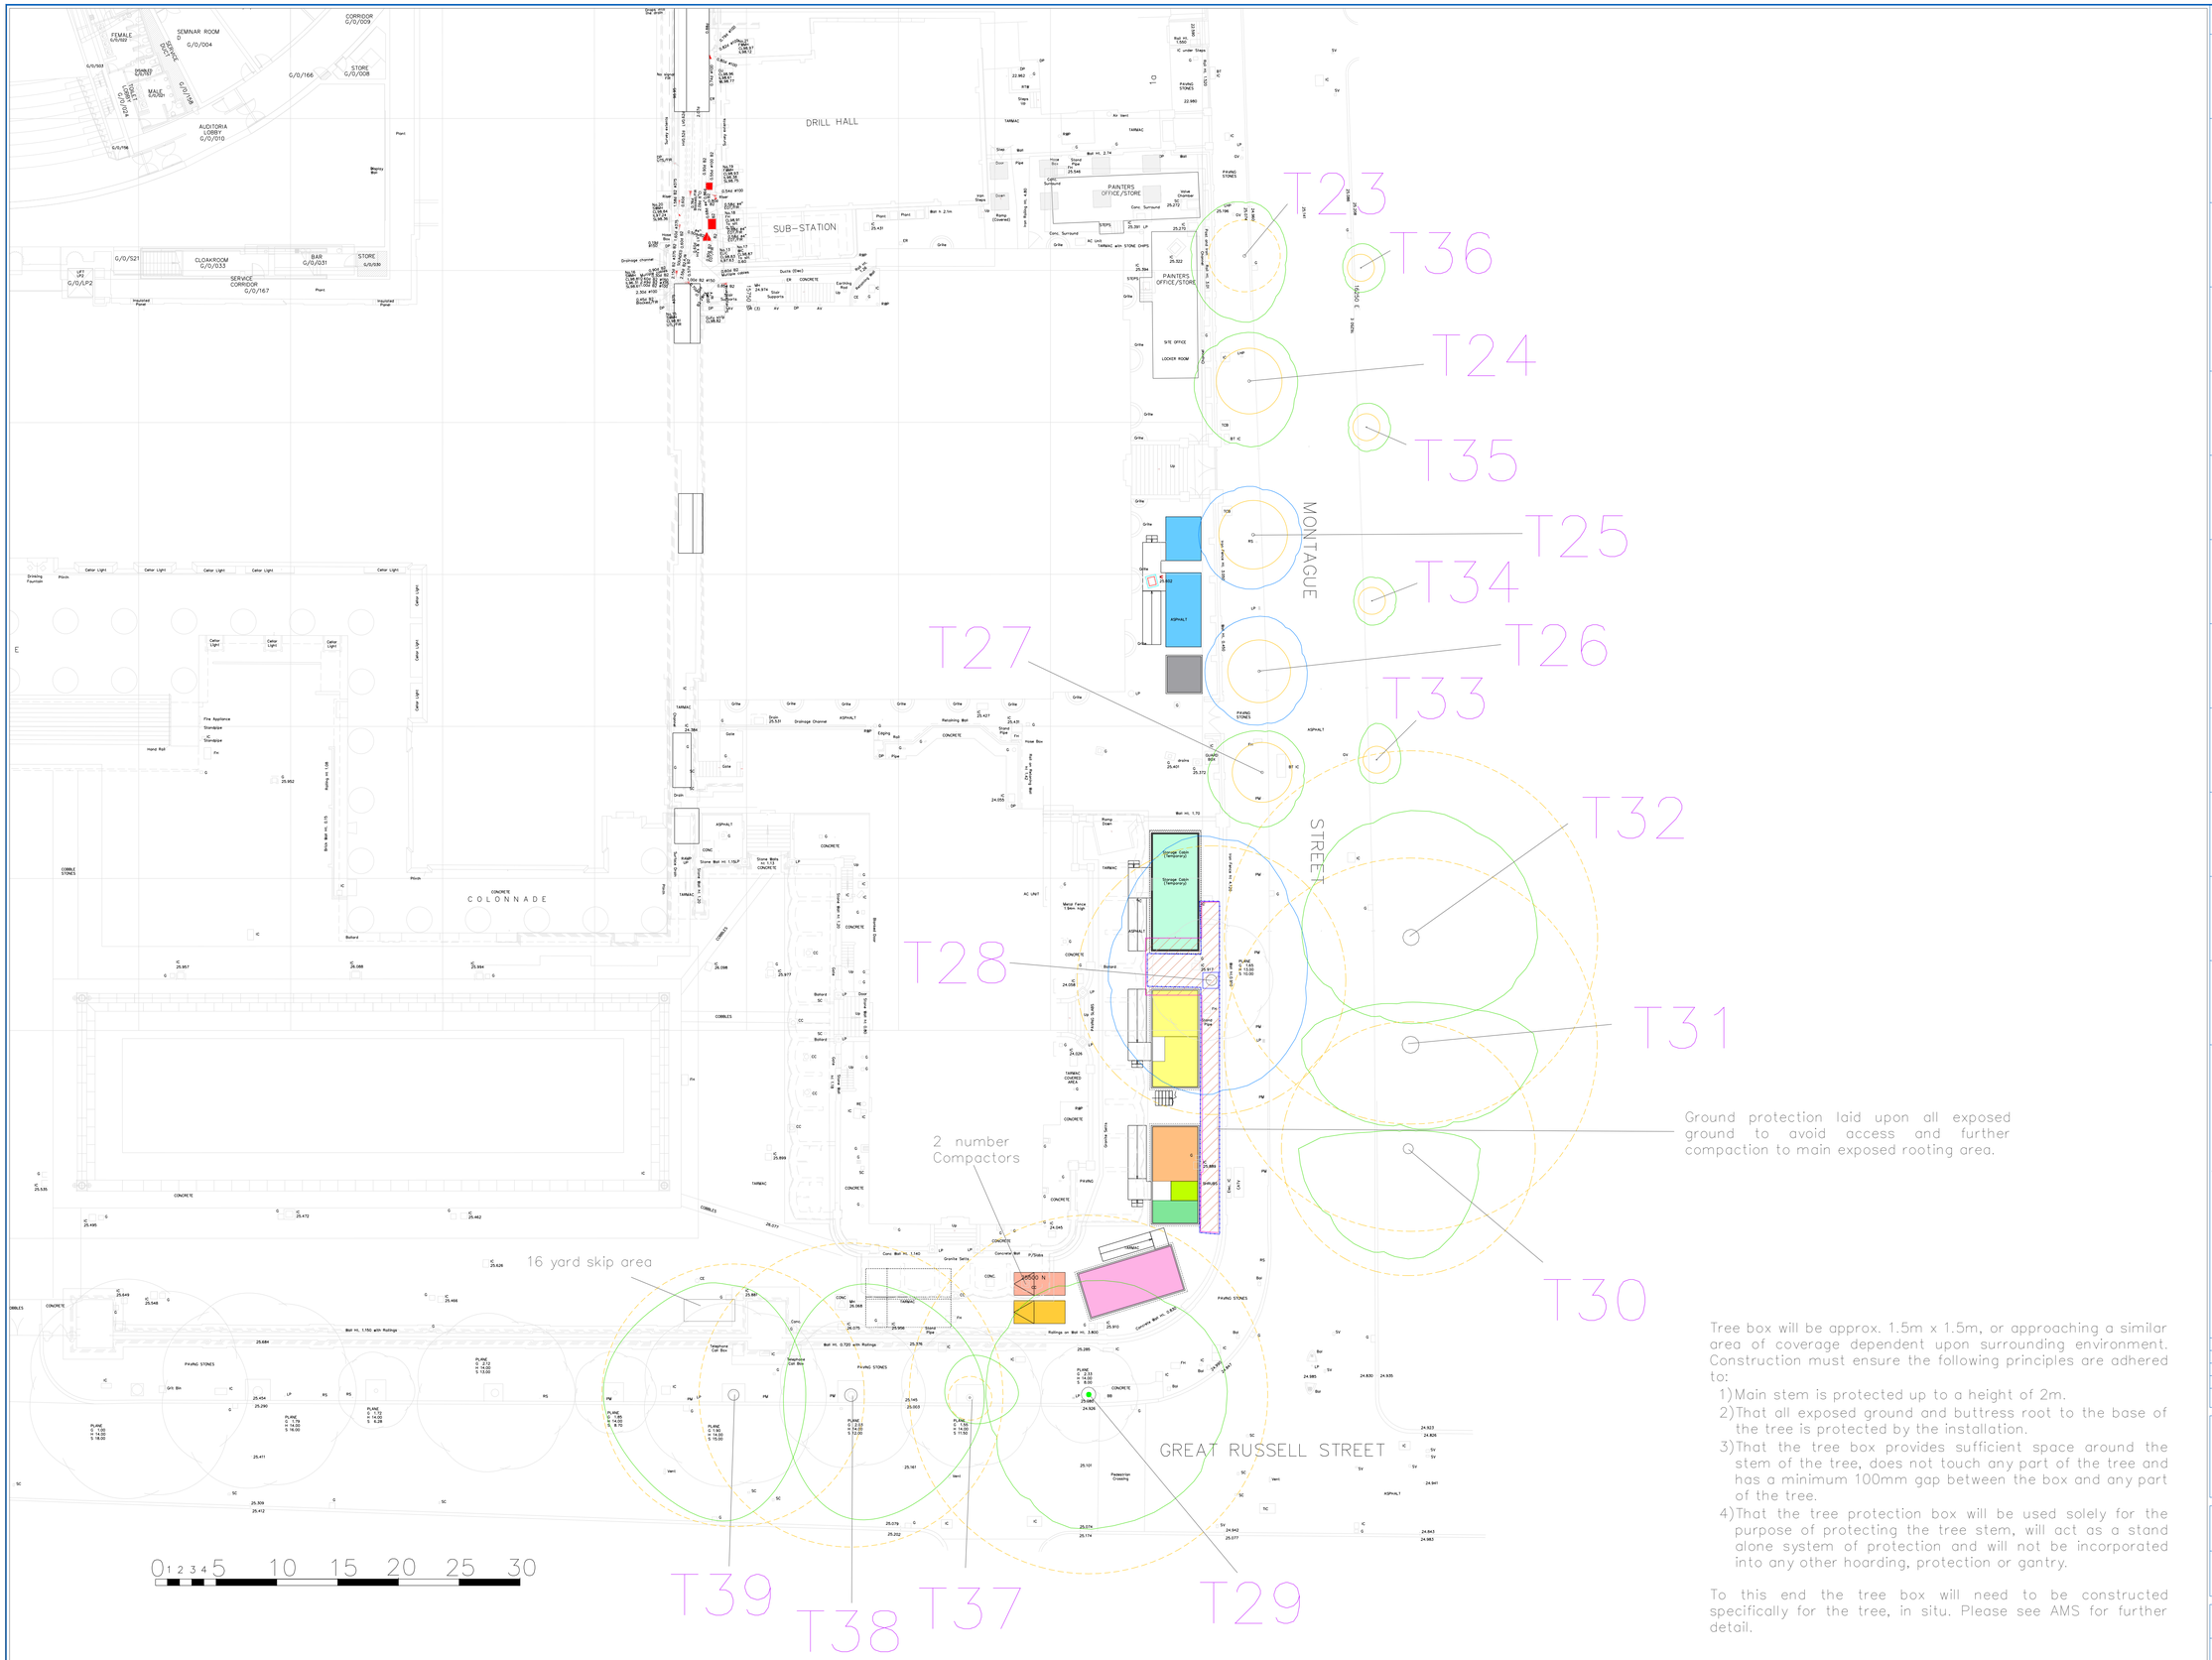

Tree box will be approx. 1.5m x 1.5m, or approaching a similar area of coverage dependent upon surrounding environment. Construction must ensure the following principles are adhered to:

1) Main stem is protected up to a height of 2m.
2) That all exposed ground and buttress root to the base of the tree is protected by the installation.
3) That the tree box provides sufficient space around the stem of the tree, does not touch any part of the tree and has a minimum 100mm gap between the box and any part of the tree.
4) That the tree protection box will be used solely for the purpose of protecting the tree stem, will act as a stand alone system of protection and will not be incorporated into any other hoarding, protection or gantry.

To this end the tree box will need to be constructed specifically for the tree, in situ. Please see AMS for further detail.

KEY:

T1	Tree (T)/ Group (G) Hedge (H) number.
	Trees to be retained
	Trees to be pruned
	Trees to be removed
	Root Protection Area in accordance with BS5837:2012.
	Ground Protection
	Tree Box
	Protective Barrier

This drawing to be viewed in colour.

North

REV:	DESCRIPTION:	BY:	DATE:

STATUS:

Writtle Forest Consultancy Ltd
Redindyke Farm, Ivy Barns Lane, Margaretting, Ingatestone, Essex, CM4 0PU.
Telephone : 01277 355970
Website : www.writtleforest.co.uk

CLIENT: British Museum

SITE: British Museum
Gt. Russell Street
London WC1B 3DG

DRAWING NAME: Tree Protection Plan

SCALE:	DATE:	DRAWN:	CHECKED:
1:250@ A1	09.02.24	orb	
PROJECT NO:	DRAWING NO:		REVISION:
240131	240131/01		A