



5-4. NOISE CRITERION CURVES

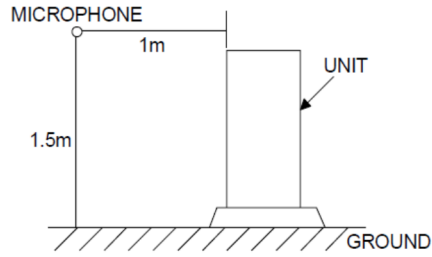


SINGLE AIR CONDITIONING CONDENSER UNIT

PUHZ-RP71VHA4

MODE	SPL(dB)	LINE
COOLING	47	○—○
HEATING	48	●—●

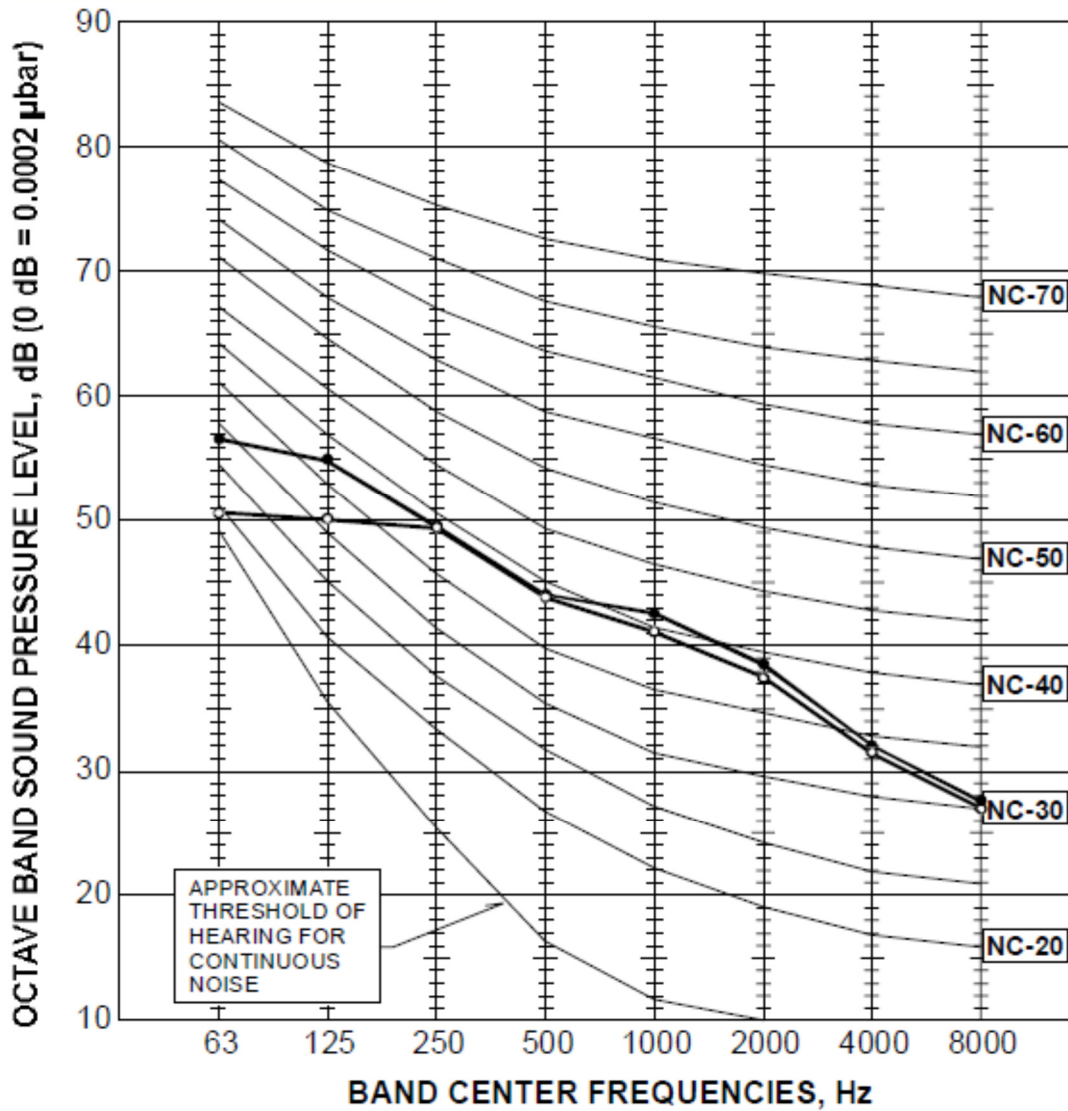

5-3. NOISE CRITERION CURVES

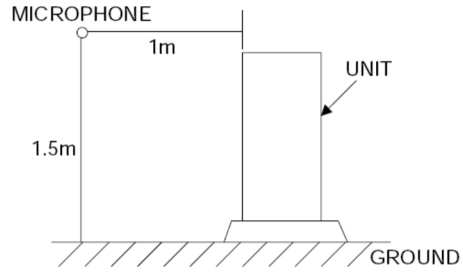

DOUBLE AIR CONDITIONING CONDENSER UNIT

PUHZ-ZRP125/140VKA

MODE	SPL(dB)	LINE
COOLING	50	○—○
HEATING	52	●—●

