

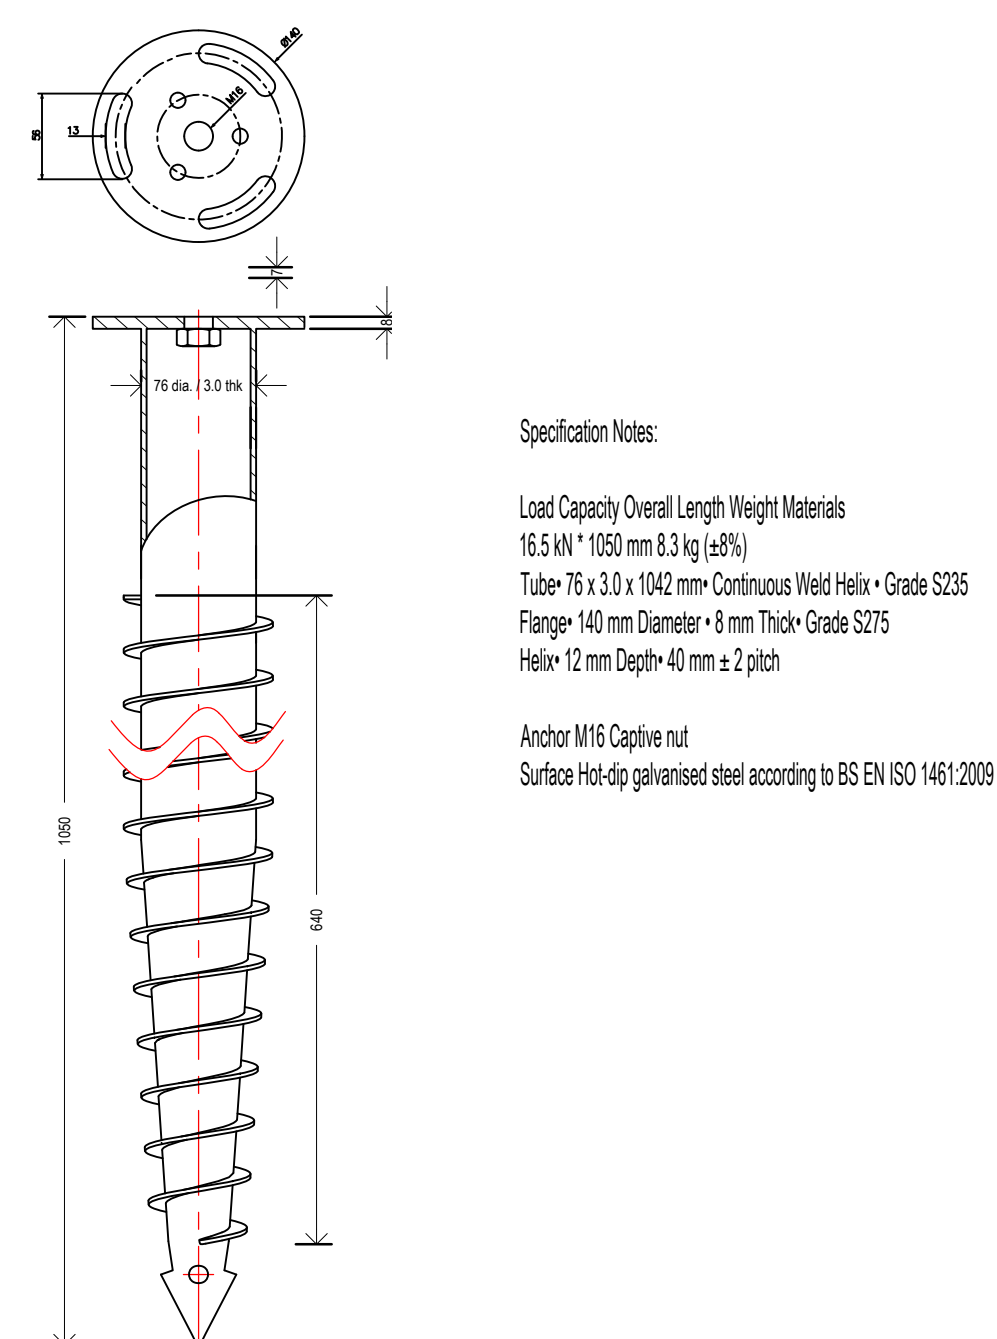


Note:
This drawing to be read in conjunction with the previously submitted and approved Arboricultural Impact Assessment and Method Statement prepared by All Arboricultural

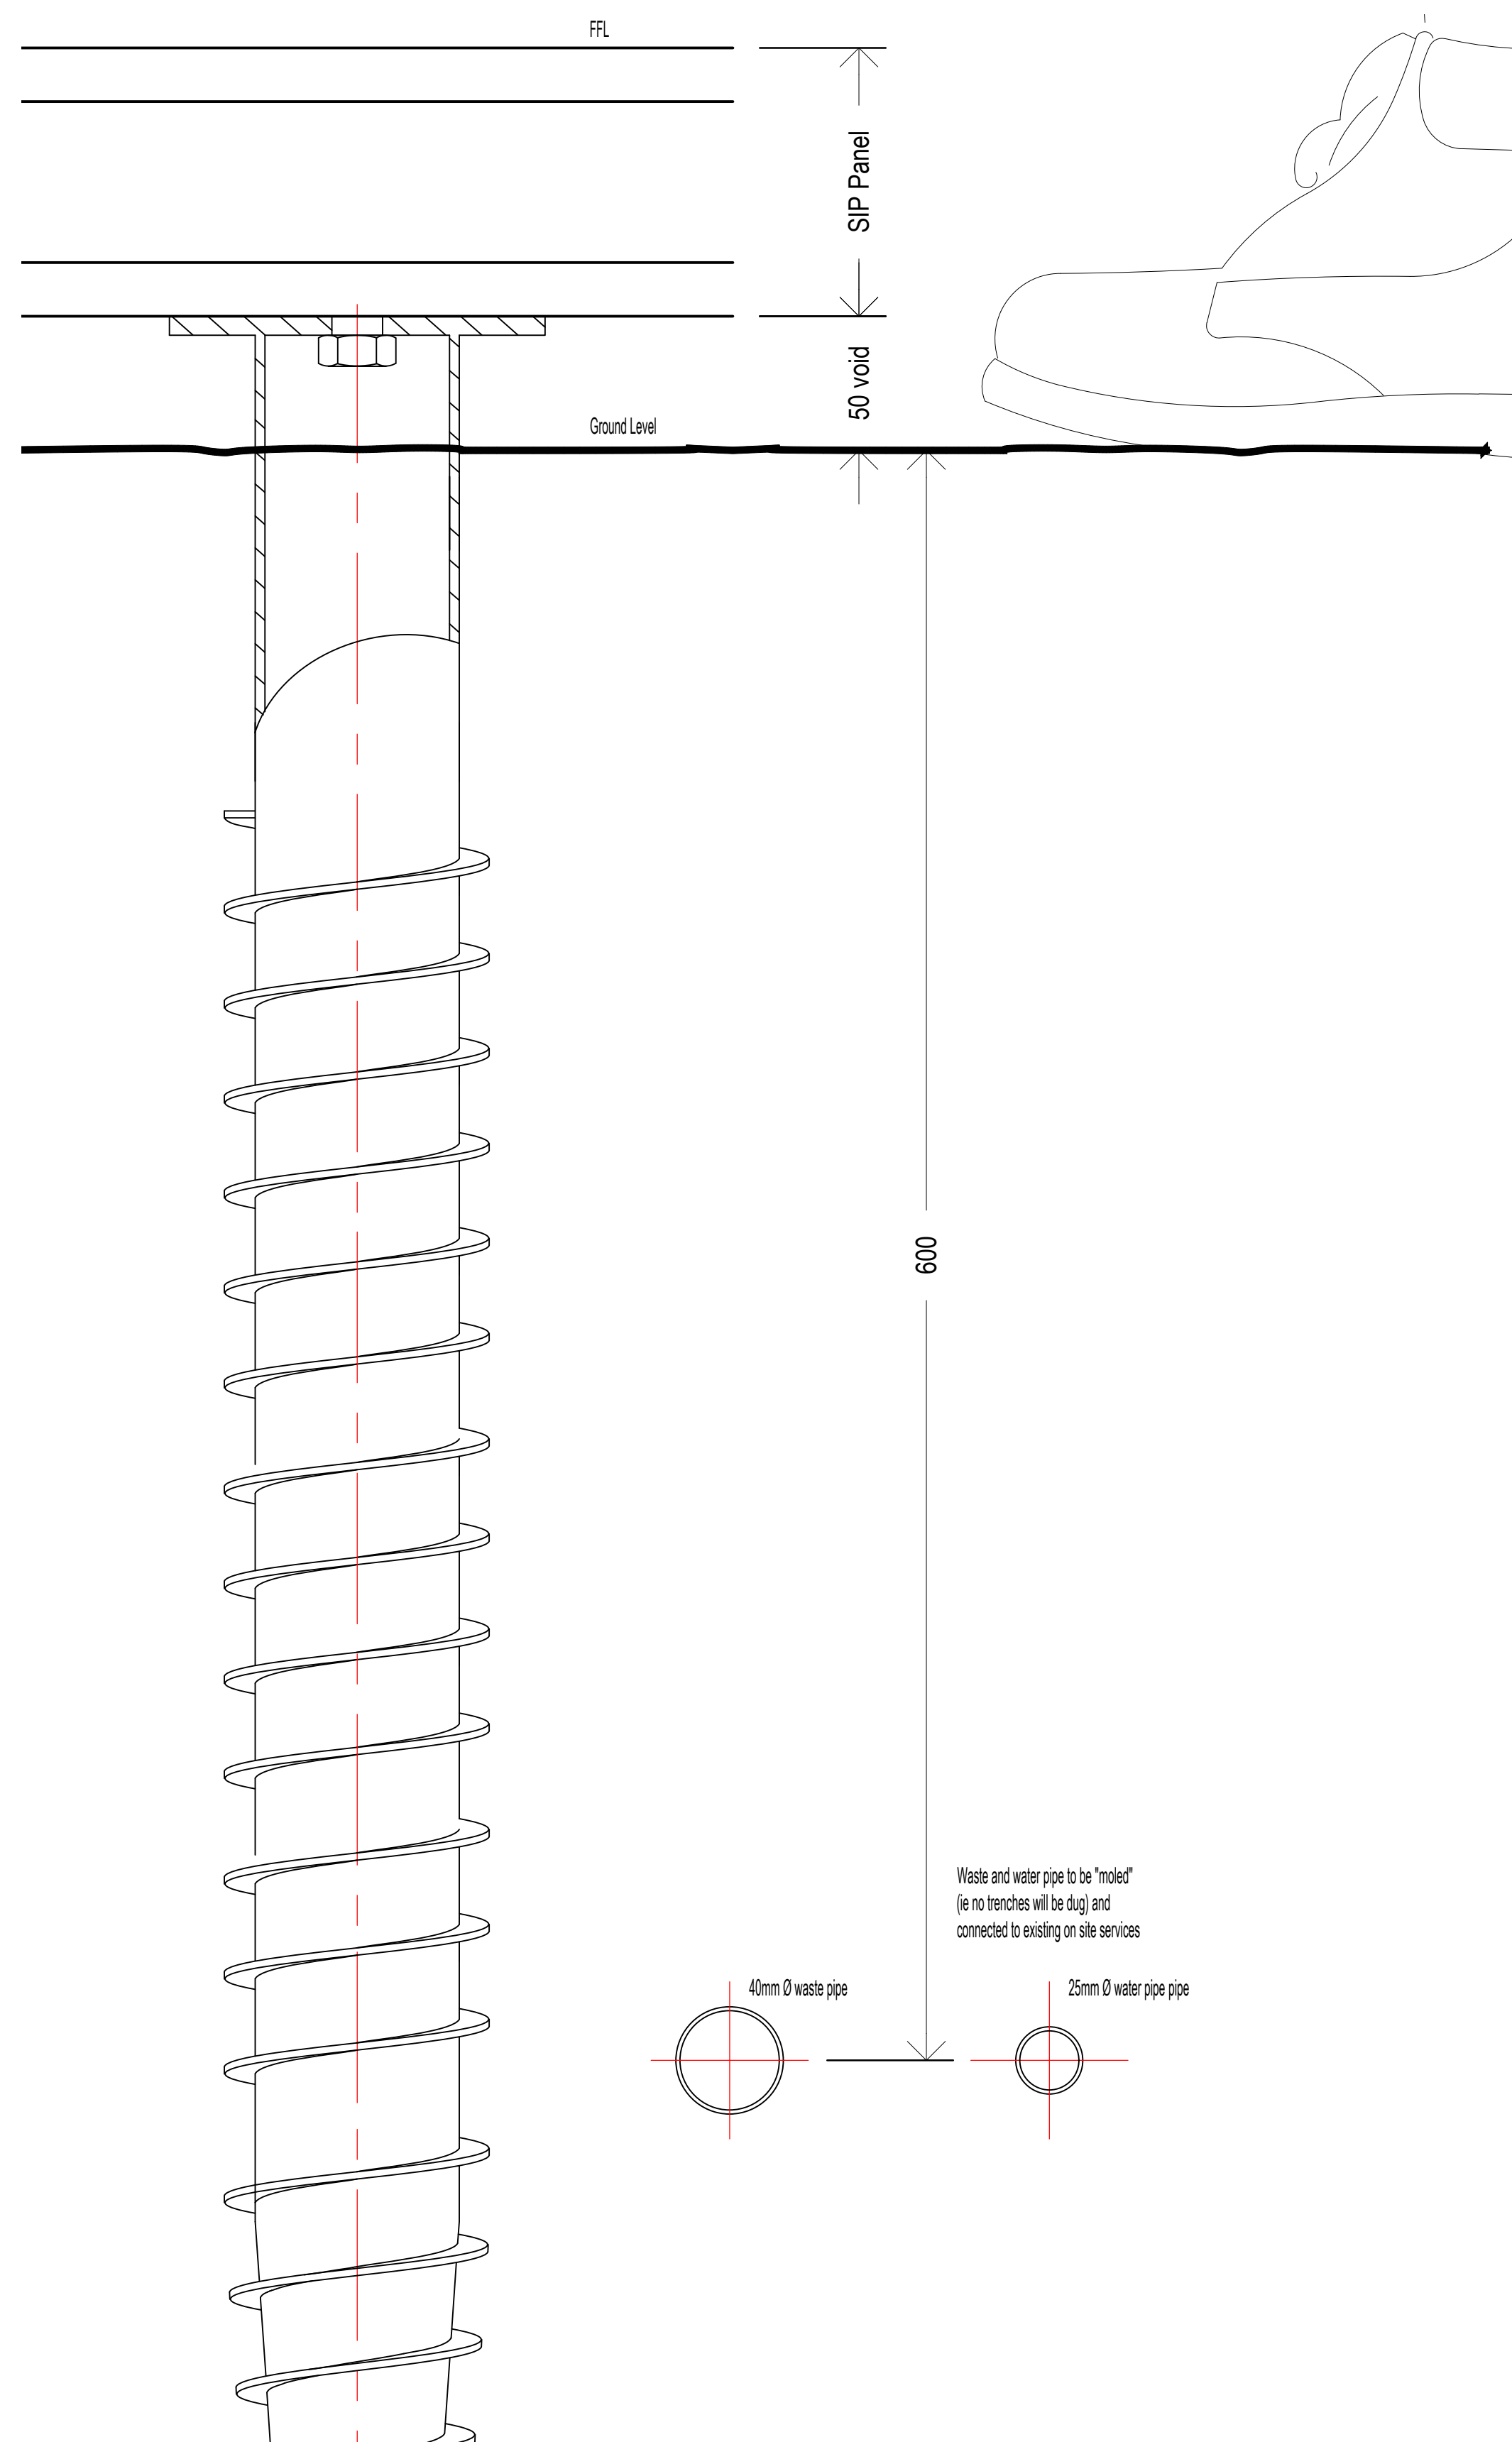

RDX PRO RF140 M16 76x1050-T3.0 Ground Screw @ 1:5

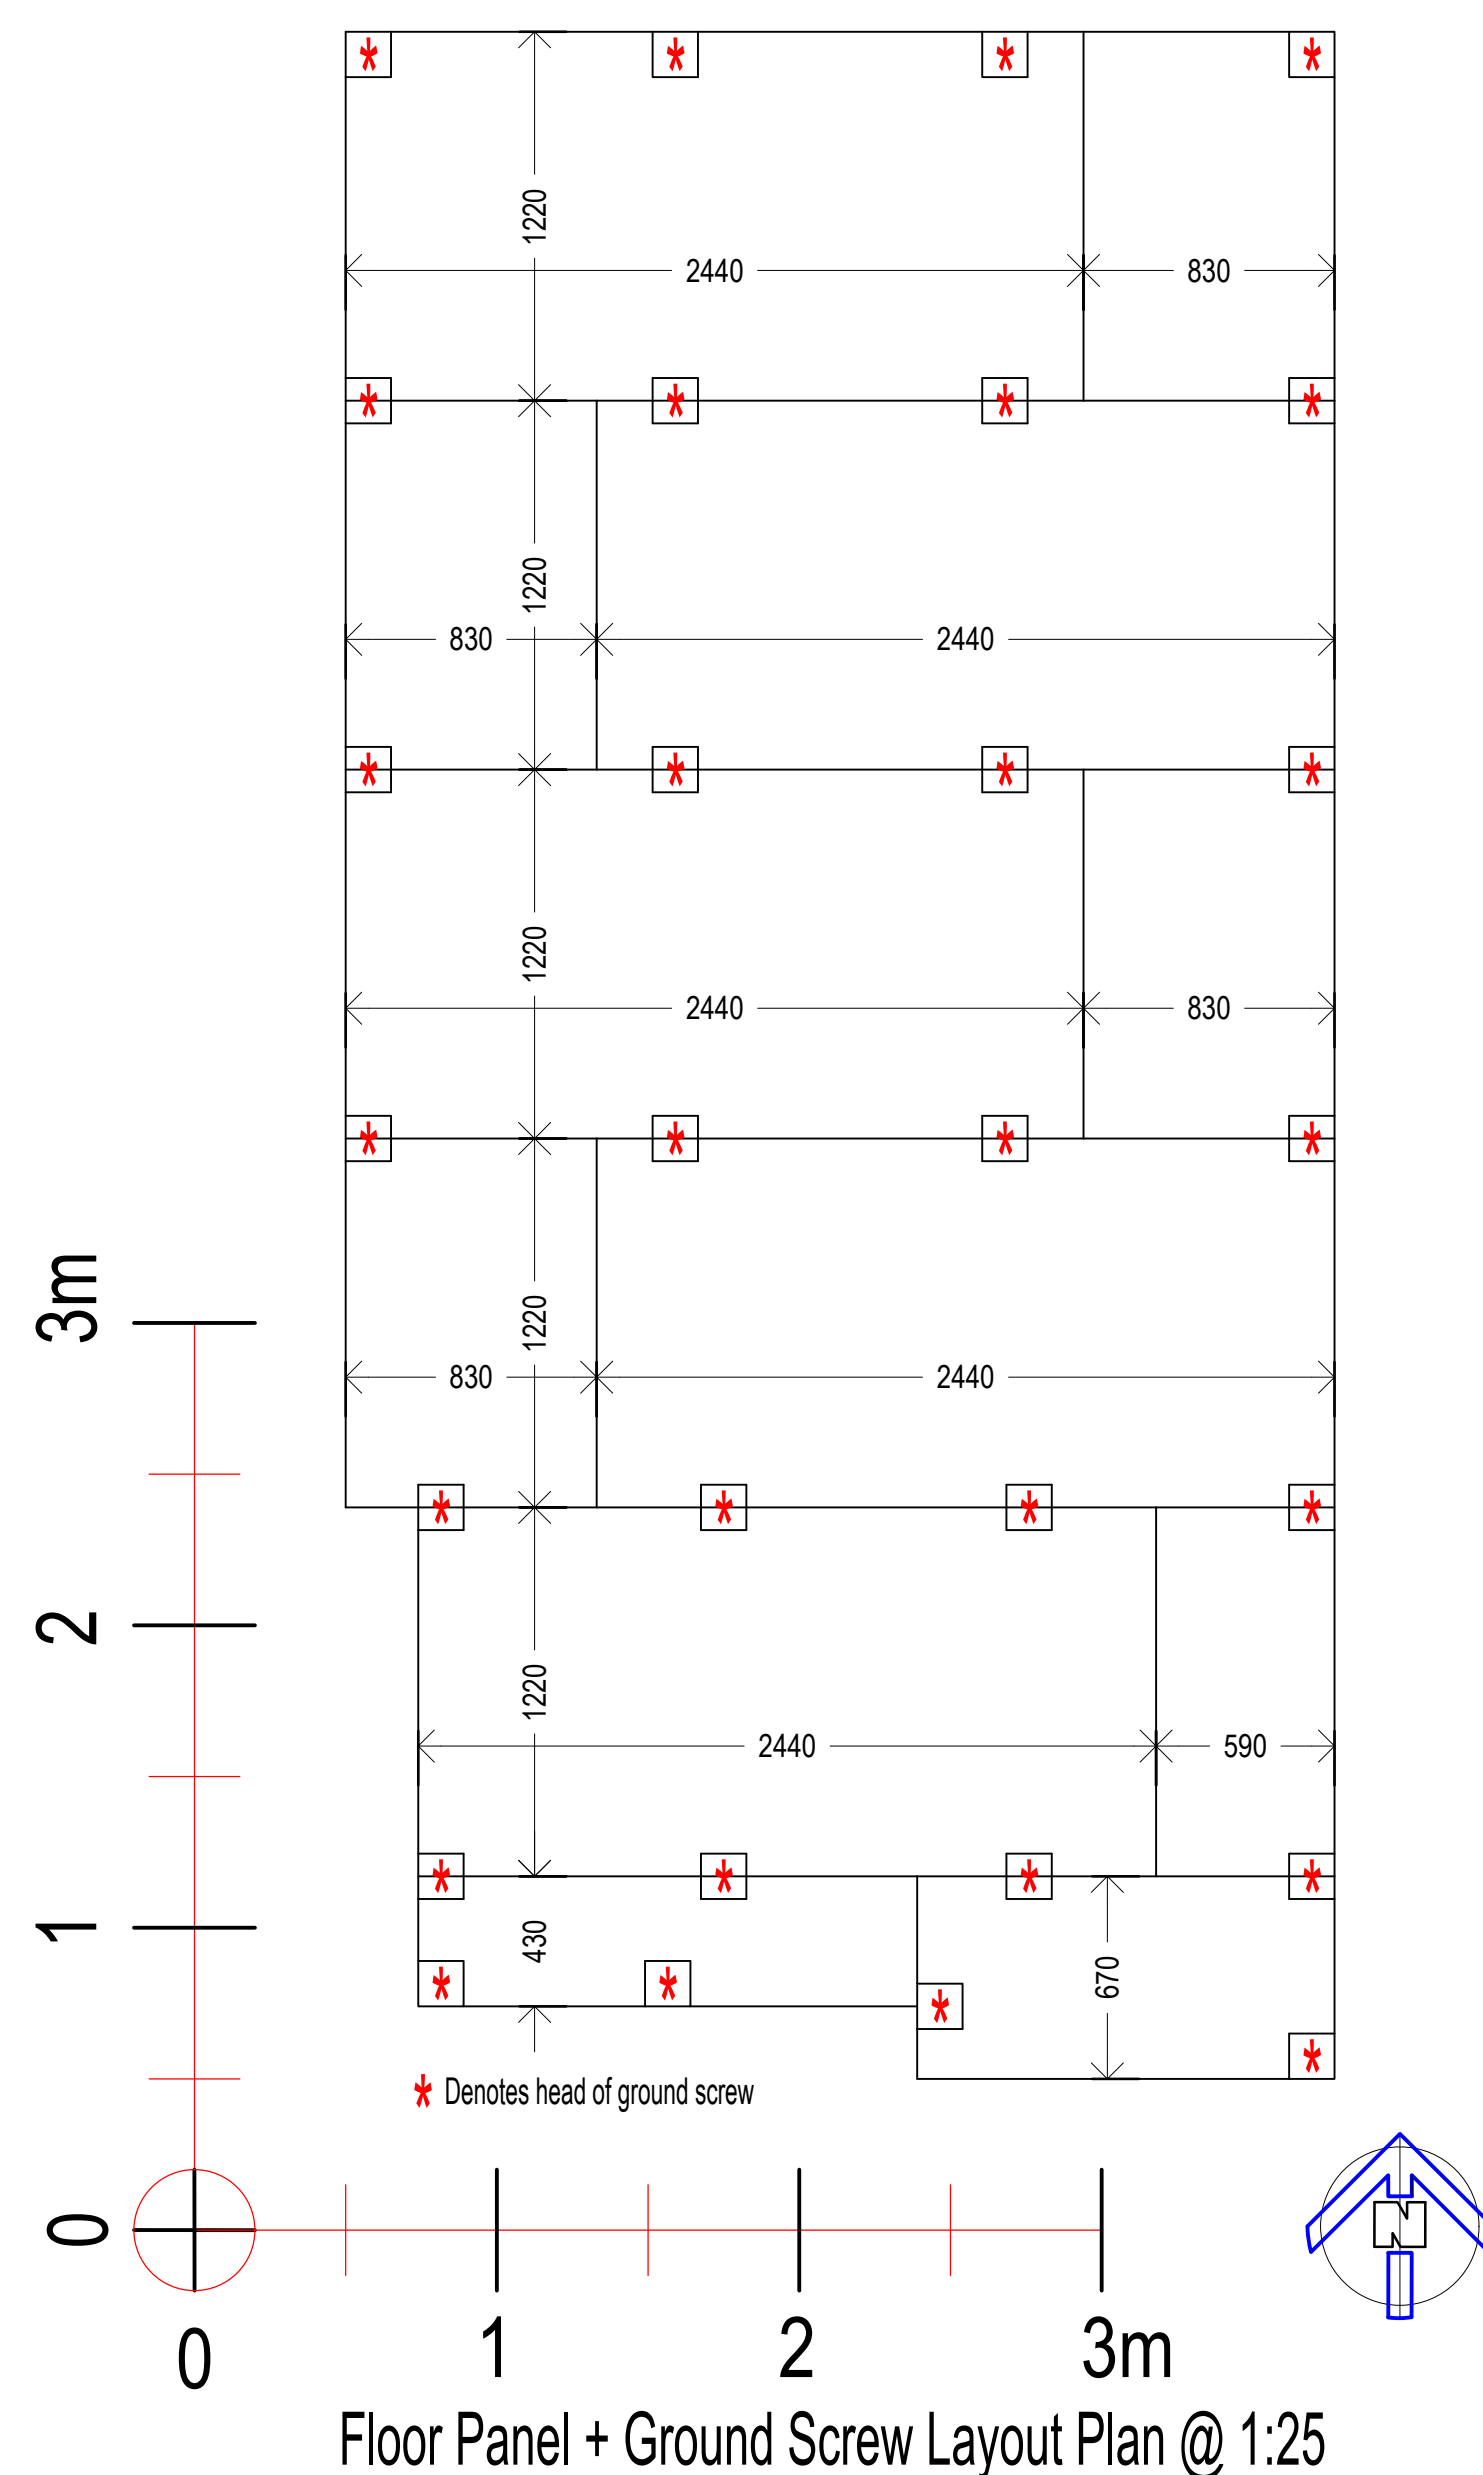


Ground Screw / Services Schematic Detail @ 1:2

To be installed in accordance with manufacturers written instructions



Ground Screws During Typical Installation

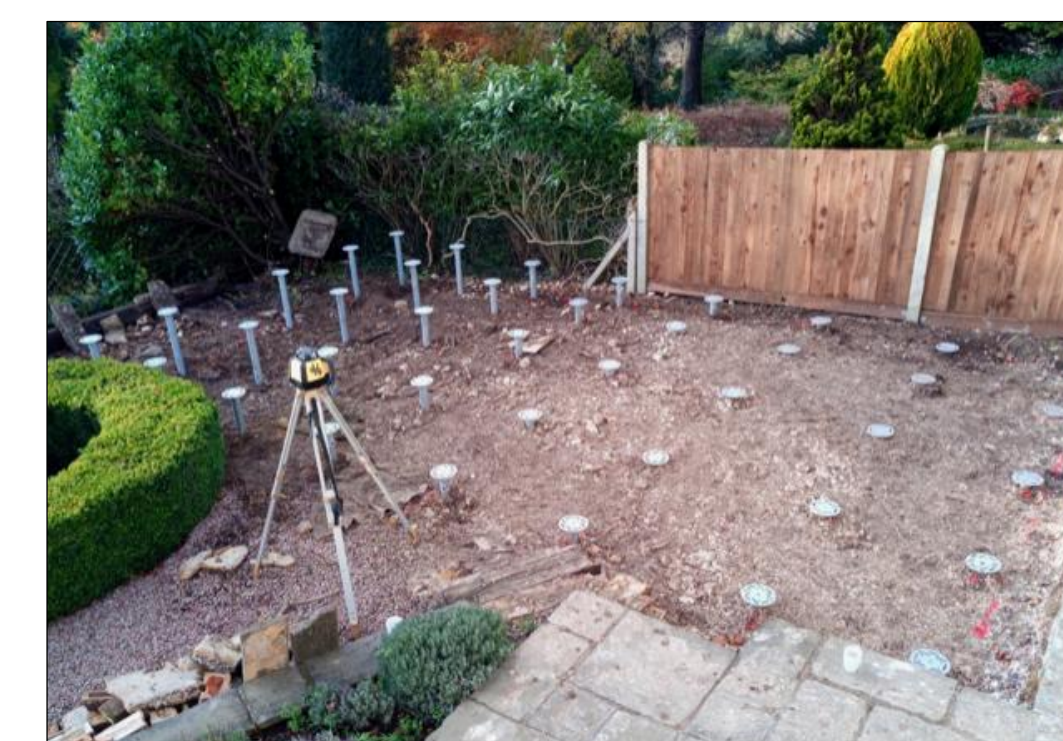

Typical Ground Screw Finished Installation