

London office

1B(c) Yukon Road
London
SW12 9PZ
Tel: 0203 475 2280

Manchester office

Suite 34 Europa House
Barcroft Street
Bury BL9 0TD
Tel: 0161 850 2280

22 Hurst Heath Road
London

8 February 2024

18256-NIA-01-RevA

Project Number
18256

Issued For
Stephen Bolster



EXECUTIVE SUMMARY

This noise impact assessment has been undertaken in order to assess a proposed plant installation for residential use at 22 Hurst Heath Road.

The proposed plant installation comprises a single Samsung DVM air source heat pump.

A background noise survey has been undertaken as detailed in the report, in order to determine an appropriate noise emission criterion, in accordance with the requirements of the London Borough of Camden.

Calculations were undertaken for the nearest identified receivers, identified as a window located behind the rear boundary wall and the rear first floor window of 24 Heath Hurst Road. It should be noted that if there are closer receivers that Clement Acoustics is not aware of, a reassessment will be necessary, and this should therefore be confirmed by the Client.

It has been demonstrated that compliance with the established criterion is feasible, dependent on the following material considerations:

- The plant could be in use at any time over a 24 hour period
- The noise emissions data for the proposed units as obtained from available manufacturer information
- Plant and receiver locations are as established in this report and marked on the attached site plan
- Mitigation is applied as recommended in this report, in the form of a louvred enclosure

If there is any deviation from the above, Clement Acoustics must be informed, in order to establish whether a reassessment is necessary.

Clement Acoustics has used all reasonable skill and professional judgement when preparing this report. The report relies on the information as provided to us at the time of writing and the assumptions as made in our assessment.




This report is designed to be suitable to discharge typical plant noise planning conditions, as per our original scope of work. The report should not be relied upon for further reasons, such as the detailed design of mitigation measures.

CONTENTS

1.0	INTRODUCTION	2
2.0	SITE DESCRIPTION	2
3.0	ENVIRONMENTAL NOISE SURVEY	3
3.1	UNATTENDED NOISE SURVEY PROCEDURE	3
3.2	WEATHER CONDITIONS	3
3.3	EQUIPMENT	4
4.0	RESULTS.....	4
4.1	UNATTENDED NOISE SURVEY RESULTS	4
5.0	NOISE CRITERIA	5
5.1	RELEVANT LOCAL POLICY	5
5.2	LOCAL AUTHORITY CRITERIA.....	5
6.0	PLANT NOISE IMPACT ASSESSMENT	6
6.1	PROPOSED INSTALLATION	6
6.2	PROPOSED MITIGATION MEASURES.....	7
6.3	NOISE IMPACT ASSESSMENT.....	7
6.4	BRITISH STANDARD REQUIREMENTS.....	7
7.0	CONCLUSION.....	8

LIST OF ATTACHMENTS

18256-SP1	Indicative Site Plan
18256-TH1	Environmental Noise Time History
Appendix A	Glossary of Acoustic Terminology
Appendix B	Acoustic Calculations

Issue	Date of Issue	Author	Reviewed	Authorised
RevA	08/02/2024			
		Daniel Ladega Technical Assistant MPhys (Hons)	Duncan Martin Director BSc (Hons) MIOA	Duncan Martin Director BSc (Hons) MIOA

Issue	Comment
0	First Issue
RevA	Change in no. of plant units and plant model

1.0 INTRODUCTION

Clement Acoustics has been commissioned by Stephen Bolster to measure existing background noise levels at 22 Hurst Heath Road. Measured noise levels have been used to determine noise emissions criteria for a proposed plant installation in agreement with the planning requirements of the London Borough of Camden.

This report presents the results of the environmental survey followed by noise impact calculations and outlines any necessary mitigation measures.

An acoustic terminology glossary is provided in Appendix A.

2.0 SITE DESCRIPTION

The site is located on a residential street Heath Hurst Road which runs off South End Road, a mixed use area populated by a parade of shops, residential units and Hampstead Heath Overground Station. The railway line runs east to west, approx. 50 m to the south of the site.

Current proposals are to install a single external air source heat pump at the far end of the rear garden.

The window located behind the rear boundary wall and the rear first floor window of 24 Heath Hurst Road have been identified as the nearest affected receivers. These nearest noise sensitive receivers were identified through observations on-site. If there are any receivers closer to that identified within this report then a further assessment will need to be carried out. Therefore, the closest noise sensitive receiver should be confirmed by the client before the plant is installed or any noise mitigation measures are implemented.

Locations are shown in attached site plan 18256-SP1.

3.0 ENVIRONMENTAL NOISE SURVEY

3.1 Unattended Noise Survey Procedure

Measurements were undertaken at one position as shown on indicative site drawing 18256-SP1. The choice of this position was based both on accessibility and on collecting representative noise data in relation to the nearest affected receiver.

The microphone was mounted on a rear first floor window at the rear of the building. The microphone was positioned 1 m in front of the window.

The position was not considered to be free-field according to guidance found in BS 4142: 2014, and a correction for reflections has therefore been applied. Based on the presence of the reflective surface and the nature of surrounding noise sources, a correction for reflections of 3 dB has been applied, in line with the recommendations of the standard.

Continuous automated monitoring was undertaken for the duration of the survey between 16:30 on 21st March 2023 and 16:15 on 23rd March 2023.

The measurement procedure generally complied with BS 7445: 1991: 'Description and measurement of environmental noise, Part 2- Acquisition of data pertinent to land use'.

The locations of the measurement positions are shown on attached site plan 18256-SP1.

3.2 Weather Conditions

Weather conditions were observed and noted during the set-up and collection of the monitoring equipment.

Wind speeds and temperatures were measured using a digital anemometer and thermometer, while other weather elements were determined through subjective observations.

The noted weather conditions are summarised in Table 3.1.

Position No.	Wind Speed	Wind Direction	Temperature	Cloud Cover	Comments
Meter Set-Up 21 March 2023					
1	< 5 m/s	SW	14 °c	60 %	None
Meter Collection 23 March 2023					
1	< 5 m/s	SW	12 °c	100 %	Mild

Table 3.1 Noted weather conditions during surveys

It is understood that the weather conditions during the unattended survey were generally dry in general.

It is considered that the weather conditions were suitable for the measurement of environmental noise.

3.3 Equipment

The equipment calibration was verified, by means of a field verification check, before and after use and no abnormalities were observed.

The equipment used was as follows.

- 1 No. Svantek Type 971 Class 1 Sound Level Meter
- Rion Type NC-74 Class 1 Calibrator

4.0 RESULTS

4.1 Unattended Noise Survey Results

The $L_{Aeq: 5min}$, $L_{Amax: 5min}$, $L_{A10: 5min}$ and $L_{A90: 5min}$ acoustic parameters were measured at the location shown in site drawing 18256-SP1.

Measured noise levels are shown as a time history in Figure 18256-TH1, with average ambient and typical background noise levels summarised in Table 4.1.

Position	Time Period	Average ambient noise level	Typical background noise level
		$L_{Aeq: T}$, dB	$L_{A90: 5min}$, dB
1	Daytime (07:00 - 23:00)	47	39
	Night-time (23:00 - 07:00)	43	34

Table 4.1 Average ambient and typical background noise levels

5.0 NOISE CRITERIA

5.1 Relevant Local Policy

The assessment and recommendations in this report have been undertaken in accordance with Policy D14 of the London Plan 2021, which contains the following relevant sections:

“D14. In order to reduce, manage and mitigate noise to improve health and quality of life, residential and other non-aviation development proposals should manage noise by:

5) mitigating and minimising the existing and potential adverse impacts of noise on, from, within, as a result of, or in the vicinity of new development without placing unreasonable restrictions on existing noise-generating uses”.

5.2 Local Authority Criteria

The Camden London Borough Council general criteria for noise emissions, as stated in the ‘Camden Local Plan (2017)’ are as follows:

“Where appropriate and within the scope of the document it is expected that British Standard 4142:2014 ‘Methods for rating and assessing industrial and commercial sound’ (BS 4142) will be used. For such cases a ‘Rating Level’ of 10 dB below background (15dB if tonal components are present) should be considered as the design criterion).”

It is understood that the proposed plant units will be for residential use and could therefore be operational at all times.

The proposed plant is not expected to present any tonal element therefore a rating level of 10dB below background is considered appropriate.

Based on the results of the environmental noise survey and requirements of the London Borough of Camden, Table 5.1 presents the proposed plant noise emission criteria to be achieved at 1 m from the nearest noise sensitive receiver:

Period	Plant Noise Emission Limit $L_{Aeq,T}$, dB
Daytime (07:00 - 23:00)	29
Night-time (23:00 - 07:00)	24

Table 5.1 Plant noise emission limits

6.0 PLANT NOISE IMPACT ASSESSMENT

6.1 Proposed Installation

The proposed plant installation comprises a Samsung DVM AM100-KXMDGH condenser unit.

Noise emissions for the proposed plant units, as provided by the manufacturer, are shown in Table 6.1. Loudest modes of operation have been used in order to present a robust worst-case assessment.

Unit	Sound Pressure Level (at 1 m, dB) in each Frequency Band, Hz								
	63	125	250	500	1k	2k	4k	8k	dB(A)
Samsung DVM AM100-KXMDGH	64	65	57	54	52	49	47	37	58

Table 6.1 Manufacturer provided noise emissions levels

British Standard 4142: 2014 +A1 2019 'Methods for rating and assessing industrial and commercial sound' provides guideline penalties that can be applied to noise emissions to account for tonality, impulsivity and intermittency. Where a sound source is neither tonal nor impulsive, but is still distinctive against the residual acoustic environment, a penalty may still be applied.

The available penalties for different characteristics are summarised in Table 6.2.

Characteristic	Comments	Maximum Penalty
Tonality	Can be converted to 2 dB for a tone which is just perceptible, 4 dB where it is clearly perceptible and 6 dB where it is highly perceptible	+6 dB
Impulsivity	Can be converted to 3 dB for impulsivity which is just perceptible, 6 dB where it is clearly perceptible and 9 dB where it is highly perceptible	+9 dB
Intermittency	When the sound has identifiable on/off conditions	+3 dB
Distinctiveness	Intended for sources that are neither tonal nor impulsive, but distinctive against background noise sources	+3 dB

Table 6.2 Available penalties according to BS 4142: 2014

The proposed plant units will be generally broadband and continuous in nature and therefore no penalty has been applied.

The proposed plant location is at the back of the rear garden, which is shown on indicative site plan 18256-SP1.

6.2 Proposed Mitigation Measures

In order to meet the proposed criteria stated in Section 5.0, it is recommended that an enclosure is installed around the plant. The enclosure should provide sufficient attenuation to achieve a maximum sound pressure level of 49 dB(A) when measured at 1 m in all directions.

Based on the information provided, an enclosure meeting the sound reduction indices as stated in Table 6.3 should be suitable to achieve this.

Mitigation	Required Attenuation (dB) in each Frequency Band, Hz							
	63	125	250	500	1k	2k	4k	8k
Louvred Enclosure	6	6	8	10	14	18	16	15

Table 6.3 Required attenuation from mitigation

6.3 Noise Impact Assessment

The closest receivers have been identified as the windows on the rear facades of a property to the north of the garden and the neighbouring property at 24 Heath Hurst Road, which are respectively 21 m and 13 m away from the proposed plant location.

Screening of the window located to the north is provided by the rear boundary wall and screening for the first floor window at 24 Heath Hurst Road is provided by a boundary wall and foliage between the two properties.

Taking into account all necessary acoustic corrections, the resulting noise level at the identified residential windows would be as shown in Table 6.4. Detailed calculations are shown in Appendix B.

Receiver	Design Criterion	Noise Level at Receiver (due to proposed plant)
Receiver 1 - Property Located to the North	24 dB(A)	14 dB(A)
Receiver 2 - 24 Heath Hurst Road		23 dB(A)

Table 6.4 Noise levels and project criterion at noise sensitive receivers

As presented in Table 6.4 and Appendix B, the proposed plant installation with acoustic enclosure would be expected to meet the requirements of the proposed criteria.

6.4 British Standard Requirements

Further calculations have been undertaken to assess whether the noise emissions from the proposed plant unit would be expected to meet recognised British Standard recommendations, in order to further ensure the amenity of nearby noise sensitive receivers.

British Standard 8233: 2014 ‘Guidance on sound insulation and noise reduction for buildings’ gives recommendations for acceptable internal noise levels in residential properties. Assuming worst case conditions, of the closest window being for a bedroom, BS 8233: 2014 recommends 30 dB(A) as being acceptable internal sleeping conditions during night-time.

With loudest external levels of 24 dB(A), acceptable internal conditions would be met without taking the attenuation of the window itself into consideration. According to BS 8233: 2014, a typical building facade with a partially open window offers 15 dB attenuation.

It can therefore be predicted that, in addition to meeting the requirements of the set criteria, the emissions from the proposed plant would be expected to meet the most stringent recommendations of the relevant British Standard, with neighbouring windows partially open. Predicted levels are shown in Table 6.5.

Receiver	Recommended Target – For sleeping conditions in a bedroom, in BS 8233: 2014	Noise Level at Receiver (due to plant installation)
Inside Residential Window of Property Located to the North	30 dB(A)	N/A
Inside Residential Window of 24 Heath Hurst Road		8 dB(A)


Table 6.5 Noise levels and BS 8233: 2014 criteria inside nearest residential space

7.0 CONCLUSION

An environmental noise survey has been undertaken at 22 Hurst Heath Road. The results of the survey have enabled criteria to be set for noise emissions from the proposed plant in accordance with the requirements of the London Borough of Camden.

A noise impact assessment has then been undertaken using manufacturer noise data to predict the noise levels, due to the proposed plant, at the nearby noise sensitive receivers.

Calculations show that noise emissions from the proposed units should meet the requirements of the London Borough of Camden with the recommended mitigation installed as stated herein.





Not to scale

Description:

Indicative site plan showing noise monitoring position and nearest sensitive receiver

Date	08 February 2024
Reference	18256-SP1
Project Name	22 Heath Hurst Road, London
Image ©	Google Earth


Key:

	Unattended Noise Survey Position
	Noise Sensitive Receivers

22 Heath Hurst Road, London

Position 1

Environmental Noise Time History
21 March 2023 to 23 March 2023

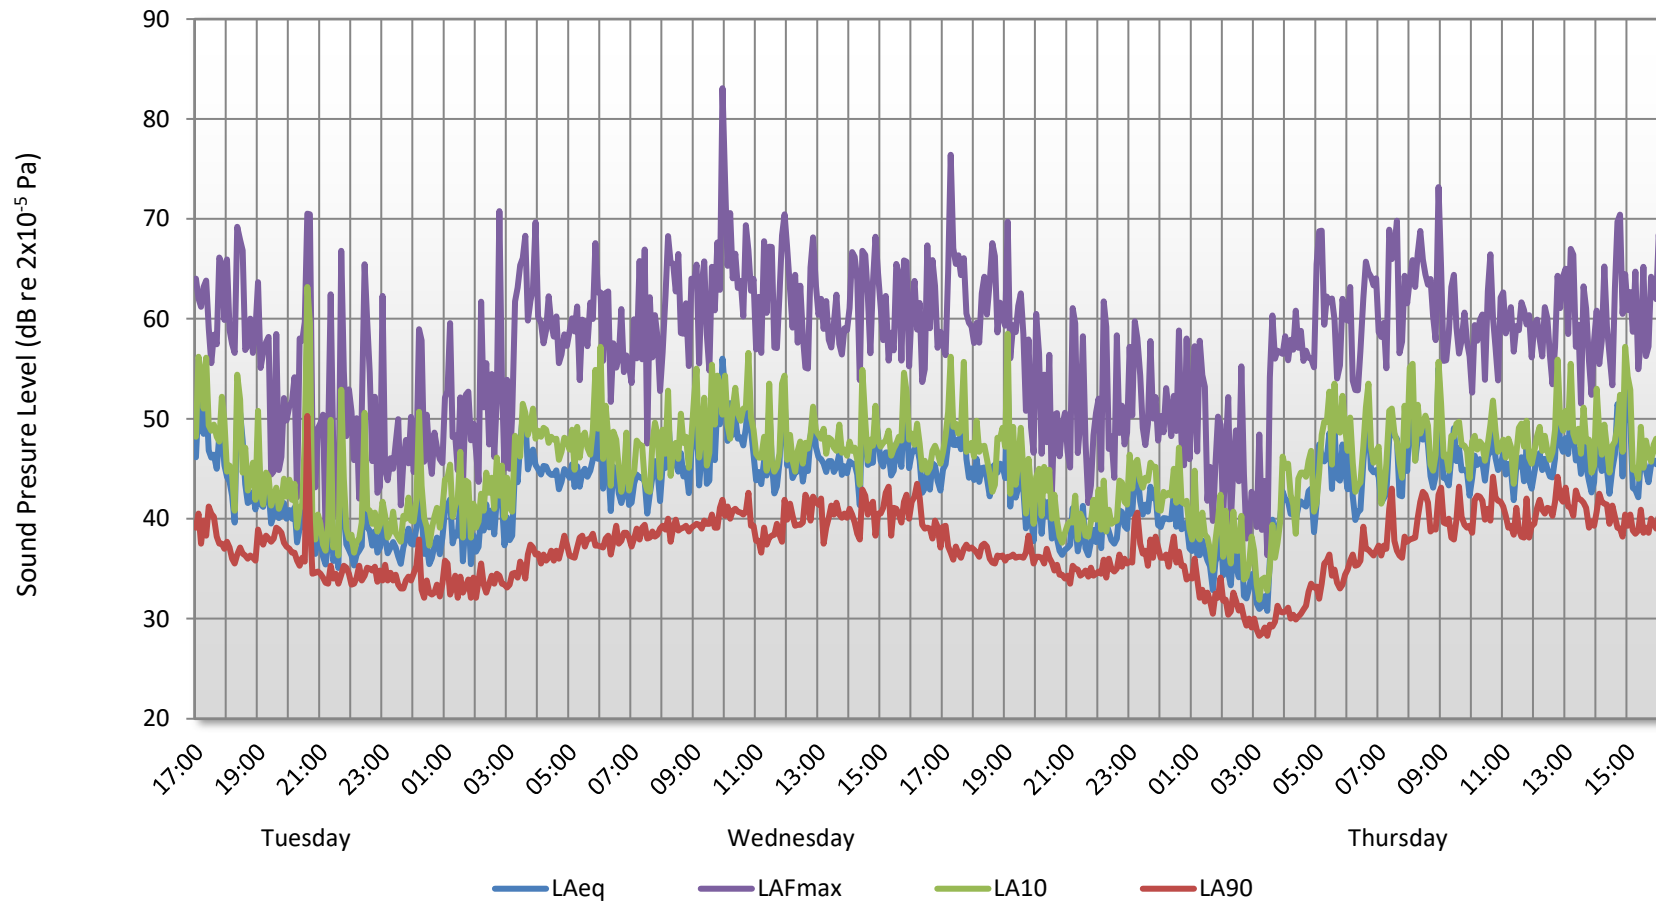

GLOSSARY OF ACOUSTIC TERMINOLOGY

dB(A)

The human ear is less sensitive to low (below 125Hz) and high (above 16kHz) frequency sounds. A sound level meter duplicates the ear's variable sensitivity to sound of different frequencies. This is achieved by building a filter into the instrument with a similar frequency response to that of the ear. This is called an A-weighting filter. Measurements of sound made with this filter are called A-weighted sound level measurements and the unit is dB(A).

L_{eq}

The sound from noise sources often fluctuates widely during a given period of time. An average value can be measured, the equivalent sound pressure level L_{eq}. The L_{eq} is the equivalent sound level which would deliver the same sound energy as the actual fluctuating sound measured in the same time period.

L₁₀

This is the level exceeded for not more than 10% of the time. This parameter is often used as a "not to exceed" criterion for noise

L₉₀

This is the level exceeded for not more than 90% of the time. This parameter is often used as a descriptor of "background noise" for environmental impact studies.

L_{max}

This is the maximum sound pressure level that has been measured over a period.

Octave Bands

In order to completely determine the composition of a sound it is necessary to determine the sound level at each frequency individually. Usually, values are stated in octave bands. The audible frequency region is divided into 10 such octave bands whose centre frequencies are defined in accordance with international standards.

Addition of noise from several sources

Noise from different sound sources combines to produce a sound level higher than that from any individual source. Two equally intense sound sources operating together produce a sound level which is 3dB higher than one alone and 10 sources produce a 10 dB higher sound level.

Attenuation by distance

Sound which propagates from a point source in free air attenuates by 6dB for each doubling of distance from the noise source. Sound energy from line sources (e.g. stream of cars) drops off by 3 dB for each doubling of distance.

Subjective impression of noise

Sound intensity is not perceived directly at the ear; rather it is transferred by the complex hearing mechanism to the brain where acoustic sensations can be interpreted as loudness. This makes hearing perception highly individualised. Sensitivity to noise also depends on frequency content, time of occurrence, duration of sound and psychological factors such as emotion and expectations. The following table is a reasonable guide to help explain increases or decreases in sound levels for many acoustic scenarios.

Change in sound level (dB)	Change in perceived loudness
1	Imperceptible
3	Just barely perceptible
6	Clearly noticeable
10	About twice as loud
20	About 4 times as loud

Barriers

Outdoor barriers can be used to reduce environmental noises, such as traffic noise. The effectiveness of barriers is dependent on factors such as its distance from the noise source and the receiver, its height and its construction.

Reverberation control

When sound falls on the surfaces of a room, part of its energy is absorbed and part is reflected back into the room. The amount of reflected sound defines the reverberation of a room, a characteristic that is critical for spaces of different uses as it can affect the quality of audio signals such as speech or music. Excess reverberation in a room can be controlled by the effective use of sound-absorbing treatment on the surfaces, such as fibrous ceiling boards, curtains and carpets.

Acoustic Calculations

18256

22 Heath Hurst Road, London

EXTERNAL PLANT NOISE EMISSIONS CALCULATION

Receiver: Window located behind rear boundary wall (exact address unknown)

Source: Proposed plant installation

Description	Frequency, Hz								dB(A)
	63	125	250	500	1k	2k	4k	8k	
Manufacturer provided sound pressure level at 1 metre									
Samsung DVM AM100-KXMDGH	64	65	57	54	52	49	47	37	58
Correction for reflections, dB	3	3	3	3	3	3	3	3	3
Attenuation provided by existing boundary wall, dB	-7	-9	-11	-13	-16	-19	-22	-25	
Distance correction to receiver, dB (21 m) *	-26	-26	-26	-26	-26	-26	-26	-26	
Mitigation from acoustic louvre	-6	-6	-8	-10	-14	-18	-16	-15	
Sound pressure level at receiver	28	28	16	8	-1	-11	-14	-26	14

* Distance loss calculated assuming Point Source attenuation (typically used where distance is more than 3x the largest source dimension)

Design Criterion

24

BS 8233 ASSESSMENT CALCULATION

Receiver: Inside Nearest Residential Window

Source: Proposed plant installation

Description	Frequency, Hz								dB(A)
	63	125	250	500	1k	2k	4k	8k	
Sound pressure level outside window	28	28	16	8	-1	-11	-14	-26	14
Minimum attenuation from partially open window, dB	-15	-15	-15	-15	-15	-15	-15	-15	
Sound pressure level inside nearest noise sensitive premises	13	13	1	-7	-16	-26	-29	-41	-1

Design Criterion

30

18256

22 Heath Hurst Road, London

EXTERNAL PLANT NOISE EMISSIONS CALCULATION

Receiver: Rear 1F Window of 24 Heath Hurst Road

Source: Proposed plant installation

Description	Frequency, Hz								dB(A)
	63	125	250	500	1k	2k	4k	8k	
Manufacturer provided sound pressure level at 1 metre									
Samsung DVM AM100-KXMDGH	64	65	57	54	52	49	47	37	58
Correction for reflections, dB	3	3	3	3	3	3	3	3	3
Attenuation provided by existing boundary wall, dB	-5	-5	-6	-6	-7	-9	-11	-14	
Distance correction to receiver, dB (13 m) *	-22	-22	-22	-22	-22	-22	-22	-22	
Mitigation from acoustic louvre, dB	-6	-6	-8	-10	-14	-18	-16	-15	
Sound pressure level at receiver	34	35	25	19	12	4	1	-11	23

* Distance loss calculated assuming Point Source attenuation (typically used where distance is more than 3x the largest source dimension)

Design Criterion

24