

Report VA5153.241210.NIA1.2

35 Templewood Avenue, Hampstead

Noise Impact Assessment

10 December 2024

RS MEP Design Ltd

01962 461016

0203 8650332

mail@ventaacoustics.com

registered company no. 10139494

Contents

1.	Introduction	1
2.	Design Criterion and Assessment Methodology	1
2.1	Camden Council Requirements	1
2.2	BS8233:2014	2
3.	Site Description	2
4.	Environmental Noise Survey	3
4.1	Survey Procedure & Equipment	3
4.2	Results	3
4.3	Plant Noise Emission Limits	4
5.	Predicted Noise Impact	4
5.1	Proposed plant	4
5.2	Recommended Mitigation Measures	4
5.3	Predicted noise levels	5
5.4	Comparison to NR35 Curve	5
5.5	Comparison to BS8233:2014 Criteria	5
6.	Conclusion	5

Attachments

VA5153/SP1	Indicative Site Plan
VA5153/TH1-TH3	Environmental Noise Time Histories
Appendix A	Acoustic Terminology
Appendix B	Acoustic Calculations
Appendix C	Product Data Sheet

Report Version	Author	Approved	Changes	Date
NIA	Jamie Duncan	Ben Alexander	-	11/3/24
NIA1.1	Ben Alexander	Jamie Duncan	Condenser location updated	2/9/24
NIA1.2	Steven Liddell	Steven Liddell	Attached Data Sheets & Assessment to West Heath Public Space	10/12/24

The interpretations and conclusions summarised in this report represent Venta Acoustics’ best technical interpretation of the data available to us at the time of assessment. Any information provided by third parties and referred to in this report has not been checked or verified by Venta Acoustics, unless otherwise expressly stated in the document. Venta Acoustics cannot accept any liability for the correctness or validity of the information provided. Due to a degree of uncertainty inherent in the prediction of all parameters, we cannot, and do not guarantee the accuracy or correctness of any interpretation and we shall not, except in the case of gross or wilful negligence on our part, be liable for any loss, cost, damages or expenses incurred or sustained by anyone resulting from any interpretations, predictions of conclusions made by the company or employees. The findings and conclusions are relevant to the period of the site survey works, and should not be relied upon to represent site conditions at later dates. Where additional information becomes available which may affect the findings of our assessment, the author reserves the right to review the information, reassess the findings and modify the conclusions accordingly.

1. Introduction

It is proposed to replace the existing condensers at 35 Templewood Avenue, Hampstead, with three new plant units to provide heating and cooling.

Venta Acoustics has been commissioned by RS MEP Design Ltd to undertake an assessment of the potential noise impact of these proposals in support of an application for planning permission.

An environmental noise survey has been undertaken to determine the background noise levels at the most affected noise sensitive receptors. These levels are used to undertake an assessment of the likely impact with reference to the planning requirements of Camden Council.

2. Design Criterion and Assessment Methodology

2.1 Camden Council Requirements

Camden Council’s Local Plan (adopted June 2017), Appendix 3, provides the following guidance regarding noise from Industrial and Commercial Noise Sources

A relevant standard or guidance document should be referenced when determining values for LOAEL and SOAEL for non-anonymous noise. Where appropriate and within the scope of the document it is expected that British Standard 4142:2014 ‘Methods for rating and assessing industrial and commercial sound’ (BS 4142) will be used. For such cases a ‘Rating Level’ of 10 dB below background (15dB if tonal components are present) should be considered as the design criterion).

Existing Noise sensitive receiver	Assessment Location	Design Period	LOAEL (Green)	LOAEL to SOAEL (Amber)	SOAL (Red)
Dwellings**	Garden used for main amenity (free field) and Outside living or dining or bedroom window (façade)	Day	‘Rating level’ 10dB* below background	‘Rating level’ between 9dB below and 5dB above background	‘Rating level’ greater than 5dB above background
Dwellings**	Outside bedroom window (façade)	Night	‘Rating level’ 10dB* below background and no events exceeding 57dB _{L_{max}}	‘Rating level’ between 9dB below and 5dB above background or noise events between 57dB and 88dB L _{max}	‘Rating level’ greater than 5dB above background and/or events exceeding 88dB _{L_{max}}

**10dB should be increased to 15dB if the noise contains audible tonal elements. (day and night). However, if it can be demonstrated that there is no significant difference in the character of the residual background noise and the specific noise from the proposed development then this reduction may not be required.*

In addition, a frequency analysis (to include, the use of Noise Rating (NR) curves or other criteria curves) for the assessment of tonal or low frequency noise may be required.

***levels given are for dwellings, however, levels are use specific and different levels will apply dependent on the use of the premises.*

The periods in Table C correspond to 0700 hours to 2300 hours for the day and 2300 hours to 0700 hours for the night. The Council will take into account the likely times of occupation for types of development and will be amended according to the times of operation of the establishment under consideration.

There are certain smaller pieces of equipment on commercial premises, such as extract ventilation, air conditioning units and condensers, where achievement of the rating levels (ordinarily determined by a BS:4142 assessment) may not afford the necessary protection. In these cases, the Council will generally also require a NR curve specification of NR35 or below, dependant on the room (based upon measured or predicted $L_{eq,5mins}$ noise levels in octave bands) 1 metre from the façade of affected premises, where the noise sensitive premise is located in a quiet background area.

2.2 BS8233:2014

BS8233 *Guidance on sound insulation and noise reduction for buildings* provides guidance as to suitable internal noise levels for different areas within residential buildings.

The relevant section of the standard is shown below in Table 2.1.

Activity	Location	07:00 to 23:00	23:00 to 07:00
Resting	Living Room	35 dB $L_{Aeq, 16 \text{ hour}}$	-
Dining	Dining Room	40 dB $L_{Aeq, 16 \text{ hour}}$	-
Sleeping (daytime resting)	Bedroom	35 dB $L_{Aeq, 16 \text{ hour}}$	30 dB $L_{Aeq, 8 \text{ hour}}$

Table 2.1 - Excerpt from BS8233: 2014

[dB ref. 20µPa]

3. Site Description

As illustrated on attached site plan VA5153/SP1, the building is located in a residential area, with houses to the west and south.

The existing condenser units are located on the west boundary of the site, in close proximity to the neighbours at 9 West Heath Road. The proposal is to locate the new plant at a greater distance from the neighbours, substantially reducing the impact on them.

The most affected noise sensitive receiver is expected to remain the house to the west, at 9 West Heath Road, albeit with a dramatically reduced impact.

Across West Heath Road, to the north, is the West Heath public space.

4. Environmental Noise Survey

4.1 Survey Procedure & Equipment

In order to establish the existing background noise levels at the site, a noise survey was carried out between Tuesday 27th February and Friday 1st March 2024 at the location shown in site plan VA5153/SP1. This location was chosen to be representative of the background noise level at the most affected noise sensitive receivers.

Continuous 5-minute samples of the L_{Aeq} , L_{Amax} , L_{A10} and L_{A90} sound pressure levels were undertaken at the measurement location.

The weather during the survey period was generally dry with light winds. The background noise data is not considered to have been compromised by these conditions.

Measurements were made generally in accordance with ISO 1996 2:2017 *Acoustics - Description, measurement and assessment of environmental noise – Part 2: Determination of sound pressure levels*.

The following equipment was used in the course of the survey:

Manufacturer	Model Type	Serial No	Calibration	
			Certificate No.	Date
Svantek Class 1 Integrating SLM	958A	59177	UCRT23/1144	31/1/23
Larson Davis calibrator	CAL200	19816	1506037-1	28/7/23

Table 4.1 – Equipment used for the tests

The calibration of the sound level meter was verified before and after use with no significant calibration drift observed.

4.2 Results

The measured sound levels are shown as time-history plots on the attached charts VA5153/TH1-3.

The background noise level is determined by road traffic in the surrounding area, with a contribution from plant.

The typical background noise levels measured were:

Monitoring Period	Typical ¹ L _{A90,5min}
07:00 – 23:00 hours	46 dB
23:00 – 07:00 hours	46 dB

Table 4.2 – Typical background noise levels [dB ref. 20 µPa]

¹The typical L_{A90} value is taken as the 10th percentile of all L_{A90} values measured during the relevant period.

4.3 Plant Noise Emission Limits

On the basis of the measured noise levels and the planning requirements of the Local Authority, and considering that it is not expected that tonal noise will be generated by the proposed plant units, the following plant specific sound levels should not be exceeded at the most affected noise sensitive receivers:

Monitoring Period	Design Criterion (L _{Aeq})
07:00 – 23:00 hours	36 dB
23:00 – 07:00 hours	36 dB

Table 4.3 – Specific sound pressure levels not to be exceeded at most affected noise sensitive receivers

5. Predicted Noise Impact

5.1 Proposed plant

The following plant is proposed for installation within a sunken plant area recessed below ground level, at the location indicated on site plan VA5153/SP1.

Plant Item	Quantity	Proposed Model	Notes
Condensers	2	Daikin REYQ16U	To be located at a greater distance from neighbours than the current installation
Condenser	1	Daikin REYQ14U	

Table 5.1 – Indicative plant selections assumed for this assessment.

Consulting the manufacturer’s datasheets, the following noise emissions levels are attributed to the proposed plant items:

Plant Item	Octave Band Centre Frequency (Hz)								dB(A)
	Sound Pressure Level, L _p @1m (dB)								
	63	125	250	500	1k	2k	4k	8k	
Daikin REYQ14U	62	63	60	60	53	49	49	47	60
Daikin REYQ16U	67	69	64	62	55	52	52	43	63

Table 5.2 – Advised plant noise data used for the assessment.

5.2 Recommended Mitigation Measures

It is not anticipated that any further mitigation measures, beyond the inherent built form of the site and surroundings, will be required for the control of plant noise emissions to nearby receivers.

5.3 Predicted noise levels

The cumulative noise level at the most affected noise sensitive receiver, at least 30 meters away from the nearest condenser, has been calculated on the basis of the above information and assuming the recommended mitigation measures, with reference to the guidelines set out in ISO 9613-2:1996 *Attenuation of sound during propagation outdoors - Part 2: General method of calculation*.

A summary of the calculations is shown in Appendix B.

Description	dB(A)
Plant noise criterion	36
L _p 1m from receiver	36

Table 5.3 – Predicted noise and level and design criteria at noise sensitive location

While not formally a planning consideration, the impact on the West Heath public grounds has been considered, with a sound level of 35db predicted. This is a low level that is unlikely to be audible within the heath.

5.4 Comparison to NR35 Curve

As can be seen from the following comparison in Table 5.4, the predicted noise levels at 1m from the most affected receiver are comfortably below the NR35 curve.

Frequency (Hz)	63	125	250	500	1k	2k	4k	8k
NR35	63	52	45	39	35	35	30	28
L _p 1m from receiver	39	41	36	35	28	25	25	18

Table 5.4 – Comparison of predicted noise levels against the NR35 criterion

5.5 Comparison to BS8233:2014 Criteria

BS8233 assumes a loss of approximately 15dB for a partially open window. The external noise level shown in Table 5.3 would result in internal noise levels that achieve the guidelines shown in Table 2.1.

6. Conclusion

A baseline noise survey has been undertaken by Venta Acoustics to establish the background noise climate in the locality of 35 Templewood Avenue, Hampstead in support of a planning application for the proposed relocation of new building services plant that will provide heating and cooling to the property.


The new units would be at a greater distance from the neighbouring properties, reducing the risk of a noise impact.

Noise emission limits to be set at the most affected noise sensitive receiver such that the proposed installation meets the requirements of Camden Council. The cumulative noise emission levels from the proposed plant have been assessed to be compliant with the plant noise emission limits.

Additionally, the impact on West Heath has been considered indicating a low impact on the public space.

The proposed scheme is expected to reduce the overall impact relative to the existing situation and is not expected to have an adverse noise impact. The relevant plant noise requirements have been shown to be met.


Steven Liddell MIOA

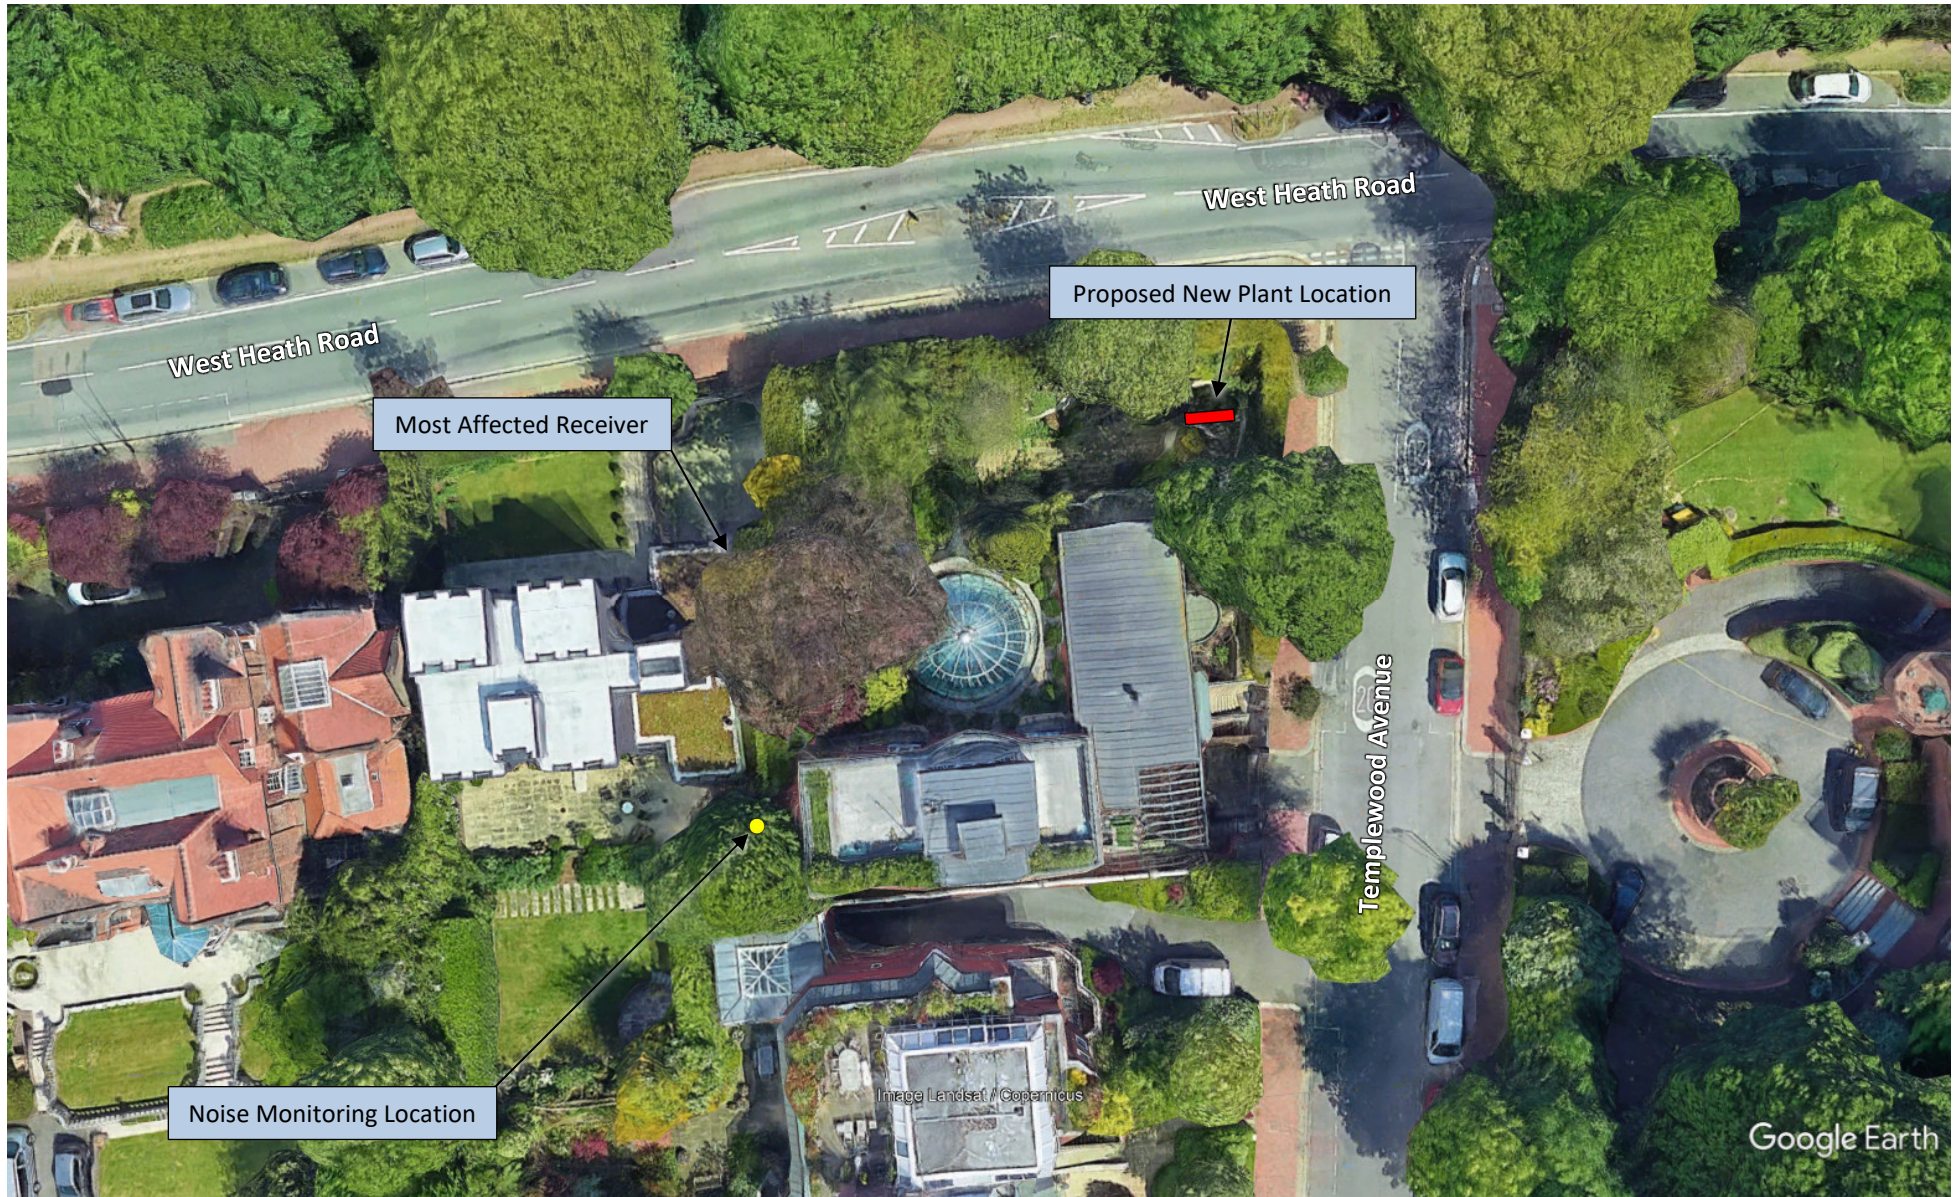

35 Templewood Avenue, Hampstead
Environmental Noise Time History: 1




Figure VA5153/TH1

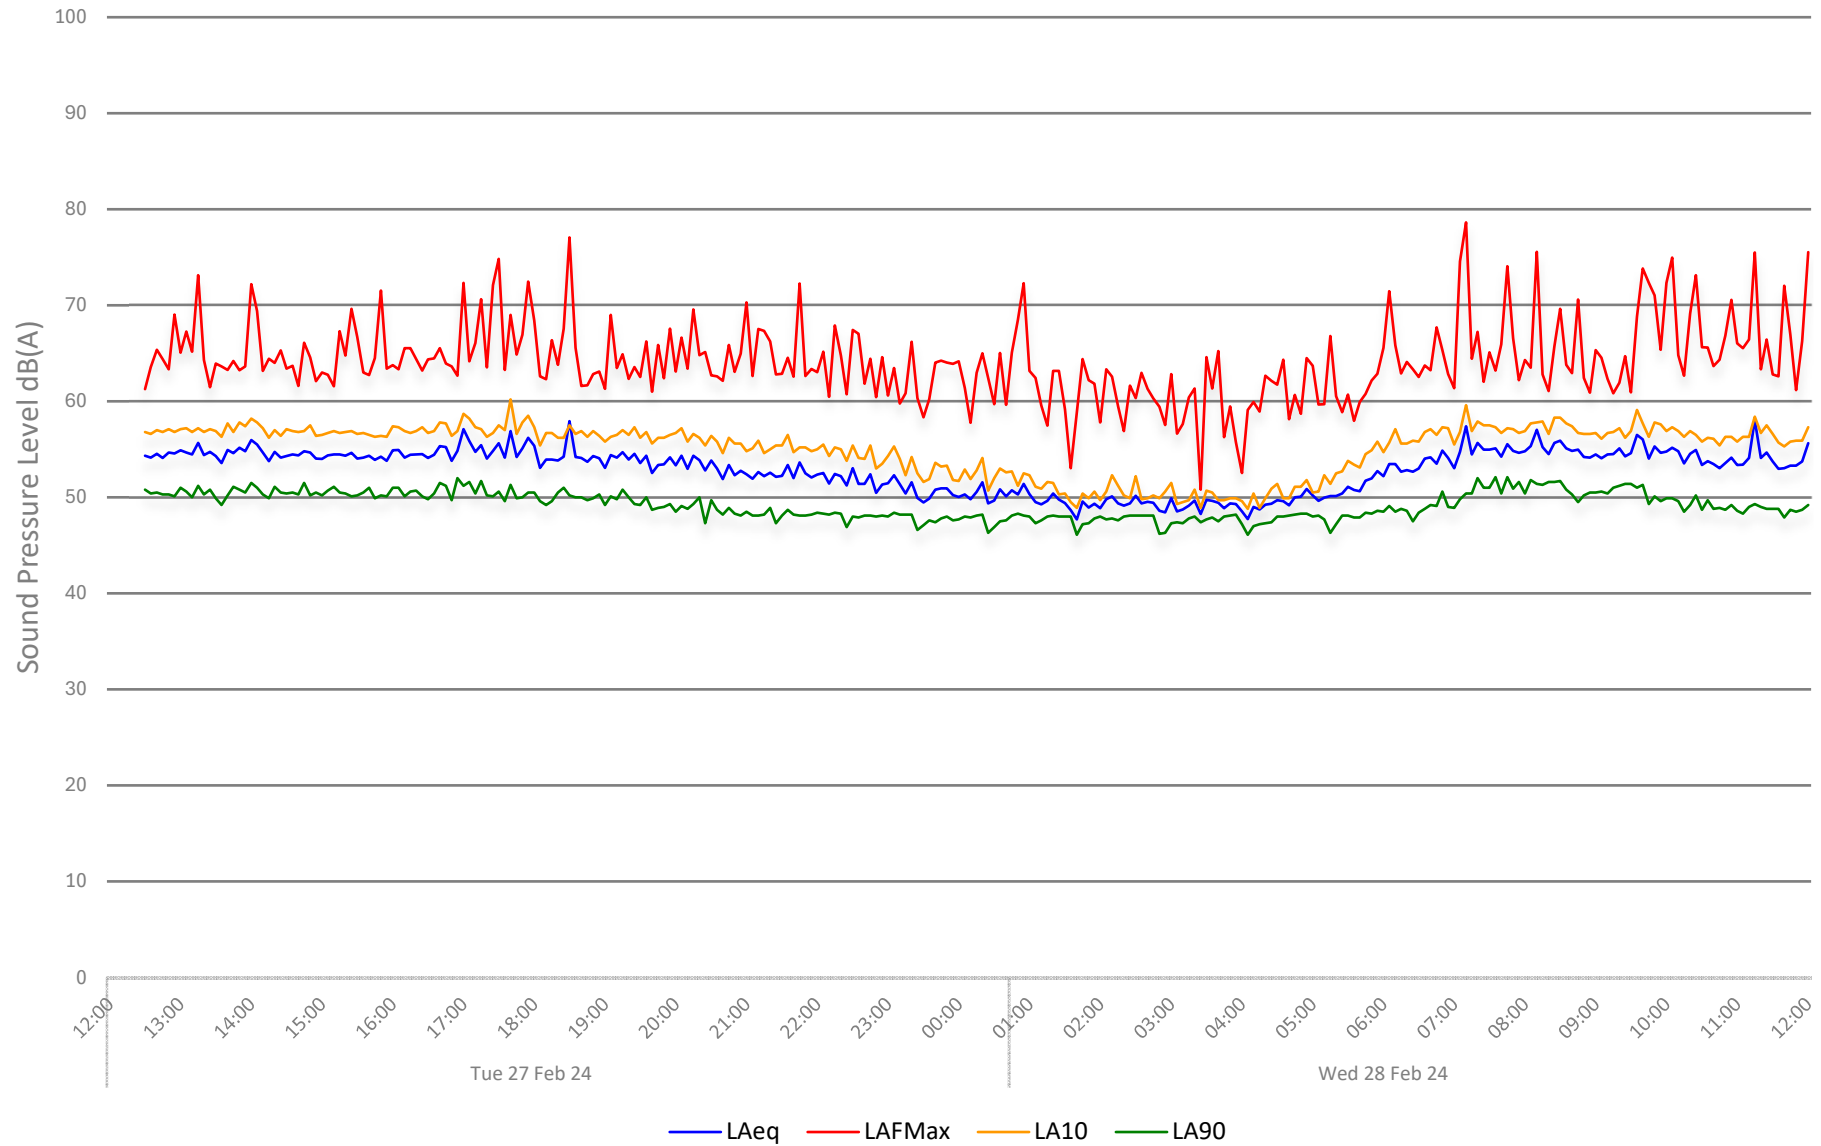

35 Templewood Avenue, Hampstead
Environmental Noise Time History: 2




Figure VA5153/TH2

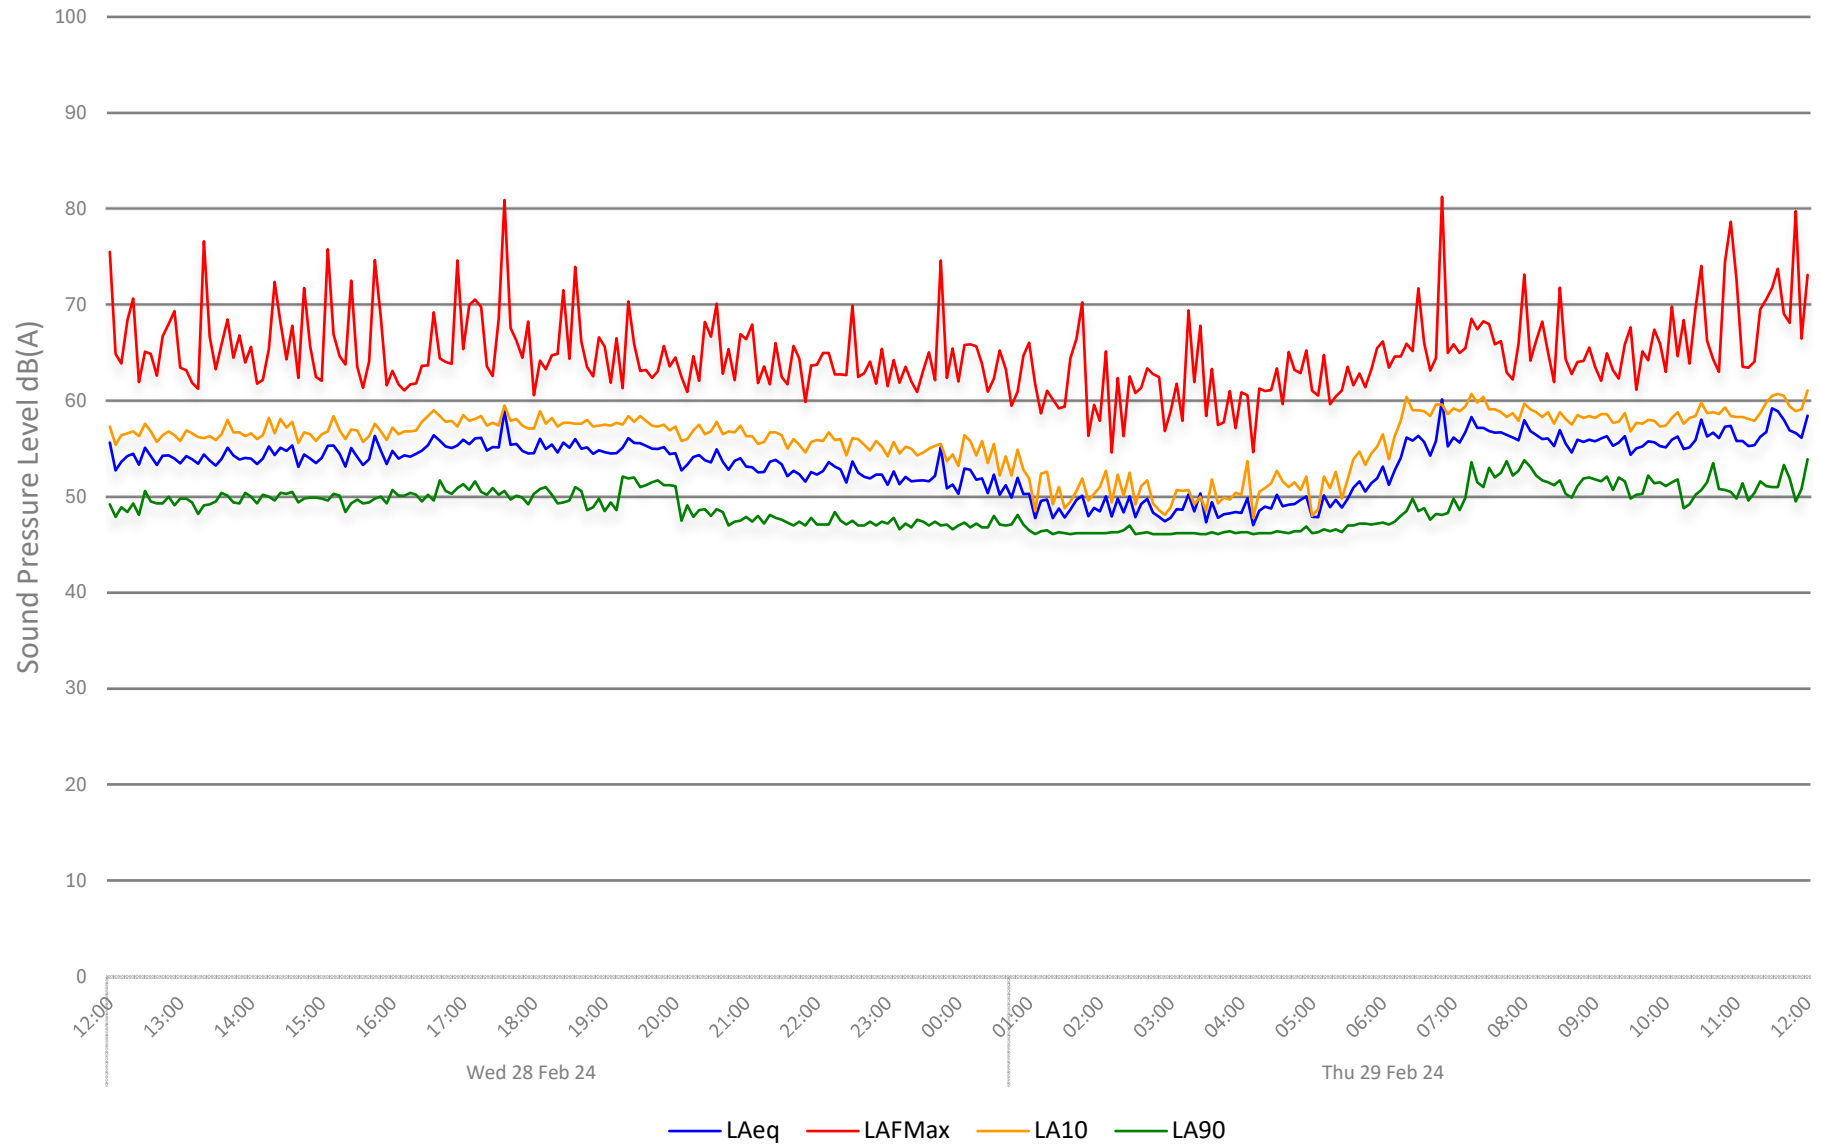

35 Templewood Avenue, Hampstead
Environmental Noise Time History: 3



Figure VA5153/TH3

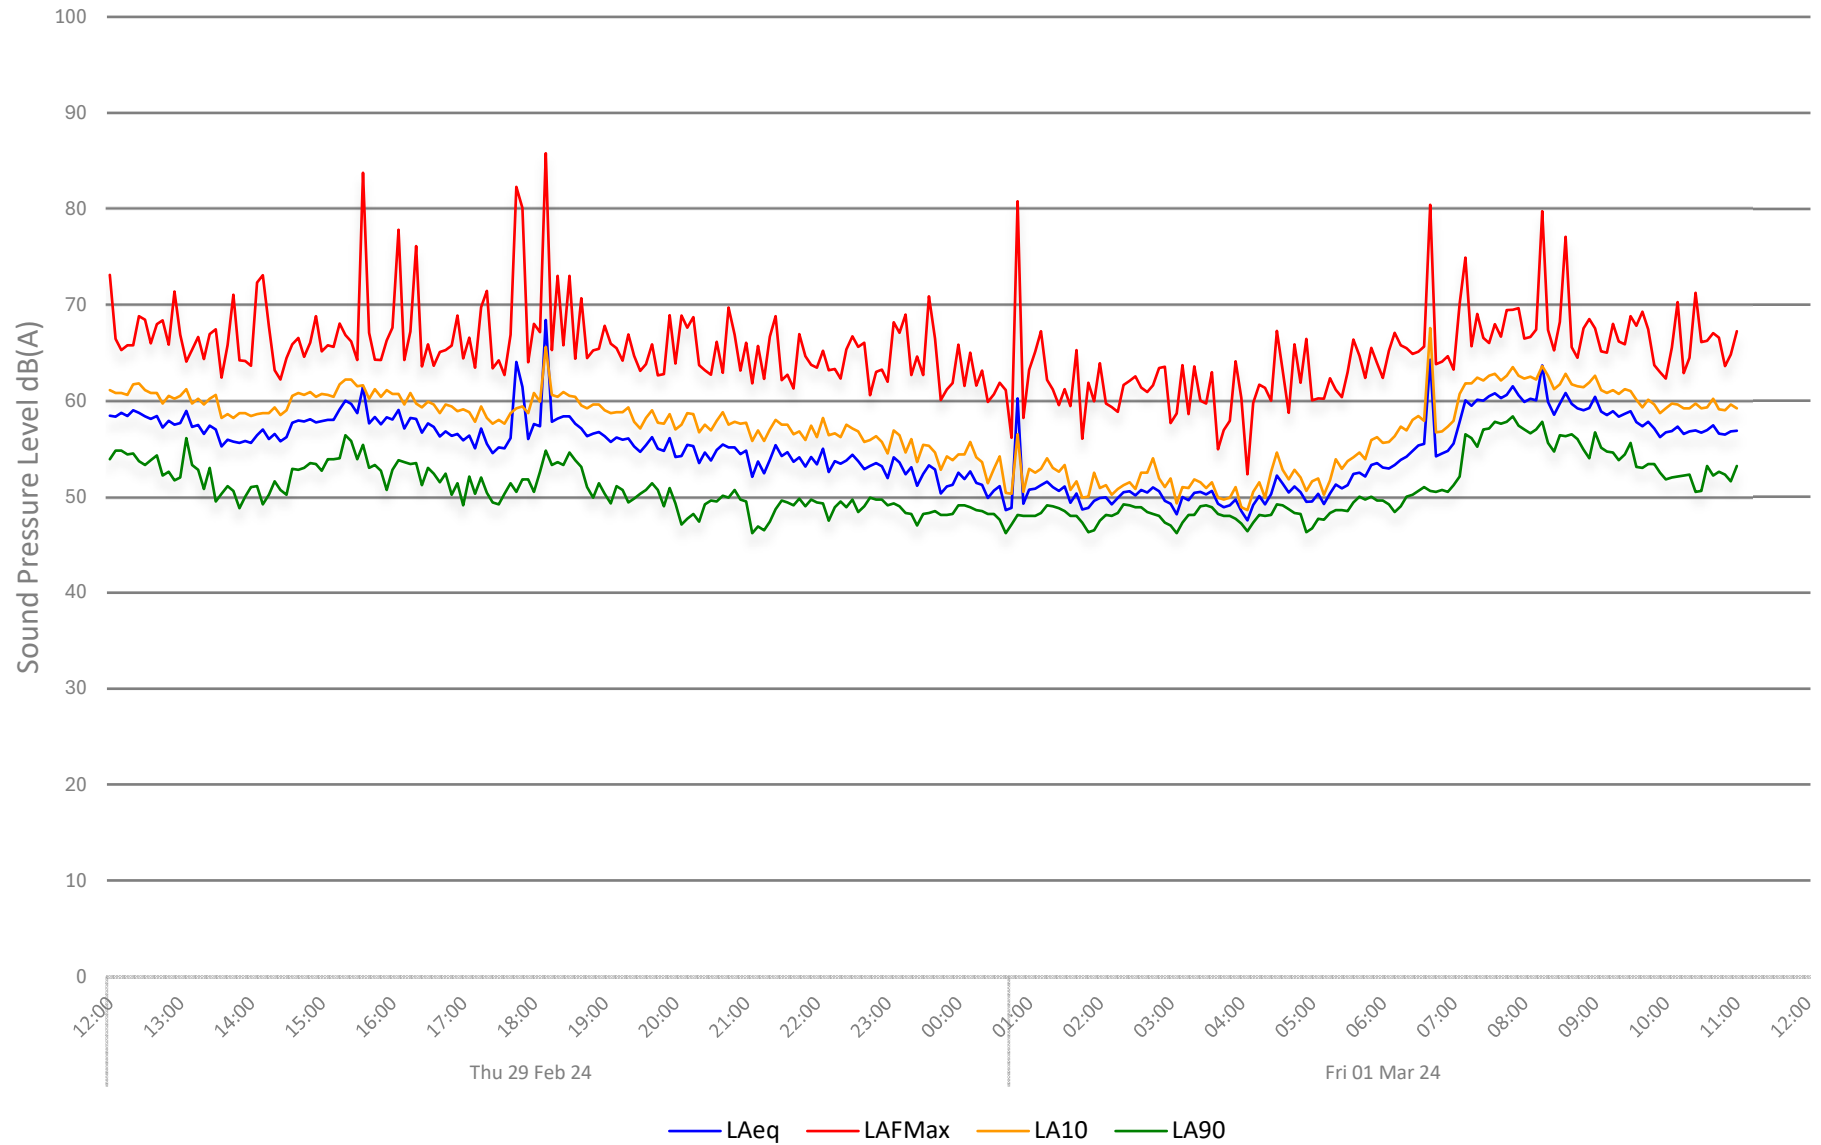

APPENDIX A

Acoustic Terminology & Human Response to Broadband Sound

Frequency	<p>The rate per second of vibration constituting a wave, measured in Hertz (Hz), where 1Hz = 1 vibration cycle per second. The human hearing can generally detect sound having frequencies in the range 20Hz to 20kHz. Frequency corresponds to the perception of 'pitch', with low frequencies producing low 'notes' and higher frequencies producing high 'notes'.</p>
dB(A):	<p>Human hearing is more susceptible to mid-frequency sounds than those at high and low frequencies. To take account of this in measurements and predictions, the 'A' weighting scale is used so that the level of sound corresponds roughly to the level as it is typically discerned by humans. The measured or calculated 'A' weighted sound level is designated as dB(A) or L_A.</p> <p>A notional steady sound level which, over a stated period of time, would contain the same amount of acoustical energy as the actual, fluctuating sound measured over that period (e.g. 8 hour, 1 hour, etc).</p>
L_{eq} :	<p>The concept of L_{eq} (equivalent continuous sound level) has primarily been used in assessing noise from industry, although its use is becoming more widespread in defining many other types of sounds, such as from amplified music and environmental sources such as aircraft and construction.</p> <p>Because L_{eq} is effectively a summation of a number of events, it does not in itself limit the magnitude of any individual event, and this is frequently used in conjunction with an absolute sound limit.</p>
L_{10} & L_{90} :	<p>Statistical L_n indices are used to describe the level and the degree of fluctuation of non-steady sound. The term refers to the level exceeded for n% of the time. Hence, L_{10} is the level exceeded for 10% of the time and as such can be regarded as a typical maximum level. Similarly, L_{90} is the typical minimum level and is often used to describe background noise.</p> <p>It is common practice to use the L_{10} index to describe noise from traffic as, being a high average, it takes into account the increased annoyance that results from the non-steady nature of traffic flow.</p>
L_{max} :	<p>The maximum sound pressure level recorded over a given period. L_{max} is sometimes used in assessing environmental noise, where occasional loud events occur which might not be adequately represented by a time-averaged L_{eq} value.</p>

1.1 Octave Band Frequencies

In order to determine the way in which the energy of sound is distributed across the frequency range, the International Standards Organisation has agreed on "preferred" bands of frequency for sound measurement and analysis. The widest and most commonly used band for frequency measurement and analysis is the Octave Band. In these bands, the upper frequency limit is twice the lower frequency limit, with the band being described by its "centre frequency" which is the average (geometric mean) of the upper and lower limits, e.g. 250 Hz octave band extends from 176 Hz to 353 Hz. The most commonly used octave bands are:

Octave Band Centre Frequency Hz		63		125		250		500		1000		2000		4000		8000
---------------------------------	--	----	--	-----	--	-----	--	-----	--	------	--	------	--	------	--	------

1.2 Human Perception of Broadband Noise

Because of the logarithmic nature of the decibel scale, it should be borne in mind that sound levels in dB(A) do not have a simple linear relationship. For example, 100dB(A) sound level is not twice as loud as 50dB(A). It has been found experimentally that changes in the average level of fluctuating sound, such as from traffic, need to be of the order of 3dB before becoming definitely perceptible to the human ear. Data from other experiments have indicated that a change in sound level of 10dB is perceived by the average listener as a doubling or halving of loudness. Using this information, a guide to the subjective interpretation of changes in environmental sound level can be given.

APPENDIX A

Acoustic Terminology & Human Response to Broadband Sound

Change in Sound Level dB	Subjective Impression	Human Response
0 to 2	Imperceptible change in loudness	Marginal
3 to 5	Perceptible change in loudness	Noticeable
6 to 10	Up to a doubling or halving of loudness	Significant
11 to 15	More than a doubling or halving of loudness	Substantial
16 to 20	Up to a quadrupling or quartering of loudness	Substantial
21 or more	More than a quadrupling or quartering of loudness	Very Substantial

1.3 Earth Bunds and Barriers - Effective Screen Height

When considering the reduction in sound level of a source provided by a barrier, it is necessary to establish the "effective screen height". For example if a tall barrier exists between a sound source and a listener, with the barrier close to the listener, the listener will perceive the sound as being louder if he climbs up a ladder (and is closer to the top of the barrier) than if he were standing at ground level. Equally if he sat on the ground the sound would seem quieter than if he were standing. This is explained by the fact that the "effective screen height" is changing with the three cases above. In general, the greater the effective screen height, the greater the perceived reduction in sound level.

Similarly, the attenuation provided by a barrier will be greater where it is aligned close to either the source or the listener than where the barrier is midway between the two.

APPENDIX B

VA5153 - 35 Templewood Avenue, Hampstead Noise Impact Assessment - 9 West Heath Road

		63 Hz	125 Hz	250 Hz	500 Hz	1 kHz	2 kHz	4 kHz	8 kHz	dB(A)
Daikin REYQ14U	Lp @ 1m	62	63	60	60	53	49	49	47	60
Location correction		3	3	3	3	3	3	3	3	
Line of sight loss		-5	-5	-5	-5	-5	-5	-5	-5	
Distance Loss	To 32m	-30	-30	-30	-30	-30	-30	-30	-30	
Level at receiver		30	31	28	28	21	17	17	15	

		63 Hz	125 Hz	250 Hz	500 Hz	1 kHz	2 kHz	4 kHz	8 kHz	dB(A)
Daikin REYQ16U	Lp @ 1m	67	69	64	62	55	52	52	43	63
Location correction		3	3	3	3	3	3	3	3	
Number of Plant	2	3	3	3	3	3	3	3	3	
Line of sight loss		-5	-5	-5	-5	-5	-5	-5	-5	
Distance Loss	To 29m	-29	-29	-29	-29	-29	-29	-29	-29	
Level at receiver		39	41	36	34	27	24	24	15	35

Cumulative noise level at receiver 36 dB(A)

Noise Impact Assessment - West Heath

		63 Hz	125 Hz	250 Hz	500 Hz	1 kHz	2 kHz	4 kHz	8 kHz	dB(A)
Daikin REYQ14U	Lp @ 1m	62	63	60	60	53	49	49	47	60
Location correction		3	3	3	3	3	3	3	3	
Line of sight loss		-5	-6	-7	-8	-10	-13	-15	-18	
Distance Loss	To 20m	-26	-26	-26	-26	-26	-26	-26	-26	
Level at receiver		34	34	30	29	20	13	11	6	

		63 Hz	125 Hz	250 Hz	500 Hz	1 kHz	2 kHz	4 kHz	8 kHz	dB(A)
Daikin REYQ16U	Lp @ 1m	67	69	64	62	55	52	52	43	63
Location correction		3	3	3	3	3	3	3	3	
Number of Plant	2	3	3	3	3	3	3	3	3	
Line of sight loss		-5	-6	-7	-8	-10	-13	-15	-18	
Distance Loss	To 20m	-26	-26	-26	-26	-26	-26	-26	-26	
Level at receiver		42	43	37	34	25	19	17	5	34

Cumulative noise level at receiver 35 dB(A)

Appendix C
Data Sheet

R-410A**LOOP**
BY DAIKIN

REYQ-U (13 to 16 hp)

VRV IV+ Condensing Units Heat Recovery



Outdoor Units			13 hp Multi		14 hp Single	16 hp Single	16 hp Multi	
			REYQ8U	REMQ5U	REYQ14U	REYQ16U	REYQ8U	REYQ8U
Capacity	Nominal Cooling	kW	36.40		40.00	45.00	44.80	
	Nominal Heating	kW	41.00		45.00	50.00	50.00	
Dimensions	Height x Width x Depth	mm	1685 x 930 x 765	1685 x 930 x 765	1685 x 1240 x 765	1685 x 1240 x 765	1685 x 930 x 765	1685 x 930 x 765
Weight		kg	230	230	314	314	230	230
Fan	Air Flow Rate	m ³ /sec	2.700	2.700	3.717	4.334	2.700	2.700
Electrical Details	Power Supply	Phase / Hz / V	3 / 50 / 380~415					
	Running Current	amps	8.9	5.3	17.4	21.1	8.9	8.9
	Starting Current	amps	4					
	Fuse Rating	amps	20	20	32	40	20	20
Refrigerant Circuit	Refrigerant Type		R410A					
	Refrigerant Charge	kg	9.7	9.7	11.8	11.8	9.7	9.7
	Additional Charge	kg	data book					
Sound Pressure		dBA	57.0	57.0	60.0	63.0	57.0	57.0
Sound Power		dBA	78.0	78.0	81.0	85.6	78.0	78.0
Piping Limits	Maximum Total Length	m	1000					
	Maximum Actual Length	m	165					
Piping Connections - Systems	Liquid	inch (mm)	1/2 (12.7)		1/2 (12.7)	1/2 (12.7)		1/2 (12.7)
	Discharge	inch (mm)	3/4 (19.1)		7/8 (22.2)	7/8 (22.2)		
	Gas	inch (mm)	1 1/8 (28.6)		1 1/8 (28.6)	1 1/8 (28.6)		
Capacity Index Limit			162.5 ~ 422.5		175 ~ 455		200 ~ 520	
Maximum Number of Connected Indoor Units			64		64		64	

R410A

REYQ-U (13 to 16 hp)

LOOP

VRV IV+ Condensing Units
Heat Recovery

Parameter	Unit	REYQ8U	REMQ5U	REYQ14U	REYQ16U	REYQ8U	REYQ8U	
Capacity	Nominal Cooling	kW	36.40	40.00	45.00	44.80	44.80	
	Nominal Heating	kW	41.00	45.00	50.00	50.00	50.00	
Dimensions	Height x Width x Depth	mm	1685 x 930 x 765	1685 x 930 x 765	1685 x 1240 x 765	1685 x 1240 x 765	1685 x 930 x 765	
Weight		kg	230	230	314	314	230	
Fan	Air Flow Rate	m ³ /sec	2.700	2.700	3.717	4.334	2.700	
Electrical Details	Power Supply	Phase / Hz / V	3 / 50 / 380~415					
	Running Current	amps	8.9	5.3	17.4	21.1	8.9	
	Starting Current	amps	4					
	Fuse Rating	amps	20	20	32	40	20	
Refrigerant Circuit	Refrigerant Type		R410A					
	Refrigerant Charge	kg	9.7	9.7	11.8	11.8	9.7	
	Additional Charge	kg	data book					
Sound Pressure		dBA	57.0	57.0	60.0	63.0	57.0	
Sound Power		dBA	78.0	78.0	81.0	85.6	78.0	
Piping Limits	Maximum Total Length	m	1000					
	Maximum Actual Length	m	165					
Piping Connections - Systems	Liquid	inch (mm)	1/2 (12.7)		1/2 (12.7)	1/2 (12.7)		
	Discharge	inch (mm)	3/4 (19.1)		7/8 (22.2)	7/8 (22.2)		
	Gas	inch (mm)	1 1/8 (28.6)		1 1/8 (28.6)	1 1/8 (28.6)		
Capacity Index Limit			162.5 ~ 422.5		175 ~ 455		200 ~ 520	
Maximum Number of Connected Indoor Units			64		64		64	