SUBJECT TO SURVEY

FIRE KEY

H

FE

(SAB)

BS5266-1:2016

KEY DESCRIPTION

FAIP FIRE ALARM PANEL

HEAT DETECTOR HEAD

SMOKE DETECTOR HEAD

INTERNAL SOUNDER

EXTERNAL SOUNDER


FIRE ALARM SYSTEM TO BE COMPLIANT WITH BS 5839-1:2017. ALARM SOUNDERS TO PROVIDE A MINIMUM OF 65DB IN ALL AREAS.

SPRINKLER HEAD


FIRE SAFETY / EXIT SIGNAGE TO COMPLY WITH BS EN ISO 7010, BS5499-4 2013,

ILLUMINATED RUNNING MAN

Ground Level

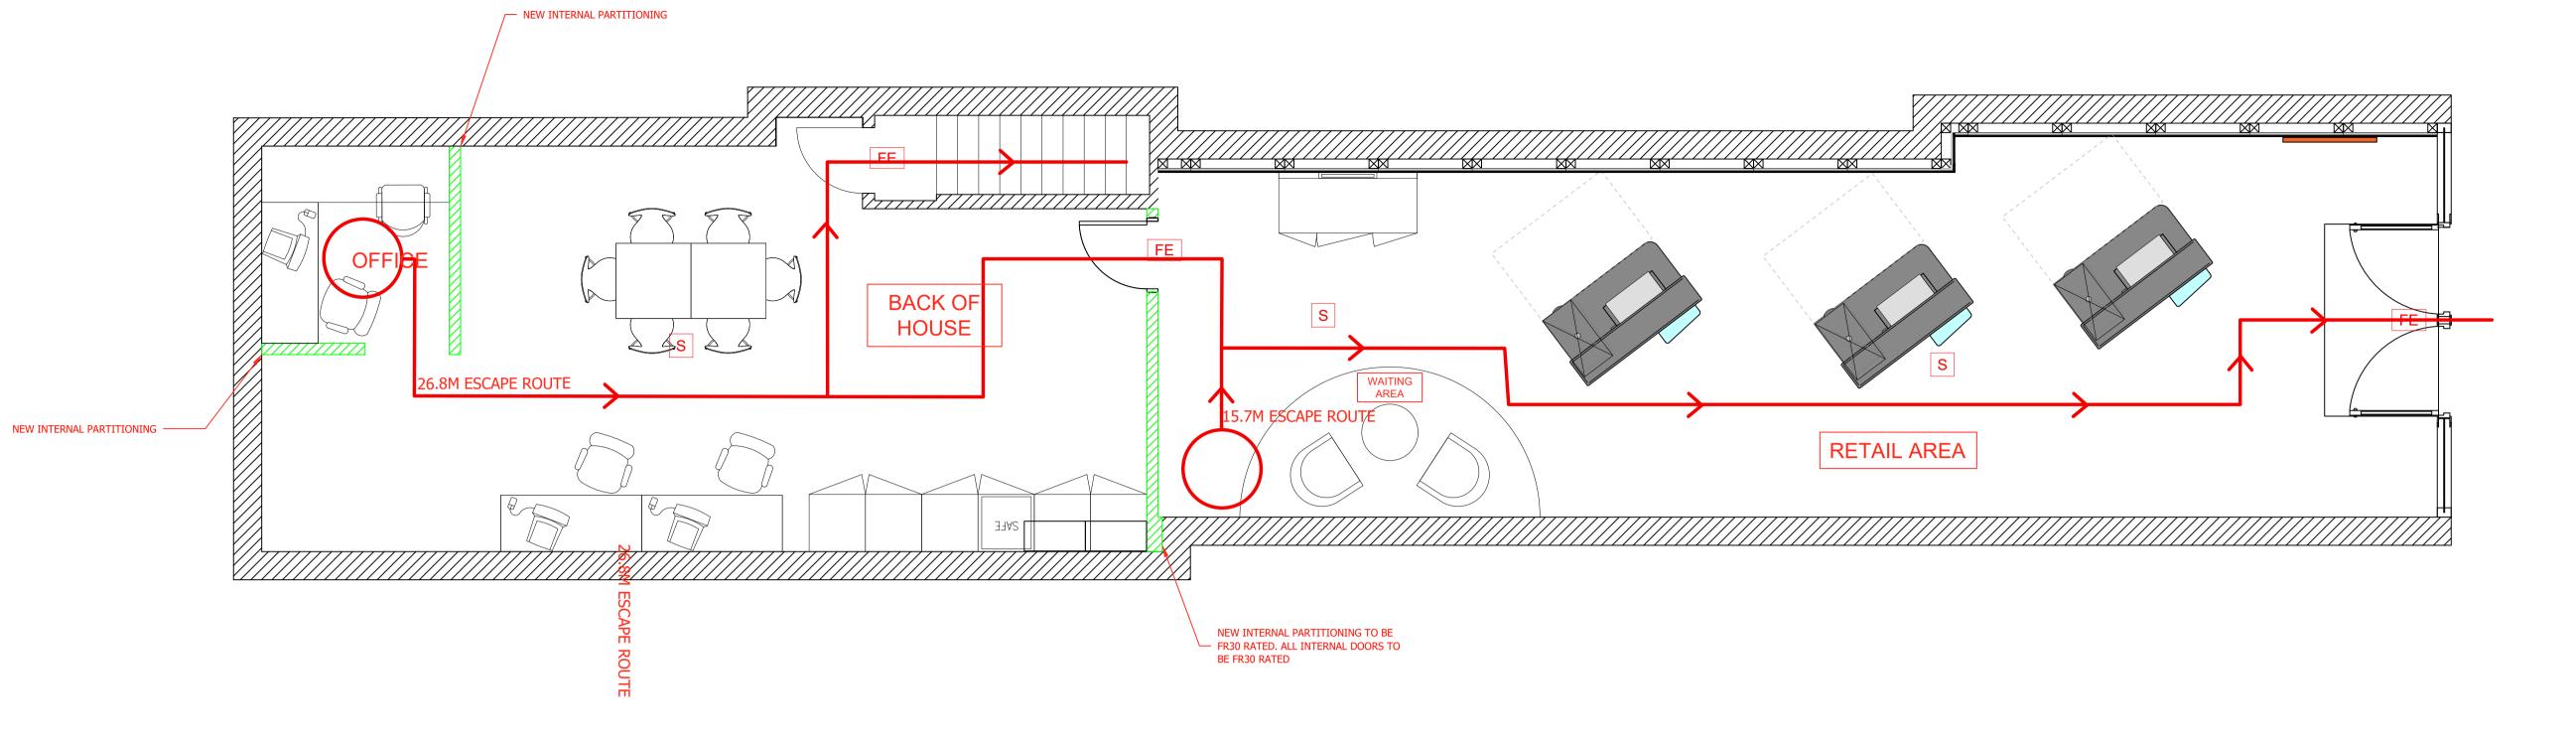

BASEMENT HAS NOT BEEN SURVEYED.

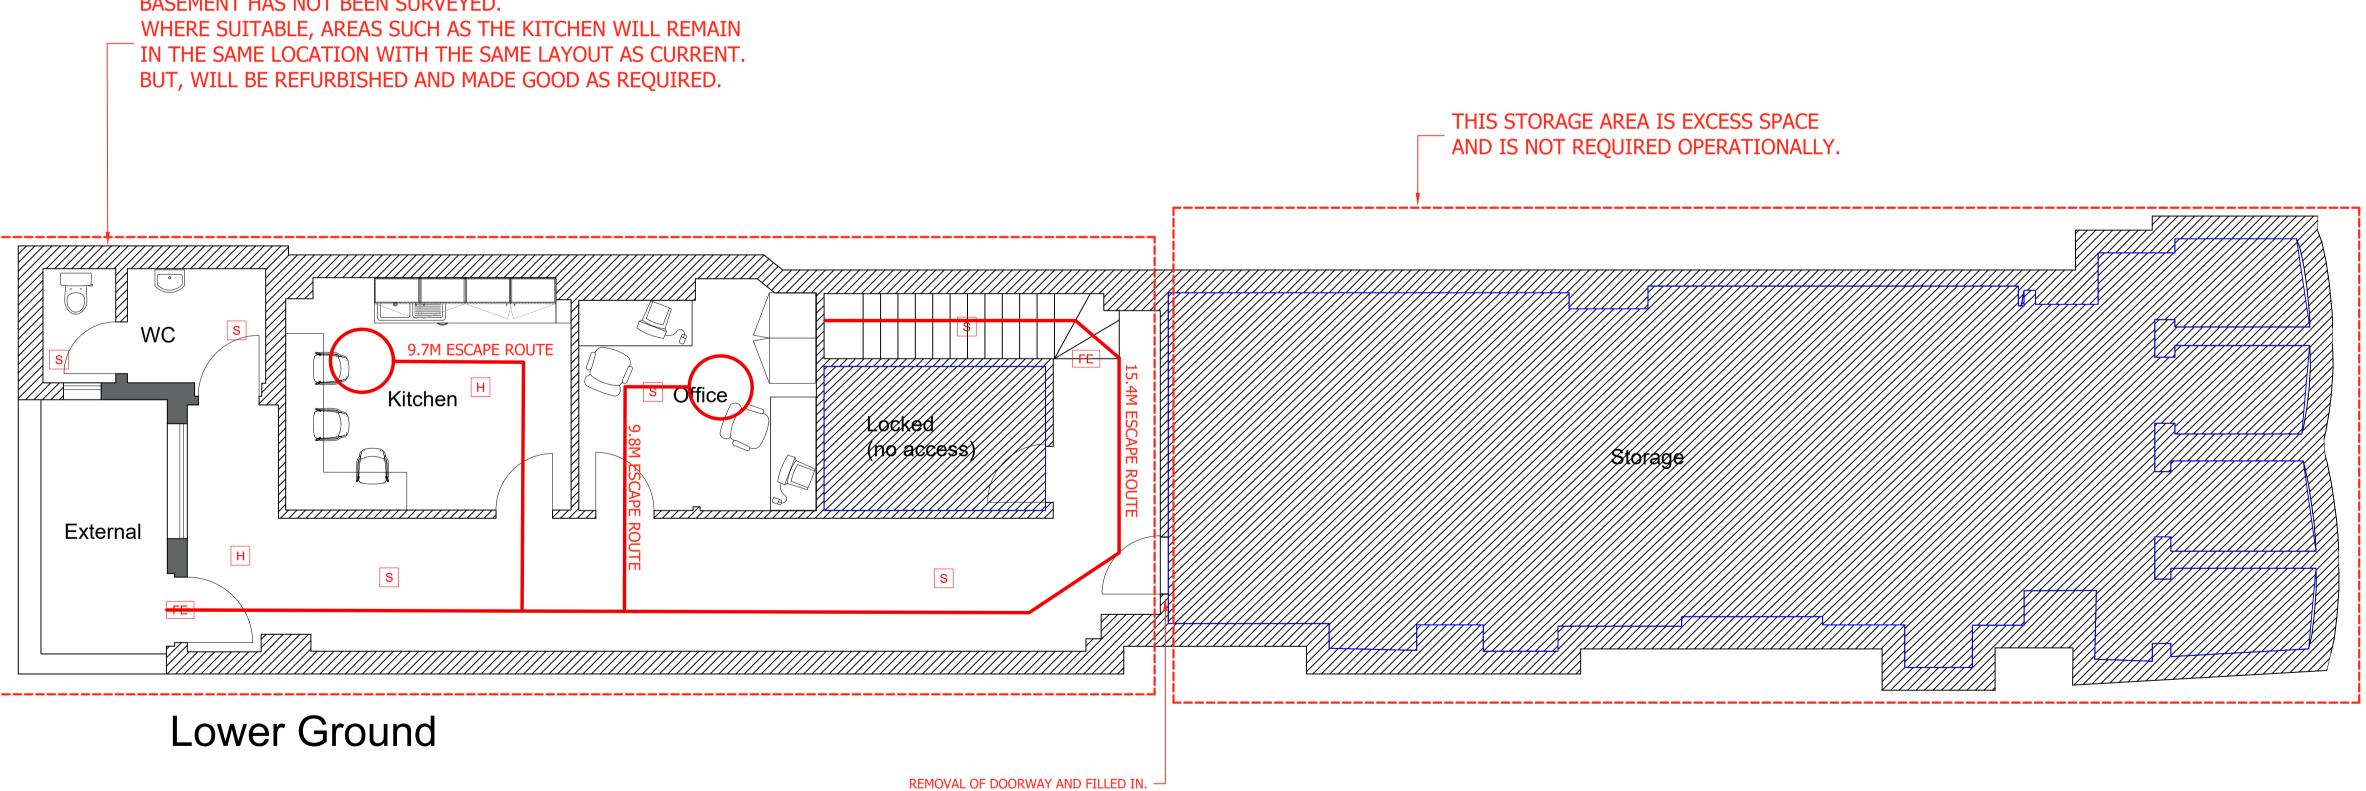

STAMP	123A BOROUGH HIGH STREET LONDON SE1 1NP WWW.STAMPDESIGN.CO.UK	TITLE	FIRE STRATEGY	ISSUE RECORD			(ADD EXTRA NOTES HERE)	FOR DESIGN INTENT O
				A	FIRST ISSUE	12/12/24		BUILDER AND / OR SUB-CONTRAC FABRICATIONS FIGURED DIMENSI CANNOT BE REPRODUCED IN WHO
		SCALE	1:40 @ A1					NO WARRANTY IS OFFERED OR IN THEMSELVES THAT THE DESIGN I
Six	88 SOUTHAMPTON ROW LONDON WC1B 4BB	DRAWN BY	DRAWING NO. STA.SIXT.SOUTHAMPTONROW.FS00					SHOULD BE SOUGHT FROM THE L FEASIBILITY OF DESIGN INTENT O THE LANDLORDS AGENTS WILL BE AND SIGN OFF OF DESIGN INTEN NO STRUCTURAL DESIGN HAS TAE SIGNED OFF BY AN INDEPENDENT SUITABILITY OF ANY WORK CONT IF IN DOUBT, ASK!

ONLY.

ACTORS SHALL VERIFY ALL PROJECT DIMENSIONS BEFORE COMMENCING ON-SITE OR OFF-SITE NSIONS SHALL TAKE PRECEDENCE OVER SCALED DIMENSIONS. THIS DRAWING IS COPYRIGHT AND NHOLE OR IN PART OR BY ANY MEDIUM WITHOUT THE WRITTEN PERMISSION OF STAMP DESIGN. R IMPLIED ON THE CONTENT OF THESE DRAWINGS. CLIENT AND CONTRACTOR SHOULD SATISFY GN INTENT AS INDICATED IS SUITABLE IN TERMS OF FUNCTION AND FEASIBILITY. GUIDANCE E LANDLORDS RETAINED ARCHITECT, STRUCTURAL ENGINEERS AND PROJECT TEAM AS TO THE NT CONTAINED HEREIN.

. BE RESPONSIBLE IN ALL CASES FOR ENSURING ADEQUATE PROVISION OF DESIGN INFORMATION, ENT HEREIN.

TAKEN PLACE. SHOULD STRUCTURAL DESIGN BE REQUIRED, THIS MUST BE COMMISSIONED AND ENT STRUCTURAL ENGINEER IN ALL CASES. NO GUIDANCE OR WARRANTY AS TO THE STRUCTURAL ONTAINED HEREIN IS OFFERED OR IMPLIED.