


Typical detail at parapet abutment wall: Use slate and a half slate to form verge at parapet.

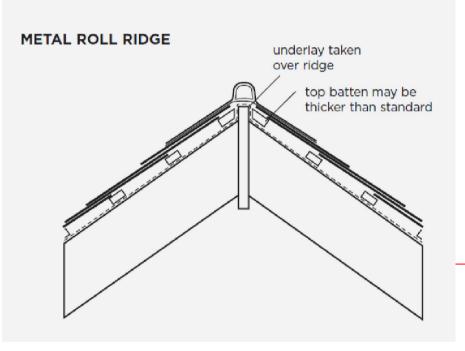

Replace existing rooflight with new Velux Heritage rooflight, ref: FC06, size 660mm wide x 1178mm long, including all necessary flashings, collars etc, or other equal and approved, make good where required.


-• New Lead roll to ridge line. Including Installation of Ridge line Air Vent -

Lead abutment flashing to change in roof pitch to mansard roof. LeadWorx -ventilation units within new slated roof, installed strictly in accordance with manufacturers instructions (or other equal and approved).

New slate roof covering to be Penrhyn grade 1 first quality and to have supporting certificate from supplier.


Lead abutment flashing to change in roof pitch to mansard roof.

MANSARD ROOF

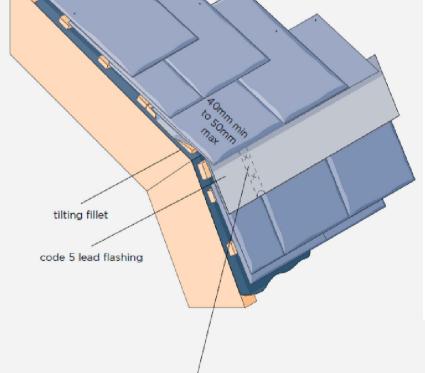

Clips (as specified on abutment detail) \_\_\_\_ boarding

with additional fixing (x)

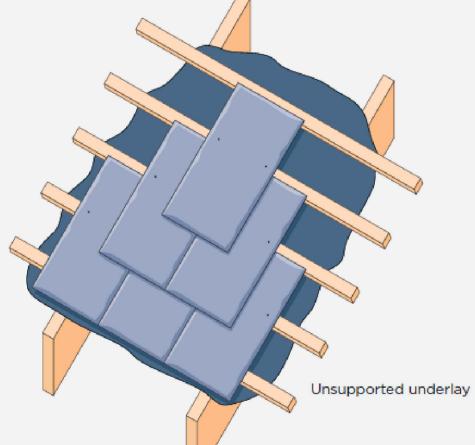

Typical layout for unsupported draped underlay.

0.5 1 1.5 2 2.5


7.5

Roof Plan scale 1:50 @ A1

Entire roof and mansard slopes to be reslated with new Penrhyn slates to match existing as identified the original for the building. Gauging and all details as shown here indicatively to follow the BS 5534 Code of Practice for Slating and Tiling.


All image details were sourced from: https://www.welshslate.com/roofing/penrhyn-welsh-slate-roofing/ (Roofing Brochure)

All leadwork to be treated with patination oil to avoid any staining to the new slates.

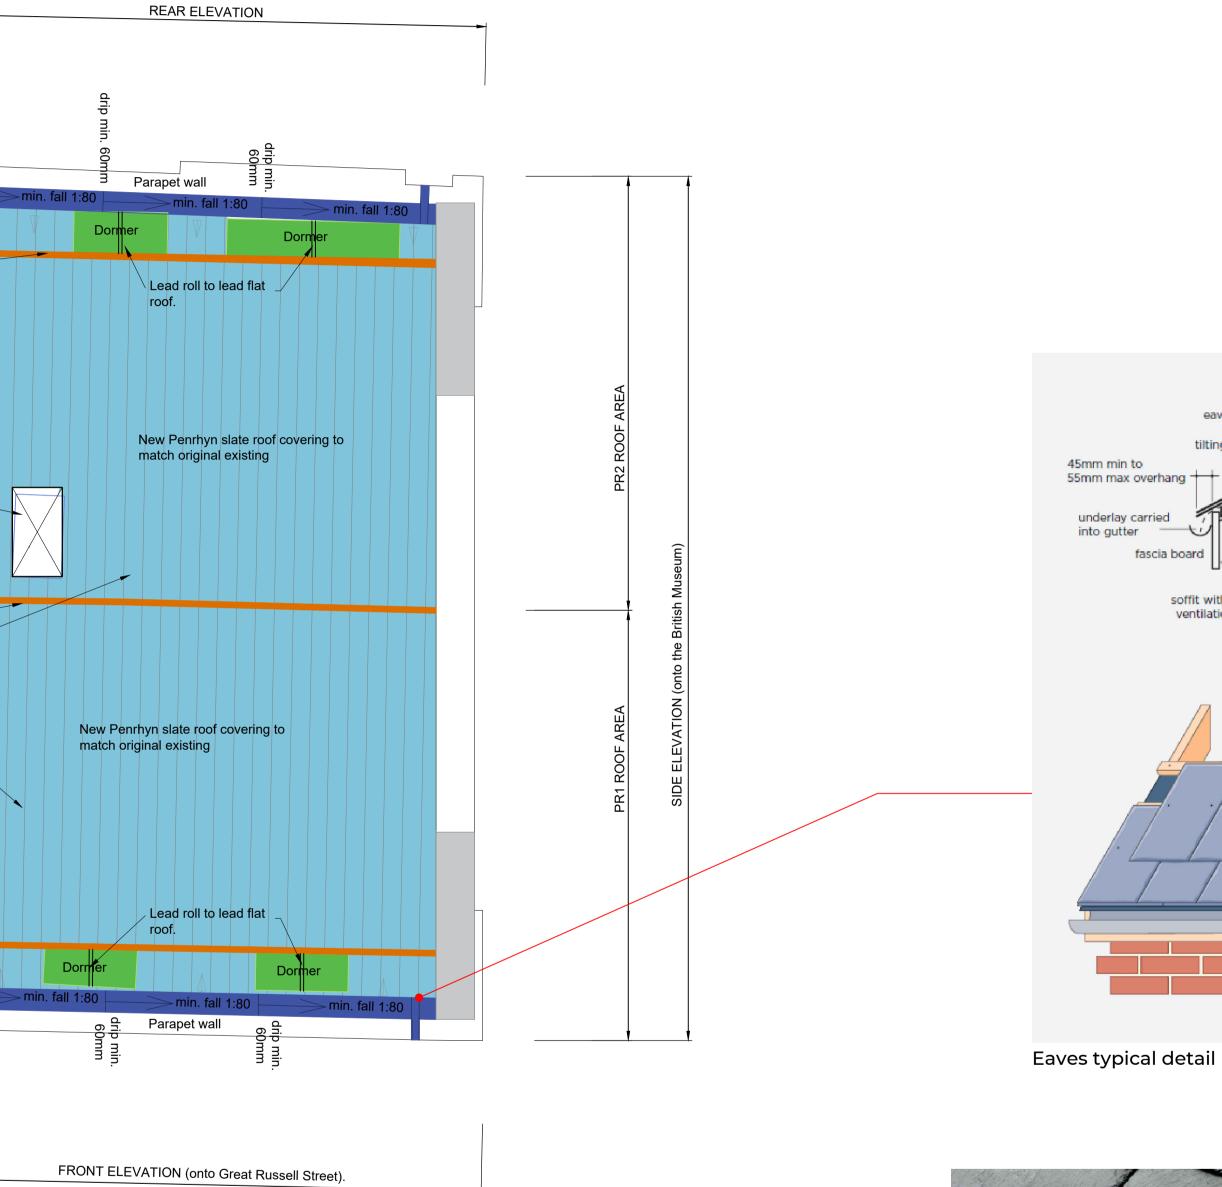




Penryhn slate sample as provided on site (photo from CBP).

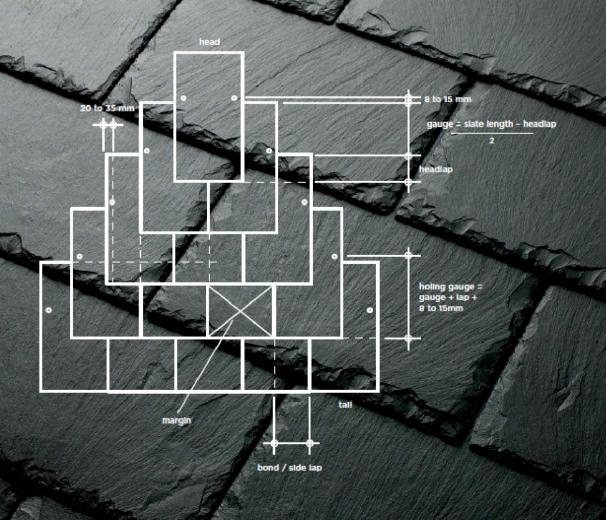

Typical slate gauging diagram.

Notes:

- 1. This is an A1 drawing, if reproduced in any other format the scale shown will be incorrect.
- 2. Do not scale off this drawing. 3. Any ambiguities, omissions and errors, or inconsistencies with other documents, on this drawing should be notified immediately to the architect before the commencement of works on site.
- 4. All dimensions are in millimeters unless otherwise stated. 5. All dimensions, unless otherwise stated,
- are to the face of unfinished masonry walls or to the face of stud partitions, excluding plasterboard. 6. All dimensions are to be checked on site.
- any discrepancies are to be notified immediately to the architect before the commencement of works on site. 7. All levels are in meters unless otherwise
- stated. 8. This drawing is to be read in conjunction with all other relevant drawings and specifications for this project and apparent inconsistencies brought to the attention of
- the architect. 9. It is the responsibility of specialist roofing/wall cladding/insulation manufacturer to ensure full compliance with their composite build up as specified by them, and that the integration of their product into the building design meets the required fire tests and complies with Building Regulations.

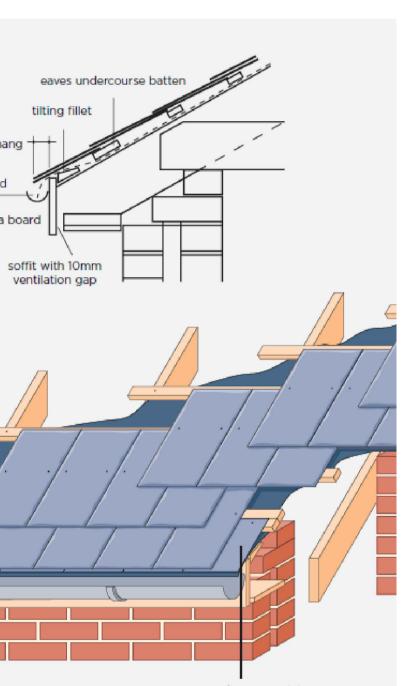

eaves undercourse slate



P02 19.12.2 P01 19.12.2		EB CP CP EP CP CP
Rev Date	Description	By Ck Ap
С	bp	•
T: 0115 9	48 1144 p-arch.co.uk	
44 The	Ropewalk, Nottir	ngham, NGI 5DW
<sup>Project</sup> 89 Grea London	t Russell Street,	
Drawing title Roof Re	-Slating Plan	
Drawn by Chec EP CP	ed by Approved by Scale CP 1:50	Date RIBA Stage

Role Number Suitability Revision 20180 -CBP -Z0 - 04 -DR -A-3010 -S0 -P02 Reproduced subject to copyright Original sheet size A1