















THIS DRAWING IS INDICATIVE AND REPRESENTS ONLY THE DESIGN INTENT, THE CONTRACTOR MUST PRODUCE FULLY CO-ORDINATED WORKING / INSTALLATION DRAWINGS AS REFERRED TO IN THE CONTRACT DOCUMENTATION

LIGHTING NOTES

- DO NOT SCALE FROM THIS DRAWING. ALL DIMENSIONS INDICATED ARE IN MILLIMETRES
- DRAWING TO BE READ IN CONJUNCTION WITH SPECIFICATION, DOCUMENTATION, DRAWINGS & ALL RELEVANT BRITISH STANDARD DOCUMENTS
- ALL ELECTRICAL WORKS SHALL COMPLY WITH 18TH EDITION IEE WIRING REGS BS7671:2018+A2:2022, INCLUDING ALL CURRENT AMENDMENTS AND GUIDANCE NOTES AND THE CURRENT BUILDING STANDARDS REGULATIONS
- THE INSTALLATION SHALL ONLY BE CERTIFIED BY A PERSON OR A COMPANY HAVING MEMBERSHIP TO S.E.L.E.C.T. OR N.I.C.E.I.C. OR SIMILAR ELECTRICAL SCHEMES
- FINAL LOCATIONS OF ALL VISIBLE ELECTRICAL EQUIPMENT TO BE COORDINATED WITH ARCHITECT

LEGEND

- E2 EMERGENCY ESCAPE RECESSED LIGHTING
 ZUMTOBEL RESCLITE PRO MRCR RSC E3DG5 WH 42936332
- E1 EMERGENCY ANTI PANIC RECESSED EMERGENCY LIGHT
 ZUMTOBEL RESCLITE PRO MRCR ANT E3DG5 WH 42934755
- E3 EMERGENCY ESCAPE SURFACE MOUNTED LIGHTING
 PHILIP PAYNE LANTIS BULKHEAD L300
- E4 EMERGENCY WALL MOUNTED LIGHTING
 IGUIZINI MOTUS ANTIPANIC QY39 LIGHT FITTING.
-  WALL MOUNTED EXIT LIGHTS
-  VIABIZZUNO MERCATO 230 GRUPPO 101 FITTING
- E-X EMERGENCY LIGHTING TO BE PROVIDE AS A MINIMUM AT THIS POSITION INTEGRATED INTO THE ARCHITECTURAL LIGHTING DESIGNERS FITTING. REFER TO LIGHTING DESIGNERS PACKAGE FOR FURTHER INFORMATION.

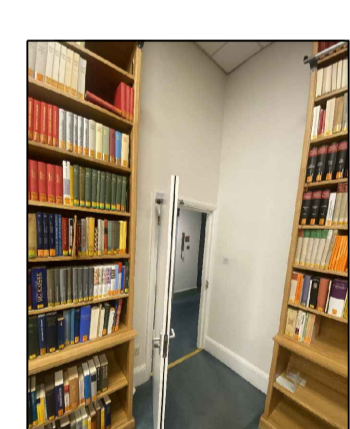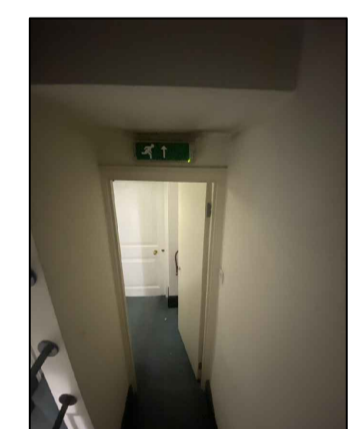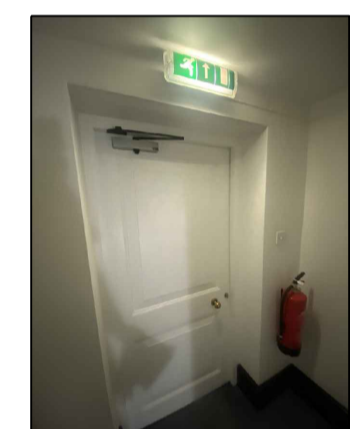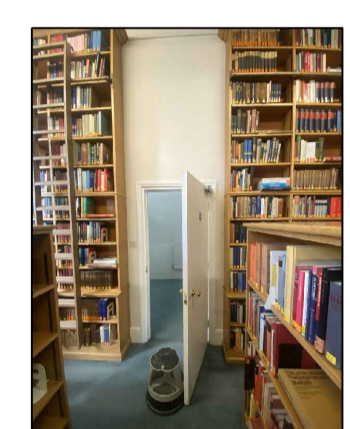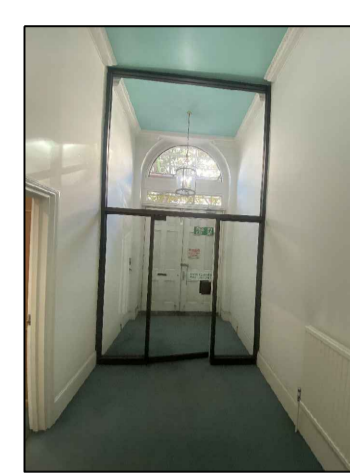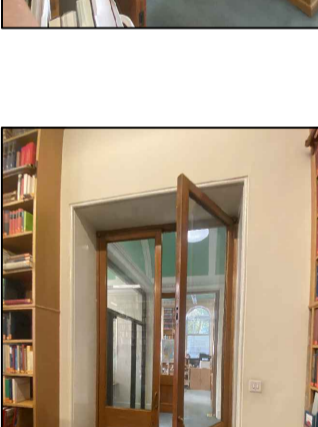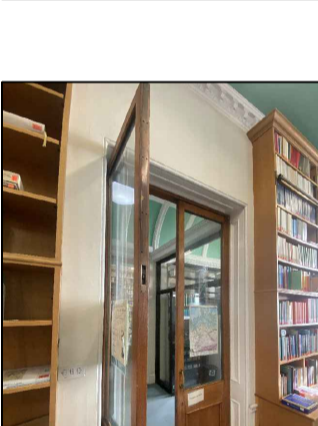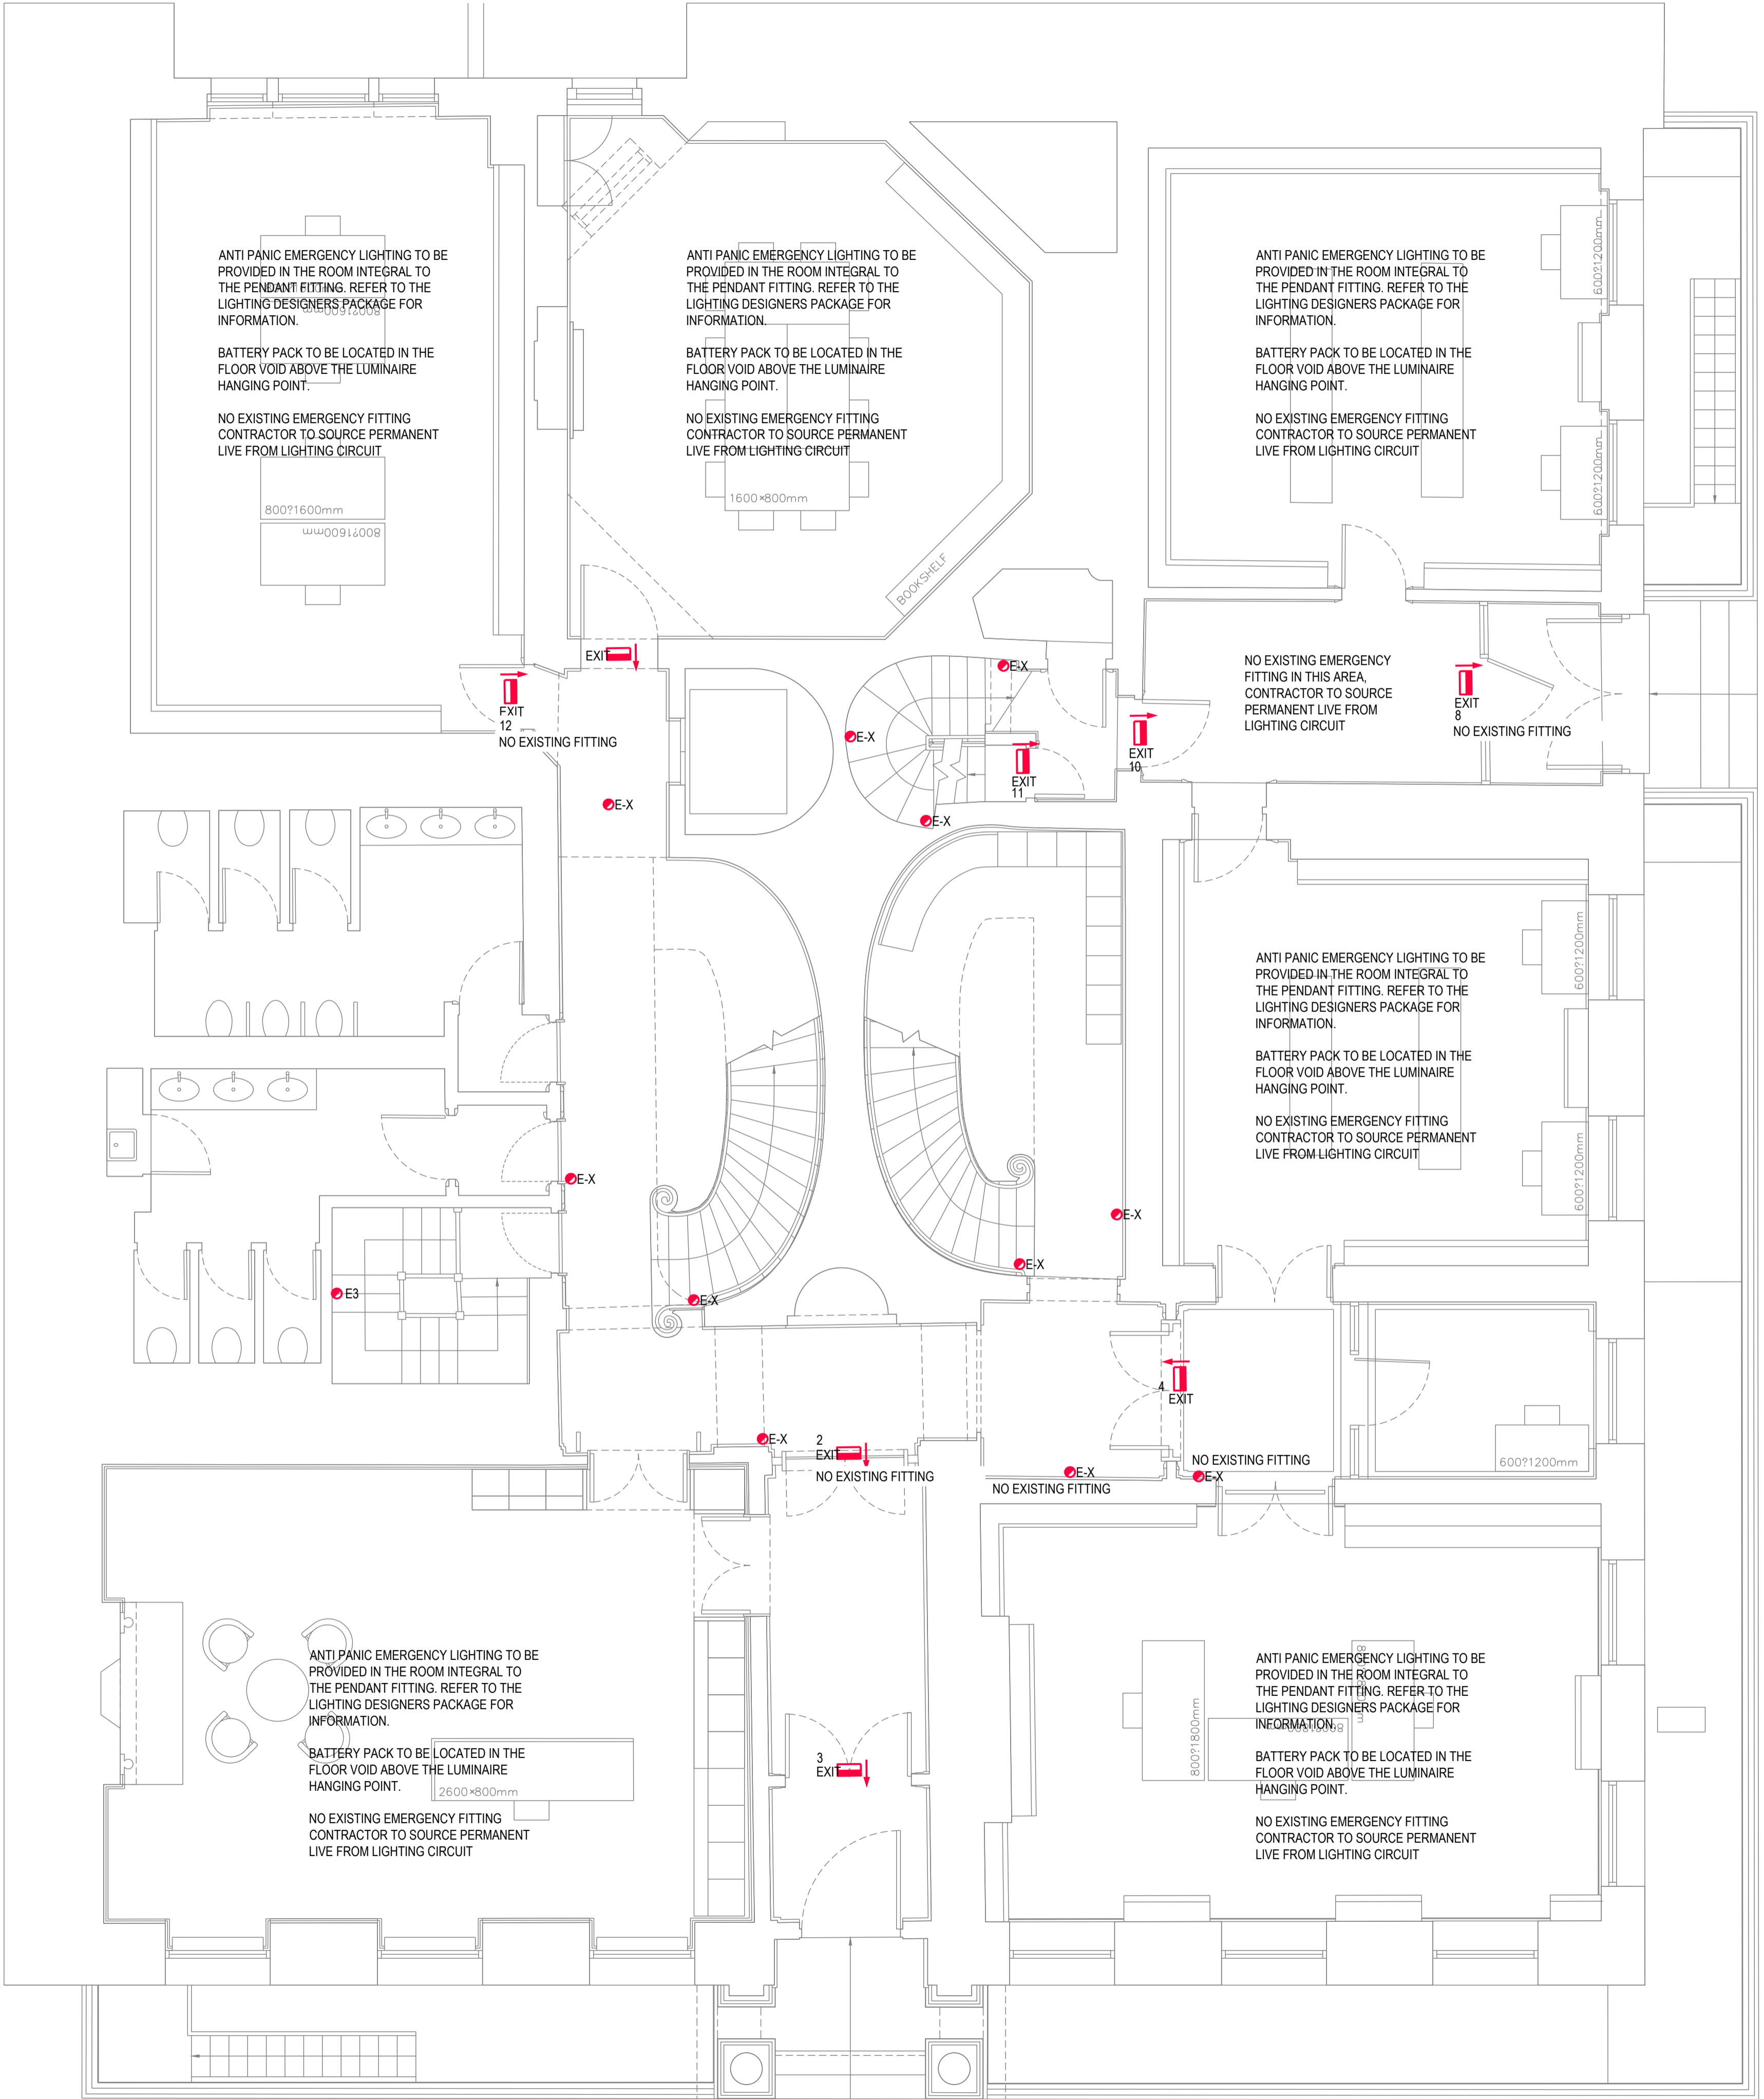

1

2

3

4

5

6

7

8

9

10

11

12

P03	TENDER ISSUE	VK	TD	AJ	19.10.23
P02	TENDER ISSUE	VK	TD	AJ	05.09.23
P01	PRELIMINARY ISSUE	JM	AJ	AJ	03.08.23
REV	DESCRIPTION	BY	CHK	APP	DATE

Project Status:
LBC SUBMISSION

The Multi-disciplinary Engineering Consultancy
h HARLEY HADDOW
 Unit A2, Hatchers Yard, 9 Tanner Street
 London, SE1 3LE
 T 44 (0) 203 735 5060
 E london@harleyhaddow.com
 Edinburgh | Glasgow | London | Manchester
 harleyhaddow.com
 Association for Consultancy and Engineering Member Firm

Project: 310311
GERMAN HISTORICAL INSTITUTE
17 BLOOMSBURY SQUARE

Drawing Title:
GROUND FLOOR PROPOSED EMERGENCY AND EXIT LIGHTING












Scale @ A1	Date	Engineer
1:50	JUNE 2023	AJ
Drawing No.	Revision	
310311-HAH-XX-00-D-E-06310	P03	




THIS DRAWING IS INDICATIVE AND REPRESENTS ONLY THE DESIGN INTENT. THE CONTRACTOR MUST PRODUCE FULLY CO-ORDINATED WORKING / INSTALLATION DRAWINGS AS REFERRED TO IN THE CONTRACT DOCUMENTATION

LIGHTING NOTES

- DO NOT SCALE FROM THIS DRAWING. ALL DIMENSIONS INDICATED ARE IN MILLIMETRES
- DRAWING TO BE READ IN CONJUNCTION WITH SPECIFICATION, DOCUMENTATION, DRAWINGS & ALL RELEVANT BRITISH STANDARD DOCUMENTS
- ALL ELECTRICAL WORKS SHALL COMPLY WITH 18TH EDITION IEE WIRING REGS BS7671:2018-A2:2022, INCLUDING ALL CURRENT AMENDMENTS AND GUIDANCE NOTES AND THE CURRENT BUILDING STANDARDS REGULATIONS
- THE INSTALLATION SHALL ONLY BE CERTIFIED BY A PERSON OR A COMPANY HAVING MEMBERSHIP TO S.E.L.E.C.T. OR N.I.C.E.I.C. OR SIMILAR ELECTRICAL SCHEMES
- FINAL LOCATIONS OF ALL VISIBLE ELECTRICAL EQUIPMENT TO BE COORDINATED WITH ARCHITECT

LEGEND

-  E2 EMERGENCY ESCAPE RECESSED LIGHTING
 -  E1 EMERGENCY ANTI PANIC RECESSED EMERGENCY LIGHT
 -  E3 EMERGENCY ESCAPE SURFACE MOUNTED LIGHTING
 -  E4 EMERGENCY WALL MOUNTED LIGHTING
 -  E-X EMERGENCY LIGHTING TO BE PROVIDED AS A MINIMUM AT THIS POSITION INTEGRATED INTO THE ARCHITECTURAL LIGHTING DESIGNERS FITTING. REFER TO LIGHTING DESIGNERS PACKAGE FOR FURTHER INFORMATION.
-  ZUMTOBEL RESCLITE PRO MRCR RSC E3DG5 WH 42936332
-  ZUMTOBEL RESCLITE PRO MRCR ANT E3DG5 WH 42934755
-  PHILIP PAYNE LANTIS BULKHEAD L300
-  IGUIZZINI MOTUS ANTIPANIC QY39 LIGHT FITTING.
-  EXIT WALL MOUNTED EXIT LIGHTS
-  VIABIZZINO MERCATO 230 GRUPPO 101 FITTING

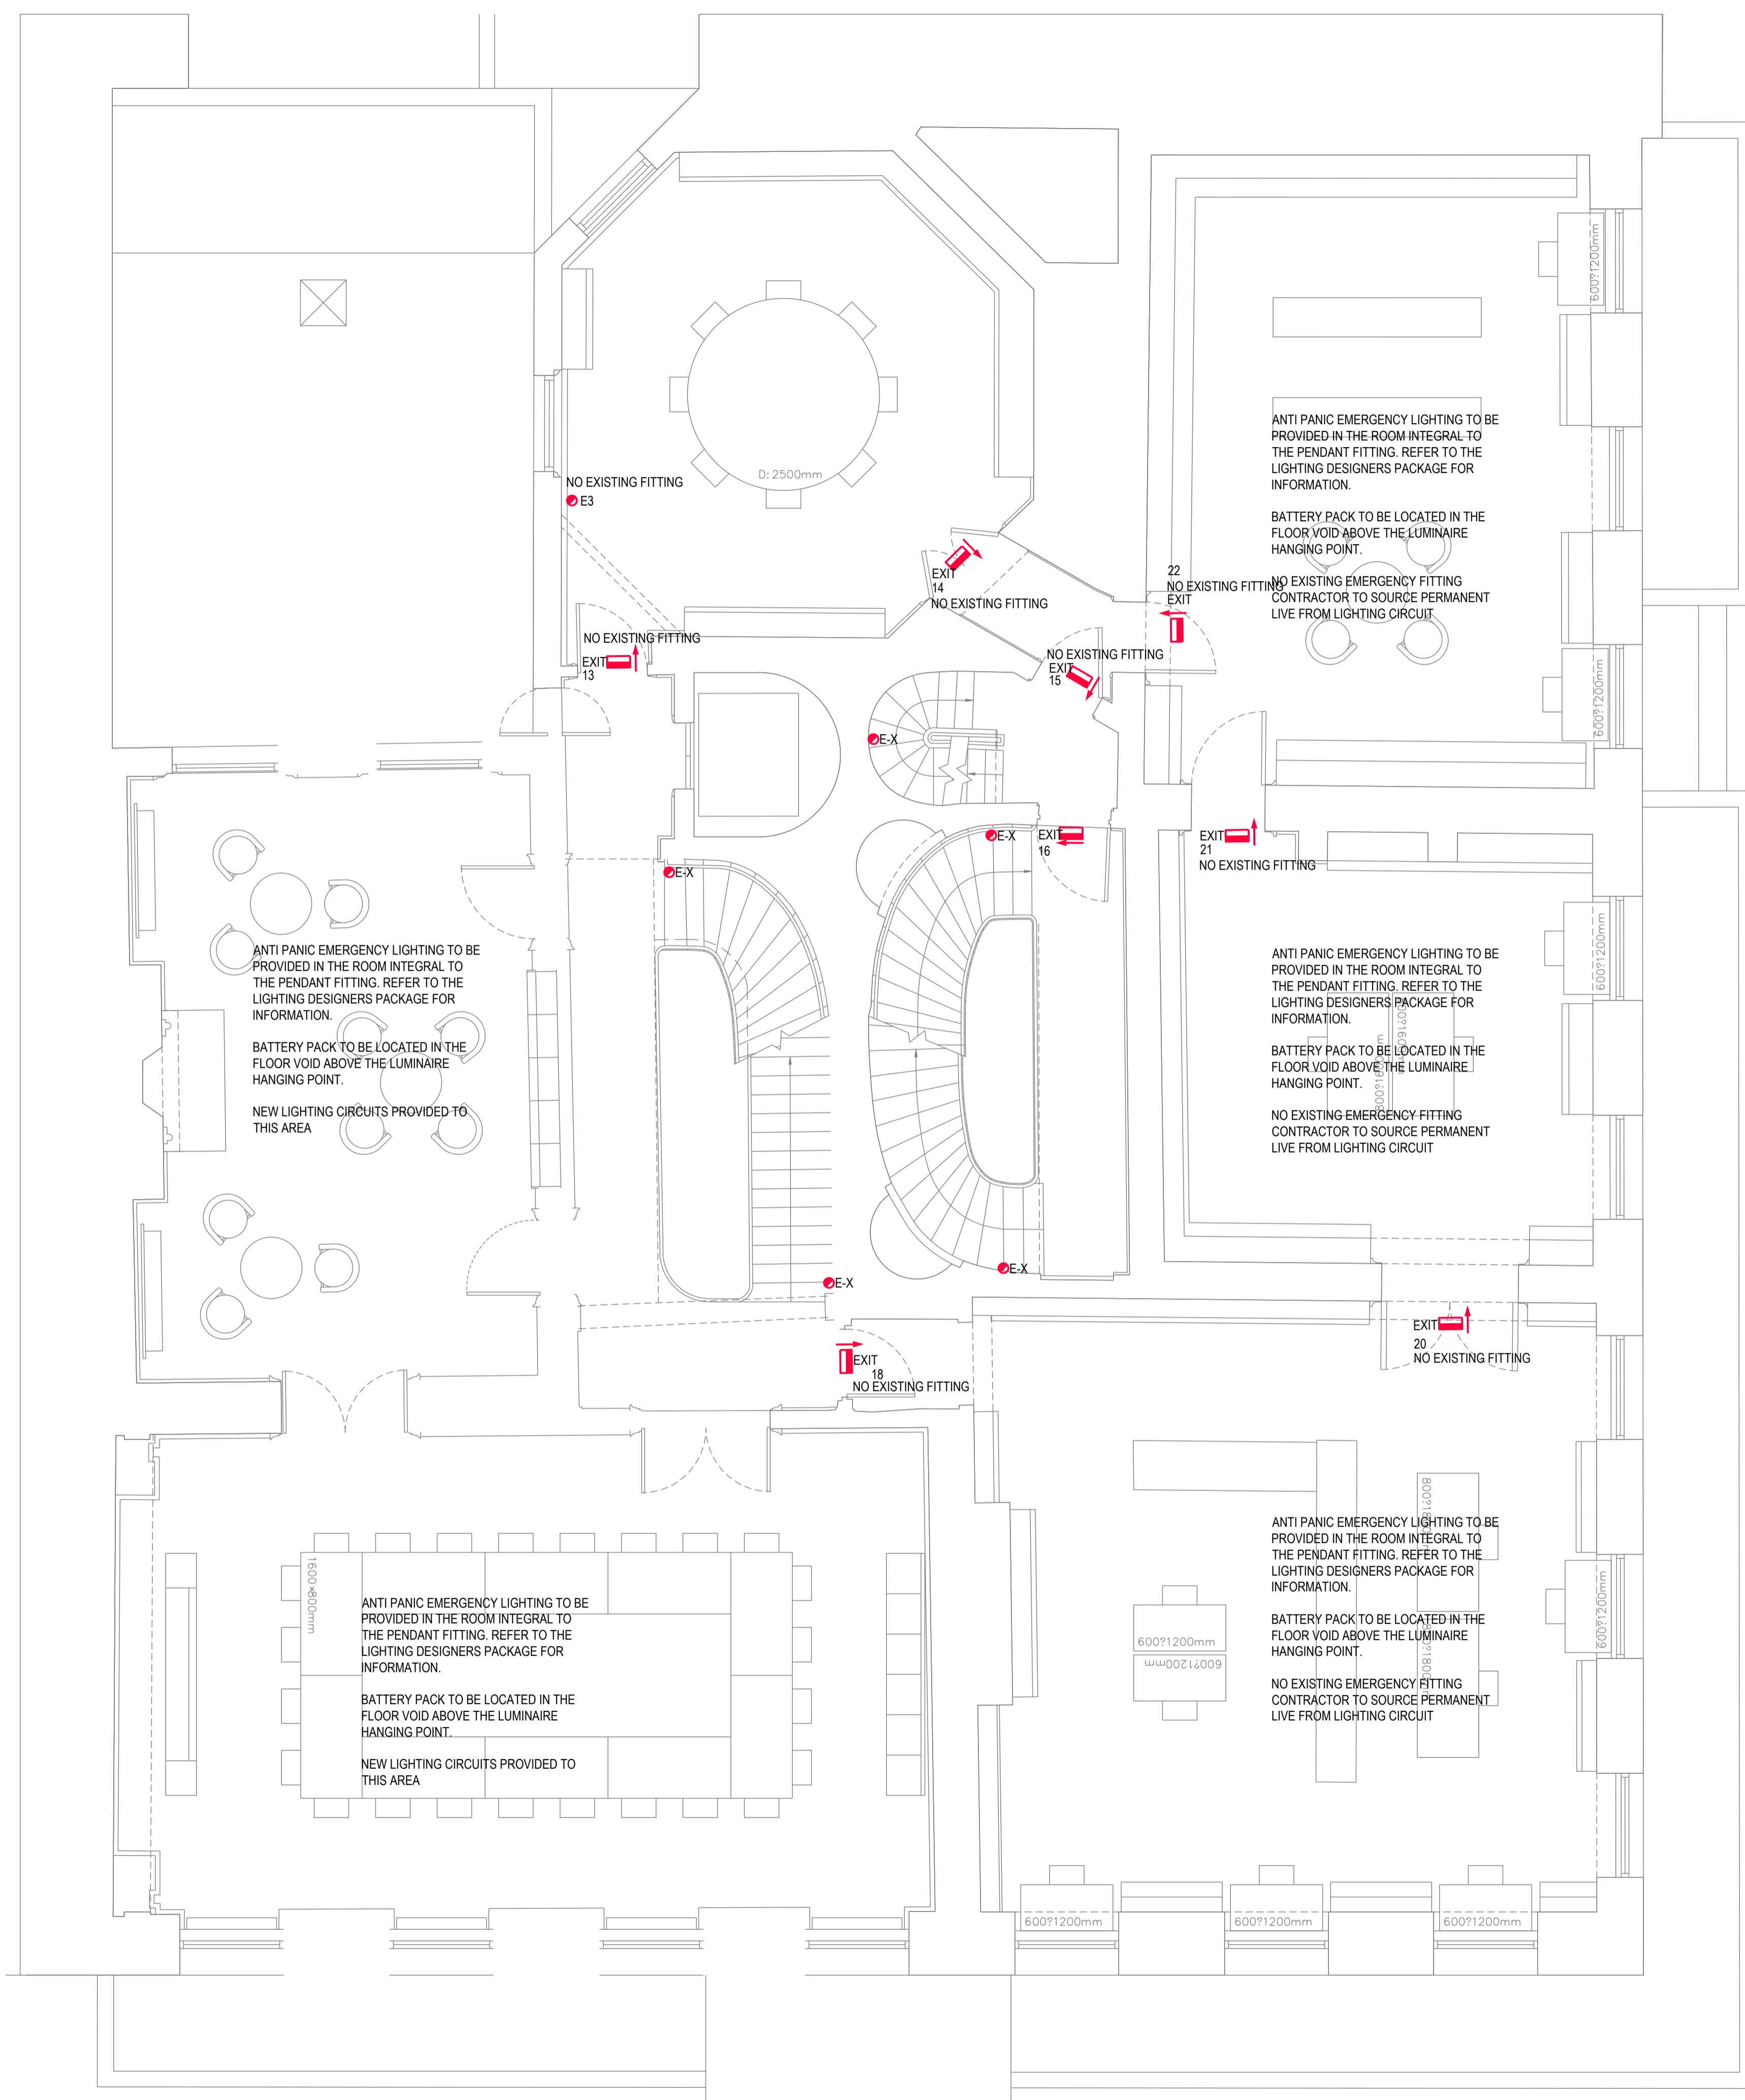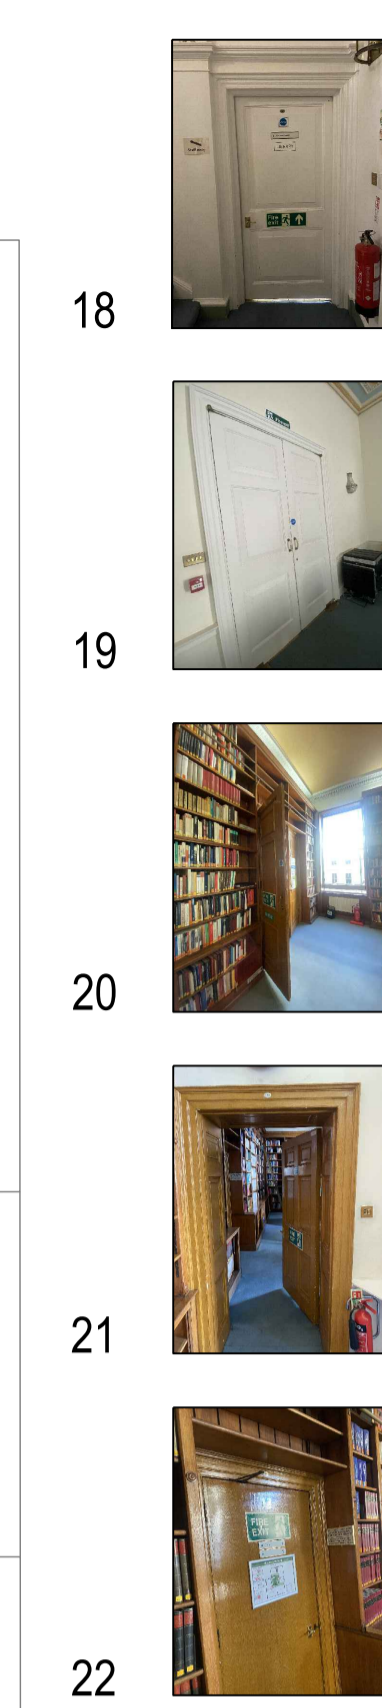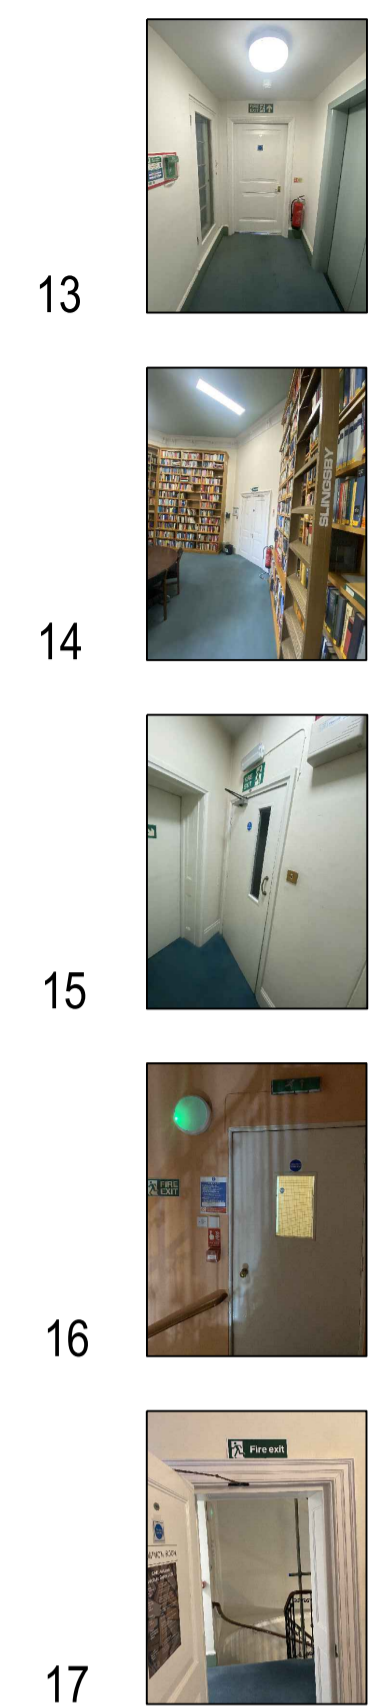

P03	TENDER ISSUE	VK	TD	AJ	19.10.23
P02	TENDER ISSUE	VK	TD	AJ	05.09.23
P01	PRELIMINARY ISSUE	JM	AJ	AJ	03.08.23
REV	DESCRIPTION	BY	CHK	APP	DATE

Project Status: **LBC SUBMISSION**

The Multi-disciplinary Engineering Consultancy

h HARLEY HADDOW

Unit A2, Hatchers Yard, 9 Tanner Street
London, SE1 3LE
T 44 (0) 203 735 5060
E london@harleyhaddow.com
Edinburgh | Glasgow | London | Manchester
harleyhaddow.com
Association for Consultancy and Engineering Member Firm

Project: 310311
**GERMAN HISTORICAL INSTITUTE
17 BLOOMSBURY SQUARE**

Drawing Title:
FIRST FLOOR PROPOSED EMERGENCY AND EXIT LIGHTING












Scale @ A1	Date	Engineer
1:50	JUNE 2023	AJ
Drawing No.	Revision	
310311-HAH-XX-01-D-E-06310	P03	



THIS DRAWING IS INDICATIVE AND REPRESENTS ONLY THE DESIGN INTENT, THE CONTRACTOR MUST PRODUCE FULLY CO-ORDINATED WORKING / INSTALLATION DRAWINGS AS REFERRED TO IN THE CONTRACT DOCUMENTATION

LIGHTING NOTES

- DO NOT SCALE FROM THIS DRAWING. ALL DIMENSIONS INDICATED ARE IN MILLIMETRES
- DRAWING TO BE READ IN CONJUNCTION WITH SPECIFICATION, DOCUMENTATION, DRAWINGS & ALL RELEVANT BRITISH STANDARD DOCUMENTS
- ALL ELECTRICAL WORKS SHALL COMPLY WITH 18TH EDITION IEE WIRING REGS BS7671:2018-A2:2022, INCLUDING ALL CURRENT AMENDMENTS AND GUIDANCE NOTES AND THE CURRENT BUILDING STANDARDS REGULATIONS
- THE INSTALLATION SHALL ONLY BE CERTIFIED BY A PERSON OR A COMPANY HAVING MEMBERSHIP TO S.E.L.E.C.T. OR N.I.C.E.I.C. OR SIMILAR ELECTRICAL SCHEMES
- FINAL LOCATIONS OF ALL VISIBLE ELECTRICAL EQUIPMENT TO BE COORDINATED WITH ARCHITECT

LEGEND

-  E2 EMERGENCY ESCAPE RECESSED LIGHTING
-  ZUMTOBEL RESCLITE PRO MRCR RSC E3DG5 WH 42936332
-  E1 EMERGENCY ANTI PANIC RECESSED EMERGENCY LIGHT
-  ZUMTOBEL RESCLITE PRO MRCR ANT E3DG5 WH 42934755
-  E3 EMERGENCY ESCAPE SURFACE MOUNTED LIGHTING
-  PHILIP PAYNE LANTIS BULKHEAD L300
-  E4 EMERGENCY WALL MOUNTED LIGHTING
-  IGUIZZINI MOTUS ANTIPANIC QY39 LIGHT FITTING.
-  EXIT WALL MOUNTED EXIT LIGHTS
-  VIABIZZUNO MERCATO 230 GRUPPO 101 FITTING
-  E-X EMERGENCY LIGHTING TO BE PROVIDE AS A MINIMUM AT THIS POSITION INTEGRATED INTO THE ARCHITECTURAL LIGHTING DESIGNERS FITTING. REFER TO LIGHTING DESIGNERS PACKAGE FOR FURTHER INFORMATION.

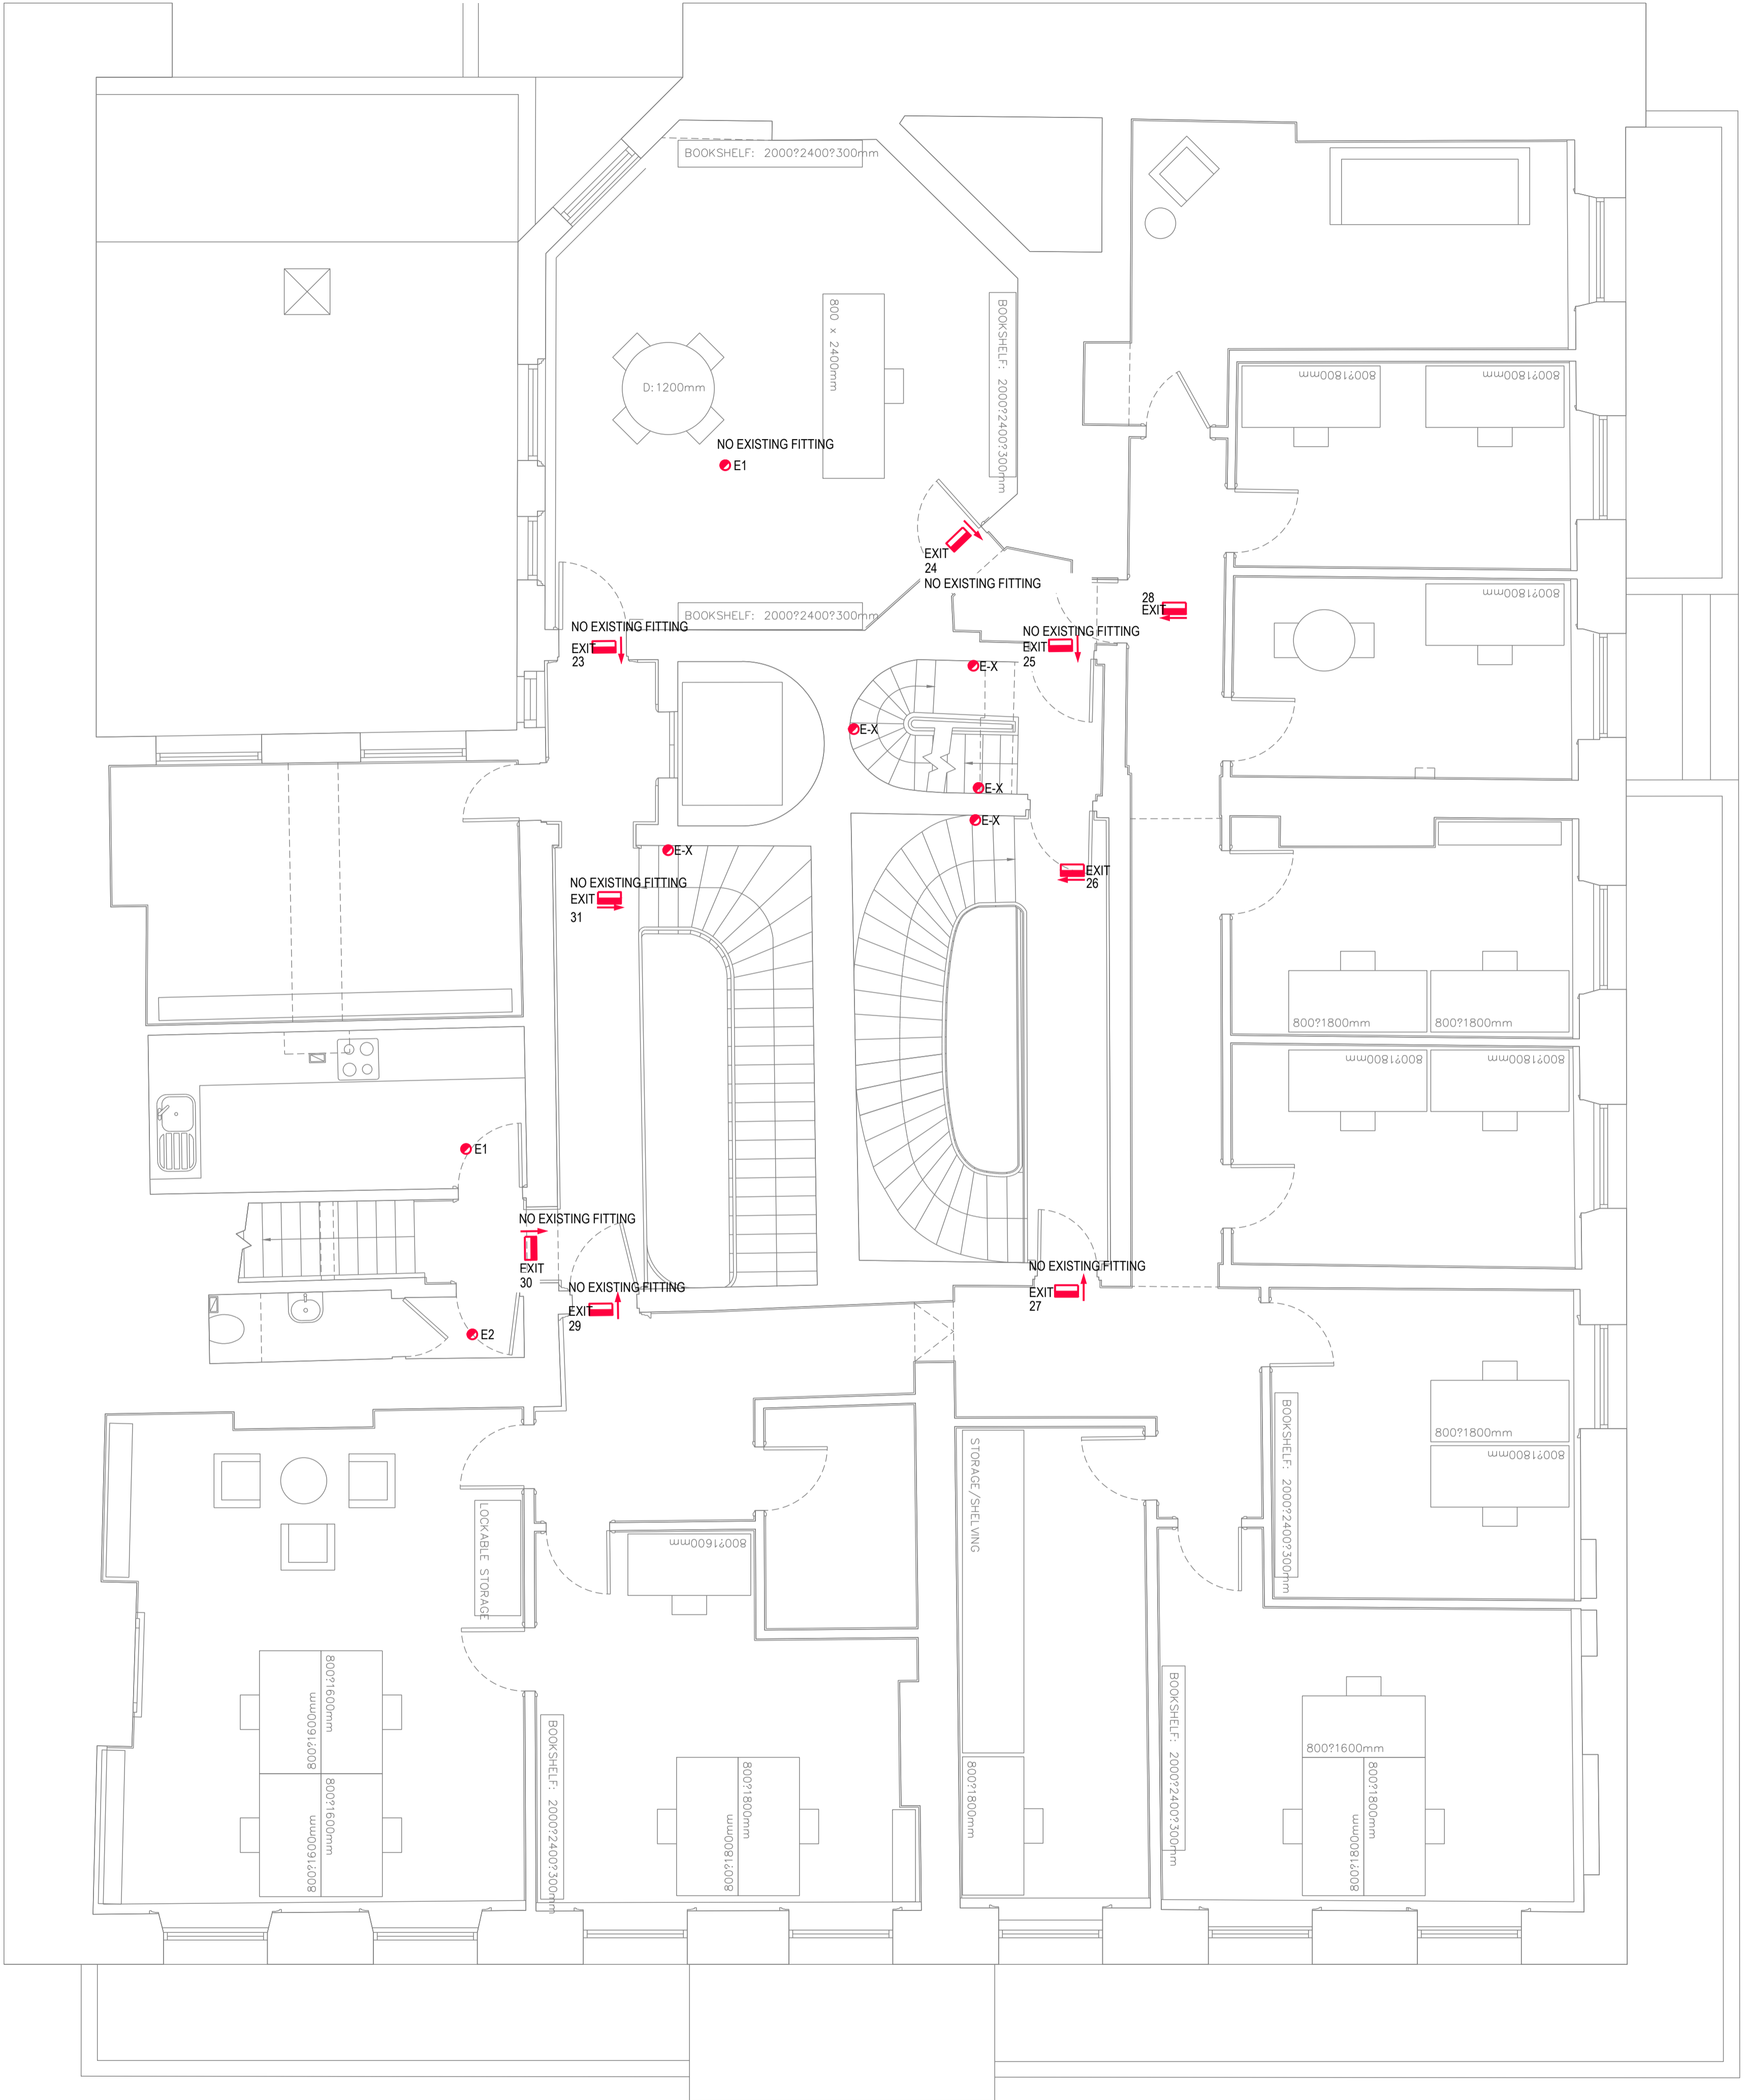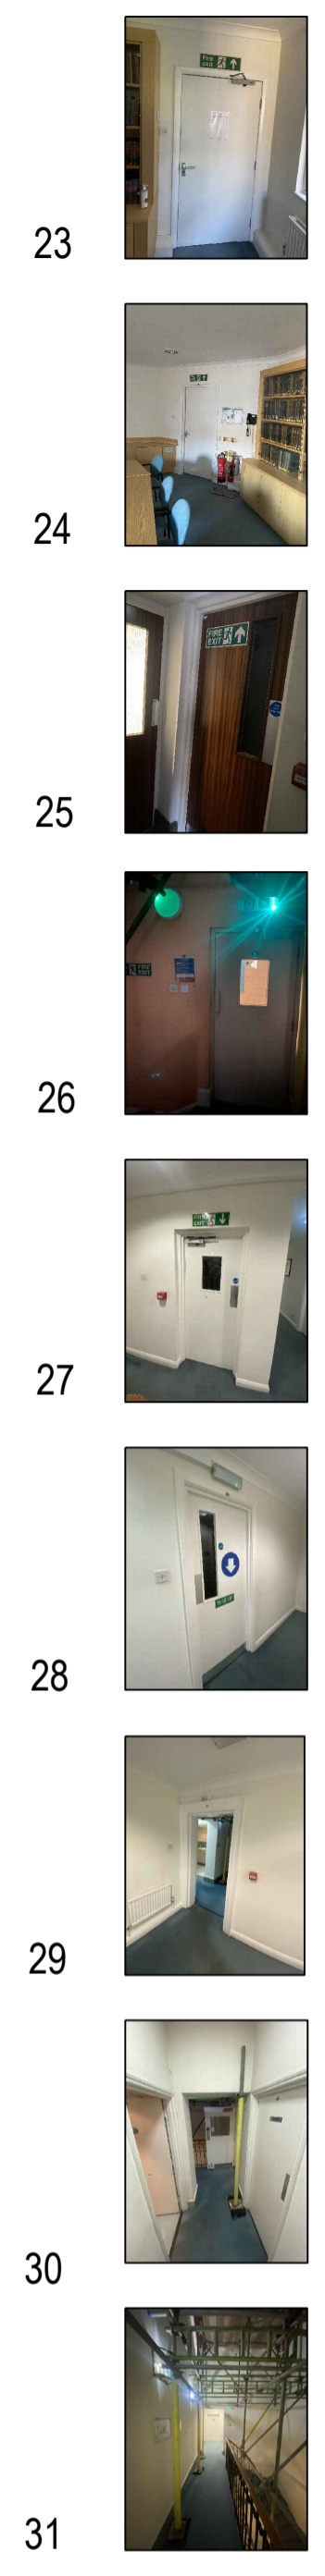

P03	TENDER ISSUE	VK	TD	AJ	19.10.23
P02	TENDER ISSUE	VK	TD	AJ	05.09.23
P01	PRELIMINARY ISSUE	JM	AJ	AJ	03.08.23
REV	DESCRIPTION	BY	CHK	APP	DATE

Project Status: **LBC SUBMISSION**



The Multi-disciplinary Engineering Consultancy
 Unit A2, Hatchers Yard, 9 Tanner Street
 London, SE1 3LE
 T 44 (0) 203 735 5060
 E london@harleyhaddow.com
 Edinburgh | Glasgow | London | Manchester
 harleyhaddow.com
 Association for Consultancy and Engineering Member Firm

Project: 310311
GERMAN HISTORICAL INSTITUTE
17 BLOOMSBURY SQUARE

Drawing Title:
SECOND FLOOR PROPOSED EMERGENCY AND EXIT LIGHTING







Scale @ A1	Date	Engineer
1:50	JUNE 2023	AJ
Drawing No.	Revision	
310311-HAH-XX-02-D-E-06310	P03	

THIS DRAWING IS INDICATIVE AND REPRESENTS ONLY THE DESIGN INTENT, THE CONTRACTOR MUST PRODUCE FULLY CO-ORDINATED WORKING / INSTALLATION DRAWINGS AS REFERRED TO IN THE CONTRACT DOCUMENTATION

LIGHTING NOTES

- DO NOT SCALE FROM THIS DRAWING. ALL DIMENSIONS INDICATED ARE IN MILLIMETRES
- DRAWING TO BE READ IN CONJUNCTION WITH SPECIFICATION, DOCUMENTATION, DRAWINGS & ALL RELEVANT BRITISH STANDARD DOCUMENTS
- ALL ELECTRICAL WORKS SHALL COMPLY WITH 18TH EDITION IEE WIRING REGS BS7671:2018-A2:2022, INCLUDING ALL CURRENT AMENDMENTS AND GUIDANCE NOTES AND THE CURRENT BUILDING STANDARDS REGULATIONS
- THE INSTALLATION SHALL ONLY BE CERTIFIED BY A PERSON OR A COMPANY HAVING MEMBERSHIP TO S.E.L.E.C.T. OR N.I.E.I.C. OR SIMILAR ELECTRICAL SCHEMES
- FINAL LOCATIONS OF ALL VISIBLE ELECTRICAL EQUIPMENT TO BE COORDINATED WITH ARCHITECT

LEGEND

-  E2 EMERGENCY ESCAPE RECESSED LIGHTING
ZUMTOBEL RESCLITE PRO MRCR RSC E3DG5 WH 42936332
-  E1 EMERGENCY ANTI PANIC RECESSED EMERGENCY LIGHT
ZUMTOBEL RESCLITE PRO MRCR ANT E3DG5 WH 42934755
-  E3 EMERGENCY ESCAPE SURFACE MOUNTED LIGHTING
PHILIP PAYNE LANTIS BULKHEAD L300
-  E4 EMERGENCY WALL MOUNTED LIGHTING
IGUIZZINI MOTUS ANTIPANIC QY39 LIGHT FITTING.
-  EXIT WALL MOUNTED EXIT LIGHTS
VIABIZZUNO MERCATO 230 GRUPPO 101 FITTING
-  E-X EMERGENCY LIGHTING TO BE PROVIDED AS A MINIMUM AT THIS POSITION INTEGRATED INTO THE ARCHITECTURAL LIGHTING DESIGNERS FITTING. REFER TO LIGHTING DESIGNERS PACKAGE FOR FURTHER INFORMATION.

P03	TENDER ISSUE	VK	TD	AJ	19.10.23
P02	TENDER ISSUE	VK	TD	AJ	05.09.23
P01	PRELIMINARY ISSUE	JM	AJ	AJ	03.08.23
REV	DESCRIPTION	BY	CHK	APP	DATE

Project Status:
LBC SUBMISSION




The Multi-disciplinary Engineering Consultancy
Unit A2, Hatchers Yard, 9 Tanner Street
London, SE1 3LE
T 44 (0) 203 735 5060
E london@harleyhaddow.com
Edinburgh | Glasgow | London | Manchester
harleyhaddow.com
Association for Consultancy and Engineering Member Firm

Project: 310311
**GERMAN HISTORICAL INSTITUTE
17 BLOOMSBURY SQUARE**

Drawing Title:
THIRD FLOOR PROPOSED EMERGENCY AND EXIT LIGHTING

Scale @ A1	Date	Engineer
1:50	JUNE 2023	AJ
Drawing No.	Revision	
310311-HAH-XX-03-D-E-06310	P03	

32
33
34
35
36
37
38
39

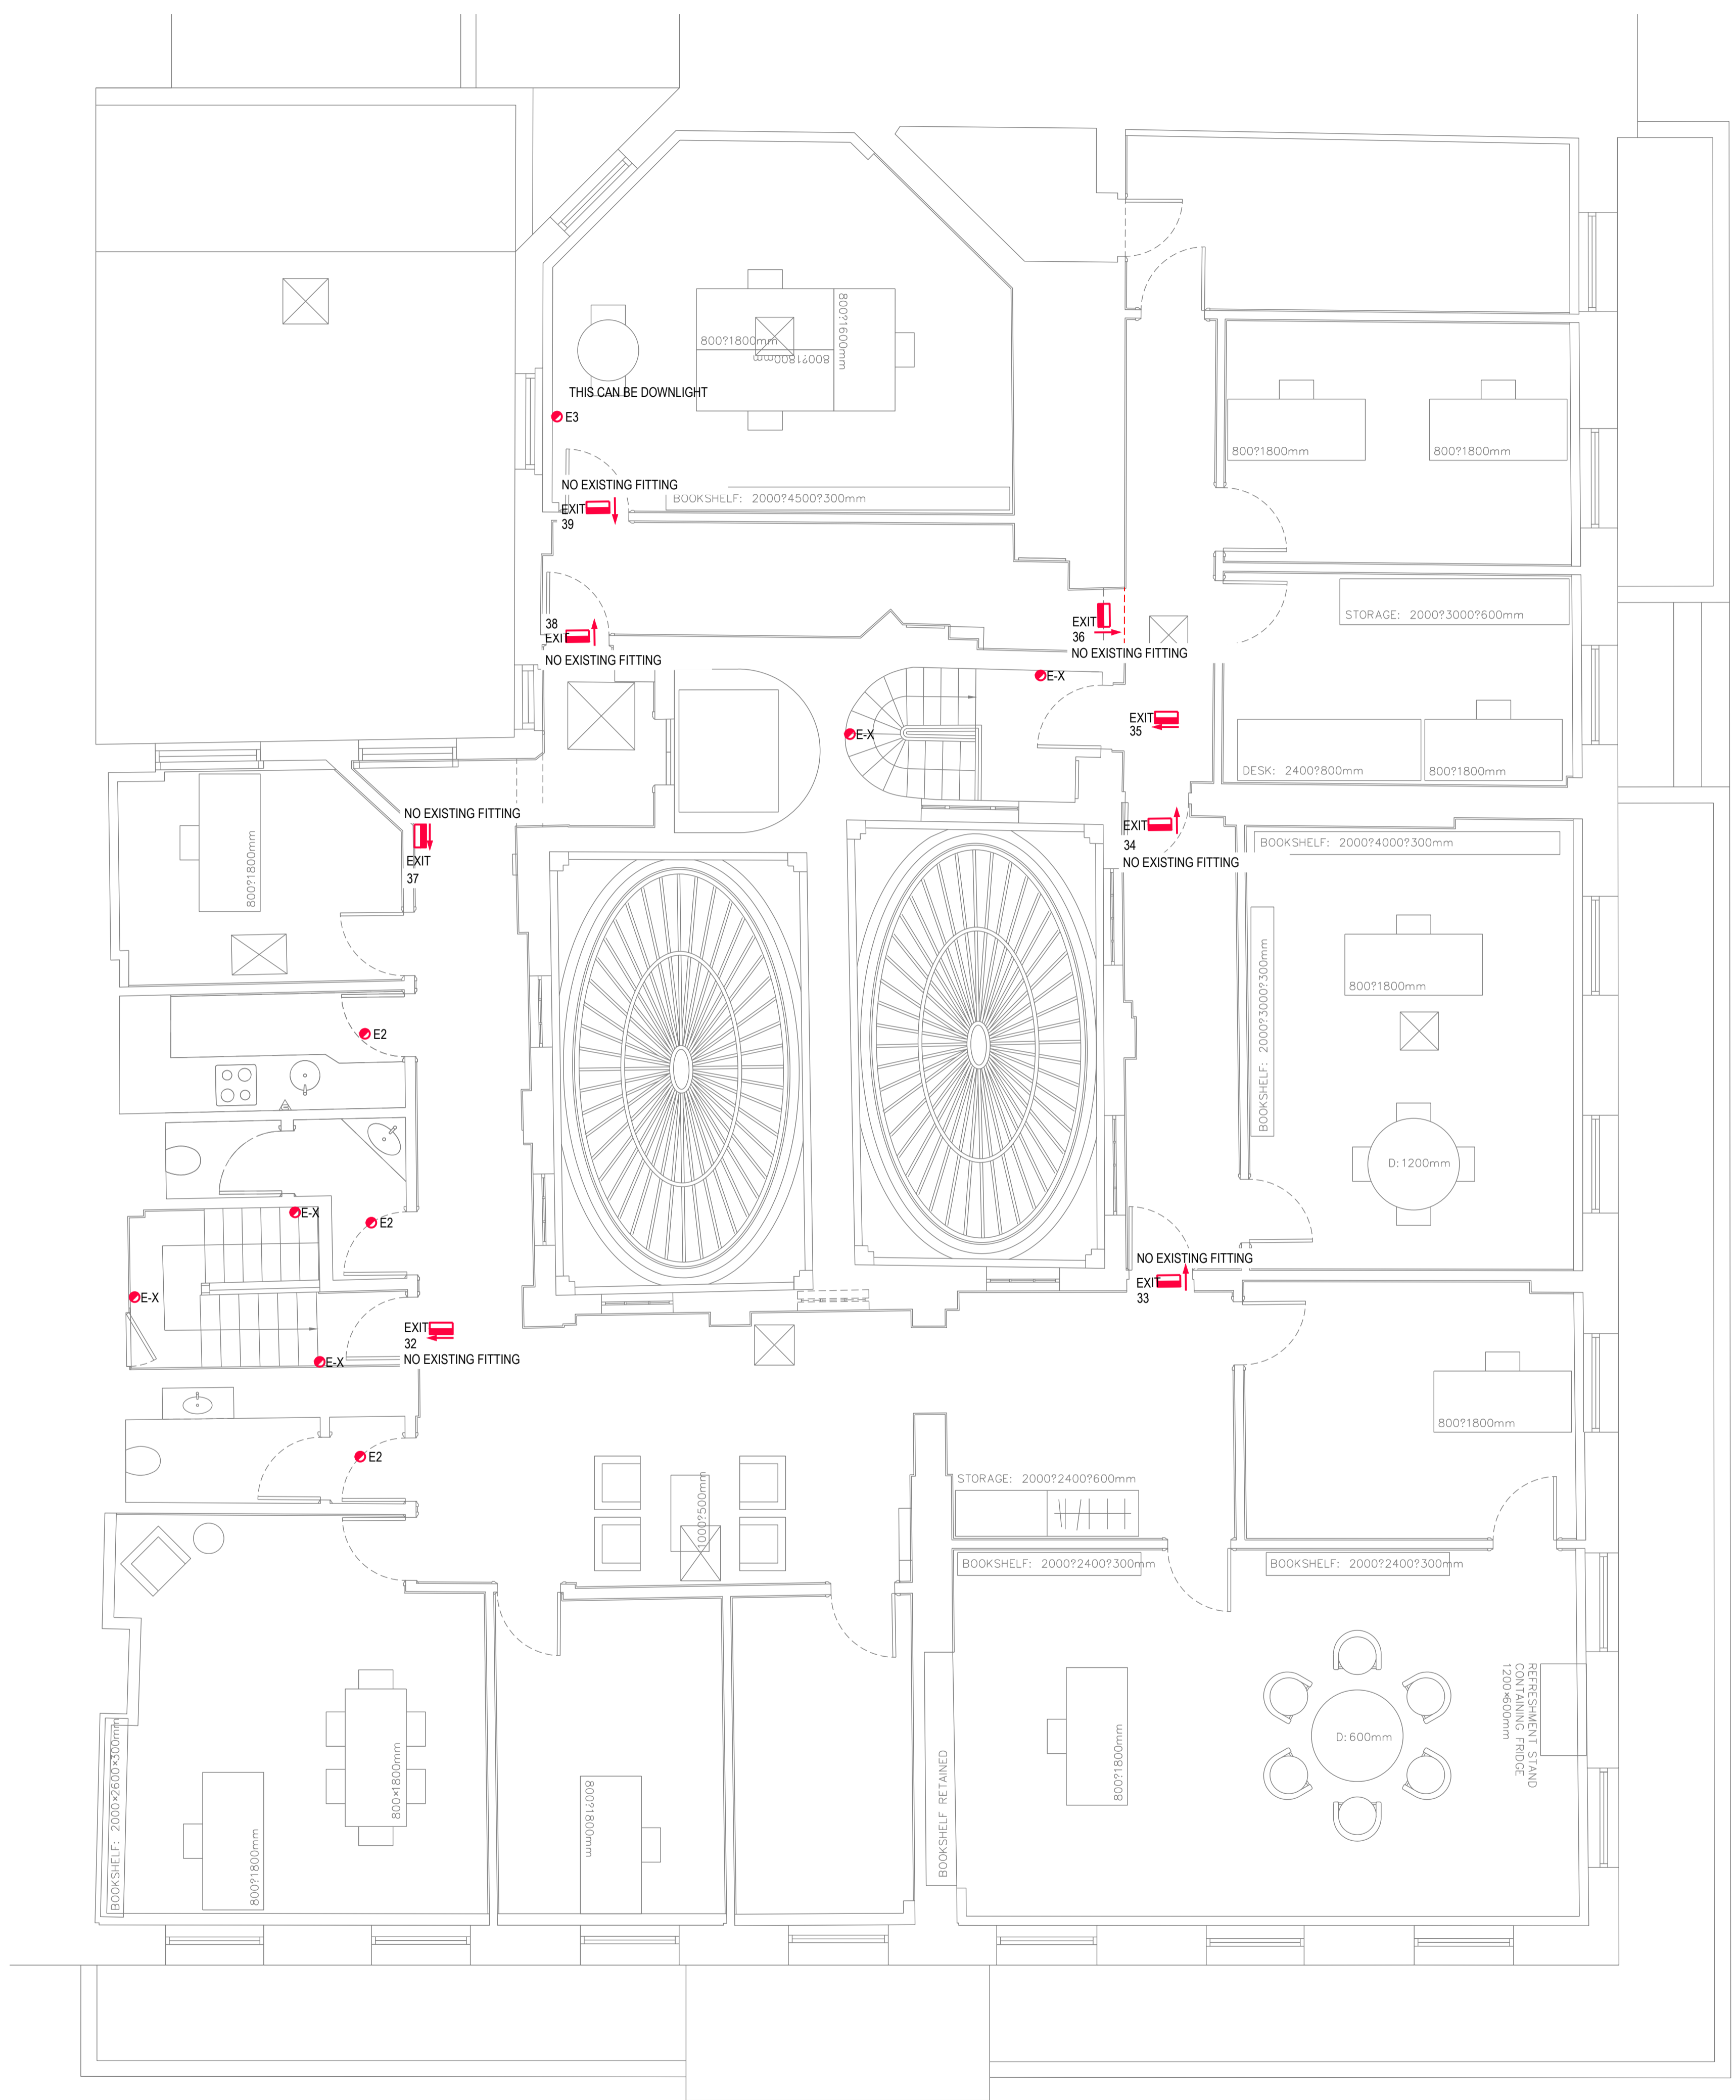












THIS DRAWING IS INDICATIVE AND REPRESENTS ONLY THE DESIGN INTENT, THE CONTRACTOR MUST PRODUCE FULLY CO-ORDINATED WORKING / INSTALLATION DRAWINGS AS REFERRED TO IN THE CONTRACT DOCUMENTATION

LIGHTING NOTES

- DO NOT SCALE FROM THIS DRAWING. ALL DIMENSIONS INDICATED ARE IN MILLIMETRES
- DRAWING TO BE READ IN CONJUNCTION WITH SPECIFICATION, DOCUMENTATION, DRAWINGS & ALL RELEVANT BRITISH STANDARD DOCUMENTS
- ALL ELECTRICAL WORKS SHALL COMPLY WITH 18TH EDITION IEE WIRING REGS BS7671:2018+A2:2022, INCLUDING ALL CURRENT AMENDMENTS AND GUIDANCE NOTES AND THE CURRENT BUILDING STANDARDS REGULATIONS
- THE INSTALLATION SHALL ONLY BE CERTIFIED BY A PERSON OR A COMPANY HAVING MEMBERSHIP TO S.E.L.E.C.T. OR N.I.C.E.I.C. OR SIMILAR ELECTRICAL SCHEMES
- FINAL LOCATIONS OF ALL VISIBLE ELECTRICAL EQUIPMENT TO BE COORDINATED WITH ARCHITECT

LEGEND

-  E2 EMERGENCY ESCAPE RECESSED LIGHTING
 ZUMTOBEL RESCLITE PRO MRCR RSC E3DG5 WH 42936332
-  E1 EMERGENCY ANTI PANIC RECESSED EMERGENCY LIGHT
 ZUMTOBEL RESCLITE PRO MRCR ANT E3DG5 WH 42934755
-  E3 EMERGENCY ESCAPE SURFACE MOUNTED LIGHTING
 PHILIP PAYNE LANTIS BULKHEAD L300
-  E4 EMERGENCY WALL MOUNTED LIGHTING
 IGUIZINNI MOTUS ANTIPANIC QY39 LIGHT FITTING.
-  EXIT WALL MOUNTED EXIT LIGHTS
 VIABIZZUNO MERCATO 230 GRUPPO 101 FITTING

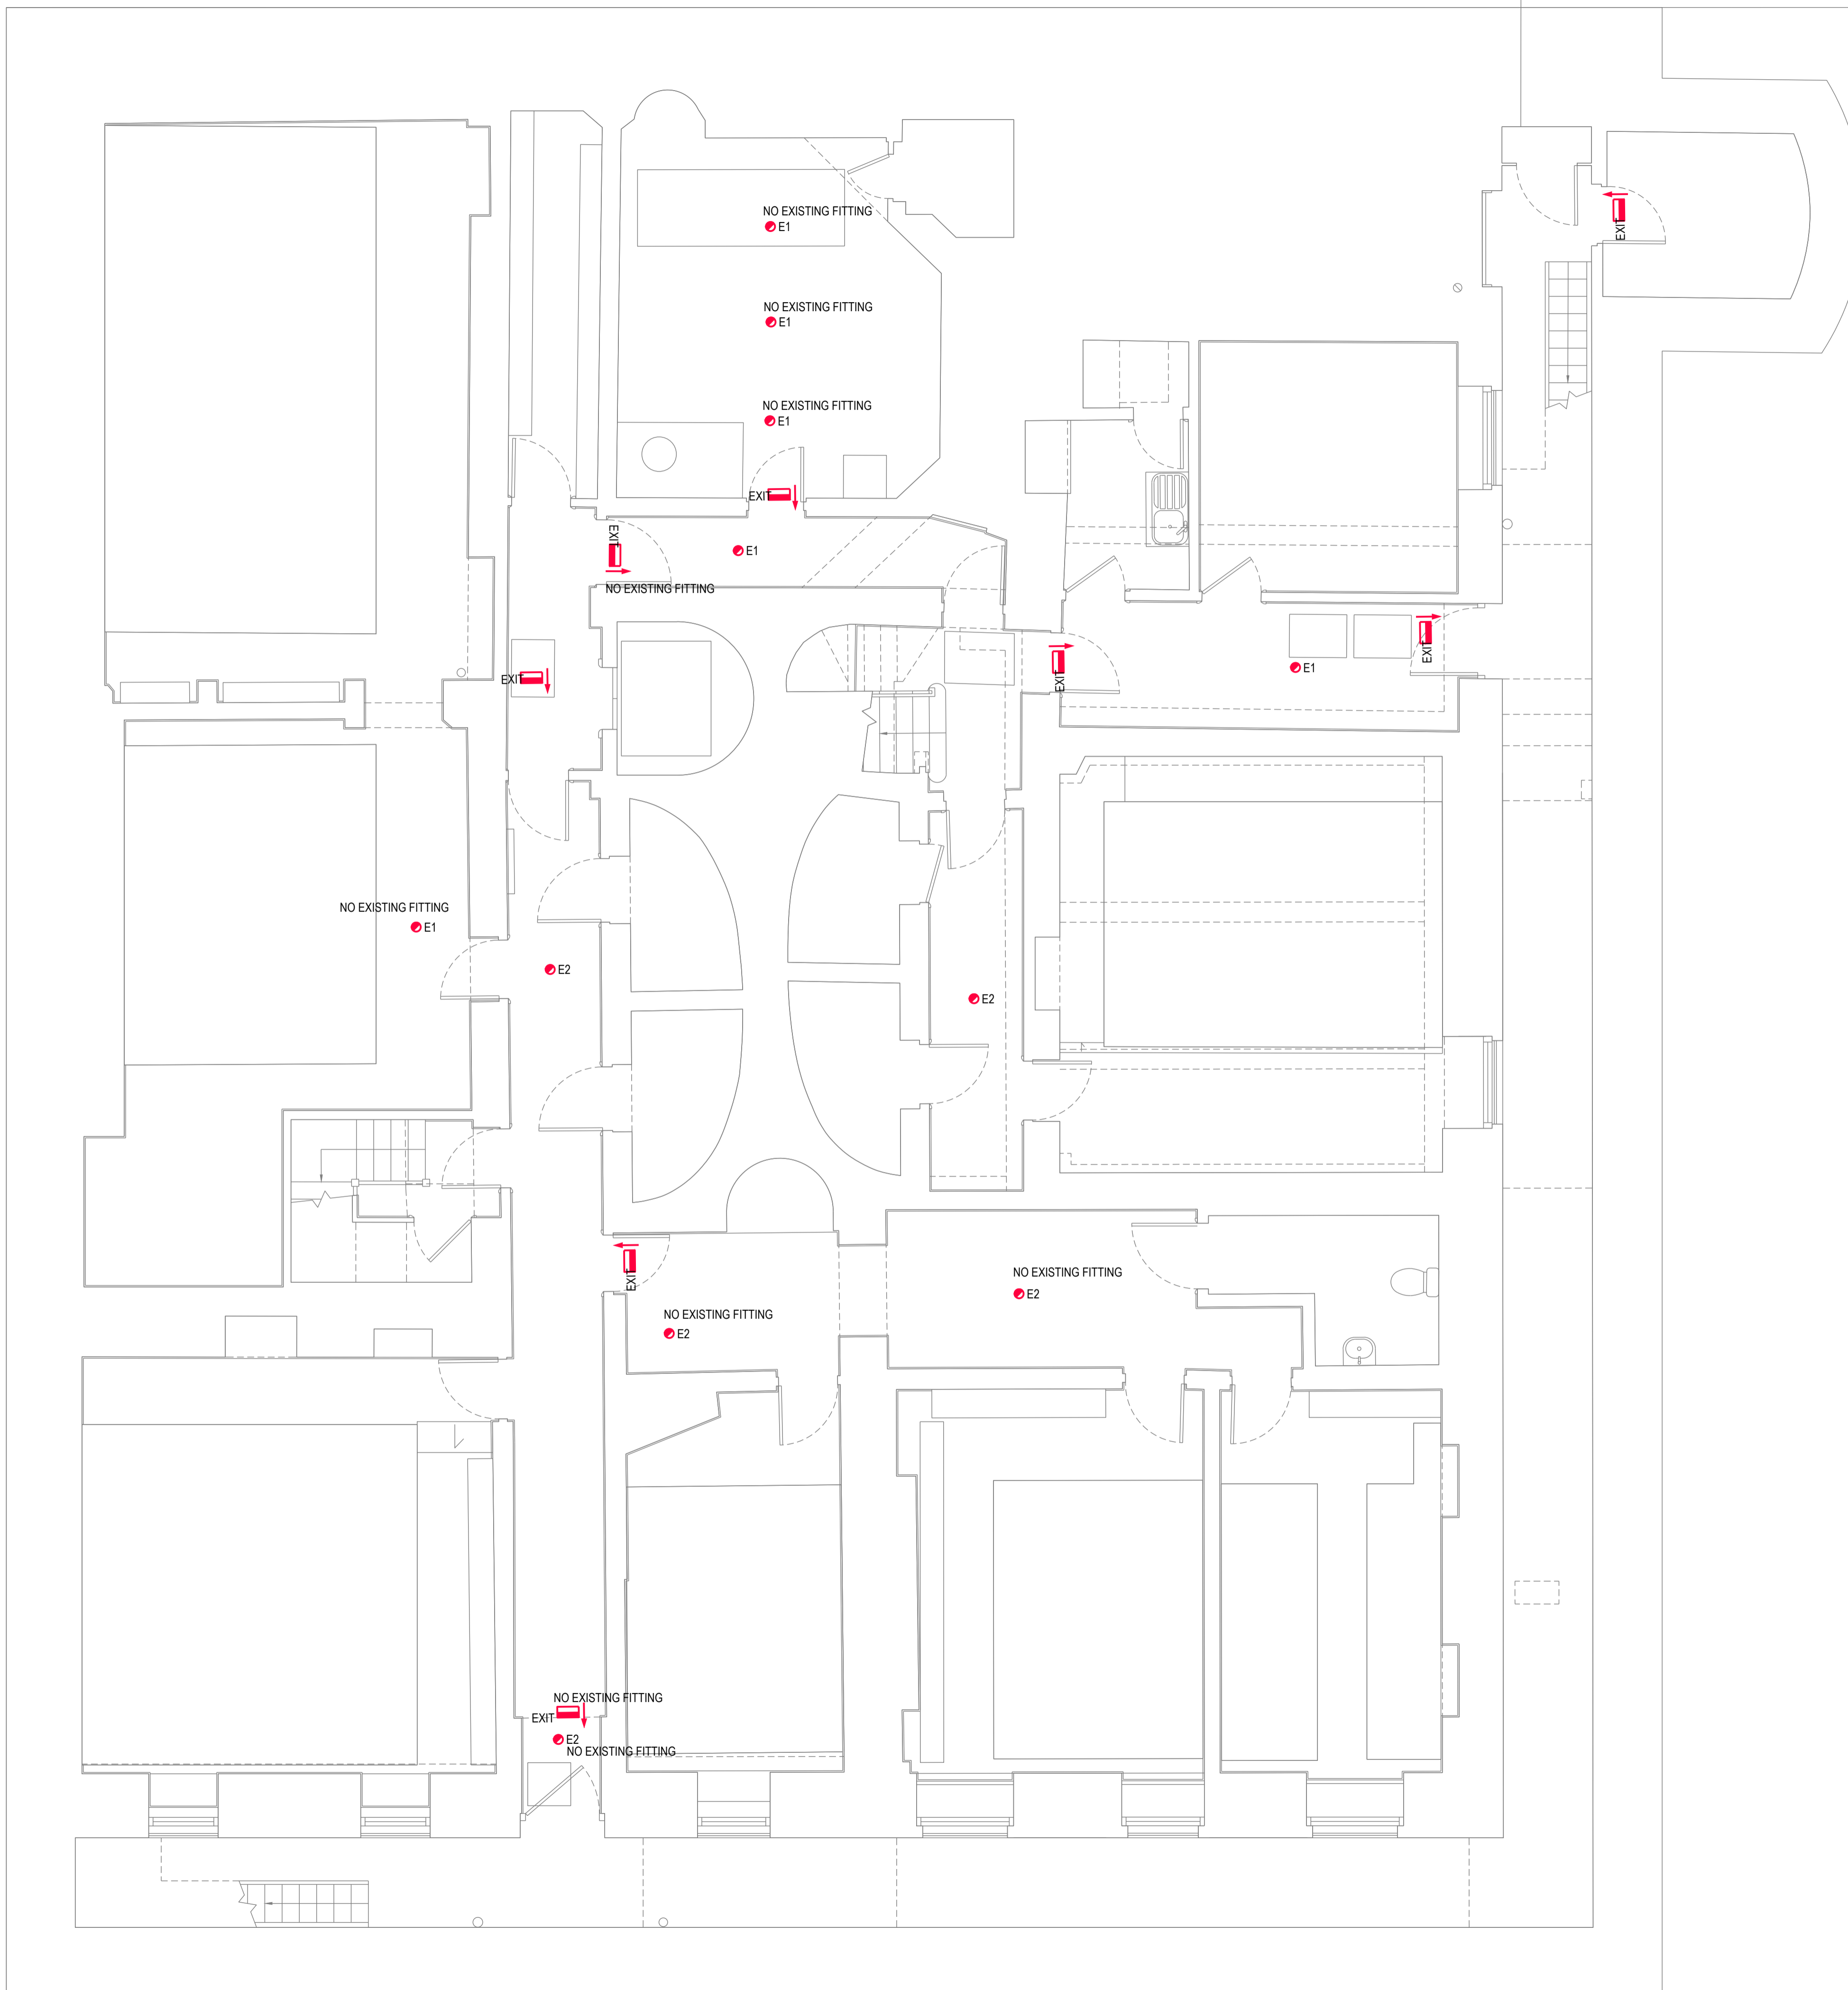

P03	TENDER ISSUE	VK	TD	AJ	19.10.23
P02	TENDER ISSUE	VK	TD	AJ	05.09.23
P01	PRELIMINARY ISSUE	JM	AJ	AJ	03.08.23
REV	DESCRIPTION	BY	CHK	APP	DATE

Project Status:
LBC SUBMISSION

The Multi-disciplinary Engineering Consultancy

h HARLEY HADDOW

Unit A2, Hatchers Yard, 9 Tanner Street
London, SE1 3LE
T 44 (0) 203 735 5060
E london@harleyhaddow.com
Edinburgh | Glasgow | London | Manchester
harleyhaddow.com
Association for Consultancy and Engineering Member Firm

Project: 310311
GERMAN HISTORICAL INSTITUTE
17 BLOOMSBURY SQUARE

Drawing Title:
BASEMENT FLOOR PROPOSED EMERGENCY AND EXIT LIGHTING

Scale @ A1	Date	Engineer
1:50	JUNE 2023	AJ
Drawing No.	Revision	
310311-HAH-XX-B1-D-E-06310	P03	