

SAVILLE THEATRE

135 SHAFTESBURY AVENUE


AIR QUALITY ASSESSMENT
34/13914

HOARE LEA

**Former Saville Theatre.
135-149 Shaftesbury Avenue,
London.
YC Saville Theatre Limited.**

AIR QUALITY
AIR QUALITY ASSESSMENT

REVISION 04 – 22 JANUARY 2025

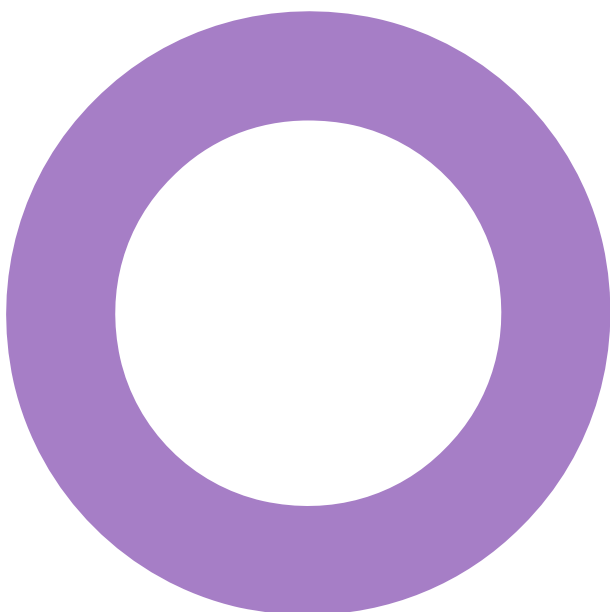

Audit sheet.

Rev.	Date	Description of change / purpose of issue	Prepared	Reviewed	Authorised
00	18/01/2024	First Draft	AJ	OP	AD
01	23/01/2024	First Issue	AJ	OP	CE
02	29/01/2024	Second Issue	AJ	OP	CE
03	31/01/2024	Third Issue	TB	AD	AD
04	22/01/2025	Fourth Issue	AJ	OP	CE
05	27/01/2025	Fifth Issue	AJ	OP	OP

This document has been prepared for YC Saville Theatre Limited only and solely for the purposes expressly defined herein. We owe no duty of care to any third parties in respect of its content. Therefore, unless expressly agreed by us in signed writing, we hereby exclude all liability to third parties, including liability for negligence, save only for liabilities that cannot be so excluded by operation of applicable law. The consequences of climate change and the effects of future changes in climatic conditions cannot be accurately predicted. This report has been based solely on the specific design assumptions and criteria stated herein.

Project number: 34/13914

Document reference: 3413914-HLE-RP-AQ-Shaftesbury Avenue AQA_Rev05.docx

Contents.

Audit sheet.	2
Contents.	3
Executive Summary.	5
1. Introduction.	6
1.1 Proposed Development.	6
1.2 Application Site Description and Location.	6
1.3 Scope of Assessment.	7
2. Legislation, Policy and Guidance Documents.	8
2.1 Air Quality Strategy and Local Air Quality Management.	8
2.2 EU Limit Values.	9
2.3 World Health Organisation Guideline values.	9
2.4 Statutory Nuisance Legislation.	9
2.5 Clean Air Strategy.	9
2.6 Building Regulations	10
2.7 Planning Policy.	10
2.8 Local Policy.	11
2.9 Assessment Guidance and Standards.	14
3. Methodology of Assessment.	15
3.1 Consultation.	15
3.2 Existing Air Quality in the Study Area.	15
3.3 Construction Phase Impacts.	15
3.4 Operational Phase Impacts.	16
3.5 Assessment of Significance.	16
4. Baseline Environment.	18
4.1 Local Air Quality Management Review and Assessment.	18
4.2 Local Air Quality Monitoring.	18
4.3 Industrial Pollution.	22
4.4 Defra Predicted Concentrations.	22
4.5 Greater London Authority	23
4.6 Summary of Background Data.	26
5. Construction Phase Assessment.	27
5.1 Construction Phase Dust Assessment.	27

5.2 Construction Phase – Vehicular Pollutants.	30
5.3 Construction Phase – Non-road Mobile Machinery.	30
6. Operational Phase Assessment.	31
6.1 Road Traffic Emissions Screening Assessment.	31
6.2 Site Suitability Assessment.	31
6.3 Air Quality Neutral Assessment	33
7. Mitigation.	34
7.1 Construction Phase.	34
7.2 Operational Phase.	36
8. Summary and Conclusions.	38
9. Glossary of Terms.	39
References.	40
Appendix 1 - EHO Consultation.	42
Appendix 2 - Professional Experience.	44

Executive Summary.

Hoare Lea have been commissioned by YC Saville Theatre Limited to undertake an Air Quality Assessment to support the planning application for the proposed redevelopment at former Saville Theatre at 135-149 Shaftesbury Avenue, London, WC2H 8AH (the 'Application Site').

The Proposed Development comprises the part demolition, restoration and refurbishment of the existing Grade II listed building, roof extension, and excavation of basement space, to provide a theatre (Sui Generis) at lower levels; restaurant / bar and office space (Class E(b) / Class E(g) / Sui Generis) at ground floor level; and hotel (Class C1) at upper levels; provision of ancillary cycle parking, servicing and rooftop plant, and other associated works (the 'Proposed Development').

Since the previous submission of the Air Quality Assessment, the Proposed Development plans have been amended. The total number of floors proposed has been reduced by one. This has not changed the outcomes or conclusions of the Air Quality Assessment. This report has been updated to reflect new air quality monitoring data released since the previous submission.

The baseline assessment has shown that the Application Site is located within the Camden Air Quality Management Area (AQMA), but not within an Air Quality Focus Area (AQFA). There were no exceedances of the 1-hour mean Air Quality Objective (AQO) for Nitrogen Dioxide (NO₂), or the annual mean AQOs and World Health Organisation (WHO) guidelines for NO₂ or particulate matter (PM₁₀ and PM_{2.5}) were recorded at automatic monitoring locations in 2023, the most recent year of available representative data. However, two exceedances of the annual mean NO₂ AQO and WHO guideline were recorded at passive diffusion tube monitoring locations in the vicinity of the Application Site in 2023.

The impacts of demolition and construction work on dust soiling and ambient fine particulate matter concentrations have been assessed and appropriate mitigation measures have been identified. Provided these mitigation measures are implemented and included within a dust management plan, for example through a planning condition, the residual impacts are considered to be not significant.

The traffic generated by the Proposed Development was supplied by Momentum Transport, the appointed transport consultant, and has been screened against the criteria set-out in the Environmental Protection United Kingdom (EPUK) and Institute of Air Quality Management (IAQM) planning guidance to determine the need for a detailed assessment. This showed that the potential impact of additional road traffic on local air quality is considered insignificant and a detailed assessment is not required.

The energy strategy for the primary supply to the Proposed Development is all electric utilising Air Source Heat Pumps (ASHPs), a zero emission technology. A diesel generator is also proposed for emergency back-up use only and will be tested for maintenance purposes for fewer than 18 hours per year. As no combustion sources are proposed for the primary energy supply, no local air quality impacts are anticipated and a detailed assessment of impacts of combustion emissions from the energy plant has been screened out of this assessment.

The Proposed Development is considered air quality neutral with regard to building and transport emissions, in line with the London Plan Air Quality Neutral Guidance, and as such no mitigation for either building or transport emissions are required.

A qualitative site suitability assessment shows that pollutant concentrations are in compliance with the relevant Air Quality Objectives (AQOs) and therefore, the Application Site is considered suitable for theatre and hotel use without mitigation.

Based on the assessment results, the Application Site is considered suitable for the Proposed Development without the inclusion of mitigation. Air quality should therefore not be considered as a constraint to the planning consent and the Proposed Development conforms to the principles of the National Planning Policy Framework Plan, the London Plan 2021 policies, the Camden Local Plan.

1. Introduction.

Hoare Lea have been commissioned by YC Saville Theatre Limited to undertake an Air Quality Assessment to support the planning application for the proposed redevelopment of the former Saville Theatre at 135-149 Shaftesbury Avenue, London, WC2H 8AH (the 'Application Site').

1.1 Proposed Development.

The Proposed Development comprises the part demolition, restoration and refurbishment of the existing Grade II listed building, roof extension, and excavation of basement space, to provide a theatre (Sui Generis) at lower levels; restaurant / bar and office space (Class E(b) / Class E(g) / Sui Generis) at ground floor level; and hotel (Class C1) at upper levels; provision of ancillary cycle parking, servicing and rooftop plant, and other associated works (the 'Proposed Development').

Since the previous submission of the Air Quality Assessment, the Proposed Development plans have been amended. The total number of floors proposed has been reduced by one. This has not changed the outcomes or conclusions of the Air Quality Assessment. This report has been updated to reflect new air quality monitoring data released since the previous submission.

The energy strategy for the primary supply to the Proposed Development is all electric utilising Air Source Heat Pumps (ASHPs), a zero emission technology. A diesel generator is also proposed for emergency back-up use only and will be tested for maintenance purposes for fewer than 18 hours per year. As no combustion sources are proposed for the primary energy supply, no local air quality impacts are anticipated and a detailed assessment of impacts of combustion emissions from the energy plant has been screened out of this assessment.


The proposed ventilation strategy for the Proposed Development will be served by multiple Air Handling Units (AHUs). The AHUs for the theatre will be located in the basement, the AHUs for the hotel communal spaces will be located on each floor, and the AHUs for the hotel rooms will be located on the roof. All intakes and exhausts will be through louvres wrapped around the upper sections of the building.

1.2 Application Site Description and Location.

The Application Site is located within the London Borough of Camden (LBC) administrative area at the approximate National Grid Reference (NGR): 529980, 181150. The Application Site is an island site, bordered by Shaftesbury Avenue to the south, St Giles Passage to the east, Stacey Street to the west, and New Compton Street to the north. The surrounding buildings primarily comprise commercial and office developments.

The Application Site is currently a cinema.

Figure 1 illustrates the location of the Application Site.

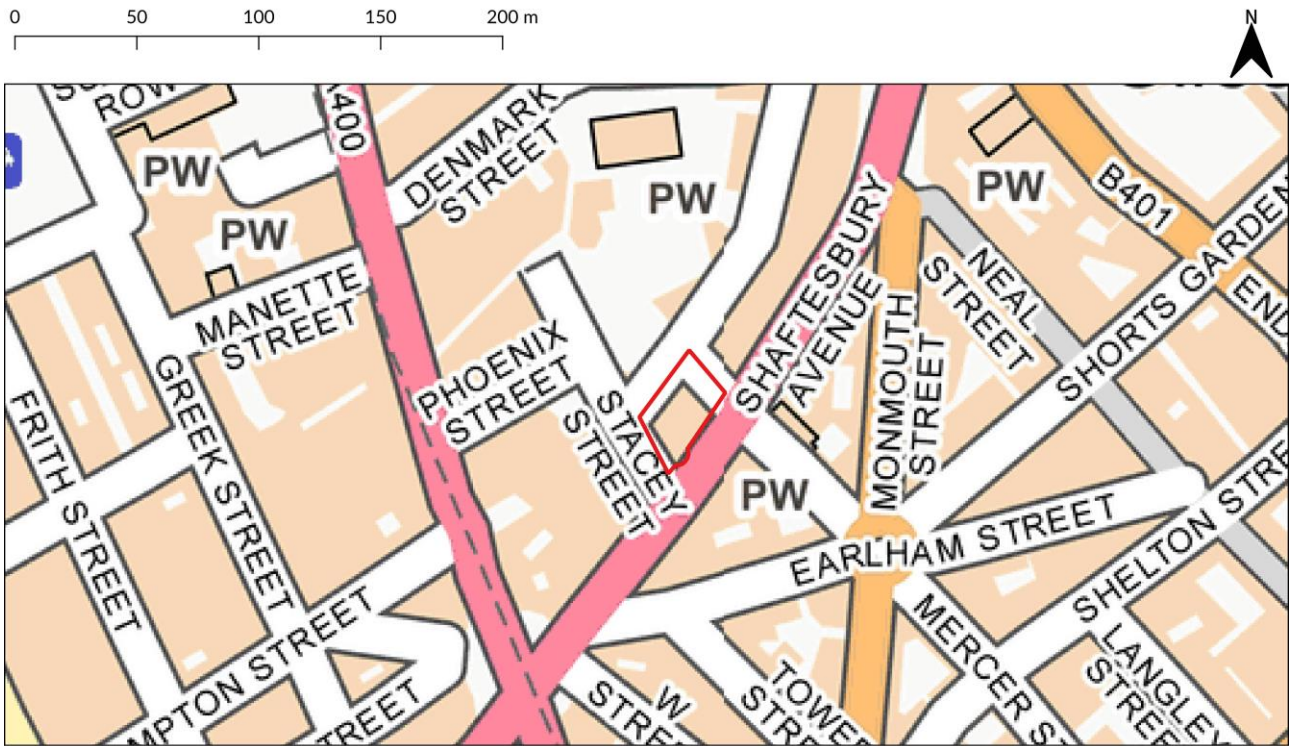

Legend

 Approximate Application Site Boundary

Figure 1: Approximate location of the Application Site. Contains OS Data © Crown Copyright and Database rights 2024.

1.3 Scope of Assessment.

An email detailing the proposed methodology for the Air Quality Assessment was provided to LBC on the 9th of January 2024. At the time of writing, a response has not yet been received. A copy of the correspondence with LBC has been included in Appendix 1.

A summary of the scope of the assessment includes:

- Review of National and Local Policy;
- Determination of baseline scenario, using LBC monitoring data;
- Assessment of potential air quality impacts during the construction phase;
- Assessment of potential air quality impacts during the operational phase;
- Assessment of air quality neutral;
- An assessment of the suitability of the Application Site for its proposed theatre and hotel use; and
- Identification of required mitigation measures.

2. Legislation, Policy and Guidance Documents.

2.1 Air Quality Strategy and Local Air Quality Management.

The Environment Act 1995 (Part IV)¹ requires the Secretary of State to publish an air quality strategy and local authorities to review and assess the quality of air within their boundaries. The latter has become known as Local Air Quality Management (LAQM).

The Air Quality Strategy² provides the policy framework for local air quality management and assessment in the UK. It sets out air quality standards and objectives for key air pollutants. These standards and objectives are designed to protect human health and the environment. The Strategy also sets out how the different sectors of industry, transport and local government, can contribute to achieving these Air Quality Objectives (AQOs).

Local authorities are required to identify whether the AQOs have been, or will be, achieved at relevant locations, by the applicable date. If the AQOs are not achieved, the authority must declare an Air Quality Management Area (AQMA) and should prepare an action plan within 12 months. An action plan must identify appropriate measures and policies that can be introduced in order to work towards achieving the AQO(s).

The AQOs set out the extent to which the Government expects the standards to be achieved by a certain date. They take account of economic efficiency, practicability, technical feasibility and timescale. The AQOs for use by local authorities are prescribed within the Air Quality (England) Regulations 2000³, and the Air Quality (England) (Amendment) Regulations 2002⁴.

The AQOs for Nitrogen Dioxide (NO₂) and particulate matter (PM₁₀ and PM_{2.5}) are set out in Table 1. The AQOs for NO₂, PM₁₀ and PM_{2.5} were to have been achieved by 2005, 2004 and 2020 respectively and continue to apply in all future years thereafter.

The Environment Act 2021⁵ acts as the UK's new framework of environmental protection and came into force on 1st April 2022. With regard to air quality, the Environment Act establishes a legally binding duty on government to bring forward at least two new air quality targets in secondary legislation. This was implemented through the Environmental Improvement Plan 2023⁶ which outlines new PM_{2.5} targets for future years. These are a long term target of 10 µg/m³ by 2040 and an interim target of 12 µg/m³ by 31st January 2028. These targets are expected to focus on reducing concentrations of, and exposure to, PM_{2.5}.

Additionally, a new National Air Quality Strategy⁷ has been published in April 2023 which sets out a framework which should be followed by local authorities in England in support of Defra's long term air quality goals, including new PM_{2.5} targets.

Table 1: Air Quality Objectives for NO₂, PM₁₀ and PM_{2.5}

Pollutant	Time Period	Objective
Nitrogen Dioxide (NO ₂)	1-hour Mean	200 µg/m ³ Not to be exceeded more than 18 times a year
	Annual Mean	40 µg/m ³
Fine Particles (PM ₁₀)	24-hour Mean	50 µg/m ³ Not to be exceeded more than 35 times a year
	Annual Mean	40 µg/m ³
Fine Particles (PM _{2.5}) *	Annual Mean	20 µg/m ³
Notes: Measured gravimetrically *The time period in LLAQM.TG(19) states "Work towards reducing emissions/concentrations of fine particulate matter (PM _{2.5})"		

The AQOs apply at locations where members of the public are likely to be regularly present and exposed over the averaging period of the AQO. Examples of where the annual mean AQOs should apply are provided in the

London Local Air Quality Management Technical Guidance (LLAQM.TG(19))⁸, and include: building façade of residential properties, schools, hospitals. The annual mean AQOs are not relevant for the building façade of offices or other places of work where members of the public do not have regular access, kerbsides or gardens.

The 24-hour AQO for PM₁₀ is considered to apply at the same locations as the annual mean AQO, as well as in gardens of residential properties and at hotels.

The 1-hour AQO for NO₂ also applies wherever members of the public might regularly spend 1-hour or more, including outdoor eating locations, pavements of busy shopping streets, carparks and bus stations which are not fully enclosed. The 1-hour AQO does not apply at kerbside sites where the public do not have regular access.

2.2 EU Limit Values.

The European Union has also set limit values for NO₂, PM₁₀ and PM_{2.5}; these are legally binding and have been implemented into English legislation by The Air Quality Standards Regulations 2010⁹ and The Air Quality Standards (Amendment) Regulations 2016¹⁰.

The limit values for NO₂, PM₁₀ and PM_{2.5} are the same as the English objectives (given in Table 1), but applied from 2010 for NO₂, 2005 for PM₁₀ and 2015 for PM_{2.5}. The limit values apply at all locations (apart from where the public does not have access, where health and safety at work provisions apply and on the road carriageway).

2.3 World Health Organisation Guideline values.

The World Health Organisation (WHO) has produced air quality guidelines¹¹ to offer global guidance on thresholds and limits for key air pollutants that pose health risks. The Greater London Authority (GLA) confirmed that the relevant WHO guidelines referred to in the London Plan are from 2005 and as such these have been provided below in Table 2 for NO₂, PM₁₀ and PM_{2.5} concentrations. The WHO published updated air quality guidelines in 2021¹², however these have not been adopted into policy at the current time.

Table 2: WHO guidelines for NO₂, PM₁₀ and PM_{2.5}

Pollutant	Time Period	Objective
NO ₂	1-hour Mean	200 µg/m ³ Not to be exceeded more than 18 times a year
	Annual Mean	40 µg/m ³
PM ₁₀	Annual Mean	20 µg/m ³
PM _{2.5}	Annual Mean	10 µg/m ³

2.4 Statutory Nuisance Legislation.

Part III of the Environmental Protection Act (EPA) 1990 (as amended)¹³ contains the main legislation on Statutory Nuisance and allows local authorities and individuals to take action to prevent a statutory nuisance. Section 79 of the EPA defines, amongst other things, smoke, fumes, dust and smells emitted from industrial, trade or business premises so as to be prejudicial to health or a nuisance, as a potential Statutory Nuisance.

Fractions of dust greater than 10 µm (i.e. greater than PM₁₀) in diameter typically relate to nuisance effects as opposed to potential health effects and therefore are not covered within the UK Air Quality Strategy. In legislation there are currently no numerical limits in terms of what level of dust deposition constitutes a nuisance.

2.5 Clean Air Strategy.

The Clean Air Strategy (CAS)¹⁴, published in 2019, sets out the Government's proposals aimed at delivering cleaner air in England, and also indicates how devolved administrations intend to make emissions reductions. It sets out the comprehensive action that is required from across all parts of government and society to deliver clean air.

2.6 Building Regulations

The Building Regulations help to ensure that new buildings, conversions, renovations and extensions (domestic or commercial) will be safe, healthy and high performing. Detailed regulations cover specific topics including structural integrity, fire protection, accessibility, energy performance, acoustic performance, protection against falls, electrical and gas safety. Approved Document Part F of the Building Regulations (2021)¹⁵ provides guidance for indoor air quality and the pollutant concentrations that must not be exceeded in both buildings for dwellings and non-dwellings.

2.7 Planning Policy.

2.7.1 National Planning Policy Framework

The National Planning Policy Framework (NPPF) 2024¹⁶ sets out planning policy for England. It includes advice on when air quality should be a material consideration in development control decisions. Relevant sections are set out below:

Paragraph 187: *“Planning policies and decisions should contribute to and enhance the natural and local environment by: [...]”*

e) preventing new and existing development from contributing to, being put at unacceptable risk from, or being adversely affected by, unacceptable levels of soil, air, water or noise pollution or land instability. Development should, wherever possible, help to improve local environmental conditions such as air and water quality, taking into account relevant information such as river basin management plans. [...]”

Paragraph 198: *“Planning policies and decisions should also ensure that new development is appropriate for its location taking into account the likely effects (including cumulative effects) of pollution on health, living conditions and the natural environment, as well as the potential sensitivity of the site or the wider area to impacts that could arise from the development.”*

Paragraph 199: *“Planning policies and decisions should sustain and contribute towards compliance with relevant limit values or national objectives for pollutants, taking into account the presence of Air Quality Management Areas and Clean Air Zones, and the cumulative impacts from individual sites in local areas. Opportunities to improve air quality or mitigate impacts should be identified, such as through traffic and travel management, and green infrastructure provision and enhancement. So far as possible these opportunities should be considered at the plan-making stage, to ensure a strategic approach and limit the need for issues to be reconsidered when determining individual applications. Planning decisions should ensure that any new development in Air Quality Management Areas and Clean Air Zones is consistent with the local air quality action plan.”*

The NPPF is supported by Planning Practice Guidance (PPG)¹⁷.

The PPG states that:

Paragraph 001 (Reference ID: 32-001-20191101): *“Defra carries out an annual national assessment of air quality using modelling and monitoring to determine compliance relevant Limit Values. It is important that the potential impact of new development on air quality is taken into account in planning where the national assessment indicates that relevant limits have been exceeded or are near the limit or where the need for emissions reductions has been identified.”*

Paragraph 002 (Reference ID: 32-002-20191101): *“Plans may need to consider ways in which the development could be made appropriate in locations where air quality is or is likely to be a concern, and not give rise to unacceptable risks from pollution. This could, for example entail identifying measures for offsetting the impact on air quality arising from new development including supporting measures in an air quality action plan or low emissions strategy where applicable.”*

Paragraph 005 (Reference ID: 32-005-20191101): *“Whether air quality is relevant to a planning decision will depend on the proposed development and its location. Concerns could arise if the development is likely to have an adverse effect on air quality in areas where it is already known to be poor, particularly if it could affect the implementation of air quality strategies and action plans and / or breach legal obligations*

(including those relating to the conservation of habitats and species). Air quality may also be a material consideration if the proposed development would be particularly sensitive to poor air quality in its vicinity.“

The PPG also sets out the information that may be required in an air quality assessment, stating that:

Paragraph 007 (Reference ID: 32-007-20191101): *“Assessments need to be proportional to the nature and scale of development proposed and the potential impacts (taking into account existing air quality conditions), and because of this are likely to be locationally specific. The scope and content of supporting information is best discussed and agreed between the local planning authority and applicant before it is commissioned”.*

It also provides guidance on options for mitigating air quality impacts, and makes clear that:

Paragraph 008 (Reference ID: 32-008-20191101): *“Mitigation options will need to be locationally specific, will depend on the proposed development and need to be proportionate to the likely impact.”*

2.8 Local Policy.

2.8.1 The London Plan 2021

The London Plan 2021¹⁸ is the Spatial Development Strategy for Greater London. It sets out a framework for how London will develop over the next 20-25 years (covering the period 2019-2041) and the Mayor’s vision for Good Growth. The Plan is part of the statutory development plan for London, meaning that the policies in the Plan should inform decisions on planning applications across the capital.

The London Plan 2021 is the third London Plan, the previous ones being the 2004 London Plan and the 2011 London Plan. All of the other iterations of the London Plan from 2004-2016 have been alterations. This London Plan replaces all previous versions.

The following policy relating to air quality is contained within The London Plan 2021¹⁸: Policy SI 1 ‘Improving air quality’ states:

“A: Development Plans, through relevant strategic, site-specific and area-based policies, should seek opportunities to identify and deliver further improvements to air quality and should not reduce air quality benefits that result from the Mayor’s or boroughs’ activities to improve air quality.

B: To tackle poor air quality, protect health and meet legal obligations the following criteria should be addressed:

1) Development proposals should not:

- a) lead to further deterioration of existing poor air quality*
- b) create any new areas that exceed air quality limits, or delay the date at which compliance will be achieved in areas that are currently in exceedance of legal limits*
- c) create unacceptable risk of high levels of exposure to poor air quality.*

2) In order to meet the requirements in Part 1, as a minimum:

- a) development proposals must be at least Air Quality Neutral*
- b) development proposals should use design solutions to prevent or minimise increased exposure to existing air pollution and make provision to address local problems of air quality in preference to post-design or retro-fitted mitigation measures*
- c) major development proposals must be submitted with an Air Quality Assessment. Air quality assessments should show how the development will meet the requirements of B1.*
- d) development proposals in Air Quality Focus Areas or that are likely to be used by large numbers of people particularly vulnerable to poor air quality, such as children or older people should demonstrate that design measures have been used to minimise exposure.*

C: Masterplans and development briefs for large-scale development proposals subject to an Environmental Impact Assessment should consider how local air quality can be improved across the area of the proposal as part of an air quality positive approach. To achieve this a statement should be submitted demonstrating:

- 1) how proposals have considered ways to maximise benefits to local air quality, and*
- 2) what measures or design features will be put in place to reduce exposure to pollution, and how they will achieve this.*

D: In order to reduce the impact on air quality during the construction and demolition phase development proposals must demonstrate how they plan to comply with the Non-Road Mobile Machinery Low Emission Zone and reduce emissions from the demolition and construction of buildings following best practice guidance.

E: Development proposals should ensure that where emissions need to be reduced to meet the requirements of Air Quality Neutral or to make the impact of development on local air quality acceptable, this is done on-site. Where it can be demonstrated that emissions cannot be further reduced by on-site measures, off-site measures to improve local air quality may be acceptable, provided that equivalent air quality benefits can be demonstrated within the area affected by the development.”

The London Plan 2021 provides further information on Policy SI that requires consideration, as detailed below.

Section 9.1.2: *“The Mayor is committed to making air quality in London the best of any major world city, which means not only achieving compliance with legal limits for Nitrogen Dioxide as soon as possible and maintaining compliance where it is already achieved, but also achieving World Health Organisation targets for other pollutants such as Particulate Matter.”*

Section 9.1.3: *“The aim of this policy is to ensure that new developments are designed and built, as far as is possible, to improve local air quality and reduce the extent to which the public are exposed to poor air quality. This means that new developments, as a minimum, must not cause new exceedances of legal air quality standards, or delay the date at which compliance will be achieved in areas that are currently in exceedance of legal limits. Where limit values are already met or are predicted to be met at the time of completion, new developments must endeavour to maintain the best ambient air quality compatible with sustainable development principles.”*

Section 9.1.4: *“Where this policy refers to ‘existing poor air quality’ this should be taken to include areas where legal limits for any pollutant, or World Health Organisation targets for Particulate Matter, are already exceeded and areas where current pollution levels are within 5 per cent of these limits.”*

Additionally, Policy GG3 ‘Creating a healthy city’ states:

“To improve Londoners’ health and reduce health inequalities, those involved in planning and development must:

[...]

F seek to improve London’s air quality, reduce public exposure to poor air quality and minimise inequalities in levels of exposure to air pollution.”

2.8.2 The London Environment Strategy

The London Environment Strategy (LES), published in May 2018¹⁹, supersedes the previous Mayor’s Air Quality Strategy (MAQS) for London, published in December 2010. The LES aims to reduce pollution concentrations in London to achieve compliance within the EU limit values as soon as possible. The LES commits to the continuation of measures identified in the 2002 and 2010 MAQS and sets out a series of additional measures.

Proposal 4.3.3.a states that the London Strategy provides policies in which all new large-scale developments can not only become ‘Air Quality Positive’, but also maintain Air Quality Neutral requirements for all other developments. Within the planning guidance for building operations and transport emissions, information about

emission benchmarks for 'Air Quality Neutral' developments are set out. Any development that either meets or exceeds the benchmarks is considered air quality neutral as they avoid any increase in PM and NO_x emissions. In order for the benchmarks to remain relevant, the Mayor will continue to review them. To ensure that the requirements are met, execution of the air quality neutral policy will be monitored by utilising both the LLAQM and the London Plan monitoring report.

The following proposed policies relate to the planning process with regards to improving air quality:

Policy 4.2.2: *"Reduce emissions from non-road transport sources, including by phasing out fossil fuels;"*

Policy 4.2.3: *"Reduce emissions from non-transport sources, including by phasing out fossil fuels;"*

Policy 4.2.4: *"The Mayor will work with the government, the London boroughs and other partners to accelerate the achievement of legal limits in Greater London and improve air quality;"*

Policy 4.2.5: *"The Mayor will work with other cities (here and internationally), global city and industry networks to share best practice, lead action and support evidence-based steps to improve air quality;"*

Policy 4.3.1: *"The Mayor will establish new targets for PM_{2.5} and other pollutants where needed. The Mayor will seek to meet these targets as soon as possible, working with government and other partners;"*

Policy 4.3.2: *"The Mayor will encourage the take up of ultra-low and zero emission technologies to make sure London's entire transport system is zero emission by 2050 to further reduce levels of pollution and achieve WHO air quality guidelines;"*

Policy 4.3.3: *"Phase out the use of fossil fuels to heat, cool and maintain London's buildings, homes and urban spaces, and reduce the impact of building emissions on air quality;"*

Policy 4.3.4: *"Work to reduce exposure to indoor air pollutants in the home, schools, workplace and other enclosed spaces;"*

Furthermore, the LES outlines that negative consequences that can occur from developing air quality and climate policies in isolation, particularly with regards to energy and planning policy. Instead, integrated policy design can lead to benefits such as reducing carbon emissions by switching to zero emission vehicles simultaneously.

The LES also includes the focus on the 187 Air Quality Focus Areas (AQFA) declared by the GLA. Focus Areas are defined to address concerns raised by boroughs within the LAQM review process and forecasted air pollution trends. These are locations that not only exceed the EU annual mean limit value for NO₂ but are also locations with high human exposure. This is not an exhaustive list of London's hotspot locations, but where the GLA believe the problem to be most acute.

2.8.3 Camden Local Plan

The Camden Local Plan was published by LBC in 2017²⁰. It sets out the Council's planning policies and priorities, replacing the previous Core Strategy and Development Policies planning documents. The policies relevant to air quality are set out below:

"Policy CC4 Air Quality

The Council will ensure that the impact of development on air quality is mitigated and ensure that exposure to poor air quality is reduced in the borough.

The Council will take into account the impact of air quality when assessing development proposals, through the consideration of both the exposure of occupants to air pollution and the effect of the development on air quality. Consideration must be taken to the actions identified in the Council's Air Quality Action Plan.

Air Quality Assessments (AQAs) are required where development is likely to expose residents to high levels of air pollution. Where the AQA shows that a development would cause harm to air quality, the Council will not grant planning permission unless measures are adopted to mitigate the impact. Similarly, developments that introduce sensitive receptors (i.e. housing, schools) in locations of poor air quality will not be acceptable unless designed to mitigate the impact.

Development that involves significant demolition, construction or earthworks will also be required to assess the risk of dust and emissions impacts in an AQA and include appropriate mitigation measures to be secured in a Construction Management Plan.”

2.9 Assessment Guidance and Standards.

The primary guidance documents consulted in undertaking this assessment are detailed below.

2.9.1 Mayor of London, London Local Air Quality Management Technical Guidance

The Mayor of London’s LLAQM.TG(19) was published for use by local authorities in their LAQM review and assessment work. The document provides key guidance in aspects of air quality assessment, including screening, use of monitoring data and use of background data that are applicable to all air quality assessments.

2.9.2 EPUK and IAQM ‘Air Quality Guidance for Planning’

Environmental Protection UK (EPUK) and the Institute of Air Quality Management (IAQM) have together published guidance (EPUK and IAQM planning guidance)²¹ to help ensure that air quality is properly accounted for in the development control process. It clarifies when an air quality assessment should be undertaken, what it should contain, and how impacts should be described and assessed including guidelines for assessing the significance of impacts.

2.9.3 IAQM ‘Construction and Demolition Dust Guidance’

Guidance on the assessment of dust from demolition and construction has been published by the IAQM (referred to as the IAQM construction guidance throughout this report)²². The guidance provides a methodology to determine the dust emission magnitude and provides a series of matrices to determine the risk magnitude of potential dust sources associated with construction activities. This allows for the identification of appropriate mitigation measures that are defined further within the IAQM construction guidance.

2.9.4 GLA ‘Construction and Demolition Dust Guidance’

Guidance on the assessment of dust from demolition and construction has been published by the GLA (referred to as the GLA construction guidance throughout this report)²³. The guidance is based on the site evaluation process outlined in the IAQM construction guidance.

2.9.5 Sustainable Design and Construction Supplementary Planning Guidance

The GLA published supplementary planning guidance (SPG) on sustainable design and construction in April 2014²⁴, in order to improve the environmental performance of new developments.

2.9.6 Air Quality Neutral London Plan Guidance

The Air Quality Neutral London Plan Guidance (AQN LPG)²⁵ was adopted in February 2023. This document sets out the benchmarks for transport and building emissions from new developments. These are based on research and evidence carried out by building and transport consultants. This ensures that new developments do not worsen air quality throughout London.

2.9.7 Camden Planning Guidance – Air Quality

LBC published an Air Quality SPD in 2021²⁶ to accompany the Camden Local Plan. It sets out specific measures relevant to the Camden AQMA and what must be covered in the scope of an Air Quality Assessment. This SPD has been considered in regard to the methodology of this assessment and appropriate mitigation measures have been recommended based on the local conditions.

3. Methodology of Assessment.

3.1 Consultation.

The approach to the assessment, as described in section 1.3, was provided to the LBC for review on the 9th of January 2024. At the time of writing, a response has not yet been received.

3.2 Existing Air Quality in the Study Area.

A baseline air quality review was undertaken to determine the existing air quality in the vicinity of the Application Site.

This desk-top study was undertaken using the following sources:

- Air quality data for LBC, including a review of the LBC air quality reports and local monitoring data;
- The UK Pollutant Release and Transfer Register²⁷;
- Background pollution maps from Defra's Local Air Quality Management (LAQM) website²⁸;
- London Atmospheric Emissions Inventory (LAEI) modelled annual mean concentrations from the GLA
- Pollution Inventory from the Environment Agency²⁹
- The UK Ambient Air Quality Interactive Map³⁰;
- Ordnance Survey data and Aerial photography from Google Maps.

3.3 Construction Phase Impacts.

3.3.1 Construction Dust Assessment

The GLA construction guidance outlines that its approach or methodology for assessment is: *"based on the site evaluation process set out in the Institute of Air Quality Management's (IAQM) 2014 Guidance on the Assessment of dust from demolition and construction. This guidance is periodically updated and, therefore, the latest version of the IAQM Guidance should be used."*

In recognition of this statement, the assessment of construction dust impacts outlined in this report has therefore been undertaken in line with the latest v2.2 IAQM construction guidance, released in January 2024¹⁸

Activities on the proposed construction site have been divided into four types to reflect their different potential impacts. These are:

- Demolition;
- Earthworks;
- Construction; and
- Trackout

The risk of dust emissions was assessed for each activity with respect to:

- Potential loss of amenity due to dust soiling;
- The risk of health effects due to a significant increase in exposure to PM₁₀; and
- The risk of ecological impacts due to a significant increase in exposure to dust.

The first stage of the assessment involves screening to determine whether there are any sensitive receptors within the threshold distances defined by the GLA construction guidance. A detailed assessment of the impact of dust from construction sites will be required where:

- A 'human receptor' is located within 250 m of the boundary of the Application Site or within 50 m of the route(s) used by construction vehicles on the public highway, up to 250 m from the Application Site entrance;
- An 'ecological receptor' is located within 50 m of the boundary of the Application Site or within 50 m of the route(s) used by construction vehicles on the public highway, up to 250 m from the Application Site entrance.

The magnitude of dust emission for each activity is determined on the basis of the guidance, indicative thresholds, information available relating to the project and expert judgement. The risk of dust effects arising is based upon the relationship between the dust emission magnitude and the sensitivity of the area. The risk of impact is then used to determine the mitigation requirements.

Descriptors for magnitude of impact and impact significance used in this assessment of construction phase dust are given in the IAQM construction guidance available online.

3.3.2 Construction Traffic

3.3.2.1 Construction Traffic Emissions Screening

The screening assessment has been undertaken with reference to the following EPUK and IAQM planning guidance indicative criteria:

- a change of Light Duty Vehicle (LDV) flows of more than 100 AADT (within an AQMA); and/or
- a change of Heavy Duty Vehicle (HDV) flows of more than 25 AADT (within an AQMA).

3.3.2.2 NRMM Emissions Screening

Non-Road Mobile Machinery (NRMM) refers to mobile machines, transportable industrial equipment or vehicles which are fitted with an internal combustion engine and not intended for transporting goods or passengers on roads. NRMM emissions have been screened following IAQM construction guidance²².

3.4 Operational Phase Impacts.

3.4.1 Road Traffic Impacts

The screening assessment has been undertaken following the EPUK and IAQM planning guidance indicative criteria, i.e.:

- a change of LDV flows of more than 100 AADT (within an AQMA); and/or
- a change of HDV flows of more than 25 AADT (within an AQMA).

Where these criteria are exceeded, a detailed assessment is required, although the guidance advises that “*the criteria provided are precautionary and should be treated as indicative*”, and “*it may be appropriate to amend them on the basis of professional judgement*”.

Where impacts can be screened out there is no need to progress to a more detailed assessment.

3.4.2 Site Suitability Assessment

An assessment has been undertaken to consider the Site Suitability which refers to the exposure of future occupants of the Proposed Development to existing air quality.

The assessment of Site Suitability will be assessed qualitatively using monitoring data and LAEI modelled concentrations.

3.4.3 Air Quality Neutral Assessment

To enable the implementation of the air quality neutral policy of the London Plan, emissions benchmarks have been developed for buildings and transport, the latter of which are dependent on the zone in London where the Proposed Development is located. Developers are required to calculate emissions due to buildings operations and transport, and to compare these emissions to the benchmarks set out in the AQN LPG.

Where the Proposed Development's emissions exceed the benchmarks, on-site mitigation is required. Where emissions continue to exceed the benchmarks after appropriate on-site mitigation, the excess emissions need to be off-set through agreement with the local planning authority.

3.5 Assessment of Significance.

3.5.1 Construction Dust

The IAQM and GLA construction guidance on the assessment of dust from demolition and construction states that the primary aim of the risk assessment is to identify site specific mitigation that, once implemented, should ensure that there will be no significant effect. Therefore, the assessment has been used to determine an appropriate level of mitigation for the construction phase.

The determination of which mitigation measures are recommended include elements of professional judgement and the professional experience of the consultants preparing this report is set out in Appendix 2.

3.5.2 Operational Impacts

The EPUK and IAQM planning guidance has been used to assess the potential for significant impacts as a result of vehicle emissions from traffic associated with the Proposed Development. The focus of the guidance is to assess traffic emission impacts and advises on how to describe the air quality impacts and their significance.

3.5.3 Site Suitability Assessment

To determine the significance of predicted air quality impacts based upon a Site Suitability Assessment, the EPUK and IAQM planning guidance states:

“Where the air quality is such that an air quality objective at the building façade is not met, the effect on residents or occupants will be judged as significant, unless provision is made to reduce their exposure by some means.”

Only the short term AQOs apply for theatre and hotel use. However, the long-term NO₂ AQO has also been considered for the Proposed Development in order to predict compliance with Approved Document Part F of the Buildings Regulations (2021).

Additionally, as stated in the London Plan 2021:

“The Mayor is committed to making air quality in London the best of any major world city, which means not only achieving compliance with legal limits for Nitrogen Dioxide as soon as possible and maintaining compliance where it is already achieved, but also achieving World Health Organisation targets for other pollutants such as Particulate Matter”.

As such, pollutants will also be assessed against WHO guidelines when determining the suitability of the Application Site for its proposed use.

It should be noted that, based on recent advice from the GLA, mitigation measures against particulate matter concentrations are not recommended for the sole purpose of meeting the WHO guidelines. This is due to the energy penalties associated with the installation, operation, and maintenance of this filtration which, in the absence of any other objectives exceedances, is not considered to be appropriate. Particulate matter concentrations exceed WHO guidelines across London and regional measures to reduce concentrations (being principally delivered by the GLA) are considered more appropriate than mitigation at individual developments.

4. Baseline Environment.

This section sets out the available information on air quality in the vicinity of the Application Site.

4.1 Local Air Quality Management Review and Assessment.

The most recent Air Quality Annual Status Report (ASR) published by LBC for 2023³¹ states that the primary source of emissions in the area can be attributed to road traffic. There is a borough wide AQMA for LBC declared due to exceedances of the annual mean NO₂ AQO and the 24-hour mean PM₁₀ AQO. As such, LBC have subsequently published the Camden Clean Air Strategy 2019-2034³² and the Camden Clean Air Action Plan 2023-2026³³. These documents set out the Council's approach for improving air quality and protecting health from exposure to air pollution in Camden.

It should be noted that the pollutant concentrations recorded in 2020 and 2021 from the most recent ASR for 2022 are lower than previous years as a direct result of reduced traffic levels during the COVID-19 pandemic. As such the pollutant concentrations recorded in 2020 and 2021 are not considered to be representative of 'normal' air quality conditions. However, 2022 data is considered a return to normal operation and been used as the latest year of available representative monitoring data.

4.2 Local Air Quality Monitoring.



LBC operate five automatic monitoring stations, with the closest site being BL0, located approximately 850 m north of the Application Site. As the Application Site is also close to the border of Westminster City Council (WCC), monitoring data from their most recent ASR (2022)³⁴ has been included within this section.

Recent monitoring data for the automatic monitoring stations within a 1 km vicinity of the Application Site are detailed in Table 3 and a visual representation of the locations of the automatic monitoring stations is shown in Figure 2.

Table 3: Automatic Monitoring Locations

Monitoring site and distance (m) from Application Site boundary	Objective	2016	2017	2018	2019	2020	2021	2022	2023
NO₂									
Oxford Street East (WCC) – 500 m from Application Site	Annual mean (µg/m ³)	n/d	n/d	76	51	35	34	37	n/d
	Number of hours with concentrations >200 µg/m ³	n/d	n/d	11	5	0	0	1	n/d
Covent Garden (WCC) – 510 m from Application Site	Annual mean (µg/m ³)	n/d	37	39	39	21	24	24	39
	Number of hours with concentrations >200 µg/m ³	n/d	0	0	0	0	0	0	0
Strand (WCC) – 825 m from Application Site	Annual mean (µg/m ³)	101	92	88	76	44	43	35	n/d
	Number of hours with concentrations >200 µg/m ³	245	26	34	21	0	3	0	n/d
	Annual mean (µg/m ³)	42	38	36	32	28	27	26	24

Monitoring site and distance (m) from Application Site boundary	Objective	2016	2017	2018	2019	2020	2021	2022	2023
BLO (LBC) – 850 m from Application Site	Number of hours with concentrations >200 µg/m ³	0	0	0	0	0	0	0	0
PM₁₀									
Oxford Street East (WCC) – 500 m from Application Site	Annual mean (µg/m ³)	n/d	n/d	28	24	22	22	23	n/d
	Number of days with concentrations > 50 µg/m ³	n/d	n/d	1	0	6	5	6	n/d
BLO (LBC) – 850 m from Application Site	Annual mean (µg/m ³)	20	19	17	18	16	16	17	13
	Number of days with concentrations > 50 µg/m ³	9	6	1	9	4	0	5	0
PM_{2.5}									
BLO (LBC) – 850 m from Application Site	Annual mean (µg/m ³)	12	13	10	11	9	9	9	8
<p>Notes:</p> <p>Concentrations in bold indicate an exceedance of the relevant AQO</p> <p>Exceedance of the NO₂ short term AQO of 200 µg/m³ over the permitted 18 hours per year are shown in bold and <u>underlined</u>.</p> <p>n/d = no data</p>									

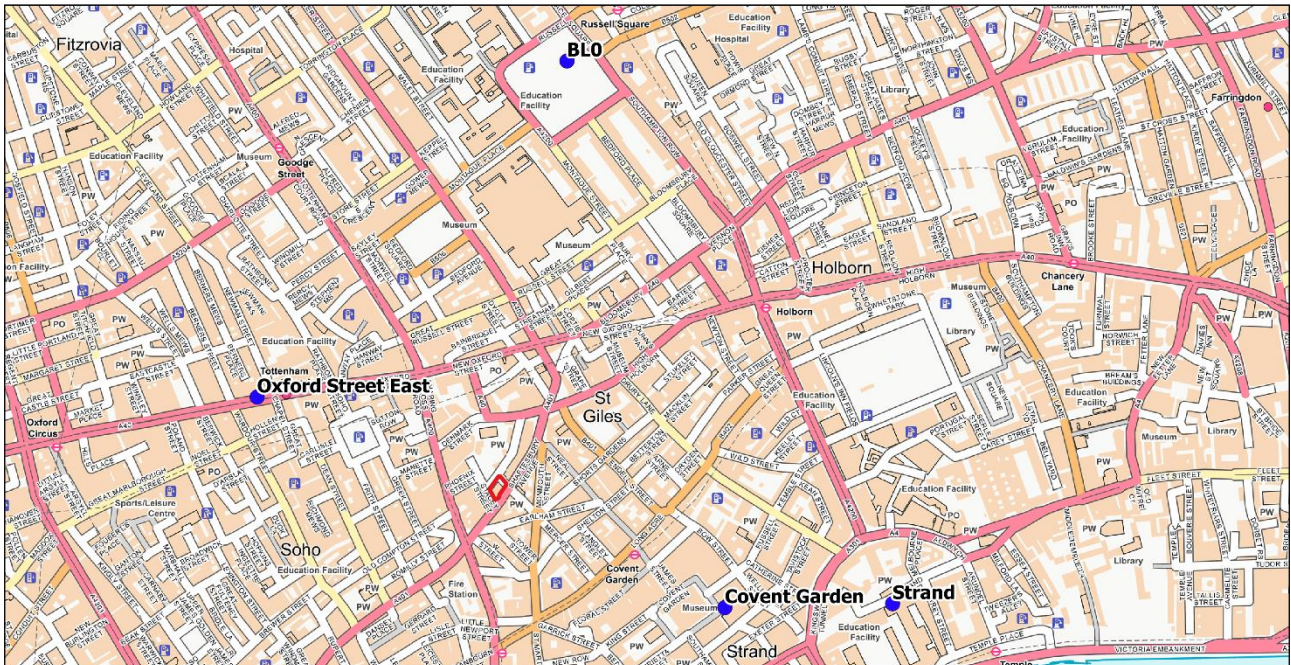

Legend

- Approximate Application Site Boundary
- Automatic Monitoring Location

Figure 2: Automatic Monitoring Locations within the vicinity of the Application Site. Contains OS Data © Crown Copyright and Database rights 2024.

The monitoring results indicate that there have been no exceedances of the annual mean NO₂, PM₁₀ or PM_{2.5} AQOs or WHO guidelines, in addition to the 1-hour mean NO₂ AQO and the 24-hour mean PM₁₀ AQO in 2023. In the past five years of representative monitoring data, there have been several exceedances of the annual mean and 1-hour mean NO₂ AQOs at Oxford Street East, Strand and BLO. However, these have all reduced each year to below the AQO. Additionally, the PM_{2.5} WHO guideline was exceeded at BLO from 2016-2019, although it was compliant in 2023.

LBC currently operate 329 passive diffusion tubes to monitor NO₂ concentrations. Within a 150 m of the Application Site, there are 15 passive diffusion tube monitoring locations. Recent monitoring results are shown in Table 4 and the passive diffusion tube monitoring locations are illustrated in Figure 3.

Of the 15 passive diffusion tube monitors in this vicinity of the Application Site, 12 were established in 2020 or 2021, which are not considered to be representative years of normal conditions. Furthermore, the earliest of the 15 diffusion tubes began in 2018, as such data is presented from 2018 to 2022.

Table 4: Passive Diffusion Tube Monitoring Results

Site ID	Site Type	Site Name	Distance (m) from Application Site	Annual Mean NO ₂ Concentration (µg/m ³)					
				2018	2019	2020	2021	2022	2023
CAM242	Roadside	Shaftesbury 2 – Mercer Street South	21	-	-	32	28	28	26
CAM245	Roadside	Shaftesbury 5 – Earlham Street West	49	-	-	36	30	31	36
CAM241	Roadside	Shaftesbury 1 – Shelton Street	53	-	-	34	33	31	33


Site ID	Site Type	Site Name	Distance (m) from Application Site	Annual Mean NO ₂ Concentration (µg/m ³)					
				2018	2019	2020	2021	2022	2023
CAM248	Roadside	Shaftesbury 8 – Shaftesbury Avenue North	59	-	-	44	38	43	51
CAM243	Roadside	Shaftesbury 3 – Monmouth Street South	74	-	-	30	27	27	32
CAM234	Roadside	WEP* 19 – Monmouth Street (25)	74	-	46	28	25	-	-
CAM235	Roadside	WEP* 20 – Monmouth Street (30)	84	-	45	30	30	-	-
CAM249	Roadside	Shaftesbury 9 – Monmouth Street North	90	-	-	29	27	28	32
CAM244	Roadside	Shaftesbury 4 – Tower Street	113	-	-	31	25	27	29
CAM251	Roadside	Shaftesbury 11 – Shorts Gardens	115	-	-	29	24	27	29
CAM246	Roadside	Shaftesbury 6 – Shaftesbury Avenue South	116	-	-	46	38	44	50
CAM225	Roadside	WEP* 10 – Denmark Street (5)	117	<u>72</u>	<u>67</u>	45	31	-	-
CAM239	Roadside	WEP* 24 – Tower Street	128	-	-	-	26	-	-
CAM247	Roadside	Shaftesbury 7 – Mercer Street North	139	-	-	31	26	27	30
CAM252	Roadside	Shaftesbury 12 – Earlham Street East	140	-	-	28	25	26	28
CAM250	Roadside	Shaftesbury 10 – Neal Street	150	-	-	27	24	26	30

Notes:

Concentrations in **bold** indicate an exceedance of the relevant AQO.

Exceedance of the NO₂ short term AQO of 200 µg/m³ over the permitted 18 hours per year are shown in **bold** and underlined

* WEP = West End Project.

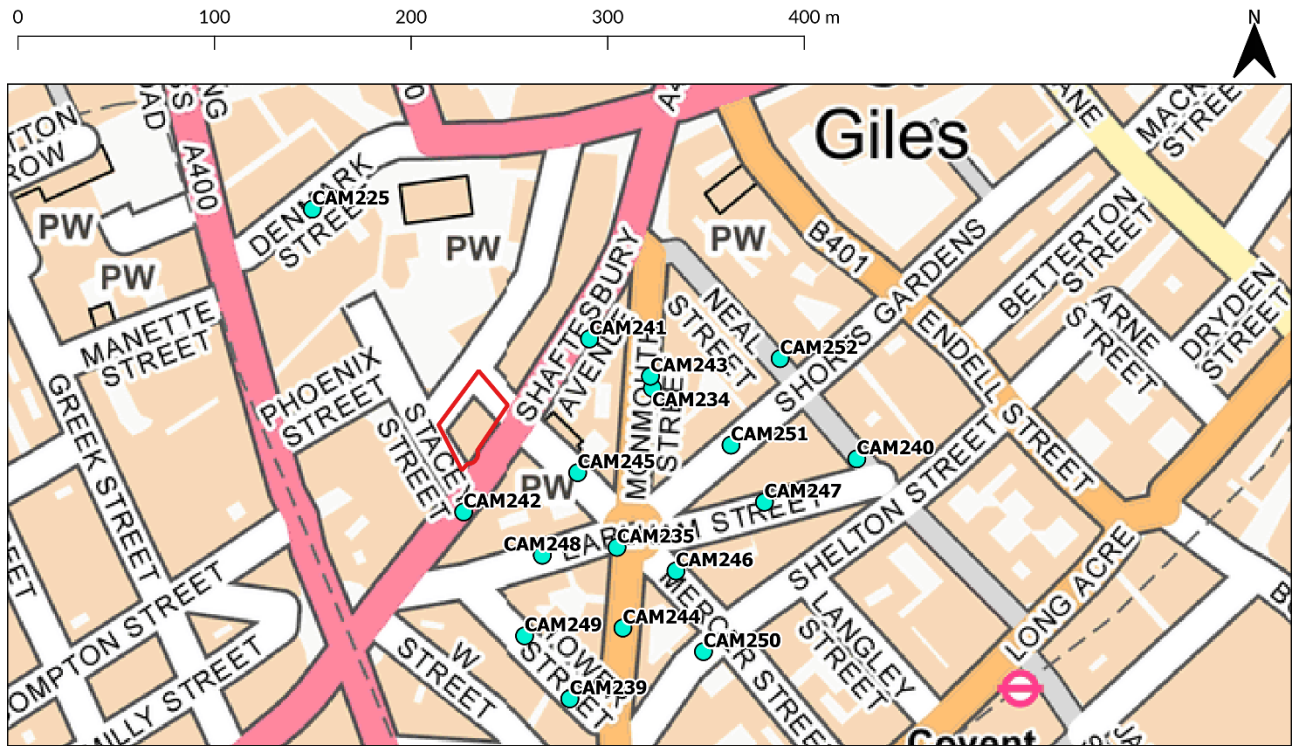

Legend
 [Red outline] Approximate Application Site Boundary [Green dot] Passive Diffusion Tube Monitoring Location

Figure 3: Passive Diffusion Tube Monitoring Locations within the vicinity of the Application Site. Contains OS Data © Crown Copyright and Database rights 2024.

As shown in Table 4, there were two exceedances of the annual mean NO₂ AQO and WHO guideline in 2023, at CAM248 and CAM246, these diffusion tubes are located within Seven Dials. However, the closest passive diffusion tube monitoring location CAM242, which is located opposite the Application Site on Shaftesbury Avenue, recorded no exceedances of the annual mean NO₂ AQO or WHO guideline in 2023.

Additionally, as outlined in LLAQM.TG(19), an annual mean concentration of 60 µg/m³ or above is often used to indicate a possible exceedance of the 1-hour mean NO₂ AQO. This has only occurred at CAM225, located on Denmark Street, in 2018 and 2019. No exceedances of 60 µg/m³ were recorded within 150 m of the Application Site in 2023.

4.3 Industrial Pollution.

A desk-based review of potential industrial sources using the UK Pollutant Release and Transfer Register and the Pollution Inventory from the Environment Agency did not identify any significant industrial or waste management sources of air pollution within 2 km of the Application Site that are likely to affect the Application Site with regard to air quality.

4.4 Defra Predicted Concentrations.

The background concentrations have been obtained from the national maps published by Defra. These estimated concentrations are produced on a 1 km by 1 km grid basis for the whole of the UK. The Application Site falls into grid square X 529500 Y 181500 and the predicted concentrations for this grid square for NO₂, PM₁₀ and PM_{2.5} are provided in Table 5 for 2023, the most recent year with available monitoring data and for 2028, the earliest anticipated opening year for the Proposed Development.

Table 5: Predicted Background Concentrations for grid square X 529500 Y 181500.

Year	Predicted Background Concentration ($\mu\text{g}/\text{m}^3$)		
	NO ₂	PM ₁₀	PM _{2.5}
2023	31.0	18.0	9.7
2028	28.4	17.8	9.5

As shown in Table 5, background concentrations are below the relevant AQOs and WHO guidelines for all pollutants.

4.5 Greater London Authority

4.5.1 Air Quality Focus Areas

Air Quality Focus Areas (AQFAs)³⁵ are locations that not only exceed the annual mean limit value for NO₂ but are also locations with high human exposure. As shown in Figure 4, the Application Site is located approximately 110 m south of the 'Oxford Street from Marble Arch to Bloomsbury' AQFA.

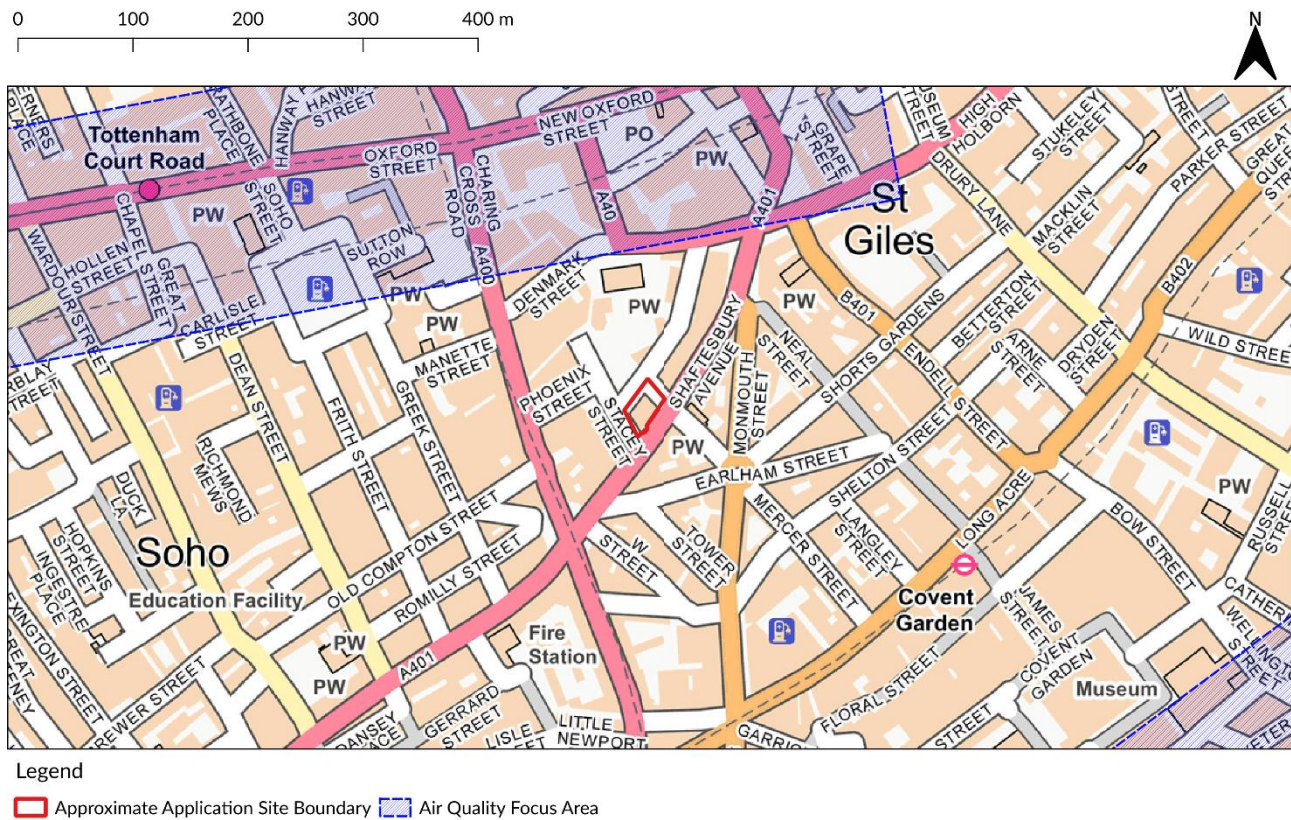


Figure 4: Air Quality Focus Areas in the vicinity of the Application Site. Contains OS Data © Crown Copyright and Database rights 2024.

4.5.2 LAEI Pollution Maps

The GLA produce LAEI annual mean concentration maps for the whole of London on a 20m by 20m grid for a future year 2025³⁶. Figure 5, Figure 6 and Figure 7 illustrate the annual mean NO₂, PM₁₀ and PM_{2.5} concentrations in the immediate area of the Application site for 2025 respectively.

It should be noted that as the resolution of the LAEI modelled concentration maps is 20 m, it is likely that the concentrations of the worst case grid square within the Application Site are more representative of air quality

conditions in the centre of the road, rather than the building facade. As such, LAEI modelled concentrations may be considered less representative of air quality concentrations at the Application Site compared to nearby roadside monitoring locations set back a similar distance from Shaftesbury Avenue.



Figure 5: Modelled 2025 annual mean concentrations of NO₂ (GLA, 2023). Contains OS Data © Crown Copyright and Database rights 2024.

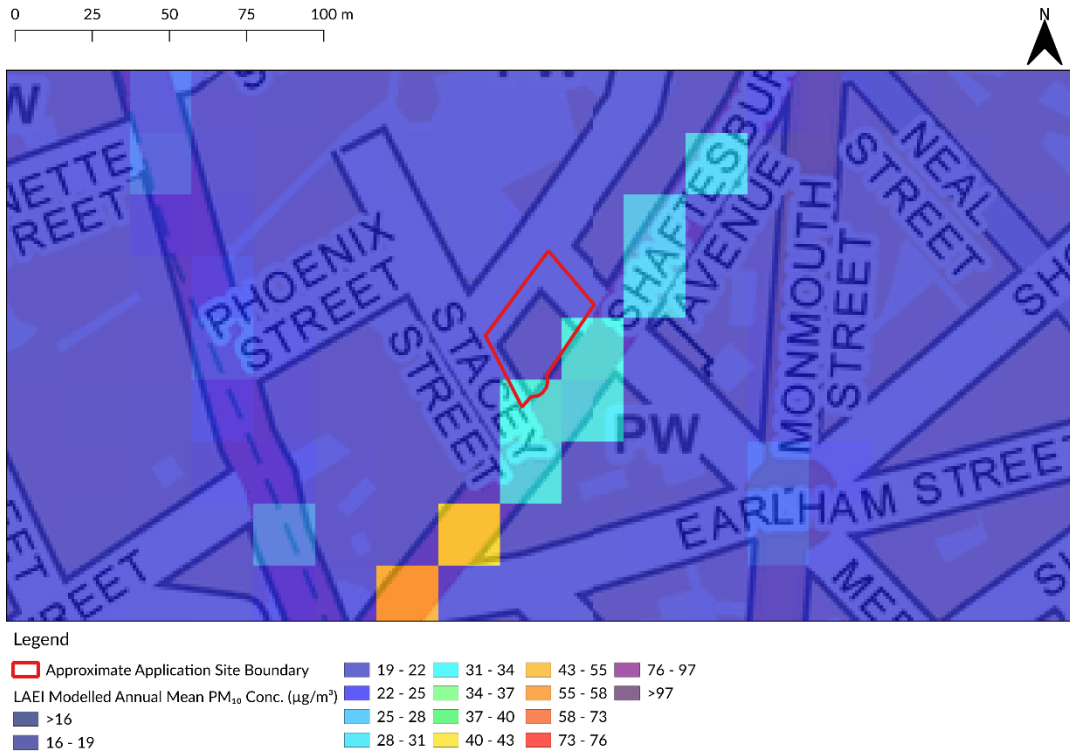


Figure 6: Modelled 2025 annual mean concentrations of PM₁₀ (GLA, 2023). Contains OS Data © Crown Copyright and Database rights 2024.

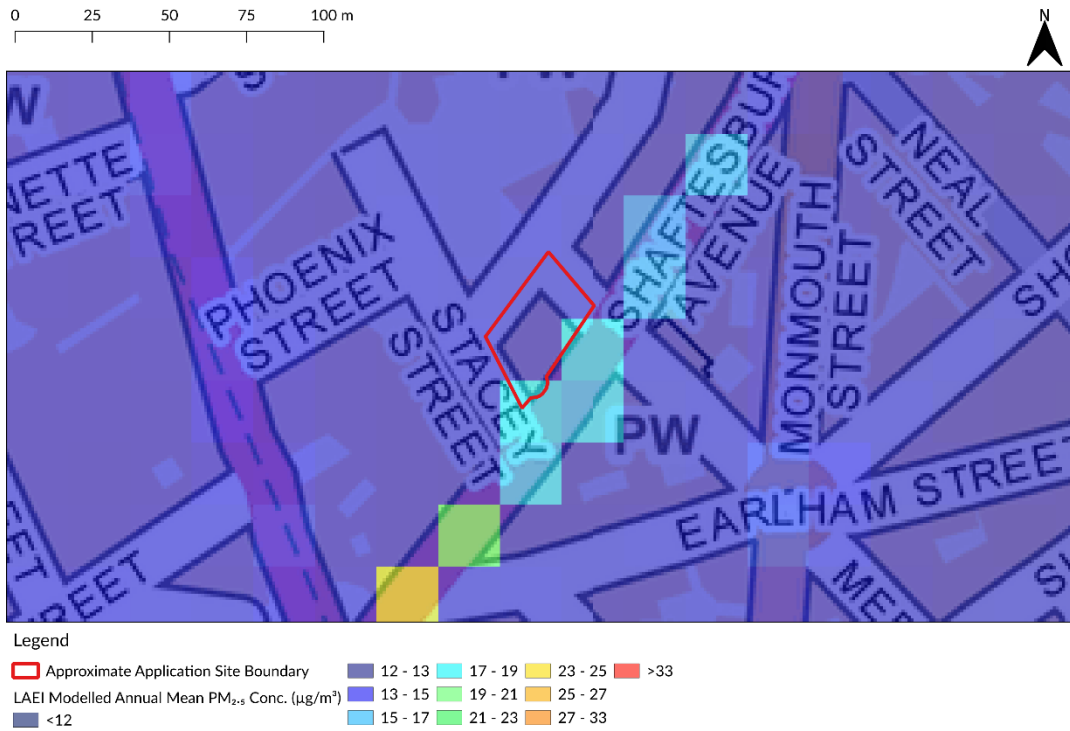


Figure 7: Modelled 2025 annual mean concentrations of PM_{2.5} (GLA, 2023). Contains OS Data © Crown Copyright and Database rights. Contains OS Data © Crown Copyright and Database rights 2024.

The worst-case concentrations of key pollutants in 2025 are shown in Table 6 for the Application Site. These concentrations have been taken from the south façade of the Application Site which bounds Shaftesbury Avenue.

Table 6: Annual mean concentrations of NO₂, PM₁₀ and PM_{2.5} taken from the LAEI annual mean concentration maps.

Year	Pollutant Concentration (µg/m ³)		
	NO ₂	PM ₁₀	PM _{2.5}
2025	50.2	31.3	16.7

As illustrated in Figure 5, Figure 6 and Figure 7, LAEI mapping shows that the main source of pollution in the vicinity of the Application Site is the local road network. Predicted concentration of NO₂ for 2025 at the south façade of the Application Site are above the respective annual mean AQO and WHO guideline. The predicted concentrations of PM₁₀ and PM_{2.5} are below their respective annual mean AQOs. However, they are both in exceedance of the WHO guidelines. However, these modelled concentrations are based on conditions prior to the COVID-19 pandemic and expansion of the ULEZ area which are no longer considered representative of current air quality.

4.6 Summary of Background Data.

The baseline assessment has shown that the Application Site is located within the Camden AQMA, but not within an AQFA.

There were no exceedances of the 1-hour mean AQO for NO₂, or the annual mean AQOs and WHO guidelines for NO₂, PM₁₀ or PM_{2.5} were recorded at automatic monitoring locations in 2023. However, two exceedances of the annual mean NO₂ AQO and WHO guideline were recorded at passive diffusion tube monitoring locations in the vicinity of the Application Site in 2023.

Defra predicted background concentrations show no exceedances of the relevant AQOs or WHO guidelines in 2023 or 2028.

LAEI modelled concentrations showed that the worst case NO₂ concentrations within the Application Site exceed the annual mean AQO and WHO guideline. The predicted concentrations of PM₁₀ and PM_{2.5} are below their respective annual mean AQOs. However, they are both in exceedance of the WHO guidelines. However, these modelled concentrations are based on conditions prior to the COVID-19 pandemic and expansion of the ULEZ area which are no longer considered representative of current air quality.

There are no sources of industrial emissions that are likely to affect the Application Site with regard to air quality.

5. Construction Phase Assessment.

The potential for air quality impacts during the construction of the Proposed Development are assessed in this section.

5.1 Construction Phase Dust Assessment.

The risk of dust impacts is based on the potential dust emissions magnitude and the sensitivity of the area. These two factors are then combined to determine the risk of dust impacts with no mitigation applied. In the absence of any site-specific information, a higher risk category has been applied to represent a worst-case scenario.

5.1.1 Assessment Screening

There are 'human receptors' within 250 m of the Application Site but no designated habitat sites within 50 m of the Application Site boundary or within 50 m of the route(s) used by construction vehicles on the public highway, up to 250 m from the Application Site entrance.

The closest ecological receptor to the Application Site is Camley Street Nature Park, classified as Local Nature Reserve, located 2 km to the north. Therefore, an assessment of construction dust at human receptors is required, but an assessment of construction at ecological receptors can be screened out from this assessment.

5.1.2 Potential Dust Emission Magnitude

The potential magnitude of dust emissions from demolition, earthworks, construction and trackout have been assessed, as identified in Table 7.

Table 7: Predicted Magnitude of Dust Emissions

Activity	Magnitude	Justification
Demolition	Small	It is understood that the Proposed Development will include the retention of the majority of the existing building structure. Demolition will consist of the top level to allow access for the extension, along with internal structures for redevelopment. As such, the estimated volume of the demolition is anticipated to be less than 12,000 m ³ . As such, in line with IAQM and GLA guidance, the magnitude of dust emissions from demolition is anticipated to be small.
Earthworks	Small	The Proposed Development will involve the extension of the existing basement by an additional two floors. This is anticipated to require less than 18,000 m ² of earthworks within loamy soil ³⁷ . As such, in line with the IAQM and GLA guidance, the magnitude of dust emissions from earthworks is expected to be small.
Construction	Medium	The total construction volume is estimated to be between 12,000 and 75,000 m ³ . This will involve potentially dust materials such as concrete. In line with the IAQM and GLA guidance, the magnitude of dust emissions from construction is anticipated to be medium.
Trackout	Small	Traffic movements during the construction phase for the Proposed Development have not yet been calculated. Due to the scale of the Proposed Development, it is estimated to be less than 10 HDV AADT. As the existing building on-site will be retained, there will be no unpaved road length. As such, in line with the IAQM and GLA guidance, the magnitude of dust emissions from trackout is anticipated to be small.

5.1.3 Sensitivity of the Study Area

The sensitivity of the area takes into account the following factors:

- The specific sensitivities of receptors in the area;
- The proximity and number of those receptors;
- In the case of PM₁₀, the local background concentration; and

- Site-specific factors, such as whether there are natural shelters, such as trees or other vegetation, to reduce the risk of wind-blown dust.

Figure 8 illustrates the distance band criteria (sensitivity buffers) from the Application Site boundary.

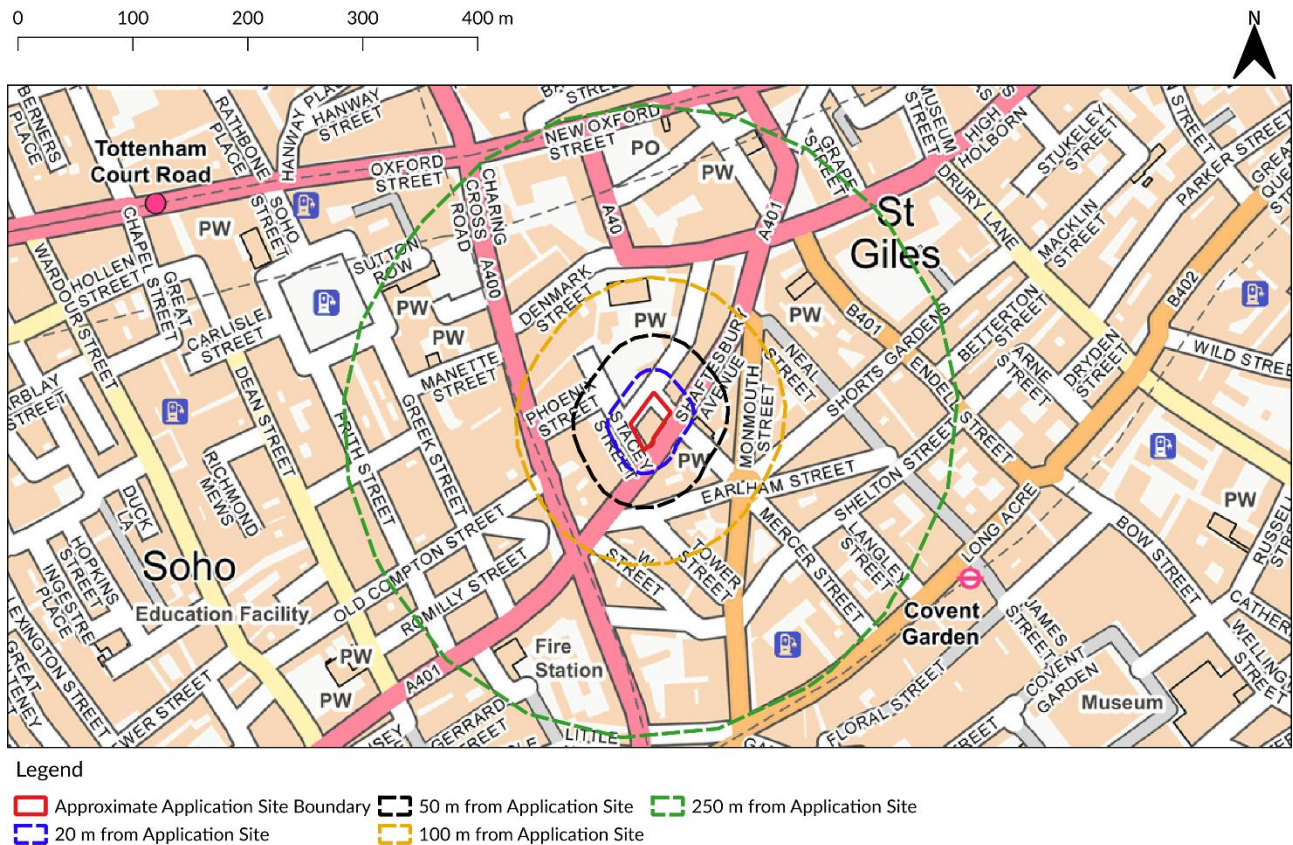


Figure 8: Demolition and Construction Dust Distance band criteria from the Application Site boundary. Contains Ordnance Survey Data © Crown Copyright 2024.

The sensitivity of the area and the factors considered are detailed in Table 8.

Table 8: Sensitivity of the Area

Sensitivity Type	Factors	Sensitivity of Area	
		On - Site Activity	Trackout
Dust Soiling	<p>Within 20 m of the Application Site, there are 10-100 commercial receptors. Within 50 m of the Application Site, there are approximately 10-100 residential receptors which would be considered high sensitivity receptors, along with a further 10-100 commercial receptors. Within 250 m of the Application Site, there are 100+ residential and commercial receptors. Overall, in line with the IAQM and GLA guidance, the area has a medium sensitivity to dust soiling from on-site activity.</p> <p>For trackout, distances are measured from the sides of the roads used by construction traffic. As the dust emissions</p>	Medium	Medium.

Sensitivity Type	Factors	Sensitivity of Area	
		On – Site Activity	Trackout
	from trackout are anticipated to be small, receptors have been considered along roads up to 50 m from the entrance to the Application Site. Within 20 m of these roads, there are approximately 10-100 residential receptors which would be considered high sensitivity receptors, along with 10-100 commercial receptors. Within 50 m of these roads, there are 100+ residential and commercial receptors. Overall, in line with the IAQM and GLA guidance, the area has a medium sensitivity to dust soiling from trackout.		
Human Health	<p>The Defra predicted PM₁₀ concentration for the grid square containing the Application Site was 19.0 µg/m³ in 2022. Within 20 m of the Application Site, there are 10-100 commercial receptors. Within 50 m of the Application Site, there are approximately 10-100 residential receptors which would be considered high sensitivity receptors, along with a further 10-100 commercial receptors. Within 250 m of the Application Site, there are 100+ residential and commercial receptors. Overall, in line with the IAQM and GLA guidance, the area has a low sensitivity to the human health effects of PM₁₀ from on-site activity.</p> <p>For trackout, distances are measured from the sides of the roads used by construction traffic. As the dust emissions from trackout are anticipated to be small, receptors have been considered along roads up to 50 m from the entrance to the Application Site. Within 20 m of these roads, there are approximately 10-100 residential receptors which would be considered high sensitivity receptors, along with 10-100 commercial receptors. Within 50 m of these roads, there are 100+ residential and commercial receptors. Overall, in line with the IAQM and GLA guidance, the area has a low sensitivity to the human health effects of PM₁₀ from trackout.</p>	Low	Low

5.1.4 Risk of Dust Impacts

The outcomes of the assessments of potential magnitude of dust emissions and the sensitivity of the area are combined to determine the risk of impact. This risk is then used to inform the selection of appropriate mitigation. Table 9 details the risk of dust impacts for demolition, earthworks, construction and trackout activities.

Table 9: Summary of Potential Unmitigated Dust Risks

Potential Impact	Sensitivity		Demolition	Earthworks	Construction	Trackout
	On-site	Trackout				
Magnitude			Small	Small	Medium	Small
Dust Soiling Impacts	Medium	Medium	Low Risk	Low Risk	Medium Risk	Negligible
Human Health Impacts	Low	Low	Negligible	Negligible	Low Risk	Negligible

5.2 Construction Phase – Vehicular Pollutants.

The Application Site is located within the Camden AQMA and therefore the lower screening criteria (i.e. 100 LDV and 25 HDV) applies.

Information on traffic movements anticipated during construction works was unavailable for the completion of the Air Quality Assessment. However, the development quantum is not anticipated to result in a significant increase in movements above the threshold outlined in the EPUK and IAQM planning guidance. The duration of movements will be short-term in nature and are not considered further within the context of this assessment. Therefore, in accordance with the criteria presented within EPUK and IAQM planning guidance, additional road vehicle trips during the construction phase of the Proposed Development “*can be considered to have insignificant effects*” on air quality.

5.3 Construction Phase – Non-road Mobile Machinery.

Pollutants emitted by NRMM that may have the most significant potential effects on local air quality are particulate matter (PM₁₀ and PM_{2.5}), and NO_x/NO₂. Typically, NRMM is associated with construction sites and, therefore there is a potential for NRMM emissions to adversely affect local air quality as a result of the Proposed Development.

The London Environment Strategy states that “*Emissions from NRMM construction and maintenance activities will, where appropriate, meet or exceed the standards set out by the NRMM Low Emission Zone*” and, as such, emissions from NRMM will be controlled at the Application Site.

Furthermore, IAQM construction guidance states that, with the application of suitable control measures and site management, exhaust emissions from on-site NRMM are “*unlikely to make a significant impact on local air quality. In the vast majority of cases, they will not need to be quantitatively assessed*”.

6. Operational Phase Assessment.

The potential for air quality impacts during the operation of the Proposed Development are assessed in this section.

6.1 Road Traffic Emissions Screening Assessment.

Road traffic data associated with the Proposed Development has been provided by Momentum Transport, the appointed Transport Consultants for the project. The traffic flows indicate that there will be a 24-hour AADT increase of 60 LDVs and 8 HDVs (within an AQMA) on the local road network as a result of the Proposed Development.

This is below the indicative criteria in the EPUK and IAQM planning guidance of a change of more than 100 LDV and 25 HDV (within an AQMA) and therefore no further assessment is required.

In accordance with the EPUK and IAQM planning guidance, the impacts on air quality from operational phase traffic generation are considered to be not significant.

6.2 Site Suitability Assessment.

This section presents a review of nearby monitoring data in the vicinity of the Application Site, for the purpose of identifying the suitability of the Application Site for theatre and hotel use and identify any requirements for potential mitigation to be embedded into the Proposed Developments design. Due to the presence of monitoring data in close proximity to the Application Site, LAEI modelled data has not been included for this site suitability Assessment as it is predicted based on 2019 concentrations, whereas diffusion tube data is monitored 2023 data of concentrations. We have therefore opted to use the monitored passive diffusion tube monitoring data, which is considered more representative of on-site conditions for site suitability than LAEI concentrations.

As presented in Section 2 in line with LLAQM.TG(19), the 1-hour mean NO₂ and the 24-hour mean PM₁₀ AQOs apply to the Proposed Development due to its proposed theatre and hotel use. Moreover, Approved Document Part F of the Building Regulation 2021 also applies at the Proposed Development, though not required for planning. As such the annual mean NO₂, PM₁₀ and PM_{2.5} AQOs have been considered.

As such, this section considers the annual mean and 1-hour mean NO₂ concentrations; the annual mean and 24-hour PM₁₀ concentration; and the annual mean PM_{2.5} concentration at the Application Site.

6.2.1 Annual Mean NO₂ Concentrations

A review of the annual mean NO₂ concentrations monitored within 1 km of the Application Site has been completed as part of the baseline review with recent monitoring results, presented in Table 3 and Table 4.

Passive diffusion tube monitoring location CAM242, located approximately 21 m from the Application Site, and CAM 241, located approximately 53 m from the Application Site, are both located along Shaftesbury Avenue. These locations can be considered most representative of the air quality conditions at the Application Site due to their proximity and similar roadside location. The Application Site is set back approximately 3 m from the road, whereas both monitoring locations are set back by approximately 1 m. Neither of these passive diffusion tube monitoring locations recorded exceedances of the annual mean NO₂ AQO in 2023.

Therefore, NO₂ concentrations in the locale of the Proposed Development are considered to be compliant with the annual mean AQO and WHO guideline and the Application Site is considered suitable for theatre and hotel use without the need for additional mitigation measures.

6.2.2 1-Hour Mean NO₂ Concentrations

As outlined in LLAQM.TG(19), an annual mean concentration of 60 µg/m³ or above is often used to indicate a possible exceedance of the 1-hour mean NO₂ AQO, therefore 60 µg/m³ has been used as an Air Quality Assessment Level (AQAL) for the 1-hour mean NO₂ AQO.

Passive diffusion tube monitoring locations CAM242 and CAM241 showed no exceedance of $60 \mu\text{g}/\text{m}^3$ in 2023. Additionally, none of the automatic monitoring locations within 1.5 km of the Application Site recorded an exceedance of the 1-hour mean NO_2 AQO in 2023.

Therefore, NO_2 concentrations in the locale of the Proposed Development are considered to be compliant with the 1-hour mean AQO and WHO guideline and the Application Site is considered suitable for theatre and hotel use without the need for additional mitigation measures.

6.2.3 Annual Mean PM_{10} Concentrations

A review of the annual mean PM_{10} concentrations monitored within 1 km of the Application Site has been completed as part of the baseline review with recent monitoring results, presented in Table 3.

Oxford Street East is the closest PM_{10} monitoring location to the Application Site, approximately 500 m to the north west. It is a roadside monitoring location on Oxford Street, which is a busy A-road. As such, it is representative of worst-case air quality conditions at the Application Site. Oxford Street East recorded a PM_{10} concentration of $23 \mu\text{g}/\text{m}^3$ in 2022, which is below the annual mean PM_{10} AQO but in exceedance of WHO guideline. However, as outlined in section 3.5.3, the GLA has advised that filtration for the purpose of compliance with the WHO guidelines is not recommended.

Therefore, annual mean PM_{10} concentrations in the locale of the Proposed Development are considered to be compliant with the annual mean AQO guideline and the Application Site is considered suitable for theatre and hotel use without the need for additional mitigation measures.

6.2.4 24-Hour Mean PM_{10} Concentrations

A review of the annual mean PM_{10} concentrations monitored within 1 km of the Application Site has been completed as part of the baseline review with recent monitoring results, presented in Table 3.

There have been no recorded exceedances of the 24-hour mean PM_{10} AQO in 2022 at the closest PM_{10} monitoring location, Oxford Street.

Therefore, 24-hour PM_{10} concentrations in the locale of the Proposed Development are considered to be compliant with the annual mean AQO and the Application Site is considered suitable for theatre and hotel use without the need for additional mitigation measures.

6.2.5 Annual Mean $\text{PM}_{2.5}$ Concentrations

A review of the annual mean $\text{PM}_{2.5}$ concentrations monitored within 1 km of the Application Site has been completed as part of the baseline review with recent monitoring results, presented in Table 3.

BLO is the closest $\text{PM}_{2.5}$ monitoring location to the Application Site, approximately 850 m to the north. It is a roadside monitoring location on Euston Road, which is a busy A-road. As such, it is representative of worst-case air quality conditions at the Application Site. BLO recorded a $\text{PM}_{2.5}$ concentration of $8 \mu\text{g}/\text{m}^3$ in 2023, which is below the annual mean $\text{PM}_{2.5}$ AQO and WHO guideline.

Therefore, $\text{PM}_{2.5}$ concentrations in the locale of the Proposed Development are considered to be compliant with the annual mean AQO and WHO guideline the Application Site is considered suitable for theatre and hotel use without the need for additional mitigation measures.

6.2.6 Significance of Air Quality Impacts

To determine the significance of predicted air quality impacts based upon a site-suitability assessment, such as that undertaken as part of this assessment, the EPUK and IAQM planning guidance states:

“Where the air quality is such that an air quality objective at the building façade is not met, the effect on residents or occupants will be judged as significant, unless provision is made to reduce their exposure by some means.”

With regards to the Proposed Development, the unmitigated impact significance associated with the Proposed Development has been predicted in accordance with the stated assessment methodology. The following factors have been considered when providing justification:

- The Proposed Development will not introduce any new receptor into an area of exceedance of the annual mean NO₂ AQO based upon a review of NO₂ monitoring data within the development locale;
- The Proposed Development will not introduce any new receptor into an area of exceedance of the 1-hour mean NO₂ AQO based upon a review of NO₂ monitoring data within the development locale;
- The Proposed Development will not introduce any new receptor into an area of exceedance of the annual mean PM₁₀ AQO based upon a review of PM₁₀ monitoring data within the development locale;
- The Proposed Development will not introduce any new receptor into an area of exceedance of the 24-hour mean PM₁₀ AQO based upon a review of PM₁₀ monitoring data within the development locale; and
- The Proposed Development will not introduce any new receptor into an area of exceedance of the annual mean PM_{2.5} AQO based upon a review of PM_{2.5} monitoring data within the development locale.

As no exceedances of the considered AQOs are predicted, mitigation measures are not required for the operational phase of the Proposed Development. As such, the overall effect is considered to be 'not significant'.

6.3 Air Quality Neutral Assessment

6.3.1 Building Emissions.

The Proposed Development will be all-electric utilising zero emission technologies for the primary energy supply, with diesel generator being used for back-up and life emergency purposes only. Therefore, the total building emissions will be zero and under the buildings emissions benchmark since emissions from the backup generator can be exempt from the Air Quality Neutral Assessment. As there are no combustion processes under normal operation, the Proposed Development can be considered at least air quality neutral in relation to building emission.

6.3.2 Transport Emissions.

The Proposed Development will be a car-free development and is expected to only generate servicing trips. The transport emissions benchmark (TEB) in the AQN LPG, only estimates car or light van trips, whereas taxis, delivery, and servicing vehicle trips are not covered by air quality neutral calculations. However, all trips have been considered in the above assessment of impacts from road traffic.

As such the total transport emission are expected to be under TEBs and therefore the Proposed Development can be considered air quality neutral in relation to transport emission.

7. Mitigation.

7.1 Construction Phase.

To mitigate the potential impacts during the construction phase it is recommended that mitigation measures as detailed in the GLA construction guidance are implemented. These mitigation measures have been carefully selected for the Proposed Development and are based upon the dust risk categories outlined in Table 9 of this report.

It is recommended that LBC approve an Air Quality Dust Management Plan (AQDMP) prior to works commencing on site, and that this is implemented using an appropriately worded planning condition. Table 10 below details the measures that should be incorporated in the AQDMP. For general mitigation measures, which excludes those specifically targeted towards demolition, earthworks, construction and trackout (which are given towards the end of the table), medium risk measures have been applied as these represent the highest risk category determined in Table 9. This approach is consistent with the IAQM and GLA construction guidance.

Table 10: Mitigation Measures

Issue	Mitigation Measure
Communications	Develop and implement a stakeholder communications plan that includes community engagement before work commences on site.
	Display the name and contact details of person(s) accountable for air quality and dust issues on the site boundary. This may be the environment manager/engineer or the site manager.
	Display the head or regional office contact information.
Dust Management Plan	Develop and implement a Dust Management Plan (DMP), which may include measures to control other emissions, approved by the Local Authority. The DMP may include monitoring of dust deposition, dust flux, real-time PM ₁₀ continuous monitoring and/or visual inspections.
Site Management	Record all dust and air quality complaints, identify cause(s), take appropriate measures to reduce emissions in a timely manner, and record the measures taken.
	Make the complaints log available to the Local Authority when asked.
	Record any exceptional incidents that cause dust and/or air emissions, either on- or off- site, and the action taken to resolve the situation in the log book.
Monitoring	Undertake daily on-site and off-site inspection, where receptors (including roads) are nearby, to monitor dust, record inspection results, and make the log available to the Local Authority when asked. This should include regular dust soiling check of surfaces such as street furniture, cars, window sills within 100 m of the site boundary, with cleaning to be provided if necessary.
	Carry out regular site inspections to monitor compliance with the DMP, record inspection results, and make an inspection log available to the Local Authority when asked.
	Increase the frequency of site inspections by the person accountable for air quality and dust issues on site when activities with a high potential to produce dust are being carried out and during prolonged dry or windy conditions.
	Agree dust deposition, dust flux, or real-time PM ₁₀ continuous monitoring locations with the Local Authority. Where possible, commence baseline monitoring at least three months before work commences on site or, if it is a large site, before work on a phase commences.
Preparing and maintaining the site	Plan site layout so that machinery and dust causing activities are located away from receptors, as far as is possible.

	Erect solid screens or barriers around dusty activities or the site boundary that are at least as high as any stockpiles on site.
	Fully enclose site or specific operations where there is a high potential for dust production and the site is active for an extensive period.
	Avoid site runoff of water or mud.
	Keep site fencing, barriers and scaffolding clean using wet methods.
	Remove materials that have a potential to produce dust from site as soon as possible, unless being re-used on site. If they are being re-used cover as described below.
	Cover, seed or fence stockpiles to prevent wind whipping.
Operating vehicles/machinery and sustainable travel	Ensure all on-road vehicles comply with the requirements of the London Low Emission Zone and the London NRMM standards, where applicable.
	Ensure all vehicles switch off engines when stationary – no idling vehicles.
	Avoid the use of diesel or petrol-powered generators and use mains electricity or battery powered equipment where practicable.
	Impose and signpost a maximum-speed-limit of 15 mph on surfaced and 10 mph on unsurfaced haul roads and work areas (if long haul routes are required these speeds may be increased with suitable additional control measures provided, subject to the approval of the nominated undertaker and with the agreement of the Local Authority, where applicable).
	Implement a Travel Plan that supports and encourages sustainable travel (public transport, cycling, walking and car-sharing).
Operations	Only use cutting, grinding or sawing equipment fitted or in conjunction with suitable dust suppression techniques such as water sprays or local extraction, e.g. suitable local exhaust ventilation systems.
	Ensure an adequate water supply on the site for effective dust/particulate matter suppression/mitigation, using non-potable water where possible and appropriate.
	Use enclosed chutes and conveyors and covered skips.
	Minimize drop heights from conveyors, loading shovels, hoppers and other loading or handling equipment and use fine water sprays on such equipment wherever appropriate.
	Ensure equipment is readily available on site to clean any dry spillages, and clean up spillages as soon as reasonably practicable after the event using wet cleaning methods.
Waste management	Avoid bonfires and burning of waste materials.
Demolition	Soft strip inside building before demolition.
	Ensure effective water suppression is used during demolition activities. Hand held sprays are more effective than hoses attached to equipment as the water can be directed to where it is needed. In addition, high volume water suppression systems, manually controlled, can produce fine water droplets that effectively bring the dust particles to the ground.
	Avoid explosive blasting, using appropriate manual or mechanical alternatives.
	Bag and remove any biological debris or damp down such material before demolition.

Construction	Avoid scabbling (roughening of concrete surfaces) if possible.
	Ensure sand and other aggregates are stored in bunded areas and are not allowed to dry out, unless this is required for a particular process, in which case ensure that appropriate additional control measures are in place.
	Ensure bulk cement and other fine powder materials are delivered in enclosed tankers and stored in silos with suitable emission control systems to prevent escape of material and overfilling during delivery.
	For smaller supplies of fine powder materials, ensure bags are sealed after use and stored appropriately to prevent dust.
Trackout	Use water-assisted dust sweeper(s) on the access and local roads, to remove, as necessary, any material tracked out of the site. This may require the sweeper being in continuous use.
	Avoid dry sweeping of large areas.
	Ensure vehicles entering and leaving sites are covered to prevent escape of materials during transport.
	Record all inspections of haul routes and any subsequent action in a site log book.
	Implement a wheel washing system (with rumble grids to dislodge accumulated dust and mud prior to leaving the site where reasonably practicable).

Potential dust effects during the construction phase are considered to be temporary in nature. The impacts are determined to be temporary as they will only potentially occur throughout the construction phase and short-term because these will only arise at particular times when certain activities and meteorological conditions for creating the level of magnitude predicted combine.

However, with the application of the above dust control and mitigation measures, it is considered that impacts at all receptors will be 'not significant' in accordance with the GLA construction guidance.

7.1.1 Construction Phase Road Traffic Emissions

Potential air quality impacts associated with construction phase road traffic emissions, principally HDV movements, have been screened out for further assessment with associated impacts on air quality predicted to result in an 'insignificant' effect. Therefore, mitigation measures are not considered to be required.

7.1.2 Construction Phase NRMM Emissions

In accordance with Part 4 of the IAQM construction guidance, all NRMM would need to adhere to the emissions standards for NO₂ and PM₁₀ set out for NRMM. It is therefore considered the likely effects of construction plant on local air quality would be insignificant.

7.2 Operational Phase.

7.2.1 Road Traffic Emissions

Potential air quality impacts associated with operational phase development trips have been screened out from further assessment as '*the impacts [on air quality from operational phase movements] can be considered to have insignificant effects*' in accordance with the EPUK and IAQM planning guidance. Therefore, mitigation measures such as a sustainable travel plan are not considered to be required.

7.2.2 Site Suitability Assessment

A review of LBC monitoring data in consideration of the Application Site indicates no likely exceedance of the annual NO₂ 1-hour mean NO₂ or 24-hour mean PM₁₀ AQOs, or Part F of the Building Regulations (2021).

As no exceedances of any considered AQOs are predicted, this follows the 1st hierarchy principle of the EPUK and IAQM planning guidance to '*prevent and avoid*' exposure'. Therefore, no embedded mitigation into the Proposed Development design is required and natural ventilation is possible from an air quality perspective.

7.2.3 Air Quality Neutral Assessment

The Proposed Development is air quality neutral in regard to both building emissions and transport emissions in line with the AQN LPG. As such, no mitigation is required.

8. Summary and Conclusions.

This report details the potential air quality impacts associated with the construction and operation of a proposed theatre and hotel development at 135-149 Shaftesbury Avenue, London, WC2H 8AH.

The findings of the assessment are as follows:

- The baseline assessment has shown that the Proposed Development is located within an AQMA. The closest monitoring locations recorded no exceedances of the relevant AQOs in 2023;
- A qualitative assessment of the potential dust impacts during the construction of the Proposed Development has been undertaken. Through good practice and implementation of appropriate mitigation measures, it is expected that the release of dust would be effectively controlled and mitigated, with resulting impacts considered to be 'not significant'. All dust impacts are considered to be temporary and short-term in nature;
- The results of the operational phase traffic screening assessment indicate that Momentum Transport. Traffic generated by the Proposed Development is below the screening criteria set out in the IAQM and EPUK planning guidance and the effects are not predicted to be significant, therefore further assessment is not required;
- The Proposed Development energy strategy is expected to be all electric during primary operation, with a emergency back-up generator for life-safety purposes. As no combustion sources are proposed for the primary energy supply, no local air quality impacts are anticipated and a detailed assessment of impacts of combustion emissions from the energy plant has been screened out of this assessment;
- The Proposed Development is air quality neutral in regard to both building and transport emissions in line with the AQN LPG and as such no mitigation is required;
- A qualitative site suitability assessment has been undertaken to assess the suitability of the Application Site for the proposed theatre and hotel use. Based on the assessment results there will be no likely exceedances of relevant AQOs for all pollutants at the Proposed Development and therefore additional mitigation is not required.

Based on the information above, it is considered that air quality should not be viewed as a constraint to planning and the Proposed Development conforms to the principles of National Planning Policy Framework, the London Plan and the Camden Local Plan.

9. Glossary of Terms.

AADT	Annual Average Daily Traffic
AHU	Air Handling Unit
ASHP	Air Source Heat Pump
AQAP	Air Quality Action Plan
AQFA	Air Quality Focus Area
AQDMP	Air Quality Dust Management Plan
AQMA	Air Quality Management Area
AQO	Air Quality Objective
AURN	Automatic Urban and Rural Network
Defra	Department for Environment, Food and Rural Affairs
EPUK	Environmental Protection UK
GLA	Greater London Authority
HDV	Heavy Duty Vehicles (> 3.5 tonnes gross vehicle weight)
IAQM	Institute of Air Quality Management
LAQM	Local Air Quality Management
LBC	London Borough of Camden
LDV	Light Duty Vehicles (\leq 3.5 tonnes gross vehicle weight)
LES	London Environment Strategy
LLAQM.TG	London Local Air Quality Management Technical Guidance
$\mu\text{g}/\text{m}^3$	Micrograms per cubic metre
MAQS	Mayor's Air Quality Strategy
NO_2	Nitrogen dioxide
NO_x	Nitrogen oxides (taken to be $\text{NO}_2 + \text{NO}$)
NPPF	National Planning Policy Framework
NRMM	Non-Road Mobile Machinery
Objectives	A nationally defined set of health-based concentrations for nine pollutants, seven of which are incorporated in Regulations, setting out the extent to which the standards should be achieved by a defined date. There are also vegetation-based objectives for sulphur dioxide and nitrogen oxides
PM_{10}	Particulate matter with an aerodynamic diameter less than 10 micrometres
$\text{PM}_{2.5}$	Particulate matter with an aerodynamic diameter less than 2.5 micrometres
PPG	Planning Practice Guidance
SPG	Supplementary Planning Guidance
Standards	A nationally defined set of concentrations for nine pollutants below which health effects do not occur or are minimal
TBE	Total Building Emissions
Trackout	The transport of dust and dirt from the construction / demolition site onto the public road network, where it may be deposited and then re-suspended by vehicles using the network. This arises when heavy duty vehicles (HDVs) leave the construction / demolition site with dusty materials, which may then spill onto the road, and/or when HDVs transfer dust and dirt onto the road having travelled over muddy ground on site
WCC	Westminster City Council
WHO	World Health Organisation

References.

- ¹ The Stationery Office (1995) The Environment Act 1995 (Part IV), London
- ² Defra (2007) The Air Quality Strategy for England, Scotland, Wales and Northern Ireland – [online] (Last accessed: 16/01/2025), Available at: www.gov.uk/government/publications/the-air-quality-strategy-for-england-scotland-wales-and-northern-ireland-volume-1
- ³ The Stationery Office (2000) Statutory Instrument 2000, No 928, The Air Quality (England) Regulations 2000, London
- ⁴ The Stationery Office (2002) Statutory Instrument 2002, No 3043, The Air Quality (England) (Amendment) Regulations 2002, London
- ⁵ The Stationery Office (2021) Statutory Instrument 2021, The Environment Act 2021, London
- ⁶ Department for Environment, Food & Rural Affairs (2023) Environmental Improvement Plan 2023 –[online], (Last accessed: 16/01/2025), Available at: <https://www.gov.uk/government/publications/environmental-improvement-plan>
- ⁷ Defra(2023) Air Quality Strategy: framework for local authority delivery [online] (last accessed 16/01/2025) – <http://www.gov.uk/government/consultations/reviced-national-air-quality-strategy>
- ⁸ Greater London Authority (2019) London Local Air Quality Management Technical Guidance (LLAQM.TG19) – [online] (Last accessed: 16/01/2025), Available at: www.london.gov.uk/sites/default/files/llaqm_technical_guidance_2019.pdf
- ⁹ The Stationery Office (2010) Statutory Instrument 2010, No 1001, The Air Quality Standards Regulations 2010, London
- ¹⁰ The Stationery Office (2016) Statutory Instrument 2016, No 1184, The Air Quality Standards (Amendment) Regulations 2016, London
- ¹¹ WHO (2005) Air Quality Guidelines – [online], (Last accessed: 16/01/2025), Available: https://apps.who.int/iris/bitstream/handle/10665/69477/WHO_SDE_PHE_OEH_06.02_eng.pdf;jsessionid=66E22FDBE284CBF2CA8161756C3FF958?sequence=1
- ¹² WHO (2021) WHO global air quality guidelines: particulate matter (PM2.5 and PM10), ozone, nitrogen dioxide, sulfur dioxide and carbon monoxide –[online], (Last accessed: 09/01/2024), Available at <https://apps.who.int/iris/handle/10665/345329>
- ¹³ The Stationery Office (1990) Environmental Protection Act 1990 - [online] (Last accessed: 16/01/2025), Available at: legislation.gov.uk/ukpga/1990/43/part/III
- ¹⁴ Defra (2019) The Clean Air Strategy – [online] (Last accessed: 16/01/2025), Available at: www.gov.uk/government/publications/clean-air-strategy-2019
- ¹⁵ HMSO (2021). The Building Regulations 2021. Approved Document Part F: Ventilation
- ¹⁶ Department for Housing, Communities & Local Government (2024) National Planning Policy Framework, London. Available: <https://www.gov.uk/government/publications/national-planning-policy-framework--2>
- ¹⁷ Ministry of Housing, Communities & Local Government (2019) Planning Practice Guidance, London
- ¹⁸ London Plan (2021) – [online], Last accessed: 16/01/2025) Available: https://www.london.gov.uk/sites/default/files/the_london_plan_2021.pdf
- ¹⁹ Greater London Authority (2018) London Environment Strategy –[online] (Last accessed: 16/01/2025), Available at: www.london.gov.uk/sites/default/files/london_environment_strategy_0.pdf
- ²⁰ London Borough of Camden (2017) Camden Local Plan, -[online], (Last accessed: 16/01/2025), Available at: <https://www.camden.gov.uk/documents/20142/4820180/Local+Plan.pdf/ce6e992a-91f9-3a60-720c-70290fab78a6>
- ²¹ Environmental Protection UK and Institute of Air Quality Management (2017), Land-Use Planning & Development Control: Planning For Air Quality v1.2 – [online] (Last accessed: 16/01/2025), Available at: iaqm.co.uk/text/guidance/air-quality-planning-guidance.pdf
- ²² Institute of Air Quality Management (2024) Guidance on the assessment of dust from demolition and construction v2.2 – [online], (Last accessed: 16/01/2025), Available at: <https://iaqm.co.uk/wp-content/uploads/2013/02/Construction-Dust-Guidance-Jan-2024.pdf>
- ²³ Greater London Authority (2014), The Control of Dust and Emissions During Construction and Demolition Supplementary Planning Guidance – [online] (Last accessed: 16/01/2025), Available at: www.london.gov.uk/sites/default/files/gla_migrate_files_destination/Dust%20and%20Emissions%20SPG%208%20July%202014.pdf
- ²⁴ GLA (2014) Sustainable Design and Construction Supplementary Planning Guidance – [online], (Last accessed: 16/01/2025), Available: https://www.london.gov.uk/sites/default/files/osd34_sustainable_design_construction_spg.pdf
- ²⁵ London Plan Guidance Air Quality Neutral Guidance (2023), (last accessed: 16/01/2025), Available at: <https://www.london.gov.uk/sites/default/files/2023-02/Air%20Quality%20Neutral%20LPG.pdf>
- ²⁶ London Borough of Camden (2021) Air Quality Supplementary Planning Document, -[online], (Last accessed: 16/01/2025), Available at: <https://www.camden.gov.uk/documents/20142/4823269/Air+Quality+CPG+Jan+2021.pdf/4d9138c0-6ed0-c1be-ce68-a9ebf61e8477?t=1611580574285>
- ²⁷ Defra (2014) UK Pollutant Release and Transfer Register – [online], (Last accessed: 16/01/2025), Available at: www.gov.uk/guidance/uk-pollutant-release-and-transfer-register-prtr-data-sets
- ²⁸ Defra (2024) Background Pollution Maps – 2021 – [online], (Last accessed: 16/01/2025), Available at: uk-air.defra.gov.uk/data/laqm-background-maps?year=2021
- ²⁹ Environment Agency (2020) Pollution Inventory – [online], (Last accessed: 16/01/2025), Available at: data.gov.uk/dataset/cfd94301-a2f2-48a2-9915-e477ca6d8b7e/pollution-inventory
- ³⁰ Defra (n.d) UK Ambient Air Quality Interactive Map – [online], (Last accessed: 16/01/2025), Available at: uk-air.defra.gov.uk/data/gis-mapping
- ³¹ London Borough of Camden (2024) Air Quality Annual Status Report, -[online], (Last accessed: 16/01/2025), Available at: <https://www.camden.gov.uk/air-quality>
- ³² London Borough of Camden (2023) Camden Clean Air Strategy 2019-2034, -[online], (Last accessed: 16/01/2025), Available at: https://www.camden.gov.uk/documents/20142/0/Camden+Clean+Air+Action+Plan+2023-2026_Final_2022.12.19+%282%29.pdf/ad618e94-0113-696d-5fc6-104d8969ab5a?t=1671619123044
- ³³ London Borough of Camden (2023) Camden Clean Air Action Plan 2023-2026, -[online], (Last accessed: 16/01/2025), Available at: https://www.camden.gov.uk/documents/20142/0/Camden+Clean+Air+Action+Plan+2023-2026_Final_2022.12.19+%282%29.pdf/ad618e94-0113-696d-5fc6-104d8969ab5a?t=1671619123044
- ³⁴ Westminster City Council (2023) Air Quality Annual Status Report 2022, -[online], (Last accessed: 16/01/2025), Available at: <https://www.westminster.gov.uk/media/document/air-quality-report-2022>
- ³⁵ Greater London Authority (2016) London Atmospheric Emissions Inventory Air Quality Focus Areas – [online] (Last accessed: 16/01/2025), Available at: data.london.gov.uk/dataset/london-atmospheric-emissions-inventory--laei--2016-air-quality-focus-areas

³⁶ Greater London Authority (2023) London Atmospheric emissions Inventory Concentration Maps – [online] (Last accessed: 16/01/2025), Available at: <https://data.london.gov.uk/dataset/london-atmospheric-emissions-inventory--laei--2019>

³⁷ Cranfield Soil and Agrifood Institute Soilscales map – [online], (last accessed: 16/01/2025), Available at: <http://www.landis.org.uk/soilscales/>

Appendix 1 - EHO Consultation.

From: Parsons, Oliver
Sent: Tuesday, January 9, 2024 10:05 AM
To: airquality@camden.gov.uk
Subject: Air Quality Assessment - Shaftesbury Avenue

Good Morning,

Hoare Lea have been instructed to undertake an Air Quality Assessment to support the planning application for the proposed construction and operation of theatre and hotel at 135 Shaftesbury Avenue.

I have set out our proposed assessment approach below and would invite any comments or local air quality considerations you may have. The site is located at the below location (red outline):

0 25 50 75 100 m



Legend

 Approximate Application Site Boundary

The Proposed Development comprises a 1500+ capacity theatre and an upper floor extension for hotel use.

Hoare Lea propose to undertake the assessment using the following methodology:

- A baseline assessment of air quality will be undertaken using London Borough of Camden's (LBoC) data, taken from the most recently available Annual Status Reports.
- Monitoring data for 2020 and 2021 will not be included as part of our assessment, owing to the effects of the COVID-19 pandemic. Monitoring data from 2019 will be used to establish the baseline.
- A review of the LBoC Local Plan will be carried out.
- A review of relevant supplementary planning guidance including the Camden Air Quality Strategy.
- DEFRA's background pollution maps and LAEI modelled data will be used to establish background concentrations in the area.
- An assessment of the construction impacts on air quality and dust using the GLA methodology, in compliance with 'The Control of Dust and Emissions During Construction and Demolition'.
- Any construction or operational phase mitigation will be recommended as necessary in line with GLA guidance.
- The energy strategy for the Proposed Development is to be all electric, utilising zero emission technologies. There will also be diesel generators, for back up use only. However, as no combustion sources are proposed during normal operation and within the primary energy strategy, no local air quality impacts are anticipated and a detailed assessment of impacts of combustion emissions from the energy plant has been screened out of this assessment.
- An air quality neutral assessment will be carried out in line with the criteria set out in London Plan Guidance Air Quality Neutral Consultation Draft.
- Initial road traffic data associated with the Proposed Development has been provided by Momentum Transport, the appointed Transport Consultants for the project. It is expected that the annual average daily traffic (AADT) increase associated with the Proposed Development will be below the EPUK and IAQM criteria, indicating that the potential for air quality impacts from road traffic emissions associated with the Proposed Development, is unlikely. As such, a detailed assessment is not required and a screening assessment will be undertaken.
- An assessment of Site Suitability will be undertaken qualitatively with a desk-based review of the existing baseline air quality undertaken to inform the exposure of future users of the development. Local air quality monitoring, DEFRA's background pollution maps and LAEI modelled data will be used to understand concentrations at the Application Site.

I would be grateful if you could please confirm your acceptance of the proposed methodology and provide me with any comments you may have. However, if you would like to discuss further, please do not hesitate to contact me.

Please let me know if there are any additional guidance documents that aren't publicly available that you would like us to consider.

Kind regards,

Oliver Parsons
Senior Air Quality Consultant

Appendix 2 - Professional Experience.

Christelle Escoffier (Hoare Lea) MsEng. Msc. PhD MIES MIAQM

Christelle Escoffier is a Senior Associate and technical lead for air quality group with Hoare Lea. She is a Full Member of the Institution of Environmental Sciences and the Institute of Air Quality Management. She graduated with a Master in Science Diploma from Paris VI University, France and holds a Doctor of Philosophy degree in Physical Oceanography, Meteorology and Environment, from the same University.

In her twenty-two years of professional experience, she has managed and delivered air quality services for a wide range of industries in the United Kingdom (UK), the United States of America (USA) and the Middle East. Her portfolio of experience comprehends projects for diverse sectors from road transport, planning and development, wastewater and waste, oil and gas to power (energy centres, landfill gas plant, power reserve facilities, gas-fired and oil-fired combustion turbine stations). Christelle has in-depth knowledge of atmospheric dispersion models. She has delivered dispersion modelling training courses to government agencies, academic, industrial and commercial professionals worldwide since 2005.

Andy Day (Hoare Lea), BSc (Hons), MSc, AMIEnvSc, MIAQM

Andy is an Associate Air Quality Consultant with Hoare Lea. He is an Associate Member of the Institute of Environmental Sciences and a Full Member of the Institute of Air Quality Management. He is a chemistry graduate with a Master's specialising in the catalysed removal of harmful volatile organic compounds (VOCs) often generated from the combustion of fuel in car engines.

Andy has worked on a range of projects of varying size across a number of different sectors. His experience focusses on work up to and through planning for air quality assessments and environmental impact assessments. Andy also has experience in detailed dispersion modelling of road traffic and energy combustion plant, emission mitigation statements, damage cost calculations, indoor and outdoor air quality monitoring and assessing the air quality impact at ecologically sensitive sites.

Andy has a particular interest in reducing emissions for the benefit of human health and the environment through the life cycle of a building.

Oliver Parsons (Hoare Lea), BSc (Hons), MSc, AMIEnvSc, AMIAQM

Oliver is a Senior Air Quality Consultant with Hoare Lea. He is a Full Member of the Institution of Environmental Sciences and a Full Member of the Institute of Air Quality Management. He has worked on projects across multiple sectors including residential, commercial and industrial sectors.

He has completed six EIA within the past two years at Hoare Lea, including SSEN (film studio) and SBQ (mixed use residential). He has experience across different aspects of the air quality assessment processes including monitoring, detailed dispersion modelling of roads, standalone air quality assessments and environmental impact assessments.

Alex Johnson (Hoare Lea), MSc, BSc (Hons), AMIAQM

Alex is an Air Quality Consultant with Hoare Lea. He is an Associate Member of the Institution of Environmental Sciences and an Associate Member of the Institute of Air Quality Management. He has worked on a variety of graduated from the University of Southampton with a master's degree in Environmental Pollution Control.

He has completed a variety of air quality projects at Hoare Lea, including air quality assessments, indoor air quality plans, monitoring analysis, and bespoke technical reports for clients across various sectors. Previously, he has also worked on several projects for Natural England, Defra and the Environment Agency to provide geospatial data analysis and research assistance.



CHRISTELLE ESCOFFIER
SENIOR ASSOCIATE

+44 2085 859587
christelleescoffier@hoarelea.com

HOARELEA.COM

Western Transit Shed
12-13 Stable Street
London
N1C 4AB
England

