ROOF OF PETER SAMUEL HALL

INDICATIVE DIMENSIONS AND LOCATION SHOWN FOR NEW GRP ENCLOSURE.
REFER TO SPECIFICATION DOCUMENT FOR DETAILS ON NEW GRP WHICH INCLUDES:

- INTERNAL LIGHTING AND POWER,
- EXTERNAL LIGHTING (PIR TYPE)
- OPENINGS FOR CABLE ENTRIES
- 230v HEATER AND THERMOSTAT,
- BLAST RELIEF SYSTEM,
- VENTILATION LOUVERS,
- FIRE EXTINGUISHER,
- FIRE ALARM,
- TELEPHONE,
- DOORS (ON EACH SIDE)
- BUND TO HOLD FULL CONTENTS OF TRANSFORMER FLUID

FINAL LOCATION BASED ON STRUCTURAL ENGINEERS DRAWINGS

GRP PENETRATIONS DETAIL

(FINAL DIMENSIONS AGREED PRIOR TO ORDER)

GRP FOR DC SYSTEM DETAIL

(FINAL DIMENSIONS AGREED PRIOR TO ORDER)



CONTAINMENT DETAIL

(NOTE: FIXING METHOD TO BE APPROVED BY STRUCTURAL ENGINEER)

NOTE* BIRD NETTING PROTECTION REQUIRED AROUND COMPLETE EXTERNAL CONTAINMENT/CABLING INSTALLATION

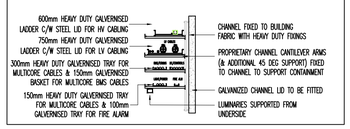


FLOOD LIGHT
FLOOD LIGHT
FLOOD LIGHT
FLOOD LIGHT
750mm CLEARANCE
750mm CLEARANCE
750mm CLEARANCE