
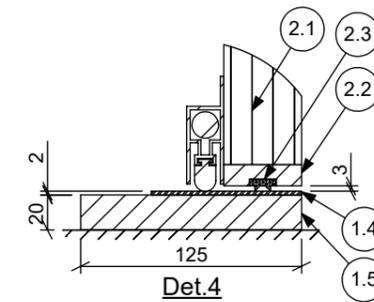
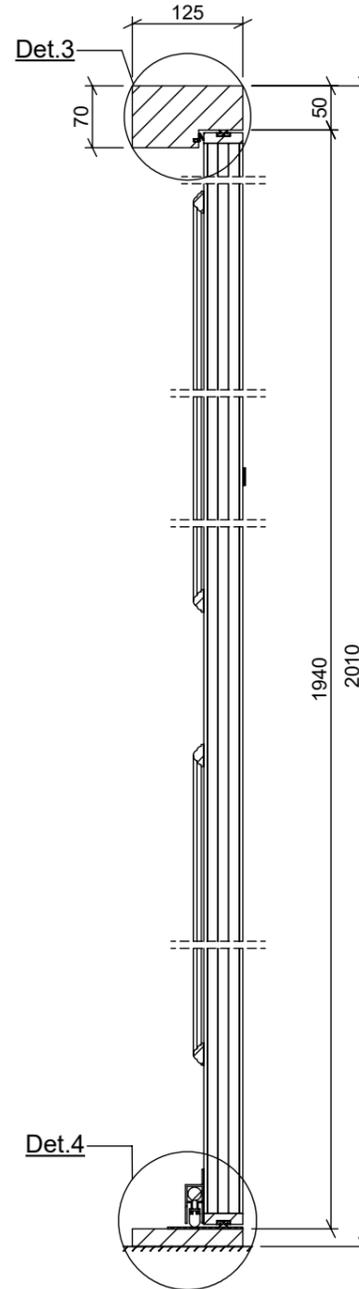
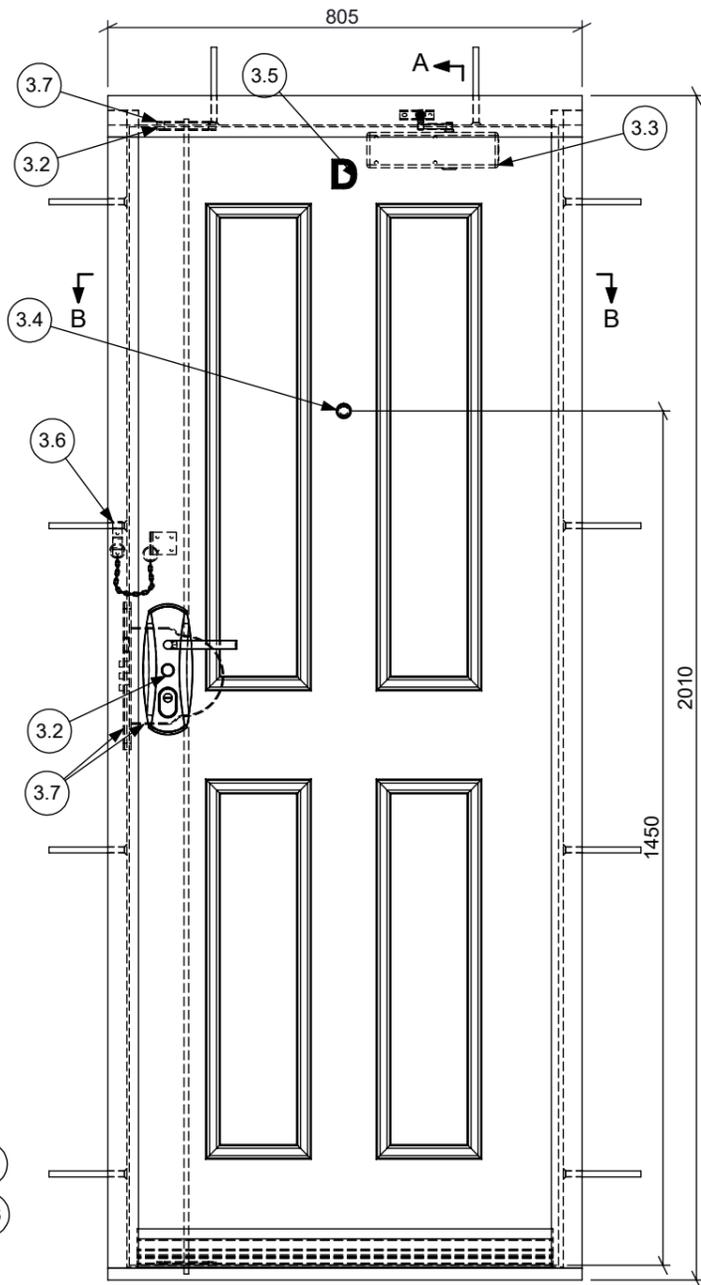
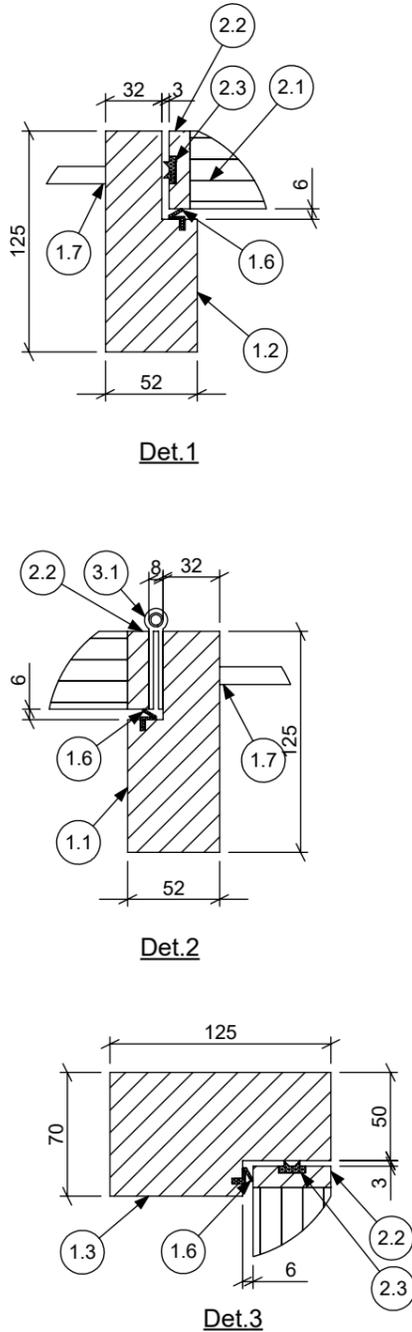


SUPPLY & INSTALL

All / Any electrical equipment to be disconnected and connected by others

**7 ST GEORGES TERRACE
FLAT ENTRANCE DOOR
TOTAL QTY. 1 DOOR
MIL 5**

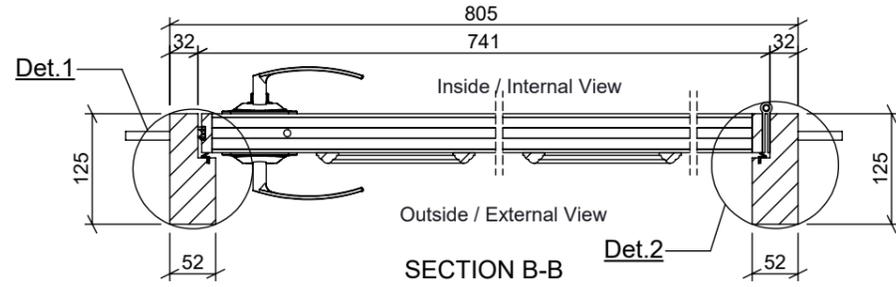

- 1. FD30S Doorset.
- 2. Door clear opening 669mm when 90° open.

REPORTS	
ITEM 1	Test Report Number : WYC412017 / 03 Testing Standard BS EN 1634-3:2004
Positive	25Pa - 0.429 m ³ /hr/m (86% under allowable capacity)
Negative	25Pa - 0.405 m ³ /hr/m (87% under allowable capacity)
Percentage of seal for Intumescent Fire Seal	61% (interruption at shoot bolts and Lock positions)
Percentage of seal for Draft Seal	100% (no interruption)
ITEM 2	Primary Burn Test Report No. WF 420594 Chil/RF13251
ITEM 3	Field Application Report No. Chilt/A12038 RevD / WF 407952
ITEM 4	Enhanced Security Doorset to PAS24 Report No. P11034
ITEM 5	Q-Mark Fire Door Manufacturing 006 Scheme Certificate No. 1244
ITEM 6	FSC Certificate No. TT-COC-002470
ITEM 7	Q-Mark Enhanced Security Door Scheme to PAS 24:2016 and BS644:2012 269
ITEM 8	SBD License Void Date 16th October, 2023
ITEM 9	Thermal Report No. WIL428978
ITEM 10	Acoustic Report No. WYC429011/P005

Q-MARK PAS 24 PD NO. 0000 APPROVED				
ITEM NO.	DESCRIPTION	MATERIAL / PROFILE	SIZES	QTY.
1 FRAME ASSEMBLY				
1.1	Jamb	Meranti Rebated Hardwood Density : 640 Kg/m ³ , ±20%	52 X 125 X 32 - 1965mm	1
1.2	Jamb	Meranti Rebated Hardwood Density : 640 Kg/m ³ , ±20%	52 X 125 X 32 - 1965mm	1
1.3	Header	Meranti Rebated Hardwood Density : 640 Kg/m ³ , ±20%	70 X 125 X 50 - 805mm	1
1.4	Sill	Stainless Steel	2mm (Thk) X 85 X 741mm	1
1.5	Threshold	Hardwood	20 X 125 X 805mm	1
1.6	Draught Excluder	Aquamac - 21	9mm X 5.28m	1
1.7	S/Sleeve Anchor Fixing	-	10 X 132mm	10
2 DOOR ASSEMBLY				
2.1	Door Leaf (W/O Lipping)	Flamebreak - Solid Core	44mm (Thk)	1
2.2	Door Lipping	Meranti	44 X 12mm - 5.30m	1
2.3	Intumescent Strip - Around Door	LP1504TS	15mm X 3.37 m	1
2.4	Plant On Moulding	Softwood	12 X 25mm - 8.96m	1
2.6	Drop Down Seal	Lorient LAS8006 SI	706mm	1
3 IRONMONGERY				
3.1	Hinge	8mm Continuous Mild Steel	1932mm	1
3.2	Door Lock	Multi-Lock ML235 (Cylinder With Thumbturn, Lever Handle & Lock Keeps)	-	1
3.3	Door Closer	ASSA Abloy DC200 Door Closer	-	1
3.4	Door Viewer	AA76	14mm Dia.	1
3.5	Door Number	As Required	-	1
3.6	Door Security Chain	As Required	-	1
3.7	Intumescent Protection at Lock & Lock Keeps	Tenmat Firefly 104E	2.1mm Thick	1

COLOUR	
Door	As Per Survey Sheet
Frame	As Per Survey Sheet

FIXING DETAIL	
	= Fixing Positions
	= 10 X 132 S/Sleeve Anchor Fixing On Masonry
	= M 10 Machine Screw (for Steel)
	= M 10 Machine Screw (for Wood)

THIS DRAWING IS THE PROPERTY OF MULTIINSTALLATIONS LIMITED AND MUST NOT BE COPIED OR DISCLOSED TO A THIRD PARTY WITHOUT THE WRITTEN PERMISSION OF MULTI-INSTALLATIONS LIMITED.

REV	DETAIL	DATE
A	Issued For Approval	14-03-2025

PROJECT : 7 St Georges Terrace

PRODUCTION			
ITEMS	EMP. NAME	EMP.SIGN	DATE
Long Drilling & Pocketing			
Frame Milling/ Cutting			
Door Cutting/ Lipping			
Door Milling			
Lock Assembly			
Glazing			
Door Hanging			

NW1 8XH
Flat Entrance Door
Clarion Housing

DRAWN BY: Meet **DATE:** 14-03-2025

CHECKED BY: Checked By **SCALE:** NTS



Manufacturing Unit : 27 Victoria Gardens, Burgess Hill, West Sussex, RH15 9NB / Tel : 020 8731 1212. e-mail info@multi1.co.uk web: www.multi1.co.uk

This document is the property of Multi-Installations Ltd. Copyright is reserved by them, the drawing is issued on the condition that it is not reproduced, copied or retained by, nor disclosed to an unauthorised person either wholly or in part, without the consent in writing from Multi-Installations Ltd.

JOB NO.: 63.0001 **DRG. NO.:** 001 **REV NO.:** A