


ELEVATION

New Internal 30min F/R Screen Room B/30

Supply and construct new internal 30min fire resisting screen to external infilled door opening consisting of 75x38mm timber studs @ 450mm max ctrs. head and sole plates. Screen size 2080x2245mm high with 2No window openings each 655x1100mm high. Studwork faced room side with 2No layers of 12.5mm Fireline board. 32x100mm sw linings to window openings . 7mm Pyrodur 30-105 EW fire rated glazing in Lorient glazing system-36/6Plus 'U' shaped gaskets fixed between 13x21mm hardwood glazing beads with 15Deg top face. 44x18mm architraves. Skirting to match existing

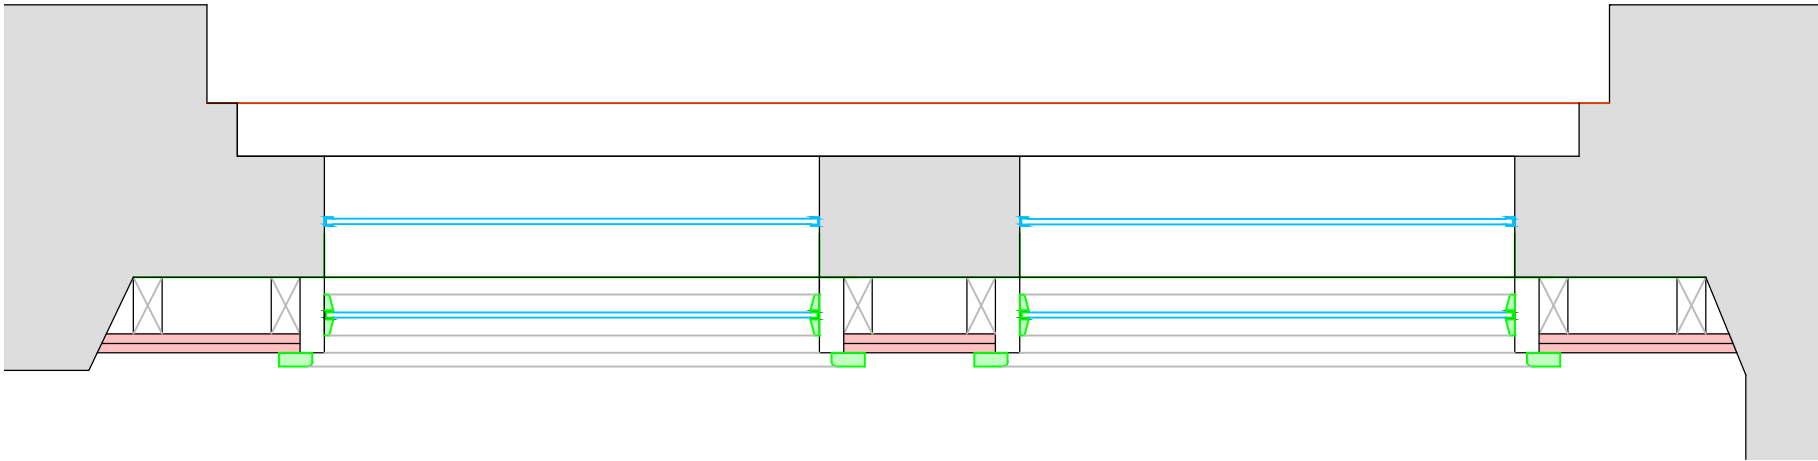

PLAN

Note:  
This drawing is not to be scaled. Use written dimensions only.

- Note:
1. This drawing remains the copyright of Drake & Kannemeyer: Surveyors and shall not be copied in any format without their specific approval in writing. The issue of the drawing in digital format (on floppy disk, CD or via email) entitles the named recipient only to utilise the elements of the drawing that are visible in paper space at the time of issue for the purposes of the named project only.
  2. Drake & Kannemeyer: Surveyors accept no responsibility for the accuracy or currency of data on digitally issued drawings that, at the time of issue, is not visible in paper space viewpoints or is located on layers that are switched off or frozen.
  3. The Contractor is responsible for checking dimensions, tolerances and information. Any discrepancies are to be verified with the Surveyors before preparing shop drawings or proceeding with the Works.
  4. Where two or more drawings illustrate the same element of the works, the drawing at the largest scale shall take precedence. Where drawings are of the same scale the drawing with the later date (or revision date) shall take precedence.
  5. Where drawings contain cross-references to a written specification that specification shall carry equal precedence with the drawing.
  6. Do not scale drawings. Figured dimensions are to be worked to in all cases.
  7. All dimensions indicated are structural unless specifically identified to the contrary.
  8. Workmanship and materials are to be in accordance with all relevant British Standards, Codes of Practice, Agreement Certificates and manufacturer's written instructions that are current at the commencement of the Works. All materials and components are to be utilised strictly in accordance with the manufacturer's written instructions.
  9. All works are to be carried out in strict accordance with the Building Regulations and to the entire satisfaction of the Building Inspector. Should this differ from that shown on the drawings, obtain the Surveyors approval prior to proceeding with the Works.
  10. The inclusion on this drawing of any elements of the Works that are subject to detailed design by other parties (whether consultant specialist supplier/subcontractor) is purely indicative and is incorporated solely to illustrate its relationship to the adjoining construction. The liability for the design of those elements shall be entirely with the relevant designer.

Rev.		Initials	Date
<div><div><div>Drake &amp; Kannemeyer LLP</div><div>CHARTERED SURVEYORS</div><div><div><div><div></div><div></div></div></div><div>Ground Floor River Court The Old Mill Business Complex Mill Lane Godalming Surrey GU7 1EZ 01483 425744 URL:www.dkgroup.co.uk</div></div></div><div>Regulated by RICS</div></div>			
Client Royal Academy of Dramatic Art			
Job Title Fire Compliance Upgrade Project 16 Chenies Street , London WC1E 7EX			
Drawing Title Basement Fire Screen (Room B/30)			
Scale 1:20, 1:10@A1	Date Apr. 2025	Drawn PH	
Job No. 224-11-02	Drawing No. SK- 01	Status	Revision

© Copyright