



**SYNTEGRA CONSULTING**  
*Intelligent & Green Building Solutions*



# Energy Strategy Report - Planning Application

7<sup>th</sup> February 2013

15 Cleve Road, Hampstead, London,  
NW6 3RL

## Table of Contents

1. INTRODUCTION:.....	5
2. THE DEVELOPMENT CONFIGURATION SCHEME: .....	7
3. BASELINE ENERGY USE & CO <sub>2</sub> EMISSIONS .....	8
4. BE LEAN – ENERGY EFFICIENT DESIGN .....	9
5. BE CLEAN .....	11
6. BE GREEN – RENEWABLE ENERGY .....	14
7. CONCLUSION .....	18
8. APPENDIX .....	25

# 15 Cleve Road, Hampstead, London, NW6 3RL



Revision:	-			
Date:	07/02/2013			
Prepared by:	RN			
Checked by:	TWK			
Authorised by:	AWK			

## Limitations

Syntegra Consulting Ltd ("SC") has prepared this report for the sole use of **AJR Charitable Trust** ("Client") in accordance with the agreement under which our services were performed. No other warranty, expressed or implied, is made as to the professional advice included in this report or any other services provided by SC. This report is confidential and may not be disclosed by the Client or relied upon by any other party without the prior and express written agreement of SC.

The conclusions and recommendations contained in this report are based upon information provided by others and upon the assumption that all relevant information has been provided by those parties from whom it has been requested and that such information is accurate. Information obtained by SC has not been independently verified by SC, unless otherwise stated in the report.

The methodology adopted and the sources of information used by SC in providing its services are outlined in this report. The work described in this report was undertaken in **January/February 2013** and is based on the conditions encountered and the information available during the stated period of time. The scope of this report and the services are accordingly factually limited by these circumstances.

This renewable report and SAP pre-assessment modelling were generated based on the provided drawings and building information assumptions. Although every effort has been made to provide accurate content within this report, SC makes no warranty or assumes no legal liability or responsibility for the accuracy or completeness of information contained in this report.

SC also wishes to make aware that this document is guidance only on energy strategy and should not be seen as a building design document. It is the responsibility of the Appointed Building Services / Design Team to develop, select and implement appropriate energy efficiency measures to ensure compliance.

Where assessments of works or costs identified in this report are made, such assessments are based upon the information available at the time and where appropriate are subject to further investigations or information which may become available.

SC disclaim any undertaking or obligation to advise any person of any change in any matter affecting the report, which may come or be brought to SC's attention after the date of the report.

Certain statements made in the report that are not historical facts may constitute estimates, projections or other forward-looking statements and even though they are based on reasonable assumptions as of the date of the report, such forward-looking statements by their nature involve risks and uncertainties that could cause actual results to differ materially from the results predicted. SC specifically does not guarantee or warrant any estimate or projections contained in this report.

Costs may vary outside the ranges quoted. Whilst cost estimates are provided for individual issues in this report these are based upon information at the time which can be incomplete. Cost estimates for such issues may therefore vary from those provided. Where costs are supplied, these estimates should be considered in aggregate only. No reliance should be made in relation to any division of aggregate costs, including in relation to any issue, site or other subdivision.

No allowance has been made for changes in prices or exchange rates or changes in any other conditions which may result in price fluctuations in the future. Where assessments of works or costs necessary to achieve compliance have been made, these are based upon measures which, in SC's experience, could normally be negotiated with the relevant authorities under present legislation and enforcement practice, assuming a pro-active and reasonable approach by site management.

Forecast cost estimates do not include such costs associated with any negotiations, appeals or other non-technical actions associated with the agreement on measures to meet the requirements of the authorities, nor are potential business loss and interruption costs considered that may be incurred as part of any technical measures.

## Copyright

© This report is the copyright of SC. Any unauthorised reproduction or usage by any person other than the addressee is strictly prohibited.

## 1. INTRODUCTION:

Syntegra Consulting Ltd have been appointed as energy consultants to produce an energy strategy for the proposed scheme at “**15 Cleve Road, Hampstead, London, NW6 3RL**” – to demonstrate compliance with national, regional & local planning policies and the **Building Regulations L1B compliance** and to demonstrate consideration towards building fabric enhancements and renewable technology.

This report will outline the following:

- 1) This report will assess the proposed development site's estimated energy demand & CO<sub>2</sub> emissions. It will look into the feasibility of Low Zero Carbon technologies, examining the following aspects relative to LZC/renewable technologies:
  - Energy generated by Renewable/Low Zero Carbon Technologies (LZC)
  - Feasibility assessment for each Renewable/Low Zero Carbon Technologies (LZC)
  - Local Planning Requirements
- 2) The proposed building fabric and Low Zero Carbon (LZC) design strategy and analysis calculations, with respect to the Standard Assessment energy assessment Procedure (SAP). **Minimum 60% of the un-weighted credits in the Energy category in BREEAM pre-assessment.**
- 3) The target of **at least 20% reduction of the development's CO<sub>2</sub> Emissions** through the utilisation of LZC /renewable technology as per the planning policy requirements, if it is feasible.
- 4) The BREEAM 'domestic' refurbishment pre-assessment report demonstrating an 'Excellent' target rating for the proposed extension and refurbishment at 15 Cleve Road. **In accordance with the local planning policy requirements.**

### 1.1 Site Description:

The proposed development, will entail refurbishment and extension of the basement, ground floor and first floor of the multi- residential property. It comprises of a 9No. Flats - 5 storey detached multi-residential unit. The development is located in an urban area of Hampstead. The development is in close proximity to West Hampstead Underground Station (approx. 0.2 miles). The site is within the London Borough of Camden.

### 1.2 Policy documents:

The proposals have been developed with regard to the relevant national, regional and local policy guidance which is reviewed within this section. The energy strategy proposal has been produced with due regard to the following key policy guidance:

#### **National Planning Policy Framework (March 2012)**

The National Planning Policy Framework is a key part of our reforms to make the planning system less complex and more accessible, to protect the environment and to promote sustainable growth.

#### **London Borough of Camden, DP22 “ Promoting sustainable Design & Construction”**

DP22 – *Promoting sustainable design and construction* contributes towards delivering the strategy in policy CS13 by providing detail of the sustainability standards we will expect development to meet.



#### **The London Plan Renewable Energy Policy 2011(Policy 5.2, 5.6 & 5.7)**

The Mayor will and boroughs should in their DPDs adopt a presumption that developments will achieve a reduction in carbon dioxide emissions of 20% from onsite renewable energy generation according to 5.42 section of Policy 5.7 Renewable Energy (which can include sources of decentralised renewable energy). According to Policy 5.2 Minimising CO2 Emissions a 25% CO2 emission reduction BER/TER based on 2010 Building Regulations should be achieved, unless it can be demonstrated that such provision is not feasible. Furthermore, intent must be shown for connecting to a Decentralised energy Network according to Policy 5.6 and utilizing a Combined Heat & Power

### 1.3 The Energy Hierarchy:

The Mayor's Energy Strategy adopts a set of principles to guide design development and decisions regarding energy, balanced with the need to optimise environmental and economic benefits. These guiding principles have been reordered since the publication of the Mayor's Energy Strategy in Feb 2004 and the recently adopted replacement London Plan 2011 states that 'The following hierarchy should be used to assess applications:

Syntegra Consulting Ltd, The Braccans Business Centre, 2 The Braccans, Bracknell, RG12 2XH  
Registered Company No. 06408056


T: 08450091625 E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)

VAT Registration No. 98001604

- Using less energy, in particular by adopting sustainable design and construction measures;
- Supplying energy efficiently, in particular by prioritising decentralised energy generation; and
- Using renewable energy.

The development Energy strategy has adopted the following design ethos:

- **BE LEAN** – By using less energy and taking into account the further energy efficiency measure in comparison to the baseline building.
- **BE CLEAN** – By supplying energy efficiently. The clean building looks at further carbon dioxide emission savings over the lean building by taking into consideration the use of efficient energy reducing equipment.
- **BE GREEN** – By integrating renewable energy into the scheme which can further reduce the carbon dioxide emission rate.

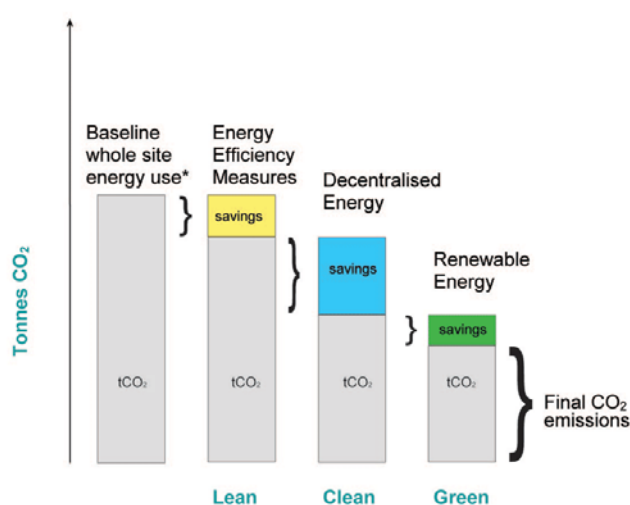

## 2. The Development configuration scheme:

The proposed development scheme consists of the following characteristics:

### 2.1 The Unit configuration

The following table presents the type, area and number of units to be assessed within this report:

#### Proposed units to be assessed for the development

Dwelling Type	Number of units	Number of bedrooms	Individual Dwelling Area m <sup>2</sup>
Flat 1	1	2	91
Flat 2	1	2	99.2
Flat 3	1	2	86.4
Flat 4	1	3	97.9
Flat 5	1	1	54.3
Flat 6	1	1	57.3
Flat 7	1	2	84.8
Flat 8	1	3	118.28
Flat 9	1	2	78.1
<b>Total</b>	<b>9</b>	<b>17</b>	<b>767.3</b>

Syntegra Consulting Ltd, The Braccans Business Centre, 2 The Braccans, Bracknell, RG12 2XH  
Registered Company No. 06408056 VAT Registration No. 98001604

T: 08450091625 E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)



Table 1

## 2.2 Specification of Building Materials

The table presented below demonstrates the material properties of the building fabric that have been proposed:

### 15 Cleve Road Envelope Specification

Building Element	Proposed Specification
External Walls U-value	0.3
Window units (whole window) U-value	1.4 double glazing
Floor U-value	0.2
Roof U-value	0.16
Air Permeability $\text{m}^3/(\text{h.m}^2)$ at 50 Pa	5.0
Low Energy Lighting	100%

Table 2

## 2.3 Fuel

The assessment has assumed the following fuel carbon emissions factors - The fuel carbon emissions factors used are in accordance with **SAP 2009 (for Building Regs Part L1B)**

Carbon Emissions Factor	SAP 2009 $\text{kgCO}_2/\text{kW}$
Grid Electricity	0.517
Grid displaced Electricity	0.529
Manufactured smokeless fuel	0.402
Coal (traditional British Coal)	0.301
Heating Oil	0.28
LPG	0.25
Natural Gas	0.198
Wood Pellets	0.028
Bio Diesel	0.098
Bio Gas	0.019

## 3. Baseline Energy Use & CO<sub>2</sub> Emissions

The baseline energy use and resulting CO<sub>2</sub> emission rate of the development has been assessed using the SAP Government approved software. The SAP calculations have been produced according to the ADL1B 2010 building regulation requirements. For the purpose of this report the baseline energy use and CO<sub>2</sub> emissions are calculated based on the minimum requirements specified in the Building Regulations ADL1B 2010.

The baseline (average) annual energy use and CO<sub>2</sub> emissions are presented in the table below.

Syntegra Consulting Ltd, The Braccans Business Centre, 2 The Braccans, Bracknell, RG12 2XH  
Registered Company No. 06408056

T: 08450091625 E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)

VAT Registration No. 98001604



The UK Passive House Organisation



Building Services (Regulated & Unregulated)	Baseline Energy Use (kWh/m <sup>2</sup> /yr)	Baseline CO <sub>2</sub> Emissions (kg of CO <sub>2</sub> /m <sup>2</sup> /yr)
Heating	63.41	12.56
Auxiliary	1.61	0.83
Lighting	7.66	3.96
Hot Water	58.4	11.6
Equipment* (Unregulated energy/emissions)	34.9	18.03
<b>Total (including unregulated emissions)</b>	<b>166.0</b>	<b>46.9</b>
<b>Total regulated emissions</b>	<b>131.1</b>	<b>28.95</b>

#### 4. BE LEAN – Energy Efficient Design

This section outlines the design energy efficient measures taken in order to minimise the building's energy demand and therefore reduce energy use and CO<sub>2</sub> emissions further than the baseline. The energy efficient measures include:

- i) Inclusion of better U-values than the minimum U-values set in the ADL1B 2010 document.

##### Heating Demand

The heating energy demand will be reduced by providing good insulation of the building envelope in order to minimise heat losses. The design will achieve U-Values and air-permeability beyond the values provided in ADL1B 2010 building regulations. This is demonstrated in the following table.

	ADL1B 2010 target values	Proposed building values
Air Permeability m <sup>3</sup> /(h.m <sup>2</sup> ) at 50 Pa	10	5
Wall U value W/m <sup>2</sup> C <sup>0</sup>	0.3	0.3
Roof U value W/m <sup>2</sup> C <sup>0</sup>	0.18	0.16
Floor U value W/m <sup>2</sup> C <sup>0</sup>	0.25	0.20
Window U value W/m <sup>2</sup> C <sup>0</sup>	2	1.4

Syntegra Consulting Ltd, The Braccans Business Centre, 2 The Braccans, Bracknell, RG12 2XH  
Registered Company No. 06408056

T: 08450091625 E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)

VAT Registration No. 98001604



The UK Passive House Organisation

**Three options are presented for the dwelling heating & HWS :**

- Option 1: Condensing Combi gas boiler (MAIN Combi - 89% efficiency at least)
- Option 2: Communal Air Source Heat Pump (ASHP) (with COP assumed at 3 at least)
- Option 3: Communal Gas Boiler (with efficiency of 95%)

**Lighting**

The light fittings installed will be low energy efficient fittings. These can be LED fittings. The following table demonstrates the reduction in CO<sub>2</sub> emissions caused by the energy efficiency measures mentioned above.

- **option 1: Combi gas boiler BE LEAN stage**

Building Services (Regulated & Unregulated)	Baseline Energy Use (kWh/m <sup>2</sup> /yr)	Proposed Building Energy Use (kWh/m <sup>2</sup> /yr)	Baseline CO <sub>2</sub> Emissions (kg of CO <sub>2</sub> /m <sup>2</sup> /yr)	Proposed Building CO <sub>2</sub> Emissions (kg of CO <sub>2</sub> /m <sup>2</sup> /yr)
Heating	63.41	42.77	12.56	8.47
Auxiliary	1.61	2.17	0.83	1.12
Lighting	7.66	4.50	3.96	2.33
Hot Water	58.4	29.06	11.6	5.75
Equipment (Unregulated energy*)	34.9	34.9	18.03	18.03
<b>Total (including unregulated)</b>	<b>166</b>	<b>113.4</b>	<b>46.9</b>	<b>35.7</b>
<b>Total (regulated)</b>	<b>131.1</b>	<b>78.5</b>	<b>28.95</b>	<b>17.67</b>

**CO<sub>2</sub> Reductions after BE LEAN stage**

	Baseline CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)	Proposed Building CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)	% reduction in CO <sub>2</sub> Emissions
Regulated Emissions	28.95	17.67	38.9%
Regulated + Unregulated	46.9	35.7	23.9%

From the above table it can be seen that the overall CO<sub>2</sub> reduction due to energy efficiency is **38.9%** for the regulated emissions and **23.9%** for the total emissions (including unregulated emissions).

- Option 2: Communal ASHP BE LEAN stage**

Building Services (Regulated & Unregulated)	Baseline Energy Use (kWh/m <sup>2</sup> /yr)	Proposed Building Energy Use (kWh/m <sup>2</sup> /yr)	Baseline CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)	Proposed Building CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)
Heating + Hot Water	121.81	105.91	24.16	20.97
Auxiliary	1.61	1.61	0.83	0.83
Lighting	7.66	4.5	3.96	2.33
Equipment (Unregulated energy*)	34.9	34.9	18.03	18.03
<b>Total (including unregulated)</b>	<b>166</b>	<b>146.9</b>	<b>46.9</b>	<b>42.2</b>
<b>Total (regulated)</b>	<b>131.1</b>	<b>112.02</b>	<b>28.95</b>	<b>24.1</b>

- CO<sub>2</sub> Reductions after BE LEAN stage**

	Baseline CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)	Proposed Building CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)	% reduction in CO <sub>2</sub> Emissions
<b>Regulated Emissions</b>	<b>28.95</b>	<b>24.1</b>	<b>16.8%</b>
<b>Regulated + Unregulated</b>	<b>46.9</b>	<b>42.2</b>	<b>10%</b>

From the above table it can be seen that the overall CO<sub>2</sub> reduction due to energy efficiency is **16.8 %** for the regulated emissions and **10 %** for the total emissions (including unregulated emissions).

• **option 3: Communal gas boiler BE LEAN stage**

Building Services (Regulated & Unregulated)	Baseline Energy Use (kWh/m <sup>2</sup> /yr)	Proposed Building Energy Use (kWh/m <sup>2</sup> /yr)	Baseline CO <sub>2</sub> Emissions (kg of CO <sub>2</sub> /m <sup>2</sup> /yr)	Proposed Building CO <sub>2</sub> Emissions (kg of CO <sub>2</sub> /m <sup>2</sup> /yr)
Heating	63.41	40.61	12.56	8.46
Auxiliary	1.61	0	0.83	0
Lighting	7.66	4.50	3.96	2.33
Hot Water	58.4	27.81	11.6	5.80
Equipment (Unregulated energy*)	34.9	34.9	18.03	18.03
<b>Total (including unregulated)</b>	<b>166</b>	<b>107.82</b>	<b>46.9</b>	<b>34.62</b>
<b>Total (regulated)</b>	<b>131.1</b>	<b>72.92</b>	<b>28.95</b>	<b>16.59</b>

**CO<sub>2</sub> Reductions after BE LEAN stage**

	Baseline CO <sub>2</sub> Emissions (kg of CO <sub>2</sub> /m <sup>2</sup> /yr)	Proposed Building CO <sub>2</sub> Emissions (kg of CO <sub>2</sub> /m <sup>2</sup> /yr)	% reduction in CO <sub>2</sub> Emissions
Regulated Emissions	28.95	16.59	42.7%
Regulated + Unregulated	46.9	34.62	26.2%

From the above table it can be seen that the overall CO<sub>2</sub> reduction due to energy efficiency is **42.7%** for the regulated emissions and **26.2%** for the total emissions (including unregulated emissions).

## **5. BE CLEAN – CHP & DECENTRALISED ENERGY NETWORKS**

The energy hierarchy encourages the use of a CHP system and the connection to District Heating systems (including site wide heating networks) or centralised heating systems to reduce CO<sub>2</sub> emissions further.

### **CHP**

The Energy Hierarchy identifies combined heat and power (CHP) as a method of producing heat and electricity with much lower emissions than separate heat and power. Also, it encourages the creation of district heating systems supplied by CHP.

The implementation of a CHP strategy should be decided according to good practice design. Key factors for the efficient implementation of the CHP system are:

Syntegra Consulting Ltd, The Braccans Business Centre, 2 The Braccans, Bracknell, RG12 2XH  
Registered Company No. 06408056

T: 08450091625 E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)

VAT Registration No. 98001604



- Development with high heating load for the majority of the year.
- CHP operation based on maximum heat load for minimum 10 hours per day.
- CHP operation at maximum capacity of 90% of its operating period.

A CHP system will not be considered for this development due to the following reasons:

- The heating and electrical daily load of the building is insufficient for a CHP system.
- Economic viability is heavily dependent on the demand for heat and power, as well as the price of electricity and gas. The heat and power demand of the proposed development is not sufficient for a CHP system to run efficiently
- The minimum additional cost of a CHP system would be in the order of £ 80,000, which does not represent value for money.
- Excessive plant spatial requirements for the development.

Hence, the implementation of a CHP strategy is not recommended for this development.

### Micro - CHP


Micro CHP has not been considered further for this project for the following reasons:

Micro-CHP is a relatively new concept (Baxi Ecogen was made available in 2009) and issues are raised in relation to unproven technology, inefficiency for shorter run cycles and lack of technical knowledge that can limit the practical application of micro CHP at present. In addition other issues surrounding the fact that around 50% of electricity generated in domestic properties is surplus, high installation costs and estimated low life expectancy has also been taken into consideration as to its commercial un-viability for this development scheme. Micro-CHP also has lower FIT tariff rate and period duration and is only applicable for systems under 2kW.

### Decentralised Energy Network

The feasibility of connecting into an existing heating network or providing the building with its own combined heat and power plant has been assessed alongside the **London Heat Map Study For London Borough of Camden (June 2010)** as part of this assessment. The study does not identify the area in 15 Cleve Road as a high potential area for a District Heating network. The development is not in close proximity to an existing nor a potential District Heating transmission line. At the moment there is no decentralized energy network available and in particular a district heating network in the proximity of the proposed development site that would allow the development to connect to such a network. This is demonstrated clearly from the London Heat Map (<http://www.londonheatmap.org.uk>) snapshot below.



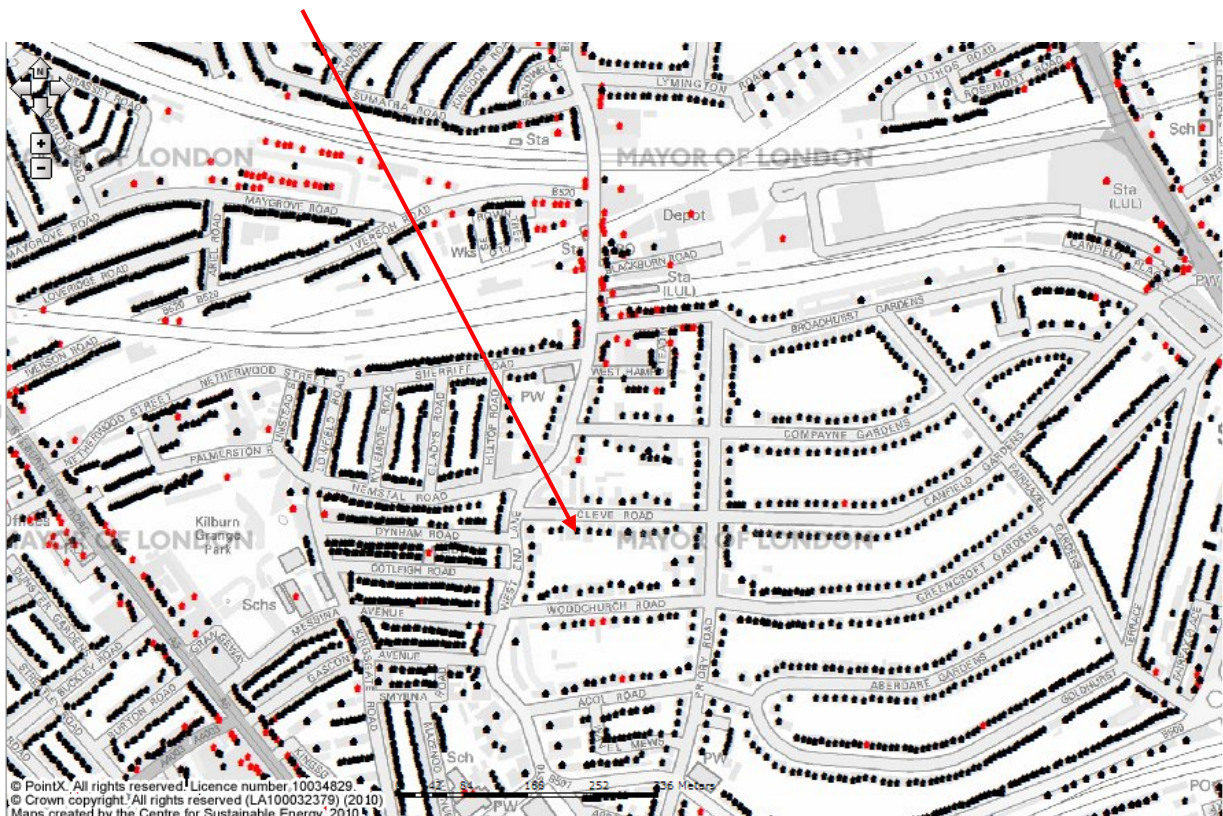

The clean strategy includes:

- i) Utilising low energy efficient lighting such as LED lighting.
- ii) Designing for a buildings air permeability exceeding ADL1B 2010 target values.
- iii) Utilising the highly efficient heating and hot water systems.

• **option 1: Combi gas boiler BE CLEAN stage**

Building Services (Regulated & Unregulated)	Baseline Energy Use (kWh/m <sup>2</sup> /yr)	Proposed Building Energy Use (kWh/m <sup>2</sup> /yr)	Baseline CO <sub>2</sub> Emissions (kg of CO <sub>2</sub> /m <sup>2</sup> /yr)	Proposed Building CO <sub>2</sub> Emissions (kg of CO <sub>2</sub> /m <sup>2</sup> /yr)
Heating	63.41	42.77	12.56	8.47
Auxiliary	1.61	2.17	0.83	1.12
Lighting	7.66	4.50	3.96	2.33
Hot Water	58.4	29.06	11.6	5.75
Equipment (Unregulated energy*)	34.9	34.9	18.03	18.03
<b>Total (including unregulated)</b>	<b>166</b>	<b>113.4</b>	<b>46.9</b>	<b>35.7</b>
<b>Total (regulated)</b>	<b>131.1</b>	<b>78.5</b>	<b>28.95</b>	<b>17.67</b>

Syntegra Consulting Ltd, The Braccans Business Centre, 2 The Braccans, Bracknell, RG12 2XH  
 Registered Company No. 06408056 VAT Registration No. 98001604

T: 08450091625 E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)

### CO<sub>2</sub> Reductions after BE CLEAN stage

	BE LEAN CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)	Proposed Building CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)	% reduction in CO <sub>2</sub> Emissions
Regulated Emissions	17.67	17.67	0%
Regulated + Unregulated	35.7	35.7	0%

From the above table it can be seen that the overall CO<sub>2</sub> reduction due to energy efficiency is 0% for the regulated emissions and 0% for the total emissions (including unregulated emissions).

- **Option 2: Communal ASHP BE CLEAN stage**

Building Services (Regulated & Unregulated)	Baseline Energy Use (kWh/m <sup>2</sup> /yr)	Proposed Building Energy Use (kWh/m <sup>2</sup> /yr)	Baseline CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)	Proposed Building CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)
Heating + Hot Water	121.81	71.62	24.16	12.71
Auxiliary	1.61	0	0.83	0
Lighting	7.66	4.5	3.96	2.33
Equipment (Unregulated energy*)	34.9	34.9	18.03	18.03
<b>Total (including unregulated)</b>	<b>166</b>	<b>111.02</b>	<b>46.9</b>	<b>33.07</b>
<b>Total (regulated)</b>	<b>131.1</b>	<b>76.12</b>	<b>28.95</b>	<b>15.04</b>

- **CO<sub>2</sub> Reductions after BE CLEAN stage**

	BE LEAN CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)	Proposed Building CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)	% reduction in CO <sub>2</sub> Emissions
Regulated Emissions	24.1	15.04	37.6%
Regulated + Unregulated	42.2	33.07	21.6%

From the above table it can be seen that the overall CO<sub>2</sub> reduction due to energy efficiency is 37.6 % for the regulated emissions and 21.6 % for the total emissions (including unregulated emissions).

Syntegra Consulting Ltd, The Braccans Business Centre, 2 The Braccans, Bracknell, RG12 2XH  
Registered Company No. 06408056

T: 08450091625 E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)

VAT Registration No. 98001604





• **option 3: Communal gas boiler BE CLEAN stage**

Building Services (Regulated & Unregulated)	Baseline Energy Use (kWh/m <sup>2</sup> /yr)	Proposed Building Energy Use (kWh/m <sup>2</sup> /yr)	Baseline CO <sub>2</sub> Emissions (kg of CO <sub>2</sub> /m <sup>2</sup> /yr)	Proposed Building CO <sub>2</sub> Emissions (kg of CO <sub>2</sub> /m <sup>2</sup> /yr)
Heating	63.41	40.61	12.56	8.46
Auxiliary	1.61	0	0.83	0
Lighting	7.66	4.50	3.96	2.33
Hot Water	58.4	27.81	11.6	5.80
Equipment (Unregulated energy*)	34.9	34.9	18.03	18.03
<b>Total (including unregulated)</b>	<b>166</b>	<b>107.82</b>	<b>46.9</b>	<b>34.62</b>
<b>Total (regulated)</b>	<b>131.1</b>	<b>72.92</b>	<b>28.95</b>	<b>16.59</b>

**CO<sub>2</sub> Reductions after BE CLEAN stage**

	BE LEAN CO <sub>2</sub> Emissions (kg of CO <sub>2</sub> /m <sup>2</sup> /yr)	Proposed Building CO <sub>2</sub> Emissions (kg of CO <sub>2</sub> /m <sup>2</sup> /yr)	% reduction in CO <sub>2</sub> Emissions
Regulated Emissions	16.59	16.59	0%
Regulated + Unregulated	34.62	34.62	0%

From the above table it can be seen that the overall CO<sub>2</sub> reduction due to energy efficiency is 0% for the regulated emissions and 0% for the total emissions (including unregulated emissions).

## 6. BE GREEN – RENEWABLE ENERGY

In this section the viable renewable energy technologies that will reduce the development's CO<sub>2</sub> emissions by a target of 20% are examined. Incorporating green design measures, could significantly reduce the onsite energy consumption and the CO<sub>2</sub> emissions of the building. The 'London Plan' states that a target CO<sub>2</sub> reduction of 20% must be achieved by the installation of renewable technologies. Below is a review of **non feasible** renewable technologies for incorporation in the proposed development.

- Wind Turbines [See Appendix Section 10.1]
- Biomass Boilers [See Appendix Section 10.2]

Syntegra Consulting Ltd, The Braccans Business Centre, 2 The Braccans, Bracknell, RG12 2XH  
Registered Company No. 06408056 VAT Registration No. 98001604

T: 08450091625 E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)



- Hydrogen Fuel Cells [See Appendix Section 10.3]
- Small scale hydro power [See Appendix Section 10.4]
- Grd. Source Heat Pump (GSHP) [See Appendix Section 10.5]
- CHP & Micro CHP [See Appendix Section 10.6]
- Solar Thermal

## **6.1 Photovoltaics (PV) – PREFERRED TECHNOLOGY**

PV is the proposed renewable technology for this development. The PV system will provide self-generating electricity which can be sold back to the grid. The CO<sub>2</sub> reduction via renewables target is achieved with the implementation of PV. For the calculation of the payback period, the Feed-In-Tariffs' (FITs) has been taken into account. The PV load falls within the bracket associated with a FIT tariff applied of 13.50p per kWh for electricity generated and 4.50p per kWh for electricity exported back to the grid (over 20 years).

**The amount of the PV panels is limited due to the available unshaded flat roof area of approximately 18m<sup>2</sup> giving around ONLY 3kWp using high efficiency monocrystalline 333 watts/panel.**

### **CO<sub>2</sub> Emissions Reduction by PV**

The table below demonstrate the results of the CO<sub>2</sub> emissions and energy use after the implementation of the PV technology. The target according to the London borough of Camden planning policy is to meet a further 20% reduction in CO<sub>2</sub> emissions from renewable technology. The following tables demonstrate the reductions achieved by PV technology for each of the three heating options:

- i) Combi gas boiler + 3kWp PV**
- ii) Communal ASHP + 3kWp PV**
- iii) Communal gas boiler + 3kWp PV**

• **option 1: Combi gas boiler + 3kWp PV BE GREEN stage**

Building Services (Regulated & Unregulated)	Baseline Energy Use (kWh/m <sup>2</sup> /yr)	Proposed Building Energy Use (kWh/m <sup>2</sup> /yr)	Baseline CO <sub>2</sub> Emissions (kg of CO <sub>2</sub> /m <sup>2</sup> /yr)	Proposed Building CO <sub>2</sub> Emissions (kg of CO <sub>2</sub> /m <sup>2</sup> /yr)
Heating	63.41	42.77	12.56	8.47
Auxiliary	1.61	2.17	0.83	1.12
Lighting	7.66	4.50	3.96	2.33
Hot Water	58.4	29.06	11.6	5.75
Equipment (Unregulated energy*)	34.9	34.9	18.03	18.03
Energy generated by renewable (kWh/m <sup>2</sup> /yr)	0	-3.20	0	-1.69
<b>Total (including unregulated)</b>	<b>166</b>	<b>110.2</b>	<b>46.9</b>	<b>34.01</b>
<b>Total (regulated)</b>	<b>131.1</b>	<b>75.3</b>	<b>28.95</b>	<b>15.98</b>

**Total CO<sub>2</sub> Reductions after BE GREEN stage**

	BE CLEAN CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)	Proposed Building CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)	% reduction in CO <sub>2</sub> Emissions
<b>Regulated Emissions</b>	<b>17.67</b>	<b>15.98</b>	<b>9.6%</b>

	BE CLEAN CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)	Proposed Building CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)	% reduction in CO <sub>2</sub> Emissions
<b>Regulated + Unregulated Emissions</b>	<b>35.7</b>	<b>34.01</b>	<b>4.7%</b>

From the above table it can be seen that the overall CO<sub>2</sub> reduction due to energy efficiency is **9.6%** for the regulated emissions and **4.7%** for the total emissions (including unregulated emissions).

• **Option 2: Communal ASHP + 3kWp PV BE GREEN stage**

Building Services (Regulated & Unregulated)	Baseline Energy Use (kWh/m <sup>2</sup> /yr)	Proposed Building Energy Use (kWh/m <sup>2</sup> /yr)	Baseline CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)	Proposed Building CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)
Heating + Hot Water	121.81	71.62	24.16	12.71
Auxiliary	1.61	0	0.83	0
Lighting	7.66	4.5	3.96	2.33
Equipment (Unregulated energy*)	34.9	34.9	18.03	18.03
Energy generated by renewable (kWh/m <sup>2</sup> /yr)	0	-3.20	0	-1.69
<b>Total (including unregulated)</b>	<b>166</b>	<b>107.8</b>	<b>46.9</b>	<b>31.38</b>
<b>Total (regulated)</b>	<b>131.1</b>	<b>72.92</b>	<b>28.95</b>	<b>13.35</b>

**Total CO<sub>2</sub> Reductions after BE GREEN stage**

	BE CLEAN CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)	Proposed Building CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)	% reduction in CO <sub>2</sub> Emissions
<b>Regulated Emissions</b>	<b>15.04</b>	<b>13.35</b>	<b>11.2%</b>

	BE CLEAN CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)	Proposed Building CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)	% reduction in CO <sub>2</sub> Emissions
<b>Regulated + Unregulated Emissions</b>	<b>33.07</b>	<b>31.38</b>	<b>5.1%</b>

From the above table it can be seen that the overall CO<sub>2</sub> reduction due to energy efficiency is **11.2%** for the regulated emissions and **5.1%** for the total emissions (including unregulated emissions).

• **option 3: Communal gas boiler + 3kWp PV BE GREEN stage**

Building Services (Regulated & Unregulated)	Baseline Energy Use (kWh/m <sup>2</sup> /yr)	Proposed Building Energy Use (kWh/m <sup>2</sup> /yr)	Baseline CO <sub>2</sub> Emissions (kg of CO <sub>2</sub> /m <sup>2</sup> /yr)	Proposed Building CO <sub>2</sub> Emissions (kg of CO <sub>2</sub> /m <sup>2</sup> /yr)
Heating	63.41	40.61	12.56	8.46
Auxiliary	1.61	0	0.83	0
Lighting	7.66	4.50	3.96	2.33
Hot Water	58.4	27.81	11.6	5.80
Equipment (Unregulated energy*)	34.9	34.9	18.03	18.03
Energy generated by renewable (kWh/m <sup>2</sup> /yr)	0	-3.20	0	-1.69
<b>Total (including unregulated)</b>	<b>166</b>	<b>104.6</b>	<b>46.9</b>	<b>32.93</b>
<b>Total (regulated)</b>	<b>131.1</b>	<b>69.72</b>	<b>28.95</b>	<b>14.9</b>

**Total CO<sub>2</sub> Reductions after BE GREEN stage**

	BE CLEAN CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)	Proposed Building CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)	% reduction in CO <sub>2</sub> Emissions
<b>Regulated Emissions</b>	<b>16.59</b>	<b>14.9</b>	<b>10.2%</b>

	BE CLEAN CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)	Proposed Building CO <sub>2</sub> Emissions (kgr of CO <sub>2</sub> /m <sup>2</sup> /yr)	% reduction in CO <sub>2</sub> Emissions
<b>Regulated + Unregulated Emissions</b>	<b>34.62</b>	<b>32.93</b>	<b>4.9%</b>


From the above table it can be seen that the overall CO<sub>2</sub> reduction due to energy efficiency is **10.2%** for the regulated emissions and **4.9%** for the total emissions (including unregulated emissions).

**PV System specification**

The PV system capacity for the multi-residential dwelling is common for all options at 3 kWp due to the limitations of the unshaded available flat roof area.

**Indicative PV performance for all 3 options:**

Site details		Panel details	
Orientation	South	Number of panels	9
Panel tilt	30°	Manufacturer	Sunpower
Overshading	Less than 20 percent	Model	SPR-333NE-WHI-D
Proportion exported	100%	Type	Monocrystalline
Build type	New	Area	1.631 m <sup>2</sup>
Building use	Domestic	Power output	333 Wp
Energy efficiency	EPC valid and at least Band D or higher		
Installation type	Not a multi-installation		

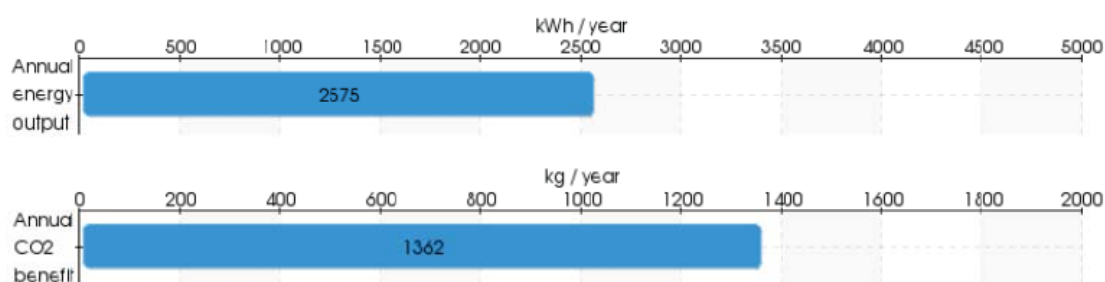**SYSTEM SPECIFICATION:****TOTAL ROOF AREA REQUIRED:****ANNUAL ELECTRICITY OUTPUT:****ANNUAL COST SAVING:****ANNUAL CO<sub>2</sub> BENEFIT:****3 kWp****14.68 m<sup>2</sup>****2575 kWh****£514****1362 kg**

Annual value of energy income and savings

Energy used onsite	£0 (@ 12.2 p per kWh)
Energy exported	£116 (@ 4.50 p per kWh)
Feed-In Tariff	£398 (@ 15.44 p per kWh)

Electrical generation

Energy used onsite	0 kWh
Energy exported	2575 kWh
Feed-In Tariff	2575 kWh

Greenhouse gas

Annual benefit

CO <sub>2</sub>	1362 kg
CH <sub>4</sub>	1 kg
N <sub>2</sub> O	9 kg
SO <sub>2</sub>	8 kg

The 3 kWp PV system will generate 2575 kWh per year. For the 3 kWp system, 9 high efficiency monocrystalline PV panels will be installed.

### **3 kWp Solar PV for ROI model below**

**Note: PV panels are based on high output, high efficiency at 333 Watts/panel.**

**Investment in 3.00kWp System: \*** £ 5,587.70

**First Year:** Income from Feed-In Generation Tariff @ 15.44p/kWh: £ 385.64

Income from exporting energy @ 4.50p/kWh: £ 73.06

Electricity Saving: £ 125.88

Total Benefit: £ 584.58

**Payback Time:** 8y

**Total Profit Over 20 years:** £ 14,159.95  
12.67 % per year  
(6.31% AER)

#### **Assumptions:**

- Illustrative solar PV performance figures only. Figures are given in good faith but do not constitute "Financial Advice".
- Exact PV subsidy figures may depend on grants available at particular locations and other factors.
- Your property has an Energy Performance Certificate (EPC) rating of level C or above.
- Yearly PV output uses a factored degradation over time based on industry estimates.
- Tariffs shown presume installation between 12 December 2011 and 31 March 2012 and do not allow for a temporarily increased rate proposed between these dates. Installations prior to 12 December 2011 would receive a different rate and you can set this by adjusting our assumptions above.
- VAT is included (at 5% where appropriate) unless a new build is specified.
- Photovoltaic Panels will not be shaded (e.g. by Trees or Buildings) as shading affects PV output.
- Exact equipment costs are estimated based on retail prices in 2011 and will vary by installer/supplier.
- Installation costs are based on industry averages for installation type/size. Every install is different and you should obtain 3 quotes.
- Assuming that you pay 14.4p per unit and that around 100% of the solar electricity that you generate will be used.

In order to qualify both the installer and the equipment must be certified under the Microgeneration Certification Scheme (MCS).

PV plant location(s) – To be located on the multi-residential dwelling flat roof facing south.



## 7. Conclusion

Due to the site spatial limitations, location and the other issues identified previously in the report technologies such as Ground Source Heat Pump, Biomass, Solar Thermal, Hydroelectricity and Wind turbines are rejected for reasons stated above. The design has incorporated building fabric enhancement (above current building regs requirements) to increase the energy efficiency of the building.

The recommendation for the proposed extension and refurbishment of the **9 No Flats of the 5-storey development of the “15 Cleve Road”** is that **an 89% efficient Combi Gas boiler + 3kWp PV** is the following. This is based to the following reasons:

- Individual **Combi gas boilers + 3kWp PV** are more cost effective in comparison to the other two proposed options and do not require additional plant space.
- In contrast, a communal gas boiler + 3kWp PV requires a plant room, heat metering, piped distribution and HWS cylinders requiring additional floor space. Thus, it is more expensive than a combi gas boiler installation. A further disadvantage is if a boiler breaks down ALL flats will be without heat.
- Similarly to the communal gas boiler, the ASHP option will require additional plant space in the garden, underground pipework and in addition electric immersion heaters in the HWS cylinders to raise the temperature and for the prevention of Legionaella.
- PV plant location(s) – The 3kWp PV panels would be located on the unshaded flat roof. PV layouts and allocation of roof areas are yet to be finalised.
- The strategy would provide approximately an average **63.05% CO<sub>2</sub> reduction saving (BER/TER) against current building regulations for the development**. This strategy meets BRUK-L1B requirements for the development.
- After the application of the Energy Hierarchy, the predicted emissions of the development are 44.8% lower than the baseline emissions.
- It is recognised that 20% renewables cannot be achieved due to the site constraints and available unshaded roof area, and request a relaxation in respect of this requirement. As can be seen from the table below approximately 10% is achievable.
- ***A BREEAM pre-assessment has been undertaken for the multi-residential dwellings of the 15 Cleve Road development. The BREEAM pre-assessment demonstrates that an “Excellent” rating can be achieved for the development as detailed in the local authority planning policy requirements. [See the Appendix for the BREEAM pre-assessment report]***

	Proposed Building CO <sub>2</sub> Emissions (kg of CO <sub>2</sub> /m <sup>2</sup> /yr)	Percentage Reduction Over each stage %
<b>BASELINE</b>	28.95	-
<b>BE LEAN</b>	17.67	38.9%
<b>BE CLEAN</b>	17.67	0%
<b>BE GREEN</b>	15.98	9.6%
<b>Total % CO2 reduction (Energy Hierarchy strategy against Baseline)</b>		<b>44.8%</b>

## 8. Appendix

- Low Zero Carbon Energy Systems
- BREEAM pre-assessment report
- SAP checklist typical sheet
- BRUKL Part L1B compliance summary report

Syntegra Consulting Ltd, The Braccans Business Centre, 2 The Braccans, Bracknell, RG12 2XH  
Registered Company No. 06408056

T: 08450091625 E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)

VAT Registration No. 98001604



## 9. Low & Zero Carbon Energy Systems

The following section is an overview of the LZC energy systems that are available and can be implemented to the building environment. Firstly, a brief description of the types of renewable energy (zero carbon energy) that can be harnessed with technology will be presented. In addition, the renewable energy system technologies that harness the renewable energy and convert it to electricity, heating and hot water etc, to be consumed in buildings will be presented as well.


The second part of this section will provide an indication of the available low carbon technologies that can be installed on a building to minimise carbon emissions and reduce energy costs.

### 9.1. Zero Carbon (Renewable) Energy Overview.

Renewable energy is the energy that is grasped by the earth's abundant natural sources. Renewable energy can be harnessed with the appropriate use of technology to satisfy the human energy needs. Solar, wind, wave, tide and bio energy are termed as renewable. These renewable energy sources can be classified as 'active' or 'passive'. Active RES are the renewable sources which with the use of renewable energy systems technology (REST) can generate power and heat to satisfy the energy and heating demands of buildings. Passive RES are the renewable sources which with the use of static building elements can enhance the natural ventilation and the heating of a building.

#### Solar Energy

Solar energy is the energy of sun light. The temperature of the Sun's surface reaches to a value of approximately 5,762K. The Earth's perimeter of 40,000 km results in an intersected sun power of 174,000TW. Attenuation by the atmosphere results in peak intensity at sea level of around 1kW/m<sup>2</sup>, giving a 24 hour annual average of 0.2kW/m<sup>2</sup> and a 24 hour annual average power of 102,000 TW.

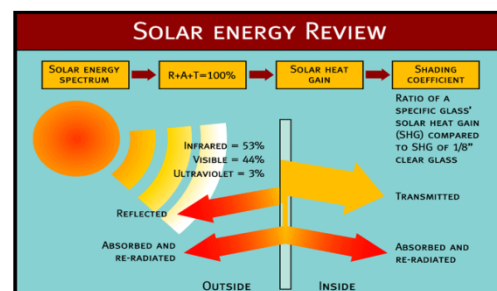

This commands the environment and maintains the life support system of Earth's ecosystem and all forms of renewable energy with the exception of geothermal energy. The solar energy reaching the earth's surface surpasses 10,000 times the current global energy demand.

To be more specific in terms of harnessing solar energy we are interested with the irradiance. Irradiance is the energy of light incident on a solar collector. Irradiance is measured in energy per area, (W/m<sup>2</sup>). The solar irradiance received on the Earth's surface consists of three components, the beam irradiance, diffuse and ground reflected irradiance. The beam component is the irradiance that reaches the solar collector directly. The diffuse irradiance is formulated due to scattering and absorption in the earth's atmosphere. Finally, the ground reflected irradiance is formed due to the sunlight reflected by the earth's ground.


#### Wind Energy

Wind energy is the energy found in the wind that is grasped by REST in order to generate power for human benefit. Wind turbines are the REST used to collect the wind resource and generate power. Today, wind turbines are used to generate electricity from the wind. There are two types of wind turbines, the horizontal axis turbine which is the most common one and the vertical axis turbine. The HAWT is the most efficient and cost effective. Most of the wind turbines used for electricity generation is of this type. Wind turbines can be found in many sizes and outputs, from small battery charging turbines (say a rotor diameter of 1 or 2 metres with an output of a few hundred Watts) to the largest machines used to supply electricity to the grid (Rotor diameters in excess of 70m and output powers of over two MW).



### Bio-energy

Bio-energy is the energy produced from biomass. Biomass is available from materials derived from biological sources. Biomass is any organic material which has stored sunlight in the form of chemical energy. As a fuel it may include wood, wood waste, straw, manure, sugar cane, and many other by products from a variety of agricultural processes. Energy from biomass is produced by burning organic matter.

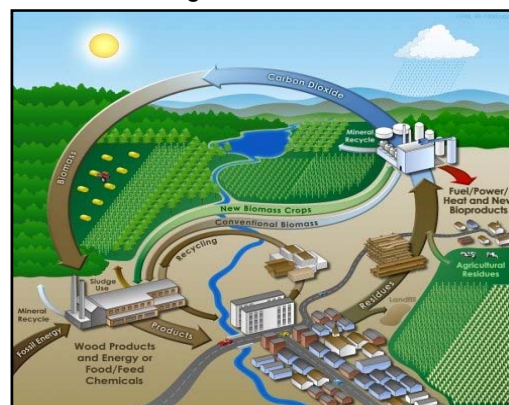


Biomass is the solid form of 'bio energy', but liquid fuels can also be generated from plant matter and this is referred to as 'bio fuel'. Biomass is carbon-based so when used as fuel it also generates carbon emissions.

However, the carbon that is released during combustion is equivalent to the amount that was absorbed during growth, and so the technology is carbon-neutral.

### Geothermal Energy

Geothermal energy is the heat from the Earth. It's clean and sustainable. Resources of geothermal energy range from the shallow ground to hot water and hot rock found a few miles beneath the Earth's surface, and down even deeper to the extremely high temperatures of molten rock called magma. Almost everywhere, the shallow ground or upper 10 feet of the Earth's surface maintains a nearly constant temperature between 10° and 16°C. Geothermal heat pumps can tap into this resource to heat and cool buildings. A geothermal heat pump system consists of a heat pump, an air delivery system (ductwork), and a heat exchanger-a system of pipes buried in the shallow ground near the building. In the winter, the heat pump removes heat from the heat exchanger and pumps it into the indoor air delivery system. In the summer, the process is reversed, and the heat pump moves heat from the

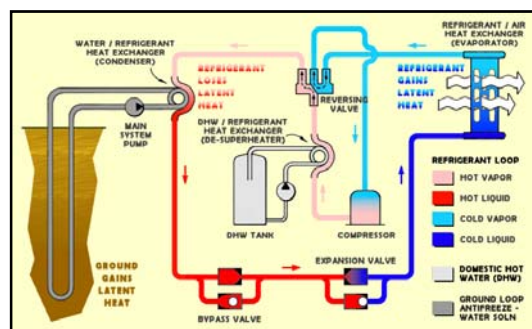



indoor air into the heat exchanger. The heat removed from the indoor air during the summer can also be used to provide a free source of hot water.

## 9.2 Zero Carbon Technologies

In this section the zero carbon technologies also known as Renewable Energy System Technologies (REST) are described.

- Photovoltaic's (PV)
- Solar Water Heating
- Wind Turbines
- Small scale Hydro Power
- Biomass Heating

### 9.2.1 Photovoltaic Systems

#### Description of PV Systems

Photovoltaic systems convert energy from the sun directly into electricity. They are composed of photovoltaic cells, usually a thin wafer or strip of semiconductor material that generates a small current when sunlight strikes them. Multiple cells can be assembled into modules that can be wired in an array of any size. These flat-plate PV arrays can be mounted at a fixed angle facing south, or they can be mounted on a tracking device that follows the sun, allowing them to capture the most sunlight over the course of a day, or even in the form of a solar PV facade. Several connected PV arrays can provide enough power for a household/building.



Thin film solar cells use layers of semiconductor materials only a few micrometers thick. Thin film technology has made it possible for solar cells to now double as rooftop shingles, roof tiles, building facades, or the glazing for skylights or atria. The solar cell version of items such as shingles offer the same protection and durability as ordinary asphalt shingles.

#### Advantages

The PV systems are relatively simple, modular, and highly reliable due to the lack of moving parts. Moreover, PV systems do not produce any greenhouse gases, on the contrary they save approximately 325kg of CO<sub>2</sub> per year kWp they generate.



#### Best Practice Design

PV installations performance is proportional to the active area (area covered by PVs). The desirable location for PV panels is on a south facing roof or façade, as long as no other building or tall trees overshadows it, resulting in reduced PV efficiency. PV panels are




Syntegra Consulting Ltd, The Braccans Business Centre, 2 The Braccans, Bracknell, RG12 2XH  
Registered Company No. 06408056 VAT Registration No. 98001604

T: 08450091625 E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)

require strong structurally roofs due to their heavy weight, especially if the panels are placed on top of existing tiles. The area of PV panels required to generate 1 kWp varies but generally 6-8m<sup>2</sup> for mono-crystalline and 10m<sup>2</sup> for polycrystalline panels will generate 1kWp(kWp-energy generated at full sunlight) of electricity.

### Cost & Maintenance

Prices for PV systems vary, depending on the size of the system to be installed, type of PV cell used and the nature of the actual building on which the PV is mounted. The size of a PV system depends on the buildings electricity demand. For an average domestic system, costs of a PV system can be around £4000 - £9000 per kWp installed, with most domestic systems usually between 1.5 and 2 kWp. Solar tiles cost more than conventional panels, and panels that are integrated into a roof are more expensive than those that sit on top. Grid connected systems require very little maintenance, generally limited to ensuring that the panels are kept relatively clean and that shade from trees does not obstruct the sunlight path. However, the wiring and system components should be checked regularly by a qualified technician.

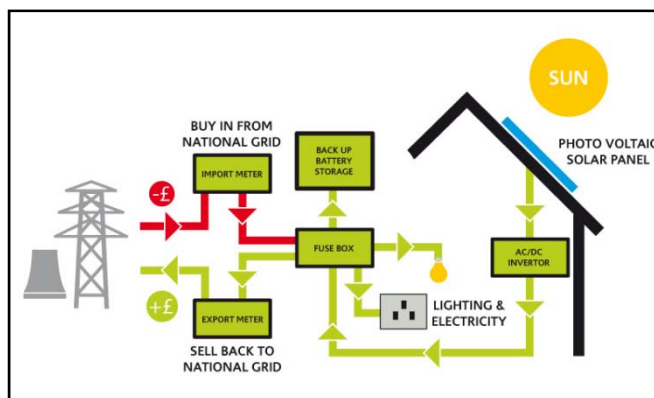

Grid connected systems require very little maintenance, generally limited to ensuring that the panels are kept relatively clean and that shade from trees does not obstruct the sunlight path. However, the wiring and system components should be checked regularly by a qualified technician.

### Available Grants

The Feed - In - Tariffs have been introduced in order to give an incentive for PV generated electricity. The Feed-In-Tariffs scheme is based on the principle that the energy supplier pays generation tariff for every kWh the PV system generates and an export tariff for every kWh of electricity supplied back to the national grid.

**Tariff level for new Solar PV installations after 1<sup>st</sup> August 2012 (pence/kWh). For non PV technologies there will be new rates as of October 2012**

Technology	Scale	Standard generation tariff	Multi-installation tariff	Lower tariff if energy efficiency requirement not met
PV	≤4 kW (new build)	16.0	14.4	7.1
PV	≤4 kW (retrofit)	16.0	14.4	7.1
PV	>4-10 kW	14.5	13.05	7.1
PV	Stand alone system	7.1	N/A	N/A

## 9.2.2 Solar Water Heating

### Description of Solar Water Heating System

Solar water heating systems use solar energy to heat water. Depending on the type of solar collector used, the weather conditions, and the hot water demand, the temperature of the water heated can

Syntegra Consulting Ltd, The Braccans Business Centre, 2 The Braccans, Bracknell, RG12 2XH  
Registered Company No. 06408056

T: 08450091625 E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)

VAT Registration No. 98001604



vary from tepid to nearly boiling. Most solar systems are meant to furnish 20 to 85% of the annual demand for hot water, the remainder being met by conventional heating sources, which either raise the temperature of the water further or provide hot water when the solar water heating system cannot meet demand.



Solar systems can be used wherever moderately hot water is required. Off-the-shelf packages provide hot water to the bathroom and kitchen of a house; custom systems are designed for bigger loads, such as multi-unit apartments.

The most common collector is called a flat-plate collector. Mounted on the roof, it consists of a thin, flat, rectangular box with a transparent cover that faces the sun. Small tubes run through the box and carry the fluid – either water or other fluid, such as an antifreeze solution – to be heated. The tubes are attached to an absorber plate, which is painted black to absorb the heat. As heat builds up in the collector, it heats the fluid passing through the tubes.

### Advantages

Solar water heating can provide about a third of a typical dwellings/business hot water needs. The average domestic system reduces CO<sub>2</sub> by 325 kg per year approximately and around £50 a year of hot water bills, when installed in a gas heated home.

Fuel Displaced	£ Saving per year	CO <sub>2</sub> saving per year kg
Gas	50	325
Electricity	80	635

**Table 4**

The savings presented on the previous table are approximate and are based on the hot water heating demand of a 3 bed semi detached house.

### Best Design Practice

For domestic systems a 3-4 m<sup>2</sup> of southeast to southwest facing roof receiving direct sunlight for the main part of the day is required. Also, more space will be needed if a water cylinder is required.

### Planning Issues

In England, changes to permitted development rights for micro generation technologies introduced on 6<sup>th</sup> April 2008 have lifted the requirements for planning permission for most solar water heating installations. Roof mounted and stand alone systems can now be installed in most dwellings, as long as they follow certain size criteria. Listed, English Heritage and buildings in conservation areas are exempted.

### Cost & Maintenance

A typical installation cost for a domestic SHW system is £3000-£5000. Evacuated tube systems are more expensive due to their higher manufacturing cost.

SWH systems in general have a 5-10 years warranty and require little maintenance. A yearly check by the owner of the system and a more detailed maintenance check by a qualified installer every 3-5 years should be adequate.

### Available Grants

In March 2011, the UK Government announced the details of their Renewable Heat Incentive (RHI). RHI is designed to provide financial support that encourages individuals, communities and businesses to switch from using fossil fuel for heating, to renewables such as wood fuel.

There will be two phases for domestic customers:

#### **Phase 1 (available from July 2011) - "RHI Premium Payment"**

This is called the "RHI Premium Payment" and will be worth around £15m and available to 25,000 householders in Great Britain who install from July 2011.

The exact amounts available to consumers are confirmed:


- \* Solar Thermal - £300/unit

These are one off payments; so not annual. DECC plan to publish details of the "Phase 2 RHI Payment" and how this will apply next year. Recipients of this payment will need to ensure that:

- \* They have a well-insulated property based on its energy performance certificate;
- \* They agree to give feedback on how the equipment performs.

#### **Phase 2 (available from October 2012) – RHI tariffs**

People in receipt of the Renewable Heat Premium Payments will be able to receive long term RHI tariff support once these tariffs are introduced, as will anybody who has installed an eligible technology since 15th July 2009.

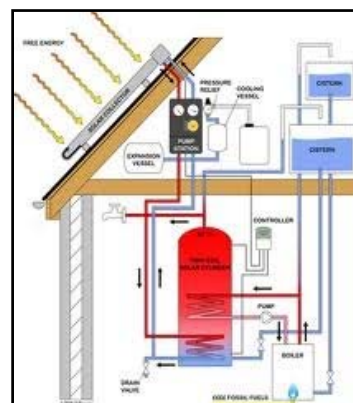

These tariff payments will start alongside the Green Deal from October 2012 to allow a more whole-house approach to heat production and energy saving.

### 9.2.3 Wind Turbines

#### Description of Wind Turbine

Wind energy systems convert the kinetic energy of moving air into electricity or mechanical power. They can be used to provide power to central grids or isolated grids, or to serve as a remote power supply or for water pumping. Wind turbines are commercially available in a vast range of sizes. The turbines used to charge batteries and pump water off-grid tend to be small, ranging from as small as 50 W up to 10 kW. For isolated grid applications, the turbines are typically larger, ranging from about 10 to 200 kW. Wind turbines are mounted on a tower to harness the most energy. At 30 meters or more aboveground, they can capture the faster and less turbulent wind in an urban environment. Turbines harness the wind's energy with their propeller-like blades. In most of the cases, two or three blades are mounted on a shaft to form a rotor.



There are two types of wind turbines that can be used for buildings:

- Mast mounted – which are free standing and located near the building that will be consuming the generated electricity.
- Roof Mounted – which can be installed on house roofs and other buildings.

#### Planning Issues

Planning issues such as visual impact, noise and conservation issues also have to be considered. System installation normally requires permission from the local authority.

#### Cost & Maintenance

- Roof mounted turbines cost from £3000. The amount of energy and carbon that roof top micro wind turbines save depends on size, location, wind speed, nearby buildings and the local landscape. At the moment there is not enough data from existing wind turbine installations to provide a figure of how much energy and CO<sub>2</sub> could typically be saved. The Energy saving trust is monitoring up to 100 installations nationwide which will give ball park figures of carbon savings.
- Mast Mounted turbines in the region of 2.5kW to 6kW would cost approximately £11000-£19000. These costs are inclusive of the turbine, mast, inverters, battery storage and installation cost. It should be noted that these costs vary depending on location, size and type of system to be installed.
- Turbines have an operational lifetime of up to 22.5 years but require service checks every few years to ensure efficient operation. For battery storage systems, typical battery life is around

Syntegra Consulting Ltd, The Braccans Business Centre, 2 The Braccans, Bracknell, RG12 2XH  
Registered Company No. 06408056

T: 08450091625 E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)

VAT Registration No. 98001604



6-10 years, depending on the type, so batteries may have to be replaced at some point in the system's life.

### Available Grants

The Feed - In – Tariffs have been introduced in order to give an incentive for wind generated electricity. The Feed-In-Tariffs scheme is based on the principle that the energy supplier pays generation tariff for every kWh the wind system generates and an export tariff for every kWh of electricity supplied back to the national grid.

- Generation Tariff: 28.0 – 36.20 pence/kWh depending on installed rated output (up to 15KW)
- Export Tariff: 3.10pence/kWh
- Tariff period duration is 20 yea

## 9.2.4 Small Scale Hydro

### Description of Small scale Hydro System

Small hydro systems convert the potential and kinetic energy of moving water into electricity, by using a turbine that drives a generator. As water moves from a higher to lower elevation, such as in rivers and waterfalls, it carries energy with it; this energy can be harnessed by small hydro systems. Used for over one hundred years, small hydro systems are a reliable and well-understood technology that can be used to provide power to a central grid, an isolated grid or an off-grid load, and may be either run-of-river systems or include a water storage reservoir.



In a residential small scale hydro system the constant flow of water is critical to the success of the project. The energy available from a hydro turbine is proportional to the flow rate of the water and the head height. Since the majority of the cost of a small hydro project stems from up front expenses in construction and equipment purchase, a hydro project can generate large quantities of electricity with very low operating costs and modest maintenance expenditures for 50 years or longer.

### Advantages

For houses with no mains connection but with access to a micro hydro site, a good hydro system can generate a steady, more reliable electricity supply than other renewable technologies at lower cost. Total system costs can be high but often less than the cost of a grid connection and with no electricity bills to follow.

### Cost & Maintenance

Small hydro schemes are very site specific and are related to energy output. For low heat systems, costs may lie in the region of £4,000 per kW installed up to about 10kW and would drop per kW for larger schemes.



For medium heads, there is a fixed cost of about £10,000 and about £2,500 per kW up to around 10kW – so a typical 5kW domestic scheme might cost £20-£25,000.

Unit costs drop for larger schemes. Maintenance costs vary but small scale hydro systems are very reliable.

### Available Grants

The Feed - In – Tariffs have been introduced in order to give an incentive for hydroelectric generated electricity. The Feed-In-Tariffs scheme is based on the principle that the energy supplier pays generation tariff for every kWh the hydroelectric system generates and an export tariff for every kWh of electricity supplied back to the national grid.

- Generation Tariff: 20.90 pence/kWh depending on installed rated output (up to 15KW)
- Export Tariff: 3.10pence/kWh
- Tariff period duration is 20 years

## 9.2.5 Biomass Heating

### Description of Biomass Heating System

Biomass heating systems also known as biomass boilers burn organic matter—such as wood chips, agricultural residues or municipal waste—to generate heat for buildings. They are highly efficient heating systems, achieving near complete combustion of the biomass fuel through control of the fuel and air supply, and often incorporating automatic fuel handling transport systems. Biomass boilers consist of a boiler, a heat distribution system, and a fuel transportation system. The biomass heating system typically makes use of multiple heat sources, including a waste heat recovery system, a biomass combustion system, a peak load boiler, and a back-up boiler. The heat distribution system conveys hot water or steam from the heating plant to the loads that may be located within the same building as the heating plant, as in a system for a single institutional or industrial building, or, in the case of a “district heating” system, clusters of buildings located in the vicinity of the heating plant.



Biomass heating systems have higher capital costs than conventional boilers and need diligent operators. Balancing this, they can supply large quantities of heat on demand with very low fuel costs, depending on the origin of the fuel.

### Best Design Practice

It's important to have storage space for the fuel and appropriate access to the boiler for loading the fuel. A local fuel supplier should be present in order to make the scheme viable.

The vent material must be specifically designed for wood appliances and there must be sufficient air movement for proper operation of the stove. Chimneys can be fitted with a lined flue.

A Biomass heating system installation should comply with all safety and building regulations. Wood can only be burned in exempted appliances, under the Clean Air Act.

### Advantages

Producing energy from Biomass has both environmental and economic advantages. Although Biomass produces CO<sub>2</sub> it only releases the same amount that is absorbed whilst growing, which is why it is considered to be carbon neutral. Furthermore, Biomass can contribute to waste management by harnessing energy from products that are often disposed at landfill sites.

It is most cost effective and sustainable when a local fuel source is used, which results in local investment and employment, which in addition minimizes transport emissions.

### Planning Issues

If the building is listed or is in an area of outstanding natural beauty, then it is required that the Local Authority Planning department is notified before a flue is fitted.

### Cost & Maintenance

Stand alone room heaters cost £2,000 to £4,000. Savings will depend on how much they are used and which fuel you are replacing. A Biomass stove which provides a detached home with 10% of annual space heating requirements could save around 840kg of CO<sub>2</sub> when installed in an electrically heated home. Due to the higher cost of Biomass pellets compared with other heating fuels, and the relatively low efficiency of the stove compared to a central heating system it will cost more to run.

The cost of Biomass boilers varies depending on the system choice; a typical 15kW pellet boiler would cost about £5,000-£14,000 installed, including the cost of the flue and commissioning process. A manual log feed system of the same size would be slightly cheaper. A wood pellet boiler could save around £750 a year in energy bills and around 6 tons of CO<sub>2</sub> per year when installed in an electrically heated home.

In terms of biomass fuel costs, they generally depend on the distance between the dwelling and the supplier and whether large quantities can be bought.

### Available Grants

In March 2011, the UK Government announced the details of their Renewable Heat Incentive (RHI). RHI is designed to provide financial support that encourages individuals, communities and businesses to switch from using fossil fuel for heating, to renewables such as wood fuel.

The RHI is in two phases:

#### **Phase 1 (available from July 2011) - "RHI Premium Payment"**

This is called the "RHI Premium Payment" and will be worth around £15m and available to 25,000 householders in Great Britain who install from July 2011.

Syntegra Consulting Ltd, The Braccans Business Centre, 2 The Braccans, Bracknell, RG12 2XH  
Registered Company No. 06408056

T: 08450091625 E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)

VAT Registration No. 98001604

The exact amounts available to consumers have yet to be confirmed. However the Department of Energy and Climate Change (DECC) have announced that the following amounts may be available:

- \* Biomass boilers - £950/unit (available only to off-gas installations)

These are one off payments; so not annual. DECC plan to publish details of the “Phase 2 RHI Payment” and how this will apply next year. Recipients of this payment will need to ensure that:

- \* They have a well-insulated property based on its energy performance certificate;
- \* They agree to give feedback on how the equipment performs.

### Phase 2 (available from October 2012) – RHI tariffs

People in receipt of the Renewable Heat Premium Payments will be able to receive long term RHI tariff support once these tariffs are introduced, as will anybody who has installed an eligible technology since 15th July 2009.

These tariff payments will start alongside the Green Deal from October 2012 to allow a more whole-house approach to heat production and energy saving.

## 9.3 Low Carbon Technologies

In this section the low carbon technologies are described.

- Air Source Heat Pumps
- Ground Source Heat Pumps (GSHP)
- Combined Heat and Power (CHP)
- Micro CHP
- Fuel Cells

### 9.3.1. Air Source Heat Pumps (ASHP)

#### Description of Air Source Heat Pumps

Air source heat pumps work in a very similar way to fridges and air conditioners and absorb heat from the air. They are ideally suited to work with under floor heating systems because of the lower design temperatures of under floor systems. The lower the water temperature, the higher the COP. Air source heat pumps use air. They are fitted outside a house; generally perform better at slightly warmer air temperatures. The seasonal efficiencies of air source heat pumps are between 200% - 400%. Heat pumps can operate at outside temperatures down to –15 degC, although there is a drop in COP.



Syntegra Consulting Ltd, The Braccans Business Centre, 2 The Braccans, Bracknell, RG12 2XH  
Registered Company No. 06408056

T: 08450091625 E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)

VAT Registration No. 98001604



### Advantages

- A reduction in carbon emission.
- No boiler flues and danger of carbon monoxide leakage.
- Maintenance is carried outside the premises.
- No annual boiler servicing and safety checks.
- Heat pump life expectancy about 25 years compared to a boiler of 15 years



### Costs & Savings

Operating Cost Savings around 15% in comparison with a typical gas fired condensing boiler installation with HWS cylinder and an electrically driven Community air to water heat pump.

### Available Grants

In March 2011, the UK Government announced the details of their Renewable Heat Incentive (RHI).

RHI is designed to provide financial support that encourages individuals, communities and businesses to switch from using fossil fuel for heating, to renewables such as wood fuel.

The RHI is in two phases:

#### **Phase 1 (available from July 2011) - "RHI Premium Payment"**

This is called the "RHI Premium Payment" and will be worth around £15m and available to 25,000 householders in Great Britain who install from July 2011.

The exact amounts available to consumers are confirmed:

- \* Air Source Heat Pumps - £850/unit (available only for off-gas installations)

These are one off payments; so not annual. DECC plan to publish details of the "Phase 2 RHI Payment" and how this will apply next year. Recipients of this payment will need to ensure that:

- \* They have a well-insulated property based on its energy performance certificate;
- \* They agree to give feedback on how the equipment performs.

#### **Phase 2 (available from October 2012) – RHI tariffs**

People in receipt of the Renewable Heat Premium Payments will be able to receive long term RHI tariff support once these tariffs are introduced, as will anybody who has installed an eligible technology since 15th July 2009.


Whilst Air source heat pumps will be eligible for the Renewable Premium Payment, a decision on whether or not they'll be included in the tariff payments will be based upon consumer feedback on the performance of the technologies. This should be clarified towards the end of 2011.

These tariff payments will start alongside the Green Deal from October 2012 to allow a more whole-house approach to heat production and energy saving.

### 9.3.2 Ground Source Heat Pumps (GSHP)


#### Description of Ground Source Heat Pumps

Ground-source heat pumps provide low temperature heat by extracting it from the ground or a body of water and provide cooling by reversing this process. Their principal application is space heating and cooling, though many also supply domestic hot water. They can even be used to maintain the integrity of building foundations in permafrost conditions, by keeping them frozen through the summer.

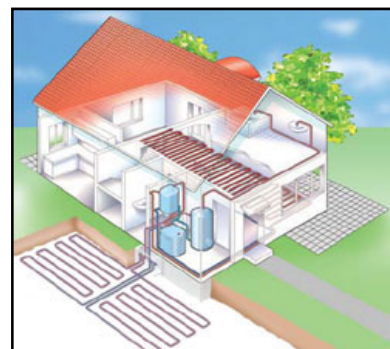

A ground-source heat pump (GSHP) system has three major components: the earth connection, a heat pump, and the heating or cooling distribution system. The earth connection is where heat transfer occurs. One common type of earth connection comprises tubing buried in horizontal trenches or vertical boreholes, or alternatively, submerged in a lake or pond. An antifreeze mixture, water or another heat-transfer fluid is circulated from the heat pump, through the tubing, and back to the heat pump in a "closed loop." "Open loop" earth connections draw water from a well or a body of water, transfer heat to or from the water, and then return it to the ground or the body of water.

Since the energy extracted from the ground exceeds the energy used to run the heat pump, GSHP "efficiencies" can exceed 100%, and routinely average 200 to 500% over a season. Due to the stable, moderate temperature of the ground, GSHP systems are more efficient than air-source heat pumps, which exchange heat with the outside air. GSHP systems are also more efficient than conventional heating and Air-conditioning technologies, and typically have lower maintenance costs. They require less space, especially when a liquid building loop replaces voluminous air ducts, and, since the tubing is located underground, are not prone to vandalism like conventional rooftop units. Peak electricity consumption during cooling

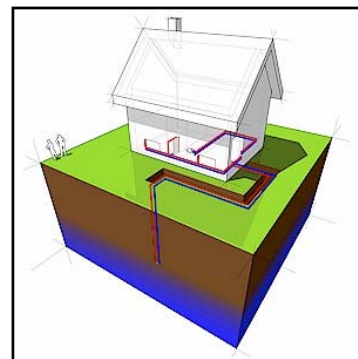

season is lower than with conventional air-conditioning, so utility demand charges may be reduced. Heat pumps typically range in cooling capacity from 3.5 to 35 kW (1 to 20 tons of Cooling). A single unit in this range is sufficient for a house or small commercial Building. The heat pump usually generates hot or cold air to be distributed locally by conventional ducts.

### Advantages

The efficiency of GSHP system is measured by the coefficient of performance (COP). This is the ratio of units of heat output for each unit of electricity used to drive the compressor and pump for the ground loop. Average COP known as seasonal efficiency, is around 3-4 although some systems may produce a greater rate of efficiency. This means that for every unit of electricity used to pump the heat, 3-4 units of heat are produced, making it an efficient way of heating a building. If grid electricity is used for the compressor and pump, then a range of energy suppliers should be consulted in order to benefit from the lower running costs.

### Cost & Savings

A typical 8-12kW system costs £6,000-£12,000 (not including the price of distribution system). This can vary with property and location. When installed in an electrically heated home a GSHP could save as much as £900 a year on heating bills and almost 7 tonnes of CO<sub>2</sub> a year. Savings will vary depending on what fuel is being replaced.

### Available Grants

In March 2011, the UK Government announced the details of their Renewable Heat Incentive (RHI). RHI is designed to provide financial support that encourages individuals, communities and businesses to switch from using fossil fuel for heating, to renewables such as wood fuel.

There will be two phases for domestic customers:

#### **Phase 1 (available from July 2011) - "RHI Premium Payment"**

This is called the "RHI Premium Payment" and will be worth around £15m and available to 25,000 householders in Great Britain who install from July 2011.

The exact amounts available to consumers are confirmed:

\*Ground Source Heat Pumps - £1,250/unit (available for off-gas installations only)

These are one off payments; so not annual. DECC plan to publish details of the "Phase 2 RHI Payment" and how this will apply next year. Recipients of this payment will need to ensure that:

- \* They have a well-insulated property based on its energy performance certificate;
- \* They agree to give feedback on how the equipment performs.

#### **Phase 2 (available from October 2012) – RHI tariffs**

Syntegra Consulting Ltd, The Braccans Business Centre, 2 The Braccans, Bracknell, RG12 2XH  
Registered Company No. 06408056

T: 08450091625 E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)

VAT Registration No. 98001604



The UK Passive House Organisation

People in receipt of the Renewable Heat Premium Payments will be able to receive long term RHI tariff support once these tariffs are introduced, as will anybody who has installed an eligible technology since 15th July 2009.

These tariff payments will start alongside the Green Deal from October 2012 to allow a more whole-house approach to heat production and energy saving

### 9.3.3 Combined Heat and Power (CHP) & Micro CHP

#### Description of CHP

The principle behind combined heat and power (cogeneration) is to recover the waste heat generated by the combustion of a fuel in an electricity generation system. This heat is often rejected to the environment, thereby wasting a significant portion of the energy available in the fuel that can otherwise be used for space heating and cooling, water heating, and industrial process heat and cooling loads in the vicinity of the plant. This cogeneration of electricity and heat greatly increases the overall efficiency of the system, anywhere from 25-55% to 60-90% depending on the equipment used, and the application.



A CHP installation comprises four subsystems: the power plant, the heat recovery and distribution system, an optional system for satisfying heating and/or cooling loads and a control system. A wide range of equipment can be used in the power plant, with the sole restriction being that the power equipment rejects heat at a temperature high enough to be useful for the thermal loads at hand. In a CHP system, heat may be recovered and distributed as hot water, conveyed from the plant to low temperature thermal loads in pipes for domestic hot water, or for space heating.

#### Advantages

CHP can significantly reduce primary energy consumption, and can therefore have a major impact on CO<sub>2</sub> emissions associated with the combustion of fossil fuels in conventional boilers. Each 1 kW of electrical capacity provided by CHP plant using fossil fuels has the potential to reduce annual CO<sub>2</sub> emissions by around 0.6 tons compared to gas-fired boilers and fully grid-derived electricity. For plant which is fuelled by renewable energy sources the potential is much greater.

#### Costs & Savings

Capital costs for CHP installations are higher than for alternative systems, but this can be recovered over a relatively short period of time (typically 5–10 years) for installations where there is a demand for heat and power for 4500 hours or more each year. The cost effectiveness is very sensitive to the relative price of electricity and fossil fuel which have been subject to frequent variations since de-regulation of the energy supply industries.

Syntegra Consulting Ltd, The Braccans Business Centre, 2 The Braccans, Bracknell, RG12 2XH  
Registered Company No. 06408056

T: 08450091625 E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)

VAT Registration No. 98001604



The UK Passive House Organisation



### Micro CHP

Micro CHP (Combined Heat & Power) is the simultaneous production of useful heat and power within the home. It works very much like the gas boiler in a central heating system and heats the home in just the same way. However, at the same time it generates electricity, some of which will be used in the dwelling and the remainder will be exported to the electricity grid. Effectively the micro CHP unit replaces the gas central heating boiler and provides heat and hot water as usual, but additionally provides the majority of the home's electricity needs. Although individual units produce, by definition, relatively small amounts of electricity, the significance of micro CHP lies in the potentially huge numbers of systems which may ultimately be installed in the millions of homes in the UK where natural gas is currently the dominant heating fuel.



### Available grants

The Feed - In – Tariffs have been introduced in order to give an incentive for micro CHP generated electricity. The Feed-In-Tariffs scheme is based on the principle that the energy supplier pays generation tariff for every kWh the micro CHP system generates and an export tariff for every kWh of electricity supplied back to the national grid.

- Generation Tariff: 10.50 pence/kWh depending on installed rated output (up to 2KW)
- Export Tariff: 3.10pence/kWh
- Tariff period duration is 10 years


### 9.3.4 Fuel Cells

#### Description of Fuel Cells

A fuel cell is a device that generates more electricity by a chemical reaction. Every fuel cell has two electrodes, one positive and one negative, called, respectively, the anode and cathode. The reactions that produce electricity take place at the electrodes.

Every fuel cell also has an electrolyte, which carries electrically charged particles from one electrode to the other, and a catalyst, which speeds the reactions at the electrodes. Hydrogen is the basic fuel, but fuel cells also require oxygen.

One great appeal of fuel cells is that they generate electricity with very little pollution—much of the hydrogen and oxygen used in generating electricity ultimately combine to form a harmless by product, namely water.

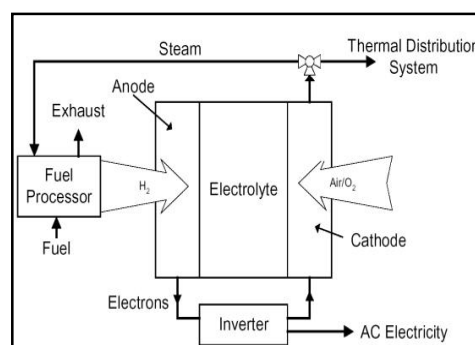

### Fuel Cell Operation

The purpose of a fuel cell is to produce an electrical current that can be directed outside the cell to do work, such as powering an electric motor or illuminating a light bulb or a city. Because of the way electricity behaves, this current returns to the fuel cell, completing an electrical circuit. The chemical reactions that produce this current are the key to how a fuel cell works.

There are several kinds of fuel cells, and each operates a bit differently. But in general terms, hydrogen atoms enter a fuel cell at the anode where a chemical reaction strips them of their electrons. The hydrogen atoms are now “ionized,” and carry a positive electrical charge. The negatively charged electrons provide the current through wires to do work. If alternating current (AC) is needed, the DC output of the fuel cell must be routed through a conversion device called an inverter.

### Advantages

Even better, since fuel cells create electricity chemically, rather than by combustion, they are not subject to the thermodynamic laws that limit a conventional power plant. Therefore, fuel cells are more efficient in extracting energy from a fuel. Waste heat from some cells can also be harnessed, boosting system efficiency still further.

### Fuel Cells with Hydrogen from Renewable Sources

Fuel cells can be used as CHP systems in buildings. There are currently several different systems under development using different chemical processes, which operate at different temperatures. They currently use natural gas as the fuel, which is reformed to produce hydrogen, the required fuel for the fuel cell. When and if hydrogen becomes available from renewable energy, fuel cell CHP from renewable sources may be possible in buildings.

## 10. BE GREEN – RENEWABLE ENERGY

In this section the viable renewable energy technologies that will reduce the development's CO<sub>2</sub> emissions further by 20% are examined. Incorporating green design measures will significantly reduce the onsite energy consumption and the CO<sub>2</sub> emissions of the building. The ‘London Plan’ states that a further CO<sub>2</sub> reduction of 20% must be achieved by the installation of renewable technologies. Below is a review of possible renewable technologies for incorporation in the proposed development.

All of the LZC technologies are assessed against a number of criteria. Hence, LZC technology feasibility will be assessed according to the following criteria:

- I. Renewable energy resource or fuel availability of the LZC technology on the site.
- II. Space limitations due to building design and urban location of the site.
- III. Capital, operating and maintenance cost.
- IV. Planning Permission
- V. Implementation with regards the overall M&E design strategy for building type



The **ADDITIONAL** renewable/LZC technologies which were found non feasible based on the above criteria are the following:

- Wind Turbines
- Biomass Boilers
- Micro CHP
- Hydrogen Fuel Cells
- Small scale hydro power
- Grd. Source Heat Pump (GSHP)

### 10.1 Wind Turbines

Wind turbines are not feasible for the development since it does not meet the criteria mentioned above. Since the development is located in a dense residential and commercial area; the wind resource may be restricted due to the adjacent large trees and air turbulence generated between them. The yearly average wind speed is quite low at 10 meters above ground.

#### Wind speed at 10m above ground level (m/s)

4.9	5.3	5.6
4.8	4.8	5
4.9	4.8	4.9

#### Wind speed at 25m above ground level (m/s)

5.7	6	6.3
5.6	5.6	5.8
5.7	5.6	5.7

#### Wind speed at 45m above ground level (m/s)

6.2	6.5	6.7
6.1	6.2	6.3
6.1	6.1	6.2

Syntegra Consulting Ltd, The Braccans Business Centre, 2 The Braccans, Bracknell, RG12 2XH  
Registered Company No. 06408056 VAT Registration No. 98001604

T: 08450091625 E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)



The UK Passive House Organisation

Squares surrounding the central square correspond to wind speeds for surrounding grid squares.

#### What does this mean?

Power generated is related to wind-speed by a cubic ratio. That means if you halve the wind-speed, the power goes down by a factor of 8 (which is  $2 \times 2 \times 2$ ). A quarter of the wind-speed gives you a 64<sup>th</sup> of the power ( $4 \times 4 \times 4$ ).

As a rough guide, if your turbine is rated at producing 1KW at 12m/s then it will produce 125W at 6m/s and 15W at 3m/s.

#### **Please Note!**

Bear in mind that the NOABL wind-speed dataset used here is a model of wind-speeds across the country, assuming **completely flat terrain**. It isn't a database of measured wind-speeds. Other factors such as hills, houses, trees and other obstructions in your vicinity need to be considered as well as they can have a significant effect.

An actual wind-speed measurement using an anemometer has not been used for the purpose of this energy strategy report.

The central square highlighted in yellow demonstrates the average wind speed in m/s for the site. Squares surrounding the central square correspond to wind speeds for surrounding grid squares.

From the above table it is shown that the average wind speed on the development according to **NOABL database was estimated at 4.8m/s at 10m high above ground and 5.6m/s at 25m above ground.**

Wind turbine(s) have been discounted for this development scheme for the following reasons:

- A large mast horizontal axis wind turbine will not be able to generate electricity at optimal operating range since it requires higher average wind speeds. Furthermore, the installation of small scale wind turbines won't be feasible due to low average wind speed at 10 meters height, 25m & 45metre heights.
- Due to the close proximity of neighboring commercial & residential properties and trees.
- In addition, the low frequency noise generated by wind turbines might cause inconvenience to the neighboring residents. However, the level a person can be affected by low frequency noise varies from individual to individual.
- Due to the size and the required height of a potential wind turbine scheme there is also an issue with the propellers' impacting bird traffic, obtrusiveness, shadow flicker which means that generally large wind turbines need to be located at least 300m from any residential properties, which would not be possible on this site.
- Roof mounted units are limited in size due to wind induced stresses which are transmitted to the building structure. Most roof mounted turbines currently on the market are approximately 2m diameter and capable of producing 1-1.5kW each. However, the output is dependent on

the surrounding obstructions and local wind speed. Thus small scale wind turbines would not make any meaningful impact on a site such as this.

- There are likely to be planning issues associated with wind turbines of a size necessary to affect any significant CO2 savings or energy savings.
- Because of the above the investment case with regards this technology solution is not viable compared to other solutions with a more attractive ROI.
- Finally, the installation of wind turbines on the development requires planning permission (and is likely to instigate neighborhood committee interest regarding its aesthetics and acoustic issues).

## 10.2 Biomass Boilers

Biomass boilers should not be considered for this project due to the following reasons:

- Furthermore, in common with other types of combustion appliances, biomass boilers are potentially a source of air pollution. Pollutants associated with biomass combustion include particulate matter (PM<sub>10</sub>/ PM<sub>2.5</sub>) and nitrogen oxides (NO<sub>x</sub>) EMISSIONS. These pollution emissions can have an impact on local air quality and affect human health. Biomass has recently been rejected by many London Boroughs as means of obtaining the on-site renewable contribution (and this will soon send ripples out to other regions). This is because of their associated flue emissions (which can be significantly higher than gas fired boilers) and the difficulty of ensuring the boiler will operate at its optimum efficiency, which is often quoted by designers at the initial design stages. Biomass flue emissions are often difficult to control because the quality of fuel can vary significantly between suppliers. Given this a bio fuel system may not be acceptable to the Council on planning grounds (e.g. concerns about associated flue emissions/impact on local 'Air Quality', increase in road traffic from pellet delivery lorries).
- Biomass fuel requires more onerous and frequent wood fuel silo (site storage issues) replenishing by delivery trucks- which in turn can cause site transportation issues that will need to be considered and addressed along with the impact on the other residents and neighborhood infrastructure.
- Restrictions on the type of fuel and appliance may apply to the development and according to studies commissioned by DEFRA the levels of particles emitted by the burning of wood chip or waste would be considered to outweigh the benefits of carbon reduction especially in an urban environment such as the proposed development site.
- Dependant on a fuel supply chain contract being confirmed.
- There is no suitable location for the plant and storage of the pellets on site at present.
- The whole of London Borough of Camden is in a smoke control zone.

## 10.3 Hydrogen Fuel Cells

Not commercially viable yet - As a result this solution will not be assessed any further.

The BlueGen product is a ceramic fuel cell and has recently entered the UK market this year. Using ceramic fuel cells, BlueGen® electrochemically converts natural gas into electricity at up to 60 per cent electrical efficiency. Electricity is consumed locally, with unused power being exported to the grid. When the integrated heat recovery system is connected, the waste heat from BlueGen can be used to produce hot water - which improves the total efficiency to approximately 85 per cent.

#### 10.4 Small scale Hydro

Small scale hydro-electric will not be studied any further because of the location and the spatial limitations of the development. There is no river or lake within the development site boundaries. As a result this solution will not be assessed any further.

#### 10.5 Ground Source Heat pump (GSHP)

GSHP will not be studied any further for the following reasons:

- If an open loop configuration was to be adopted, a test borehole would be needed to assess the available resource. The test resource process is expensive and of course does not guarantee an acceptable resource in the ground. Additionally, a closed loop borehole configuration could not be used due to spatial limitations of the site.
- There are likely to be planning issues associated with borehole excavation and drilling.
- Running costs and maintenance may be minimal. However, installation is a costly affair. A GSHP solution would represent a relatively expensive option in comparison to other renewable technologies available.
- Additional electric immersion and pumps would be required to heat the GSHP water up to suitable temperature to be used around the building and it's likely a centralised plant area will also be required to house the circulation pumps.
- This technology is not recommended due to the increased plant energy consumption requirements in turn impacting the DER/TER score for the required energy strategy objectives.
- Furthermore, boreholes also destabilize the ground surface and may be considered a minus for environmentally friendly endeavours.

#### 10.6 CHP & Micro CHP

CHP has not been considered further for this project for the following reasons:

- The average maximum heating load of a new apartment (built to 2010 building regs) is approximately 3kW and therefore most individual heating systems with independent condensing gas boilers would be incapable of working at optimal efficiencies or achieving their stated SEDBUK rating due to boiler cycling.

- Traditional CHP should not be considered for this project due to the spatial constraints of the development plot and dwelling layouts. There is not suitable space in the development for CHP plant.
- Heat from the CHP plant could be utilized to drive an absorption chiller during the summer months (tri-generation), but due to the sustainable design of the building fabric, and the use of natural ventilation wherever possible, we anticipate that the cooling load will be minimal, making this a non-viable proposition.
- Micro-CHP is a relatively new concept (Baxi Ecogen was made available in 2009) and issues are raised in relation to unproven technology, inefficiency for shorter run cycles and lack of technical knowledge that can limit the practical application of micro CHP at present. In addition other issues surrounding the fact that around 50% of electricity generated in domestic properties is surplus, high installation costs and estimated low life expectancy has also been taken into consideration as to its commercial un-viability for this development scheme. Micro-CHP also has a lower FIT tariff rate and period duration and is only applicable for systems under 2kW.



## BREEAM Domestic Refurbishment Pre-Assessment



15 Cleve Road, Hampstead, London, NW6 3RL

February 2013



## Table of Contents

1.0 Scope.....	4
2.0 Executive Summary .....	4
3.0 Project Details .....	5
4. BREEAM Domestic Refurbishment .....	5
<b>4.1 BREEAM Domestic Refurbishment Environmental Issues .....</b>	<b>6</b>
<b>4.2 BREEAM Domestic Refurbishment Scoring &amp; Rating .....</b>	<b>6</b>
5. 15 Cleve Road BREEAM Domestic Refurbishment Pre-assessment performance result .....	10
6. 15 Cleve Road BREEAM Domestic Refurbishment Pre-Assessment Issue Scoring Report.....	11

Syntegra Consulting Ltd, 2 The Braccans, London Road, Bracknell, RG12 2XH  
Registered Company No. 06408056

T: 08450091625  
VAT Registration No. 980016044

E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)



Revision:				
Date:	07/02/2013			
Prepared by:	RN			
Checked by:	AWK			
Authorised by:	AWK			

Syntegra Consulting Ltd, 2 The Braccans, London Road, Bracknell, RG12 2XH  
Registered Company No. 06408056

T: 08450091625  
VAT Registration No. 980016044

E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)



## **1.0 Scope**

This BREEAM Domestic Refurbishment Pre-Assessment Estimate for 15 Cleve Road, a 5 storey detached multi-residential dwelling in Hampstead, has been prepared to support the planning application for the 15 Cleve Road refurbishment scheme, to be submitted to the London Borough of Camden. Also, the BREEAM pre assessment estimate aims to provide the outline sustainability strategy and act as a sustainable design guide for the refurbishment scheme. The Pre-assessment is an estimate that sets out the method for which the proposed refurbishment could achieve a BREEAM rating of “Excellent”.

This report and estimate has been based on information provided by:  
MR Partnership Ltd. Architects

## **2.0 Executive Summary**

The Pre-Assessment Estimate shows that at by achieving the minimum standard requirements together with assumptions of good sustainable design practice the proposed refurbishment project could achieve a BREEAM rating of “Excellent”.

The Mechanical and Electrical specification of the building and materials used in the refurbishment of the building will be essential to the sustainable performance of the building and need to be addressed at an early stage in the design process. This assessment together with the Energy Strategy report prepared by Syntegra are therefore the starting point for developing the overall strategy of the building’s sustainable design.

The BREEAM “Excellent” rating is a planning policy requirement as it is set out in Core Strategy Policy CS13 of the London Borough of Camden Local Development Framework. The reduction is achieved by energy efficient design measures incorporated into the building fabric coupled with low and zero carbon technologies for generating electricity on site such as PVs.

### 3.0 Project Details

<b>PROJECT :</b>	15 Cleve Road
<b>CLIENT:</b>	AJR Charitable Trust
<b>ARCHITECT:</b>	MR Partnership Limited
<b>BUILDING SERVICES &amp; LZC CONSULTANT:</b>	Syntegra Consulting
<b>BREEAM CONSULTANT:</b>	Syntegra Consulting.
<b>PRINCIPAL CONTRACTOR:</b>	Not appointed yet.

### 4. BREEAM Domestic Refurbishment

BREEAM Domestic Refurbishment is a performance based assessment method and certification scheme for refurbished buildings. The primary aim of BREEAM Domestic Refurbishment is to mitigate the life cycle impacts of refurbished buildings on the environment in a robust and cost effective manner. This is achieved through integration and use of the scheme by clients and their project teams at key stages in the design and procurement process.

BREEAM Domestic Refurbishment has been developed to meet the following principles:


- Ensure environmental quality through an accessible, holistic and balanced measure of environmental impacts.
- Use quantified measures for determining environmental quality.
- Adopt a flexible approach, avoiding prescriptive specification and design solutions.
- Use best available science and best practice as the basis for quantifying and calibrating a cost effective performance standard for defining environmental quality.
- Reflect the social and economic benefits of meeting the environmental objectives covered.
- Provide a common framework of assessment that is tailored to meet the 'local' context including regulation, climate and sector.
- Integrate construction professionals in the development and operational processes to ensure wide understanding and accessibility.

Syntegra Consulting Ltd, 2 The Braccans, London Road, Bracknell, RG12 2XH  
Registered Company No. 06408056

T: 08450091625

VAT Registration No. 980016044

E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)



- Adopts existing industry tools, practices and other standards wherever possible to support developments in policy and technology, build on existing skills and understanding and minimize costs.
- Stakeholder consultation to inform ongoing development in accordance with the under-lying principles and the pace of change in performance standards.

## 4.1 BREEAM Domestic Refurbishment Environmental Issues

The environmental issues under which BREEAM assesses a building are divided up into the following seven categories:

- Management
- Health and well-being
- Energy
- Water
- Materials
- Waste
- Pollution

## 4.2 BREEAM Domestic Refurbishment Scoring & Rating


There are elements that determine the overall performance of a refurbished project assessed using BREEAM Domestic Refurbishment, the following:

- I. The BREEAM rating level benchmarks
- II. The minimum BREEAM standards
- III. The environmental section weightings
- IV. The BREEAM assessment issues and credits

Syntegra Consulting Ltd, 2 The Braccans, London Road, Bracknell, RG12 2XH  
Registered Company No. 06408056

T: 08450091625  
VAT Registration No. 980016044

E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)



The BREEAM rating level benchmarks:

The BREEAM Domestic Refurbishment rating benchmarks are shown on the following table:

BREEAM RATING	%Score
Outstanding	85
Excellent	70
Very Good	55
Good	45
Pass	30
Unclassified	<30

An unclassified BREEAM rating represents performance that is non-compliant with BREEAM, in terms of failing to meet either the BREEAM minimum standards of performance for key environmental issues or the overall threshold score required for formal BREEAM certification.

Syntegra Consulting Ltd, 2 The Braccans, London Road, Bracknell, RG12 2XH  
Registered Company No. 06408056

T: 08450091625  
VAT Registration No. 980016044

E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)





The minimum BREEAM Domestic Refurbishment standards:

In order to ensure that performance against fundamental environmental issues is achieved in pursuit of a desired BREEAM rating, minimum standards of performance are set in key areas such as energy, water, waste etc. To achieve a particular BREEAM rating, the minimum overall percentage score must be achieved together with the minimum standards, detailed in the Table below.

BREEAM issue	Minimum standards by BREEAM rating level				
	Pass	Good	Very Good	Excellent	Outstanding
Ene 02: Energy Efficiency Rating Post Refurbishment	0.5 Credits	1.0 Credits	2 Credits	2.5 Credits	3.5 Credits
Wat 01: Internal Water use	-	-	1 Credit	2 Credits	3 Credits
Hea 05: Ventilation	1 Credit	1 Credit	1 Credit	1 Credit	1 Credit
Hea 06: Safety	1 Credit	1 Credit	1 Credit	1 Credit	1 Credit
Pol 03: Flooding	-	-	-	2 Credits	2 Credits
Mat 02: Responsible sourcing of materials	Criterion 3 only	Criterion 3 only	Criterion 3 only	Criterion 3 only	Criterion 3 only

The environmental section weightings :


BREEAM uses an explicit weighting system derived from a combination of consensus based weightings and ranking by a panel of experts. Each of the environmental sections consists of a differing number of assessment issues and BREEAM credits. Hence, each individual assessment issue and credit varies in terms of its contribution to a building's overall score.

The Table below outlines the weightings for each of the nine environmental sections included in the BREEAM 2011 New Construction scheme

Syntegra Consulting Ltd, 2 The Braccans, London Road, Bracknell, RG12 2XH  
Registered Company No. 06408056

T: 08450091625  
VAT Registration No. 980016044

E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)



Environmental section	Weighting
Management	12%
Health & Wellbeing	17%
Energy	43%
Water	11%
Materials	8%
Waste	3%
Pollution	6%
Total:	100%
Innovation (additional)	10%

The BREEAM assessment issues and credits:

BREEAM Domestic Refurbishment consists of thirty three individual assessment issues spanning the seven environmental categories, plus an eighth category called 'innovation'. Each issue addresses a specific building related environmental impact or issue and has a number of 'credits' assigned to it.

'BREEAM credits are awarded where a building demonstrates that it meets the best practice performance levels defined for that issue.

**Innovation credits** are available for the recognition of sustainability related benefits or performance levels which are currently not recognised by standard BREEAM assessment issues and criteria. In that way, buildings that go beyond best practice in terms of a particular aspect of sustainability may be awarded.

Syntegra Consulting Ltd, 2 The Braccans, London Road, Bracknell, RG12 2XH  
Registered Company No. 06408056

T: 08450091625  
VAT Registration No. 980016044

E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)



## 5. 15 Cleve Road BREEAM Domestic Refurbishment Pre-assessment performance result

This project has achieved a Pre-Assessment target score of 70.17% against the BREEAM Domestic Refurbishment Pre-assessment criteria. This translates to a Pre-Assessment target rating of EXCELLENT.

BREEAM Environmental Category	Environmental Weighting	Credit Available	Credits Targeted	Section Score
Management	12%	11	11	12.0%
Health & Wellbeing	17%	12	7	9.92%
Energy	43%	29	19	28.17%
Water	11%	4	3.5	7.70%
Materials	8%	45	14	2.49%
Waste	3%	5	4	2.40%
Pollution	6%	8	6	4.50%
Innovation	10%	2	2	3.0%
<b>Total Indicative BREEAM Score</b>	<b>70.17 % EXCELLENT Rating</b>			

**Note:** As the design is progressed, the pre-assessment may be subject to change and the score therefore is indicative only at this stage.

### Specialist Reports, Calculations and other specialist items:


In order to achieve the EXCELLENT rating the below specialist reports need to be produced:

- Flood Risk Assessment.
- Ecology Report.
- Hydrologist Report (Surface Water Run-off calculations).
- Building User guide.
- Site Waste Management Plan (If Was 02 credits are pursued).

Syntegra Consulting Ltd, 2 The Braccans, London Road, Bracknell, RG12 2XH  
Registered Company No. 06408056

T: 08450091625  
VAT Registration No. 980016044

E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)



## 6. 15 Cleve Road BREEAM Domestic Refurbishment Pre-Assessment Issue Scoring Report

Syntegra Consulting Ltd, 2 The Braccans, London Road, Bracknell, RG12 2XH  
Registered Company No. 06408056

T: 08450091625  
VAT Registration No. 980016044

E: [mail@syntegra-epc.co.uk](mailto:mail@syntegra-epc.co.uk)



**BREEAM Domestic Refurbishment 2012 Pre-Assessment Estimator v0.4**

This assessment and indicative BREEAM rating is not a formal certified BREEAM assessment or rating and must not be communicated as such. The score presented is indicative of a dwelling's potential performance and is based on a simplified pre-formal BREEAM assessment and unverified commitments given at an early stage in the design process.

Building name	15 Cleve Road
Indicative building score (%)	70.17%
Indicative BREEAM rating	BREEAM Excellent
Indicative Minimum Standards level achieved	BREEAM Excellent

Management	Health & Wellbeing	Energy	Water	Materials	Waste	Pollution
------------	--------------------	--------	-------	-----------	-------	-----------

<b>INNOVATION</b>	Section Weighting: 10%	Indicative Section Score	3.00%
-------------------	------------------------	--------------------------	-------

Comments

<b>MANAGEMENT</b>	Section Weighting: 12%	Indicative Section Score	12.00%
-------------------	------------------------	--------------------------	--------

<b>Man 01 Home Users Guide</b>			
No. of BREEAM credits available	3	Available contribution to overall score	3.27%
No. of BREEAM innovation credits	0	Minimum Standards applicable	No

**Assessment Criteria**

Where a Home Users Guide be provided to all dwellings, covering all issues set out in the 'Users Guide Contents list', three credits may be awarded

Indicative Credits Achieved
3

Comments

3No credits will be achieved since a Home User Guide will be produced and will cover all listed items in the User Guide Contents List outlined in the BREEAM Domestic Refurbishment Manual 2012.

<b>Man 02 Responsible Construction Practices</b>			
No. of BREEAM credits available	2	Available contribution to overall score	2.18%
No. of BREEAM innovation credits	1	Minimum Standards applicable	No

**Assessment Criteria**

Where a compliant considerate construction scheme will be used, credits are awarded depending the score achieved as outlined below:

Indicative Credits Achieved
2

**Large Scale - project with more than 5 units**

	One Credit	Two Credits
Considerate Constructors Scheme	Score of 24 - 31.5	Score of 32 - 35.5
Alternative Compliant Scheme	Compliance	Beyond Compliance

**Small Scale - project with 5 units or fewer**

	One Credit	Two Credits
Considerate Constructors Scheme	24 - 31.5	32 - 35.5
Alternative Compliant Scheme	Compliance	Beyond Compliance
Checklist A-4	50% of the optional items	80% of the optional items

**Exemplary Credit**

Considerate Constructors Scheme	Score of >36
Alternative Compliant Scheme	Exemplary Level Compliance
Checklist A-4*	All Items (Optional & Mandatory)

\* Small Scale Project Only

Indicative Innovation Credits Achieved
0

Comments

2No Credits will be awarded. It is assumed that the principal contractor will use the Considerate Constructors Scheme (CCS) with a score of 32-35.5 or address 80% of the items in Checklist A-4 of the BREEAM Domestic Refurbishment manual.



Man 03 Construction Site Impacts			
No. of BREEAM credits available	1	Available contribution to overall score	1.09%
No. of BREEAM innovation credits	0	Minimum Standards applicable	No
Assessment Criteria			Indicative Credits
Where evidence demonstrate that site impacts will be monitored, as detailed below:			Achieved
Requirements			1
	One Credit		
Large Scale	Where there is evidence to demonstrate that <b>2 or more</b> of the sections in <b>Checklist A-5</b> are completed		
Small Scale	Where there is evidence to demonstrate that <b>2 or more</b> of the sections in <b>Checklist A-6</b> are completed		
Sections of Checklist			
Large Scale - Checklist A-5		Small Scale - Checklist A-6	
Monitor, report and set targets for CO2 production of energy use arising from site activities		Set objectives for reducing CO2 production from energy use arising from site activities	
Monitor, report and set targets for water consumption arising from site activities		Set objectives for reducing water use arising from site activities	
A main contractor with an environmental materials policy		Main contractor environmental materials statement	
A main contractor that operates an Environmental Management System		80% of site timber is reclaimed, re-used or responsibly sourced	
80% of site timber is reclaimed, re-used or responsibly sourced			
Same definition of small and large scale as in Man 02			
Comments			
1No Credits will be achieved since the main contractor will (i) set objectives for reducing CO2 production from energy use arising from site activities (ii) set objectives for reducing water use arising from site activities.			
Man 04 Security			
No. of BREEAM credits available	2	Available contribution to overall score	2.18%
No. of BREEAM innovation credits	0	Minimum Standards applicable	No
Assessment Criteria			Indicative Credits
Where the following requirements will be met:			Achieved
Requirements			2
One Credit	External doors and accessible windows meet minimum standards and appropriately certified		
Secure windows and doors			
Two Credits	Principles and guidance of Secured by Design Section 2 are complied with		
Secured by design	A suitably qualified security consultant is consulted at the design stage and their recommendations are incorporated into the refurbishment		
Comments			
2No credits will be achieved since the External Door accessible windows will meet the following criteria: (i) Doors will be certified to: PAS 24:2007 or LPS 1175 Issue 7 Security Rating 1 1 or equivalent, (ii) Windows will be certified to: BS 7950:1997 (36) and LPS 1175 Issue 7 Security Rating 1 or equivalent (iii) Principles and guidance of Secured by Design Section 2 are complied with (iv) A suitably qualified security consultant will be consulted at the design stage and their recommendations are incorporated into the refurbishment.			
Man 05 Protection and Enhancement of Ecological Features			
No. of BREEAM credits available	1	Available contribution to overall score	1.09%
No. of BREEAM innovation credits	1	Minimum Standards applicable	No
Assessment Criteria			Indicative Credits
Where the following requirements will be met:			Achieved
Requirements			1
One Credit	Site survey carried out to determine presence of ecological features		
Protecting Ecological Features	Statutory Nature Conservation Organisation notified of protected species		
	Features of ecological value protected during refurbishment works		
Requirements			
Exemplary Credit	A suitably qualified ecologist recommends features to enhance ecology of the site		Indicative Innovation Credits Achieved
Ecological enhancement	adopts all general ecological recommendations		0
	adopts 30% of additional recommendations		
Comments			
1No credits will be achieved since (i) a site survey and strategic report will be undertaken by a suitably qualified ecologist, (ii) Features of ecological value will be protected during refurbishment works (iii) Statutory nature conservation organisations will be notified of protected species.			

Man 06 Project Management			
No. of BREEAM credits available	2	Available contribution to overall score	2.18%
No. of BREEAM innovation credits	2	Minimum Standards applicable	No
Assessment Criteria			Indicative Credits
Where the following requirements will be met:			Achieved
			2
Requirements			
One Credit	Where all of the project team are involved in the project decision making		
	Small Scale - the project manager assigns individual and shared responsibilities amongst the project team including all trades on site		
	Large Scale - the project manager assigns individual and shared responsibilities across the following key design and refurbishment stages: i. Planning and Building control notification ii. Design iii. Refurbishment iv. Commissioning and handover v. Occupation		
Project Roles and Responsibilities			
Small Scale projects: five units or fewer or less than £100k			
Large Scale projects: more than five units or more than £100k			
Requirements			
One Credit	Handover meeting arranged		
	2 or more of the following committed to: - A site inspection within 3 months of occupation - Conduct post occupancy interviews with building occupants or a survey via phone or posted information within 3 months of occupation - Longer term after care e.g. a helpline, nominated individual or other appropriate system to support building users for at least the first 12 months of occupation		
	Handover and Aftercare		
Exemplary Credits			Indicative Credits
Requirements			Achieved
One Exemplary Credit	Where A BREEAM Accredited Professional has been appointed to oversee key stages within the project.		
	OR		
	Where a BREEAM Domestic Refurbishment Assessor has been appointed at an early stage of the project, prior to the production of a refurbishment specification		
Early Design Input			
Requirements			
One Exemplary Credit	Where Thermographic surveying and Airtightness testing have been carried out at both pre and post refurbishment stages		
	Where an improved air tightness target has been set at design stage and testing demonstrates that this has been achieved post refurbishment		
	Thermographic Surveying and Airtightness Testing		
Comments			
For the 1st credit, (i) all of the project team will be involved in the project decision making (ii) the project manager will assign individual and shared responsibilities amongst the project team including all trades on site. For the 2nd credit, (i) a handover meeting will be arranged (ii) a site inspection within 3 months of occupation will be carried out. 2No exemplary credits can be achieved as (i)a BREEAM Accredited Professional (AP) or a BREEAM Domestic Refurbishment Assessor will be appointed to oversee key stages within the project at an early stage, prior to the production of a refurbishment specification (ii) an improved air tightness target may			

HEALTH & WELLBEING		Section Weighting: 17%		Indicative Section Score		9.92%	
Hea 01 Daylighting							
No. of BREEAM credits available		2		Available contribution to overall score		2.83%	
No. of BREEAM innovation credits		0		Minimum Standards applicable		No	
Assessment Criteria						Indicative Credits Achieved	
Where the refurbishment results in a neutral impact on daylighting or where minimum daylighting standards are met, up to two credits may be awarded as follows:						1	
For Existing Dwellings and Change of Use Projects							
First Credit Maintaining Good Daylighting		The refurbishment results in a neutral impact on the dwellings daylighting levels in the kitchen, living room, dining room and study					
Where the property is being extended							
First Credit Maintaining Good Daylighting		New spaces achieve minimum daylighting levels					
		The extension does not reduce daylighting levels in the kitchen, living room, dining room or study of neighbouring properties					
For All Properties							
Second Credit Minimum Daylighting		The dwelling achieves minimum daylighting levels in the kitchen, living room, dining room and study					
Comments							
It is anticipated that the extension will meet the required minimum daylight factor levels. It is envisaged that daylight calculations will be undertaken during the detail design stage.							
Hea 02 Sound Insulation							
No. of BREEAM credits available		4		Available contribution to overall score		5.67%	
No. of BREEAM innovation credits		0		Minimum Standards applicable		No	
Assessment Criteria						Indicative Credits Achieved	
To ensure the provision of acceptable sound insulation standards and so minimise the likelihood of noise complaints.						2	
Properties where sound testing has been carried out:							
Up to Four Credits		Four credits awarded according to the improvement over building regulations. See table in additional information in Technical Manual					
Properties where sound testing is not feasible and not required by the appointed Building Control body							
Two Credits		Where existing separating walls and floors are designed to meet the requirements of Building Regulations with compliant construction details					
Up to Four Credits		Where a Suitably Qualified Acoustician (SQA) provides recommendations for the specification of all existing separating walls and floors					
		SQA confirms in their professional opinion that they have the potential to meet or exceed the sound insulation credit requirements					
		Where these recommendations are implemented					
		See table in additional information in Technical Manual					
Historic Buildings							
Up to Four Credits		Where the dwelling is a Historic Building and sound testing results demonstrate existing separating walls and floor meet the Historic Building credit requirements					
		See table in additional information in Technical Manual					
Detached Properties							
Four Credits		By Default					
Properties with separating walls or floors only between non habitable rooms OR Testing not required by building control body							
Four Credits		By Default					
Comments							
2No credits will be achieved if an acoustics consultant is on board and produces a noise assessment confirming Part E compliance. In the detailed stages of the project an assessment will be made of the expected reduction in internal noise levels as a result of the refurbishment.							

Hea 03 Volatile Organic Compounds			
No. of BREEAM credits available	1	Available contribution to overall score	1.42%
No. of BREEAM innovation credits	0	Minimum Standards applicable	No
Assessment Criteria			Indicative Credits
Where the refurbishment avoids the use of VOCs with new products meeting the following requirements:			Achieved
			1
One Credit Avoiding the use of VOCs	Where all decorative paints and varnishes used in the refurbishment have met the requirement listed in table 5.4 in the Technical Manual		
	Where at least five of the eight remaining product categories listed in table 5.4 have met the testing requirements and emission levels for Volatile Organic Compound (VOC) emissions against the relevant standards identified within table 5.4 in the Technical Manual		
	Where five or less products are specified within the refurbishment, all must meet the requirements in order to achieve this credit.		
Comments			
All decorative paints and varnishes and at least five of the categories listed in table 5.4 of the BRREAM domestic Refurbishment manual will meet the testing requirements and emission levels for VOC emissions against the relevant standards identified in table 5.4 of the BREEAM Domestic Refurbishment Manual.			
Hea 04 Inclusive Design			
No. of BREEAM credits available	2	Available contribution to overall score	2.83%
No. of BREEAM innovation credits	1	Minimum Standards applicable	No
Assessment Criteria			Indicative Credits
Where an access statement has been carried out using Checklist A-8 of the Technical Manual to optimise the accessibility of the home as follows:			Achieved
			1
	Checklist A-8 of the Technical Manual		
	Section 1		Section 2
One Credit Minimum Accessibility	Completed with Evidence		
Two Credits Advanced Accessibility	Completed with Evidence		Completed with Evidence
Exemplary Performance			Indicative Innovation Credits Achieved
			0
One Credit	Where an access expert suitably qualified member of the design team has completed sections 1, 2 and 3 of Checklist A-8, access statement template with evidence provided of the measures implemented in the refurbishment		
Comments			
An Access statement will be produced and checklist A-8 of the BREEAM technical manual will be completed by a member of the design team.			
Hea 05 Ventilation			
No. of BREEAM credits available	2	Available contribution to overall score	2.83%
No. of BREEAM innovation credits	0	Minimum Standards applicable	Yes
Assessment Criteria			Indicative Credits
Where the dwelling meets the following ventilation requirements:			Achieved
			1
One Credit Minimum Ventilation Requirements	A minimum level of background ventilation is provided (with trickle ventilators or other means of ventilation) for all habitable rooms, kitchens, utility rooms and bathrooms compliant with section 7, Building Regulations Approved Document Part F, 2010		
	A minimum level of extract ventilation is provided in all wet rooms (e.g. kitchen, utility and bath-rooms), compliant with section 5, Building Regulations Approved Document Part F 2010.		
	A minimum level of purge ventilation is provided in all habitable rooms and wet rooms, compliant with section 7, Building Regulations Approved Document Part F, 2010. It is an historic building and meets historic building requirements in CN4 of the technical manual		
Two Credits Advanced Requirements	Ventilation is provided for the dwelling that meets the requirements of Section 5 of Building Regulations Part F in full		
	Where the building is a historic building and meets the requirements for Historic Buildings in compliance note 4 of the technical manual		
Comments			
1. A minimum level of background ventilation is provided (with trickle ventilators or other means of ventilation) for all habitable rooms, kitchens, utility rooms and bathrooms compliant with section 7, Building Regulations Approved Document Part F, 2010 2. A			

minimum level of extract ventilation is provided in all wet rooms (e.g. kitchen, utility and bath-rooms), compliant with section 5, Building Regulations Approved Document Part F 2010. 3. A minimum level of purge ventilation is provided in all habitable rooms and wet rooms, compliant with section 7, Part F, 2010.

Hea 06 Safety			
No. of BREEAM credits available	1	Available contribution to overall score	1.42%
No. of BREEAM innovation credits	0	Minimum Standards applicable	Yes
Assessment Criteria			Indicative Credits Achieved
Where a fire and carbon monoxide (CO) detection and alarm system is specified as follows:			1
One Credit Fire and Carbon Monoxide (CO) Detection and Alarm Systems	Carbon Monoxide detector installed if dwelling is supplied with mains gas or other fossil fuel		
	Where a compliant fire detection and fire alarm system is provided		
	Mains supplied fire detection and alarm system if project involves re-wiring		
	Battery operated fire detection and alarm system if no re-wiring is to take place		
Comments			
Fire detectors, alarm system and Carbon Monoxide Detectors will be installed. These will be mains supplied if the project involves rewiring. Battery operated if not.			
ENERGY			
Section Weighting: 43%		Indicative Section Score	28.17%
Ene 01 Improvement in Energy Efficiency Rating			
No. of BREEAM credits available	6	Available contribution to overall score	8.90%
No. of BREEAM innovation credits	0	Minimum Standards applicable	No
Assessment Criteria			Indicative Credits Achieved
Where the following targets are met for the improvement in Energy Efficiency Rating achieved as a result of refurbishment:			0.5
Improvement in EER	Credits		
≥ 5	0.5		
≥ 9	1		
≥ 13	1.5		
≥ 17	2		
≥ 21	2.5		
≥ 26	3		
≥ 31	3.5		
≥ 36	4		
≥ 42	4.5		
≥ 48	5		
≥ 54	5.5		
≥ 60	6		
Comments			
The consultant Syntegra Consulting Ltd have undertaken the pre refurbishment SAP calculations as designed post refurbishment SAP calculations. The energy averaging is applied for multiple dwellings. The average EER improvement is 8.8, and therefore 0.5No credits will be achieved.			
Ene 02 Energy Efficiency Rating Post Refurbishment			
No. of BREEAM credits available	4	Available contribution to overall score	5.93%
No. of BREEAM innovation credits	2	Minimum Standards applicable	Yes
Assessment Criteria			Indicative Credits Achieved
Where the following Energy Efficiency Rating benchmarks will be met as a result of refurbishment:			3.5
EER post refurbishment	Credits	Minimum requirements	
≥50	0.5	'Pass' level EER of 50	
≥55	1	'Good' level EER of 58	
≥60	1.5		
≥65	2	'Very Good level' EER of 65	
≥70	2.5	'Excellent' level EER of 70	
≥75	3		
≥80	3.5	'Outstanding' level EER of 81	
≥85	4		
Exemplary	Credits		Indicative Innovation Credits Achieved
≥90	1		
≥100	2		
Comments			
The average EER for post refurbishment is 57.2. Therefore, 3No credits are achieved. As stated in Ene 01 the SAP calculations have been produced by the M&E consultant Syntegra Consulting Ltd.			



Ene 03 Primary energy demand																																	
No. of BREEAM credits available	7	Available contribution to overall score	10.38%																														
No. of BREEAM innovation credits	0	Minimum Standards applicable	No																														
Assessment Criteria			Indicative Credits Achieved																														
Where the following Primary Energy Demand benchmarks will be met as a result of refurbishment:			7																														
<table><tr><th>Primary Energy Demand Post Refurbishment (kWh/m<sup>2</sup>/year)</th><th>Credits</th></tr><tr><td>≤ 400</td><td>0.5</td></tr><tr><td>≤ 370</td><td>1</td></tr><tr><td>≤ 340</td><td>1.5</td></tr><tr><td>≤ 320</td><td>2</td></tr><tr><td>≤ 300</td><td>2.5</td></tr><tr><td>≤ 280</td><td>3</td></tr><tr><td>≤ 260</td><td>3.5</td></tr><tr><td>≤ 240</td><td>4</td></tr><tr><td>≤ 220</td><td>4.5</td></tr><tr><td>≤ 200</td><td>5</td></tr><tr><td>≤ 180</td><td>5.5</td></tr><tr><td>≤ 160</td><td>6</td></tr><tr><td>≤ 140</td><td>6.5</td></tr><tr><td>≤ 120</td><td>7</td></tr></table>				Primary Energy Demand Post Refurbishment (kWh/m <sup>2</sup> /year)	Credits	≤ 400	0.5	≤ 370	1	≤ 340	1.5	≤ 320	2	≤ 300	2.5	≤ 280	3	≤ 260	3.5	≤ 240	4	≤ 220	4.5	≤ 200	5	≤ 180	5.5	≤ 160	6	≤ 140	6.5	≤ 120	7
Primary Energy Demand Post Refurbishment (kWh/m <sup>2</sup> /year)	Credits																																
≤ 400	0.5																																
≤ 370	1																																
≤ 340	1.5																																
≤ 320	2																																
≤ 300	2.5																																
≤ 280	3																																
≤ 260	3.5																																
≤ 240	4																																
≤ 220	4.5																																
≤ 200	5																																
≤ 180	5.5																																
≤ 160	6																																
≤ 140	6.5																																
≤ 120	7																																
Comments																																	
As a result of the refurbishment the average area weighted primary energy demand will be 78.7 kWh/m2/year. Therefore, 7 No Credits will be achieved.																																	

Ene 04 Renewable Technologies																																			
No. of BREEAM credits available	2	Available contribution to overall score	2.97%																																
No. of BREEAM innovation credits	0	Minimum Standards applicable	No																																
Assessment Criteria			Indicative Credits Achieved																																
Where the dwelling will meet the following % contribution from renewables and primary energy demand targets as a result of refurbishment			0																																
<table><tr><th rowspan="2">Dwelling Type</th><th rowspan="2">Primary Energy Demand</th><th colspan="2">Percentage from Renewables</th></tr><tr><th>1 Credit</th><th>2 Credits</th></tr><tr><td>Detached</td><td rowspan="4">≤ 250 kWh/m<sup>2</sup>/year</td><td>≥10%</td><td>≥20%</td></tr><tr><td>Semi-Detached</td><td>≥10%</td><td>≥20%</td></tr><tr><td>Bungalow</td><td>≥10%</td><td>≥20%</td></tr><tr><td>End of Terrace</td><td>≥10%</td><td>≥20%</td></tr><tr><td>Mid Terrace</td><td rowspan="4">≤ 220 kWh/m<sup>2</sup>/year</td><td>≥10%</td><td>≥20%</td></tr><tr><td>Low Rise Flat</td><td>≥10%</td><td>≥20%</td></tr><tr><td>Mid Rise Flat</td><td>≥10%</td><td>≥15%</td></tr><tr><td>High Rise Flat</td><td>≥10%</td><td>≥15%</td></tr></table>				Dwelling Type	Primary Energy Demand	Percentage from Renewables		1 Credit	2 Credits	Detached	≤ 250 kWh/m <sup>2</sup> /year	≥10%	≥20%	Semi-Detached	≥10%	≥20%	Bungalow	≥10%	≥20%	End of Terrace	≥10%	≥20%	Mid Terrace	≤ 220 kWh/m <sup>2</sup> /year	≥10%	≥20%	Low Rise Flat	≥10%	≥20%	Mid Rise Flat	≥10%	≥15%	High Rise Flat	≥10%	≥15%
Dwelling Type	Primary Energy Demand	Percentage from Renewables																																	
		1 Credit	2 Credits																																
Detached	≤ 250 kWh/m <sup>2</sup> /year	≥10%	≥20%																																
Semi-Detached		≥10%	≥20%																																
Bungalow		≥10%	≥20%																																
End of Terrace		≥10%	≥20%																																
Mid Terrace	≤ 220 kWh/m <sup>2</sup> /year	≥10%	≥20%																																
Low Rise Flat		≥10%	≥20%																																
Mid Rise Flat		≥10%	≥15%																																
High Rise Flat		≥10%	≥15%																																
Comments																																			

Ene 05 Energy Labelled White Goods			
No. of BREEAM credits available	2	Available contribution to overall score	2.97%
No. of BREEAM innovation credits	0	Minimum Standards applicable	No
Assessment Criteria			Indicative Credits Achieved
Where Energy Efficiency White goods are to be provided as follows:			2
First Credit			
Appliance	Appliance provided	Appliance not to be provided	
Fridges, Freezers and Fridge-Freezers	Energy Saving Trust Recommended appliances specified	EU Energy Efficiency Labelling Scheme Information Leaflet provided to all dwellings	
Second Credit			
Appliance	Appliance provided	Appliance not to be provided	
Washing Machines and Dishwashers	Energy Saving Trust Recommended appliances specified	Second credit not achieved	
Washer-Dryers and Tumble Dryers	Appliances specified with B Rating under EU Energy Efficiency Labelling Scheme	EU Energy Efficiency Labelling Scheme Information Leaflet provided to all dwellings	
Comments			
An EU Energy Efficiency Labelling Scheme Information Leaflet will be provided to each flat. Also, all white goods should be selected according to the Energy Saving trust and achieve a minimum B rating under the EU Energy Efficiency Labelling.			

Ene 06 Drying Space											
No. of BREEAM credits available	1	Available contribution to overall score	1.48%								
No. of BREEAM innovation credits	0	Minimum Standards applicable	No								
Assessment Criteria			Indicative Credits Achieved								
Where adequate, secure internal or external space with posts and footings or fixings is provided with the following:			1								
<table><tr><th colspan="2">1 Credit</th></tr><tr><th>Number of bedrooms</th><th>Drying line required</th></tr><tr><td>1-2</td><td>4m+</td></tr><tr><td>3+</td><td>6m+</td></tr></table>				1 Credit		Number of bedrooms	Drying line required	1-2	4m+	3+	6m+
1 Credit											
Number of bedrooms	Drying line required										
1-2	4m+										
3+	6m+										
Comments											
4m of drying line will be installed for each flat.											

Ene 07 Lighting							
No. of BREEAM credits available	2	Available contribution to overall score	2.97%				
No. of BREEAM innovation credits	0	Minimum Standards applicable	No				
Assessment Criteria			Indicative Credits Achieved				
Where energy efficient internal and external lighting is provided as follows:			2				
<table><tr><th colspan="2">External Lighting - 1 Credit</th></tr><tr><td colspan="2">Energy Efficient Space Lighting and Energy Efficient Security Lighting OR Where Energy Efficient Space Lighting is provided ONLY</td></tr></table>				External Lighting - 1 Credit		Energy Efficient Space Lighting and Energy Efficient Security Lighting OR Where Energy Efficient Space Lighting is provided ONLY	
External Lighting - 1 Credit							
Energy Efficient Space Lighting and Energy Efficient Security Lighting OR Where Energy Efficient Space Lighting is provided ONLY							
<table><tr><th colspan="2">Internal Lighting - 1 Credit</th></tr><tr><td colspan="2">Maximum average wattage across the total floor area of the dwelling of 9 watts/m2</td></tr></table>				Internal Lighting - 1 Credit		Maximum average wattage across the total floor area of the dwelling of 9 watts/m2	
Internal Lighting - 1 Credit							
Maximum average wattage across the total floor area of the dwelling of 9 watts/m2							
Comments							
2No credits will be achieved since (i) all comunal areas will be fitted with energy efficient lighting (ii) the maxiumum average wattage across the total floor area of each flat will be 9 watts/m2.							

Ene 08 Display Energy Devices			
No. of BREEAM credits available	2	Available contribution to overall score	2.97%
No. of BREEAM innovation credits	1	Minimum Standards applicable	No
Assessment Criteria			Indicative Credits
Where consumption data is displayed to occupants by a compliant energy display device			Achieved
			2
Electricity usage data displayed	Primary Heating Fuel		
	Electricity	Other	
Electricity usage data displayed	2 credits awarded	1 credit awarded	
Primary Heating Fuel usage data displayed	N/A	1 credit awarded	
Electricity & Primary Heating Fuel usage displayed	N/A	2 credits awarded	
Exemplary Credits			Indicative Innovation
One credit	Where any compliant Energy Display Device is capable of recording consumption data		Credits Achieved
Recording consumption data			1
Comments			
A display energy device for each flat will be installed that shows electricity usage data and records consumption data.			
Ene 09 Cycle Storage			
No. of BREEAM credits available	2	Available contribution to overall score	2.97%
No. of BREEAM innovation credits	0	Minimum Standards applicable	No
Assessment Criteria			Indicative Credits
Where individual or communal compliant cycle storage is provided as follows:			Achieved
			0
Dwelling Size	One Credit	Two Credits	
Studios/ 1 bedroom	1 per two dwellings	1 per dwelling	
2-3 bedrooms	1 per dwelling	2 per dwelling	
4 bedrooms	2 per dwelling	4 per dwelling	
Comments			
N/A			
Ene 10 Home Office			
No. of BREEAM credits available	1	Available contribution to overall score	1.48%
No. of BREEAM innovation credits	0	Minimum Standards applicable	No
Assessment Criteria			Indicative Credits
Where sufficient space and services will be provided to allow occupants to set up a home office in a suitable room with adequate ventilation			Achieved
			1
Comments			
Sufficient space and services will be provided to allow a home office in some of the Bedrooms. Services must include: two double power sockets, a telephone point, a window and adequate ventilation (i.e. Windows where the minimum openable casement is 0.5m2)			

WATER		Section Weighting: 11%	Indicative Section Score	7.70%
Wat 01 Internal Water Use				
No. of BREEAM credits available	3	Available contribution to overall score	6.60%	
No. of BREEAM innovation credits	1	Minimum Standards applicable	Yes	
Assessment Criteria				Indicative Credits
Where the dwellings water consumption meets the following consumption benchmarks, or where terminal fittings meet the following water consumption standards:				Achieved
				2.5
Calculated Water Consumption (litres/person/day)	Equivalent terminal fitting standards	Minimum Standard	Credits	
>150	Typical baseline performance	N/A	0	
140-150	All showers specified to 'Good' <b>OR</b> All taps and WC's to 'Good' <b>OR</b> Kitchen fittings specified to 'Excellent'	N/A	0.5	
129-139	All showers specified to 'Excellent' <b>OR</b> All showers and bathroom taps to 'Good'	BREEAM Very Good	1	
118-128	All bathroom and WC room fittings specified to 'Good' <b>OR</b> All bathroom fittings specified to 'Excellent'	N/A	1.5	
107-117	All Bathroom and WC room fittings specified to 'Excellent' <b>OR</b> All Bathroom fittings Specified to 'Excellent' and WC room fitting specified to 'Good' <b>OR</b> All Bathroom fittings, kitchen and utility sittings specified to 'Good'	BREEAM Excellent	2	
96-106	All kitchen, bathroom, utility room and WC room fittings specified to 'Good' <b>OR</b> All bathrooms, kitchens and utility rooms specified to 'Excellent'	N/A	2.5	
<95	All bathroom fittings specified to 'Excellent' and WC room, kitchen and utility room fittings specified to 'Good'	BREEAM Outstanding	3	
NOTE: 'Good' fittings are equivalent to good practice fittings with "Excellent" fittings equivalent to best practice fittings (see the technical manual for full details).				
Exemplary Credit	If the water consumption is less than 80l/person/day	Indicative Innovation Credits Achieved		
Comments				
2No credits will be achieved since internal fittings will comply with a water consumption rate of between 96 and 106 litres/person/day.				
Wat 02 External Water Use				
No. of BREEAM credits available	1	Available contribution to overall score	2.20%	
No. of BREEAM innovation credits	0	Minimum Standards applicable	No	
Assessment Criteria				Indicative Credits
Where the following requirements will be met:				Achieved
				0
Requirements:				
One Credit	Where a compliant rainwater collection system for external/internal irrigation use has been provided to dwellings. <b>OR</b> Where dwellings have no individual or communal garden space.			
Comments				
N/A				

Wat 03 Water Meter																																			
No. of BREEAM credits available	1	Available contribution to overall score	2.20%																																
No. of BREEAM innovation credits	0	Minimum Standards applicable	No																																
Assessment Criteria			Indicative Credits Achieved																																
Where an appropriate water meter for measuring usage of mains potable water meter has been provided to dwelling(s), one credit may be awarded			1																																
Comments																																			
A water meter will be installed for each of the flats																																			
MATERIALS		Section Weighting: 8%	Indicative Section Score 2.49%																																
Mat 01 Environmental Impact of Materials																																			
No. of BREEAM credits available	25	Available contribution to overall score	4.44%																																
No. of BREEAM innovation credits	0	Minimum Standards applicable	No																																
Assessment Criteria			Indicative Credits Achieved																																
Up to 25 credits can be awarded, with credits calculated using the Mat 01 calculator tool. The table below shows the maximum number of credits available for each element:			6																																
<table><tr><td>Elements</td><td>Green Guide Rating credits available</td><td>Thermal performance credits available*</td></tr><tr><td>Roof</td><td>5</td><td>3</td></tr><tr><td>External walls</td><td>5</td><td>3.8</td></tr><tr><td>Internal walls (including separating walls)</td><td>5</td><td>-</td></tr><tr><td>Upper and Ground Floor</td><td>5</td><td>1.2</td></tr><tr><td>Windows</td><td>5</td><td>2</td></tr></table>				Elements	Green Guide Rating credits available	Thermal performance credits available*	Roof	5	3	External walls	5	3.8	Internal walls (including separating walls)	5	-	Upper and Ground Floor	5	1.2	Windows	5	2														
Elements	Green Guide Rating credits available	Thermal performance credits available*																																	
Roof	5	3																																	
External walls	5	3.8																																	
Internal walls (including separating walls)	5	-																																	
Upper and Ground Floor	5	1.2																																	
Windows	5	2																																	
The full 25 credits represents all of the elements containing refurbished or existing materials that meet the Green Guide Rating of A+(6)																																			
<table><tr><td>GG Rating</td><td>Points for existing / refurbished elements</td><td>Points for new elements</td></tr><tr><td>A+ (6)</td><td>5</td><td rowspan="5"></td></tr><tr><td>A+ (5)</td><td>4.6</td></tr><tr><td>A+ (4)</td><td>4.2</td></tr><tr><td>A+ (3)</td><td>3.8</td></tr><tr><td>A+ (2)</td><td>3.4</td></tr><tr><td>A+</td><td>3</td><td>3</td></tr><tr><td>A</td><td>2</td><td>2</td></tr><tr><td>B</td><td>1</td><td>1</td></tr><tr><td>C</td><td>0.5</td><td>0.5</td></tr><tr><td>D</td><td>0.25</td><td>0.25</td></tr><tr><td>E</td><td>0</td><td>0</td></tr></table>				GG Rating	Points for existing / refurbished elements	Points for new elements	A+ (6)	5		A+ (5)	4.6	A+ (4)	4.2	A+ (3)	3.8	A+ (2)	3.4	A+	3	3	A	2	2	B	1	1	C	0.5	0.5	D	0.25	0.25	E	0	0
GG Rating	Points for existing / refurbished elements	Points for new elements																																	
A+ (6)	5																																		
A+ (5)	4.6																																		
A+ (4)	4.2																																		
A+ (3)	3.8																																		
A+ (2)	3.4																																		
A+	3	3																																	
A	2	2																																	
B	1	1																																	
C	0.5	0.5																																	
D	0.25	0.25																																	
E	0	0																																	
Where the full 25 credits cannot be achieved the score can be 'topped up' with thermal performance credits. The full number of thermal performance credits for each element can be achieved when achieving the minimum U-values shown below.																																			
<table><tr><td>Elements</td><td>Minimum U-Value (W/m2K)</td></tr><tr><td>Roof</td><td>0.11</td></tr><tr><td>External walls</td><td>0.15</td></tr><tr><td>Internal walls (including separating walls)</td><td>-</td></tr><tr><td>Upper and Ground Floor</td><td>0.15</td></tr><tr><td>Windows</td><td>1.4</td></tr></table>				Elements	Minimum U-Value (W/m2K)	Roof	0.11	External walls	0.15	Internal walls (including separating walls)	-	Upper and Ground Floor	0.15	Windows	1.4																				
Elements	Minimum U-Value (W/m2K)																																		
Roof	0.11																																		
External walls	0.15																																		
Internal walls (including separating walls)	-																																		
Upper and Ground Floor	0.15																																		
Windows	1.4																																		
Comments																																			
The external walls, roof and windows will each attain at least a Green Guide rating of A. Therefore, at least 6No credits will be achieved.																																			

Mat 02 Responsible Sourcing of Materials			
No. of BREEAM credits available	12	Available contribution to overall score	2.13%
No. of BREEAM innovation credits	0	Minimum Standards applicable	Yes
Assessment Criteria			Indicative Credits Achieved
Where new materials are responsibly sourced, up to 12 credits may be awarded where 80% of new materials for an element are responsibly sourced. The credits achieved are dependent on % of point achieved which is based upon the responsible sourcing tier level of each material sourced as detailed below:			0
Table 1			
Tier level		Points	
1		4	
2		3.5	
3		3	
4		2.5	
5		2	
6		1.5	
7		1	
8		0	
Table 2			
BREEAM credits		% of available points achieved	
12		≥54%	
10		≥45%	
8		≥36%	
6		≥ 27%	
4		≥ 18%	
2		≥ 9%	
		Will all new timber used in the project be sourced in accordance with the UK Government's Timber Procurement Policy	
		Yes	
Comments			
All new timber used in the project will be sourced in accordance with the UK Government's Timber Procurement Policy.			
Mat 03 Insulation			
No. of BREEAM credits available	8	Available contribution to overall score	1.42%
No. of BREEAM innovation credits	0	Minimum Standards applicable	No
Assessment Criteria			Indicative Credits Achieved
Where any new insulation specified for use within external walls, ground floor, roof and buildings services meet the following requirements:			8
		Requirements	
4 Credits	Where the Insulation Index for new insulation used in the buildings is ≥2		
	Where Green Guide ratings are determined using the Green Guide to specification tool		
		Requirements	
4 Credits	Where ≥ 80% of the new thermal insulation used in the building elements is responsibly sourced.		
Comments			
8No credits will be achieved since (i) the insulation index of for new insulation used in the buildings is ≥2, (ii) green guide ratings are determined using the green guide to specification tool, (iii) ≥80% of the new thermal insulation will be responsibly sourced.			



WASTE		Section Weighting: 3%	Indicative Section Score	2.40%
Was 01 Household Waste				
No. of BREEAM credits available		2	Available contribution to overall score	1.20%
No. of BREEAM innovation credits		0	Minimum Standards applicable	No
Assessment Criteria			Indicative Credits Achieved	
Where compliant recycling and composting facilities are provided, up to two credits may be awarded as follows			1	
First Credit - Recycling Facilities				
Scenario		Internal recycling storage requirements		
Compliant collection scheme in place	3 internal recycling containers provided where recycling is not sorted post collection			
	1 internal recycling container provided where recycling is sorted post collection			
	Minimum 30 litre total capacity, no single container less than 7 litre capacity			
	Dedicated position in accordance with compliance note 1			
No compliant collection scheme in place No adequate external storage	3 internal recycling containers provided			
	Minimum 60 litre total capacity			
	Dedicated position in accordance with compliance note 1			
No compliant collection scheme in place Adequate external storage provided	3 internal recycling containers provided			
	Minimum 30 litre total capacity, no single container smaller than 7 litre capacity			
	Dedicated position in accordance with compliance note 1			
Second credit - Composting facilities				
With external space		Without external space		
Where a composting service or facility is provided for green/garden waste		Where a composting service or facility is provided for kitchen waste		
Where a composting service or facility is provided for kitchen waste		Where an interior container is provided for kitchen composting waste of at least		
Where an interior container is provided for kitchen composting waste of at least 7 litres				
Comments				
1No credit will be achieved as each flat will be provided with 3 internal recycling containers. Overall capacity will be a minimum of 30 litres.				

Was 02 Refurbishment Site Waste Management			
No. of BREEAM credits available	3	Available contribution to overall score	1.80%
No. of BREEAM innovation credits	1	Minimum Standards applicable	No
<b>Assessment Criteria</b>			<b>Indicative Credits Achieved</b>
Up to three credits are available depending on the site waste management plan to be implemented as follows			3
<b>Projects up to £100k</b>			
Three Credits	Where waste generated through the refurbishment process is managed in accordance with Checklist A-9	<b>Indicative Innovation Credits Achieved</b>	
Exemplary Credit	Where a compliant Level 1; Site Waste Management Plan (SWMP) is in place	0	
<b>Projects up to £300k</b>			
Three Credits	Where a compliant Level 1; Site Waste Management Plan (SWMP) is in place		
Exemplary Credit	Where a compliant Level 2; Site Waste Management Plan (SWMP) is in place		
	Non-hazardous construction waste generated by the dwellings refurbishment meets or exceeds the resource efficiency benchmark		
	The percentage of non-hazardous construction waste and demolition waste generated by the project has been diverted from landfill and meets or exceeds the refurbishment & demolition waste diversion benchmarks		
<b>Projects over £300k</b>			
First Credit Management Plan	Where a compliant Level 2; Site Waste Management Plan (SWMP) is in place		
Second Credit Good Practice Waste Benchmarks	First credit achieved		
	Non-hazardous construction waste generated by the dwellings refurbishment meets or exceeds the resource efficiency benchmark		
	Amount of waste generated against £100,000 of project value is recorded in the SWMP		
	Pre-refurbishment audit of the existing building is completed		
Third Credit Best Practice Waste Benchmarks	If demolition is included as part of the refurbishment programme, then the audit should also cover demolition materials		
	Where the first two credits have been achieved		
	Where Non-hazardous demolition waste generated by the dwellings refurbishment meets or exceeds the refurbishment & demolition waste diversion benchmarks		
Exemplary Credit	Where non-hazardous construction waste generated by the dwellings refurbishment meets or exceeds the <i>exemplary level resource efficiency benchmark</i>		
	Where Non-hazardous demolition waste generated by the dwellings refurbishment meets or exceeds the exemplary level diversion benchmarks		
<b>Comments</b>			
The principal contractor will ensure that a BREEAM compliant SWMP will be in place.			

POLLUTION		Section Weighting: 6%		Indicative Section Score		4.50%		
Pol 01	NOx Emissions							
	No. of BREEAM credits available		3		Available contribution to overall score		2.25%	
	No. of BREEAM innovation credits		0		Minimum Standards applicable		No	
Assessment Criteria							Indicative Credits Achieved	
Credits are awarded on the basis of NOx emissions arising from the operation of space heating and hot water systems for each refurbished dwelling as follows:							2	
		Dry NOx Emissions						
One Credit		≤100 mg/kWh (NOx class 4 boiler)						
Two Credits		≤70 mg/kWh (NOx class 5 boiler)						
Three Credits		≤40 mg/kWh						
Comments								
The proposed Gas combi boilers for each flat will emit less than 70 mg/kWh. They will be Nox class 5 rated.								
Pol 02	Surface Water Runoff							
	No. of BREEAM credits available		3		Available contribution to overall score		2.25%	
	No. of BREEAM innovation credits		1		Minimum Standards applicable		No	
Assessment Criteria							Indicative Credits Achieved	
Where impacts of the refurbishment on surface water runoff are neutralised or where runoff is reduced as a result of refurbishment, up to three credits can be awarded as follows:							2	
		Requirements						
First Credit	Neutral Impact on Surface Water	New hard standing areas must be permeable						
		If building on to previously permeable area additional run-off must be managed on site						
		Calculations should be carried out by an appropriately qualified professional						
		Requirements						
Second Credit	Reducing Run-Off From Site: Basic	Where all run-off from the roof for rainfall depths up to 5 mm, have been managed on site using source control methods						
		Include runoff from all existing and new parts of the roof.						
		An appropriately qualified professional should be used to design an appropriate drainage strategy for the site						
		Requirements						
Third Credit	Reducing Run-Off From Site: Advanced	Where run-off as a result of the refurbishment is managed on site using source control						
		An appropriately qualified professional should be used to design an appropriate drainage strategy for the site.						
		The peak rate of run-off as a result of the refurbishment for the 1 in 100 year event has been reduced by 75% from the existing site.						
		The total volume of run-off discharged into the watercourses and sewers as a result of the refurbishment, for a 1 in 100 year event of 6 hour duration has been reduced by 75%.						
		An allowance for climate change must be included for all of the above calculations, in accordance with current best practice (PPS25, 2010).						
		Requirements						
Exemplary Credit		Where all run-off from the developed site is managed on site using source control						
		The peak rate of run-off as a result of the refurbishment for the 1 in 1 year event is reduced to zero.						
		The peak rate of run-off as a result of the refurbishment for the 1 in 100 year event is reduced to zero.						
		There is no volume of run-off discharged into the watercourses and sewers as a result of the refurbishment, for a 1 in 100 year event of 6 hour duration.						
		An allowance for climate change must be included for all of the above calculations, in accordance with current best practice (PPS25, 2010).						
Comments								
2No credits will be achieved since (i) new hard standing areas will be permeable, (ii) the additional area of runoff from areas that were previously permeable will be managed on site (iii) calculations will be carried out by an appropriately qualified professional.								

Pol 03 Flooding			
No. of BREEAM credits available	2	Available contribution to overall score	1.50%
No. of BREEAM innovation credits	0	Minimum Standards applicable	Yes
Assessment Criteria			Indicative Credits Achieved
Where the dwelling is located in a low flood risk zone, or where in a medium to high flood risk zone and a flood resilience/resistance strategy has been implemented, up to two credits can be awarded as follows:			2
Minimum Standards	A minimum of two credits must be achieved for this issue at the Excellent and Outstanding levels		
Option 1 - Low Flood Risk			
Two Credits	Where a Flood Risk Assessment (FRA) has been carried out and the assessed dwellings are defined as having a low annual probability of flooding.		
Option 2 - Medium / High Flood Risk			
Two Credits	Where a Flood Risk Assessment (FRA) has been carried out and the assessed dwellings are defined as having a medium or high annual probability of flooding.		
	Two credits are awarded where as a result of the dwellings floor level or measures to keep water away the dwelling is defined as achieving avoidance from flooding by following Checklist A-10; Decision Strategy Flow Chart.		
	Where avoidance is not possible, two credits are achieved where a full flood resilience/resistance strategy is implemented for the dwellings in accordance with recommendations made by a Suitably Qualified Building Professional		
Comments			
A Flood Risk Assessment will be undertaken for 15 Cleve Road by a qualified Hydrologist. Also, according to the Environment agency the site is expected to be of low flooding risk. Therefore, 2No credits will be achieved.			

# Regulations Compliance Report

Approved Document L1A 2010 edition assessed by Stroma FSAP 2009 program, Version: 1.5.0.27

Printed on 07 February 2013 at 12:26:41

## Project Information:

Assessed By: ()

Building Type: Detached Flat

## Dwelling Details:

### NEW DWELLING AS BUILT

Site Reference : Flat 5 proposed combi gas boiler

Plot Reference: 15 Cleve Road

Address : 15 Cleve Road, Hampstead, NW6 3RL

## Client Details:

Name:

Address : 15 Cleve Road, Hampstead, NW6 3RL

This report covers items included within the SAP calculations.

It is not a complete report of regulations compliance.

## 1 TER and DER

Fuel for main heating system: Natural gas

Fuel factor: 1.00 (natural gas)

Target Carbon Dioxide Emission Rate (TER)

17.98 kg/m<sup>2</sup>

Dwelling Carbon Dioxide Emission Rate (DER)

16.00 kg/m<sup>2</sup>

OK

## 2 Fabric U-values

### Element

### Average

### Highest

External wall

0.30 (max. 0.30)

0.30 (max. 0.70)

Floor

(no floor)

Roof

0.16 (max. 0.20)

0.16 (max. 0.35)

Openings

1.40 (max. 2.00)

1.40 (max. 3.30)

OK

OK

OK

## 3 Air permeability

Air permeability at 50 pascals

5.00

Maximum

10.0

OK

## 4 Heating efficiency

Main Heating system:

Database: (rev 334, product index 015701):

Boiler system with radiators or underfloor - mains gas

Brand name: Main

Model: Combi

Model qualifier: 25 Eco

(Combi boiler)

Efficiency 89.0 % SEDBUK2009

Minimum 88.0 %

OK

Secondary heating system:

None

## 5 Cylinder insulation

Hot water Storage:

No cylinder

## 6 Controls

Space heating controls

Time and temperature zone control

OK

Hot water controls:

No cylinder

Boiler interlock:

Yes

OK

# Regulations Compliance Report

## 7 Low energy lights

Percentage of fixed lights with low-energy fittings  
Minimum

100.0%  
75.0%

OK

## 8 Mechanical ventilation

Not applicable

## 9 Summertime temperature

Overheating risk (Thames valley):

Medium

OK

Based on:

Overshading:

Very Little

Windows facing: East

2.86m<sup>2</sup>, Overhang twice as wide as window, ratio NaN

Windows facing: South

5.73m<sup>2</sup>, Overhang twice as wide as window, ratio NaN

Ventilation rate:

2.00

Blinds/curtains:

Net curtain (covering half window)  
shutter closed 30% of daylight hours

## 10 Key features

Windows U-value

1.4 W/m<sup>2</sup>K

Photovoltaic array

# DRAFT



## **Extension and refurbishment at 15 Cleve Road, Hampstead, London, NW6 3RL** **Building Regulation Part L Compliance - Report summary**

### **Summary**

Part L Compliance requires calculations to show improvements in the CO2 emissions between a conversion of an existing Day Centre to a Multi-residential unit (9 Flats) using SAP software for the small new extension, Appendix R reference values for notional values, and actual thermal values, with improvements made where necessary.

#### **Extract from L1B 2011:**

***- 4.11: Material changes of use (see regulation 5 of the Building Regulations) covered by this document are where, after the change:***

- a) the building is used as a dwelling, where previously it was not;***
- b) the building contains a flat, where previously it did not; or***
- c) the building, which contains at least one dwelling, contains a greater or lesser number of dwellings than it did previously.***

Software used – Govt approved FSAP2009 Stroma.

It is a detached 5-storey building.

### **BRUKL Calculations**

1. The calculations for the ***Existing Day Centre + Small notional Extension*** gave the following results:-

TER = 12.05 kgCO2/m2.annum

BER = 43.47 kgCO2/m2.annum

And

2. The calculations for the ***Proposed Conversion + Actual Extension*** gave the following results:-

TER = 16.26 kgCO2/m2.annum

BER = 16.06 kgCO2/m2.annum

### Improvements.

The Improvements to the property includes the following to the Thermal elements and services: -

- 1 Lighting to have a minimum of 80% energy efficient type.
- 2 Floor U value to be 0.2 w/m<sup>2</sup>k or better to the extension
3. Roof U value to be 0.16 w/m<sup>2</sup>k or better everywhere.
4. Walls to be lined 0.3 w/m<sup>2</sup>k or better to the extension
5. Window U values to be 1.4 w/m<sup>2</sup>k or better as Double glazed argon filled.
6. Combi gas condensing boilers @ 90% efficiency to each flat.
7. Target in improvement of air permeability
8. 3kWp PV installation for the development

### Conclusion

The above results show an **63.05% improvement (reduction)** in CO<sub>2</sub> emissions from the *Existing Building* to the *Proposed Converted property* and therefore meets Building Regulations Part L1B criteria.

A.M. Wing-King  
MSc, CEng, MEI, NDEA, OCDEA

07.02. 2013

