

	100Ø CHW F&R FROM		
	ABOVE		Â
	15Ø HEATING F&R DROP TO LOW LEVEL WITHIN PARTITION		
	VOID TO SERVE RAD 15Ø HEATING F&R FROM BELOW AND TO ABOVE		
	TO ABOVE	<u>(1)</u>	
	32Ø CONDENSATE		
	DRAIN		
			W313 Lobby
	CHW VALVES SET AT HIGH LEVEL FOR FUTURE UNDER TENANT FIT OUT. REFER TO DRG. 4142/5 FOR VALVE ARRANGEMENTS.		W314 Office
		(<u>2</u>)	
			W316 Lift 4
			UP
		(3)	W315 Stair 2
		(4)	
			S400 Lobby
	FOR DETAILED LAYOUT OF RISER No.7		S418 Riser S5
	REFER TO DRG. 4142/SERV/3301		S419 Void
			HALL HALL
			S415 Office
			4/01
			Riser 1 ST 4/02
			Martin S4
DO NOT SCALE FROM THIS DRAWING. ALL DIMENSIONS TO BE CHECKED ON SITE.			
1). FOR LEGEND OF SYMBOLS & ABBREVIATIONS REFER TO DRG. No:- 4142/SERV/3000			T1 DC 16
2). THIS DRAWING SHALL BE READ IN CONJUNCTION WITH BAM DESIGN PARTICULAR SPECIFICATION & PLANT EQUIPMENT SCHEDULES & AECOM			TO DC 01 12 T0 12

Q:\01 - Projects\4142 - Kings Cross Zone B - Building E1\04 - Services\01 - Mechanical\13 - Drawings\AutoCAD\Drawings\4142-SERV-3105 THIRD FLOOR STANLEY WRAP AND FOURTH FLOOR STANLEY BUILDING LTHW, CHW AND VRF LAYOUT.dwg

SPECIFICATION.

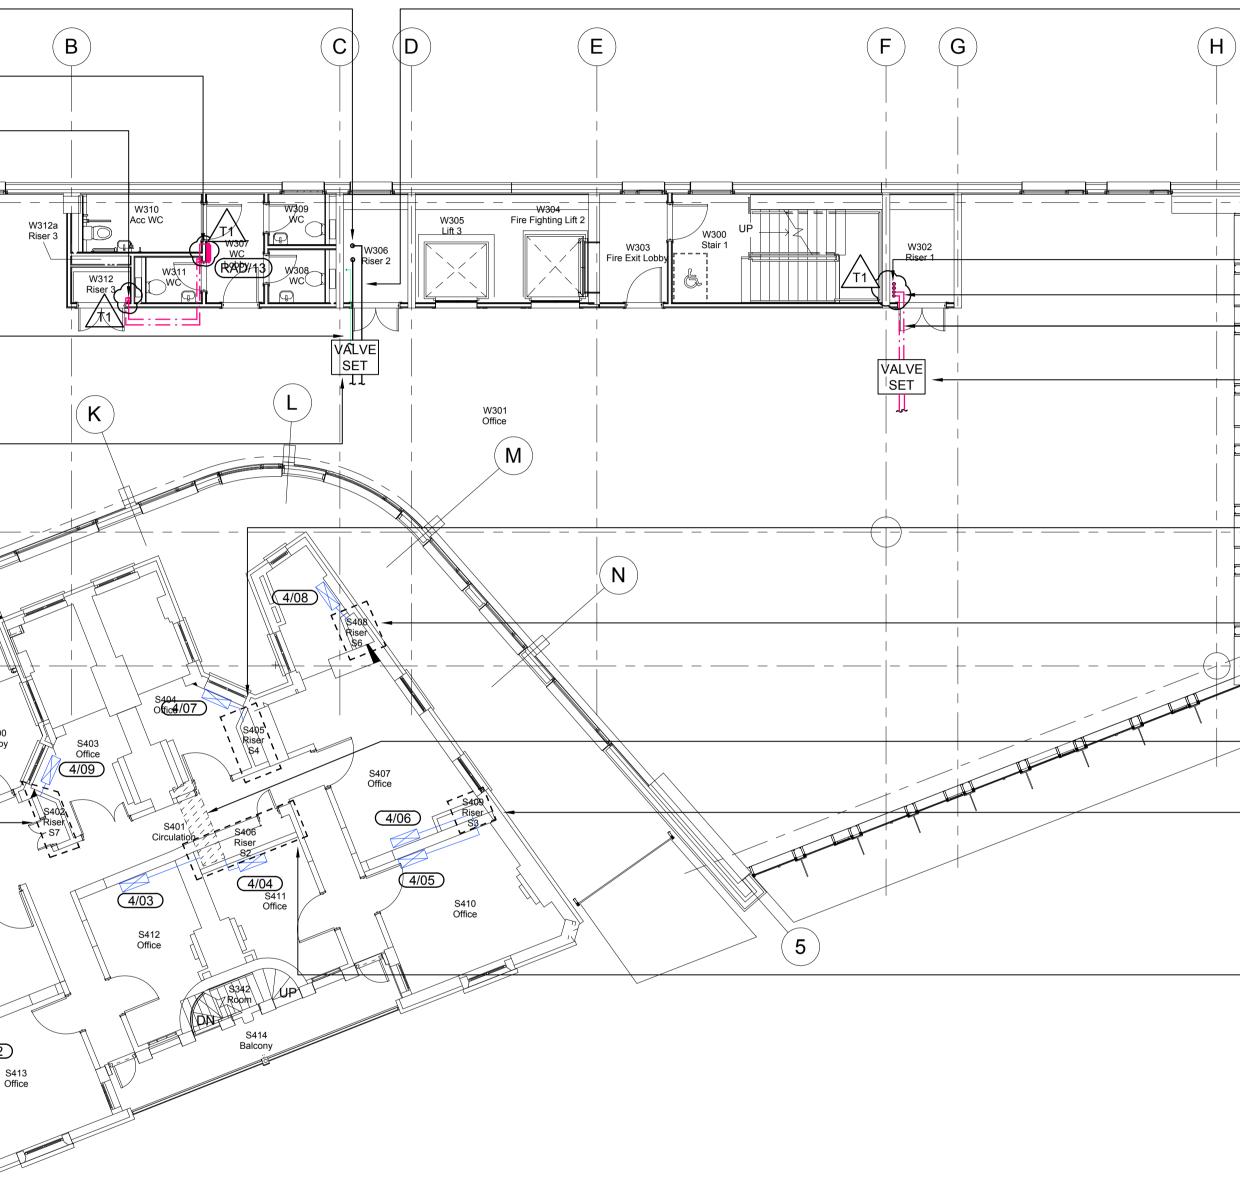

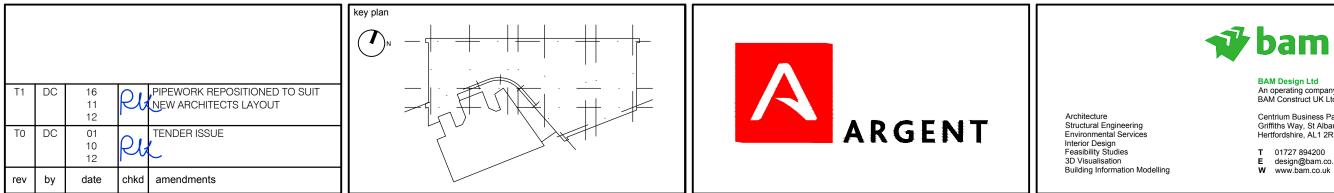

_____ 40Ø CHW

50Ø HEATING F&R FOR FUTURE ROOF LEVEL AHU'S 32Ø HEATING F&R FOR FUTURE TENANTS FCU'S 20Ø HTG F&R HTG VALVES SET AT HIGH LEVEL FOR FUTURE EXTENSION UNDER TENANT FIT OUT. REFER TO DRG. 4142/SERV/3003 FOR VALVE ARRANGEMENTS. COR DETAILED LAYOUT OF RISER No.4 REFER TO DRG. 4142/SERV/3301 FOR DETAILED LAYOUT OF RISER No.6 REFER TO DRG. 4142/SERV/3301 VRV PIPEWORK RUN AT HIGH LEVEL TO RISER No. 2 ACROSS CORRIDOR. C/02 VRF SYSTEM. FOR DETAILED LAYOUT OF RISER No.3 REFER TO DRG. 4142/SERV/3301

> FOR DETAILED LAYOUT OF RISER No.2 REFER TO DRG. 4142/SERV/3301

	project	drawing status TENDER					
	Kings Cross Zone B - Building E1	contract no.		scale	scale 1:100 @ A1		
pany of K Ltd	title	client ref.		date	October.	'12	
Park bans 2RD	THIRD FLOOR STANLEY WRAP AND FOURTH FLOOR STANLEY BUILDING LTHW, CHW AND VRF LAYOUT	drawn by DJC		checke	checked by RK		
i0 n.co.uk n.uk		drawing no.	4142	SERV	3105	T1	