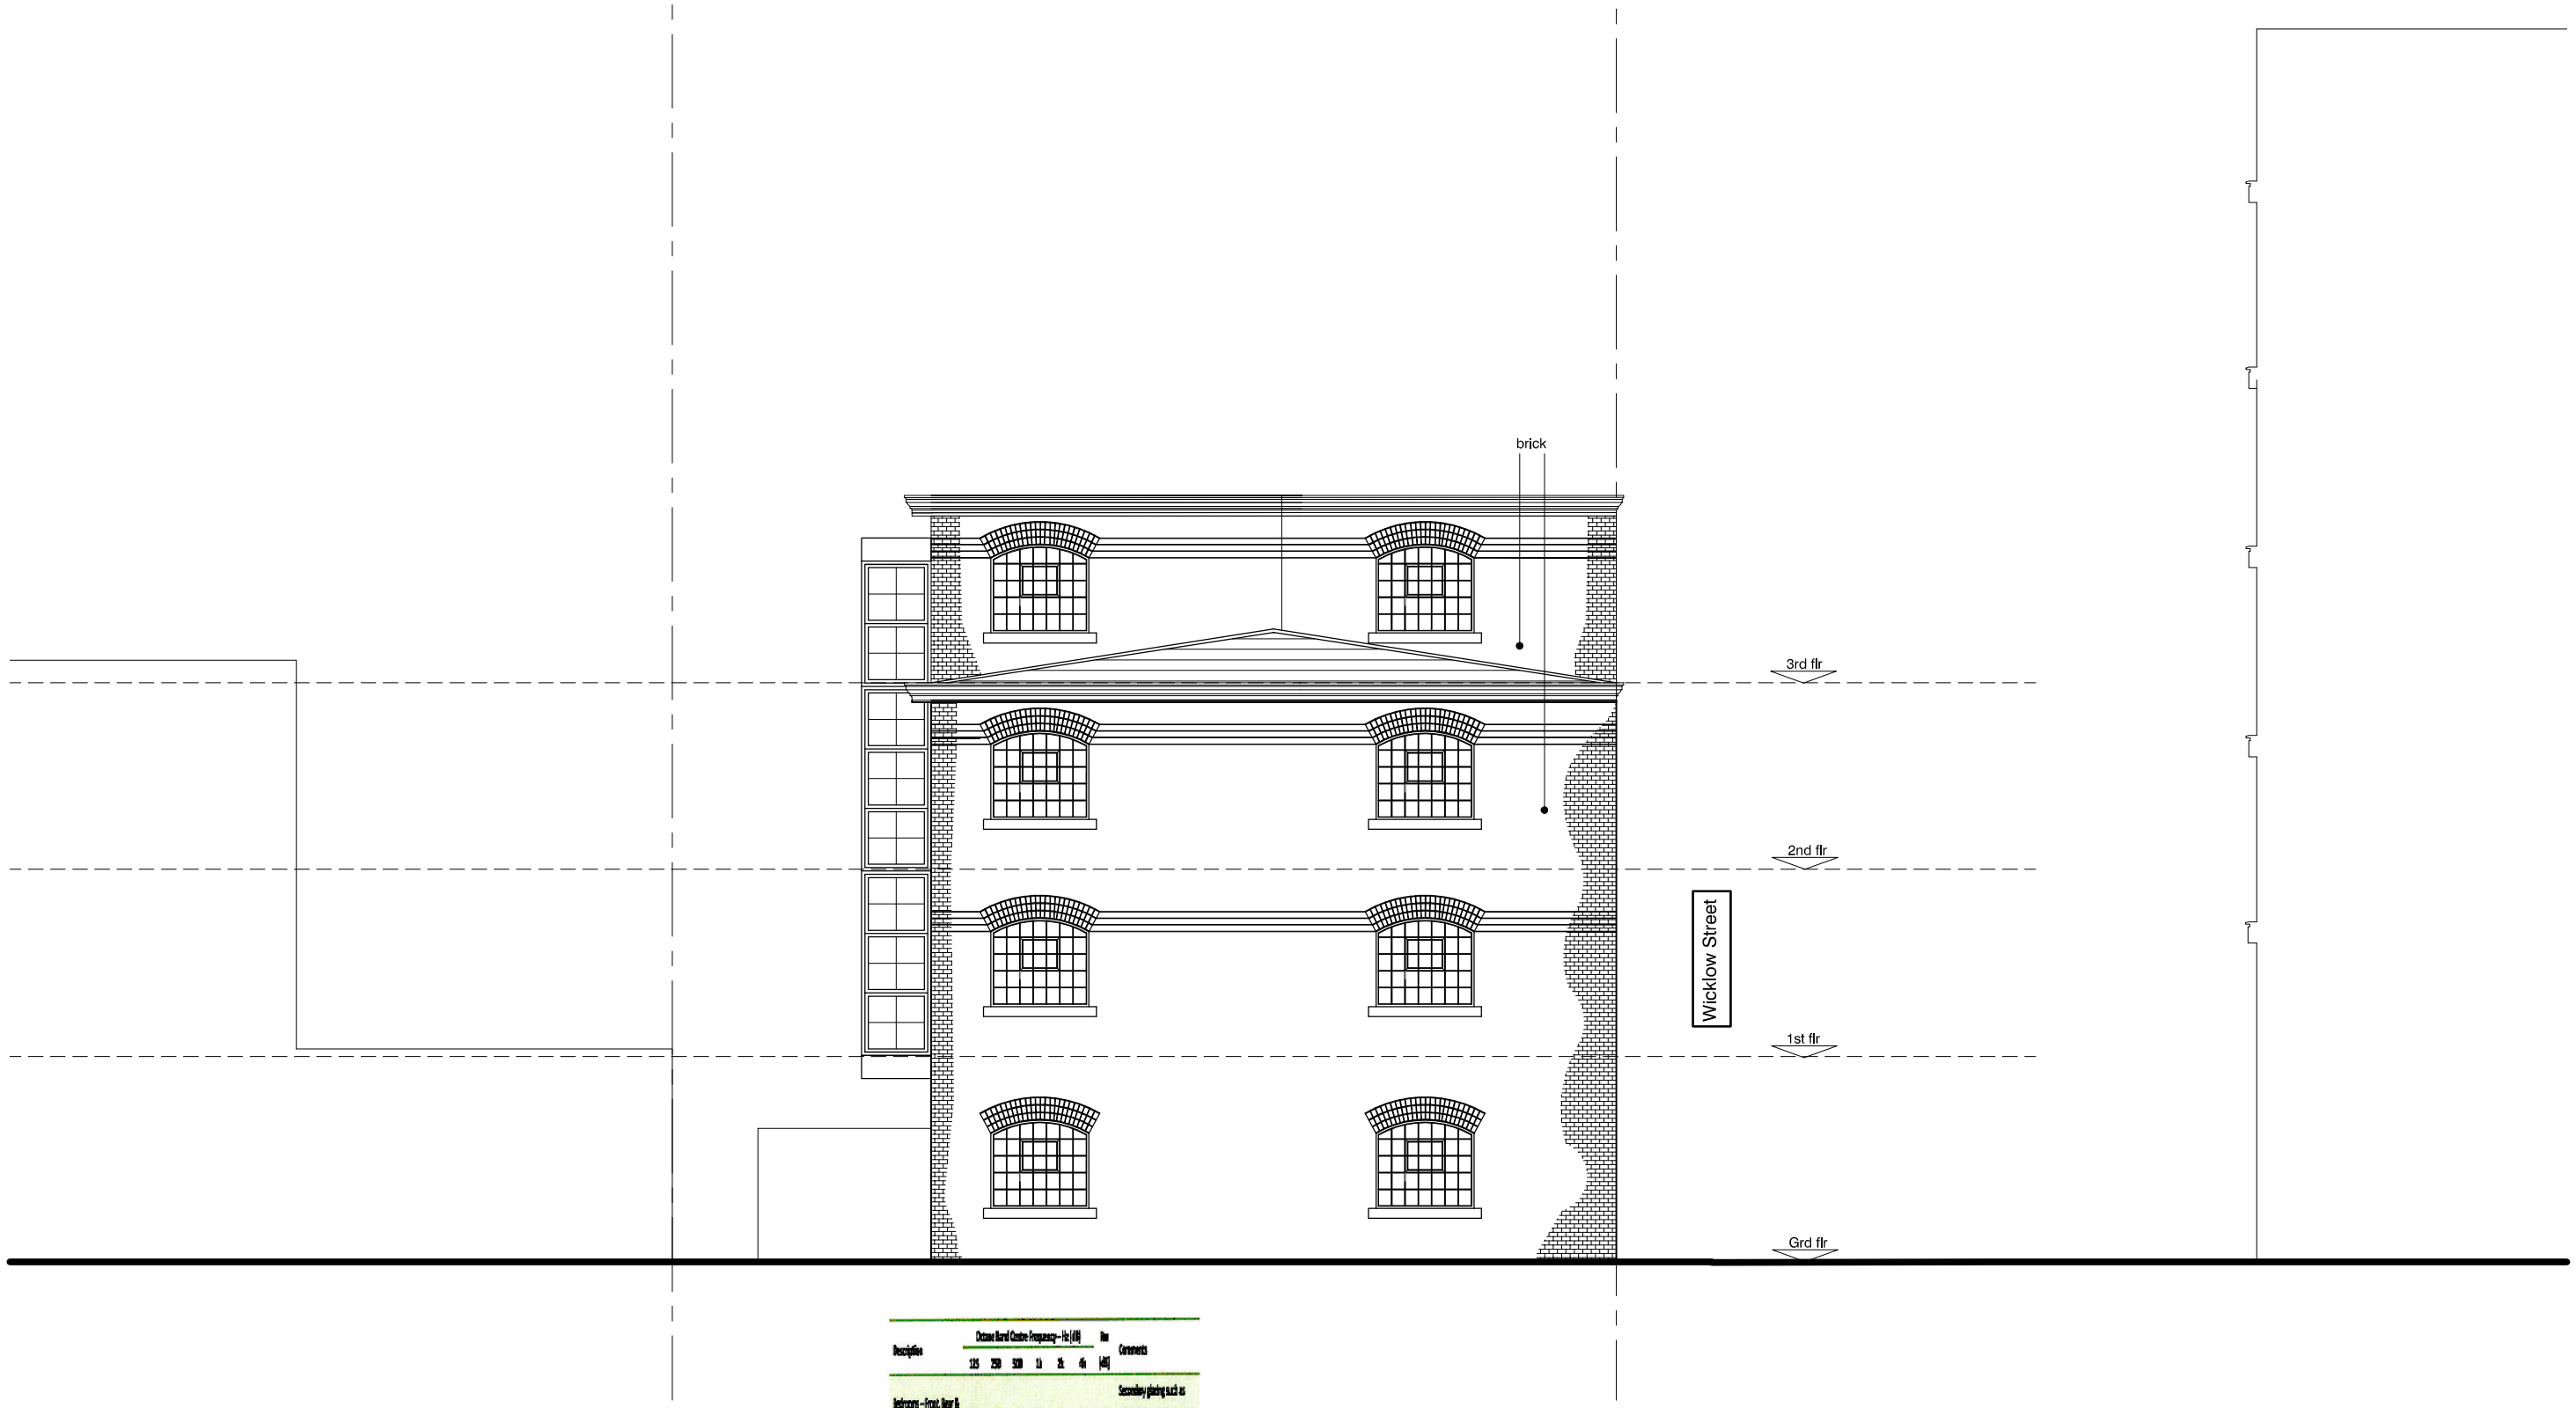

PROPOSED
Side A Elevation

NOTES:

Obscured glass

0 1m 2m 3m 4m 5m 6m 7m 8m 9m 10m

Description	Octave Band Centre Frequency – Hz (dB)							Rw (dB)	Comments
	125	250	500	1k	2k	4k			
Bedrooms – Front, Rear & Elevation B	29	35	45	54	52	55	47		Secondary glazing such as 4/16/4(ISU outer window, 150mm cavity, 6mm inner
Bedrooms – Elevation A	27	26	36	48	42	46	37		Double glazing such as 4/16/4 ISU
Living Rooms – Front, Rear & Elevation B	27	26	38	48	42	46	37		Double glazing such as 4/16/4 ISU
Living Rooms – Elevation A & rear habitable rooms	24	28	26	35	38	43	31		Double glazing such as 4/16/4 ISU

Table 9: Specification for glazing Sound Reduction Index R dB

For all living rooms and bedrooms, the window frames will need to have effective acoustic seals all around. Effective seals are rubber or neoprene beaded "P" or "D" profile type that compress all around on closure of the windows. Plastic type or brush type weatherings seals are not classed as effective acoustic seals.

NOTES
1. This drawing is copyright of Studio V Architects Ltd
2. Figured dimensions for construction purposes only
3. Drawing is scaleable for planning purposes
4. Contractor to check all dimensions on site & report any discrepancies to architect

rev.	date		drn	aud
G	07.02.13	UPDATED TO PLANNER'S ADVICE	BC	KV
F	19.10.12	ELEVATION CLARIFIED	BC	KV
E	02.10.12	UPDATED TO CLIENT'S REQUIREMENTS	BC	KV
D	23.08.12	ELEVATION UPDATED	BC	KV
C	28.02.12	ELEVATION UPDATED	BC	KV
B	18.07.11	ELEVATION UPDATED	MH	KV
A	08.04.11	UPDATED FROM REVISED PLAN	MH	KV

drawing status

PLANNING

studio V Architects

224 west hendon broadway
hendon
london nw9 7ed

T: 020 8203 9072
F: 020 8203 8210

website: www.studioVarchitects.co.uk
e-mail: info@studioVarchitects.co.uk

project	drawn	audited	scale	date
33 WICKLOW STREET, KINGS CROSS.	MH	KV	1:100 @ A3	NOV 10
drg title: PROPOSED Side A Elevation	job no. 1026		drg.no. PL11	rev G

FILE: XREF's: