


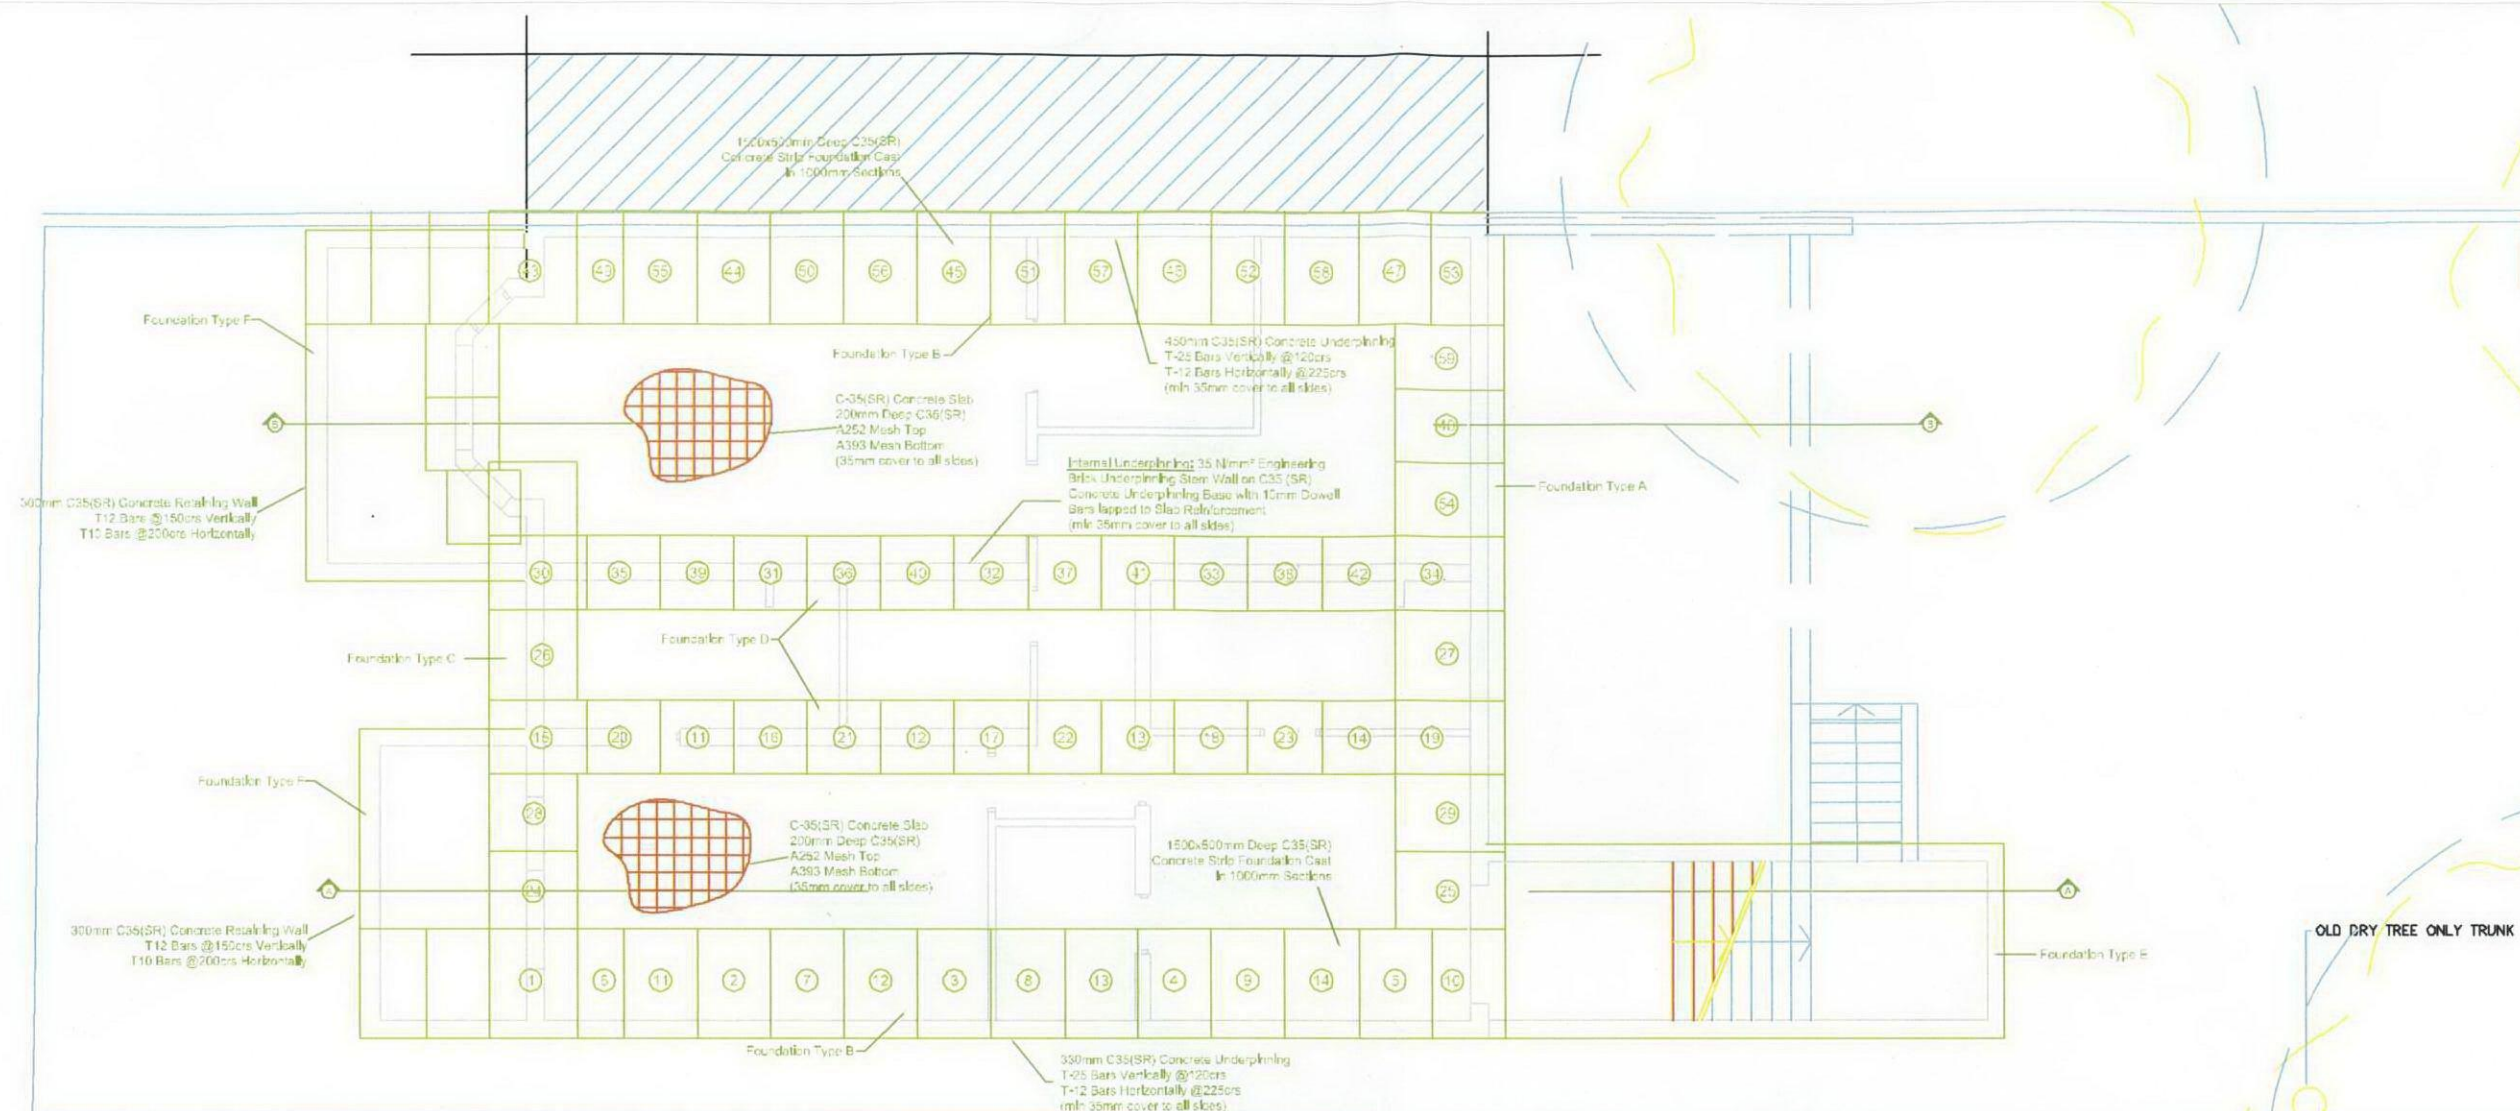

OLD DRY TREE ONLY TRUNK

FOR GENERAL NOTES REFER TO DRAWING
No. 2

1. WORKING IN STRIPS NOT EXCEEDING 1M
LONG EXCAVATE TO REQUIRED DEPTH
ADJACENT EXISTING STRUCTURE

1. WORKING STRIPS NOT EXCEEDING 1M LONG EXCAVATE TO REQUIRED DEPTH ADJACENT EXISTING STRUCTURE
2. CAST NEW CONCRETE BASE AND ALLOW 24 HOURS TO CURE. STARTER BARS TO EXTEND 400 ABOVE BASE FOR LAPPING PURPOSES (SEE DETAILS FOR BAR SIZES)
3. VERTICAL & HORIZONTAL REINFORCEMENT TO BE CONSTRUCTED IN ACCORDANCE WITH DESIGN INFORMATION AND ANY REINFORCEMENT SCHEDULES PROVIDED BY THE ENGINEER
4. SHUTTERING & PROPPING TO BE DESIGNED BY CONTRACTOR
5. CAST NEW CONCRETE WALL EMERGING GROUND BEHIND NEW FOUNDATION & WALL IS FULLY BACKFILLED AND COMPACTED CHECK AT REGULAR INTERVALS TO ENSURE THIS DURING CONSTRUCTION
6. NEVER EXCAVATE TWO ADJACENT STRIPS WITHOUT ALLOWING 5 DAYS BETWEEN OPERATIONS
7. WHEN ADJACENT SECTIONS ARE OPENED UP THE EXPOSED CONCRETE SURFACES SHOULD BE THOROUGHLY CLEANED OF ALL LOOSE MATERIAL & SCAMMED TO FORM A GOOD KEY
8. ALL REASONABLE CARE IS TO BE TAKEN TO PREVENT INJURIES TO PERSONS WORKING NEAR EXPOSED BARS ETC (THREADED COUPLERS WOULD BE SUITABLE)
9. FOUNDATIONS TO BE 1200mm WIDE UNLESS NOTED OTHERWISE
10. ALL NEW CONCRETE BELOW GROUND TO BE SULPHATE RESISTING CEMENT CONC GRADE 35
11. TRIAL PIT TO BE EXCAVATED TO CONFIRM EXISTENCE OF ANY EXISTING STRUCTURE
12. REINFORCEMENT SHALL BE TO R50@110 WITH MAX BARS TO RE GRADE 450 (TIGHT YIELD)
13. READY MIX CONCRETE MUST BE OBTAINED FROM A PLANT THAT HOLDS A CURRENT CERTIFICATE OF ACCREDITATION UNDER THE QUALITY SCHEME FOR READY MIX CONCRETE
14. NO CONCRETE IS TO BE PLACED WHEN THE AMBIENT AIR TEMPERATURE IS LESS THAN 5 DEGREES C







1

2

3

4

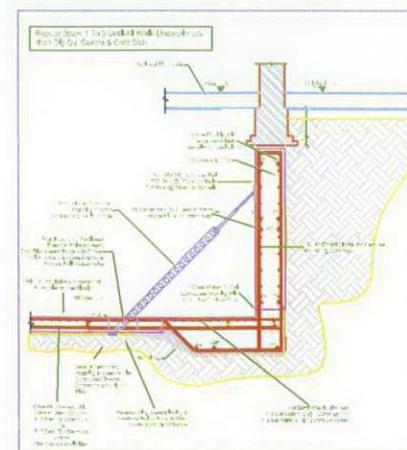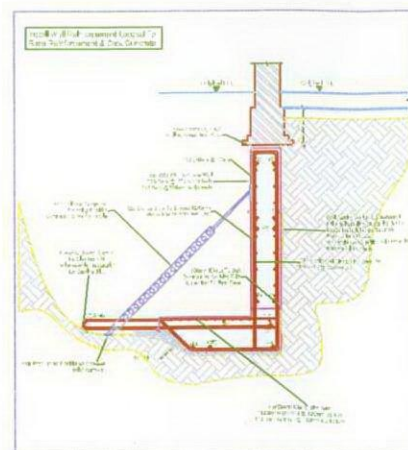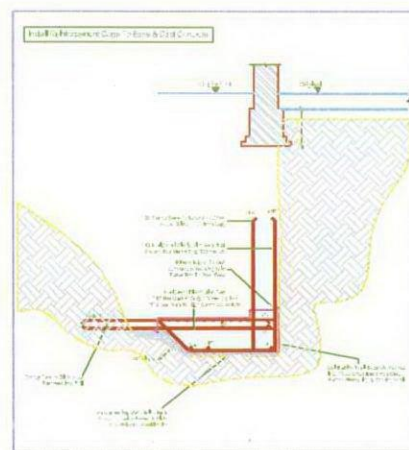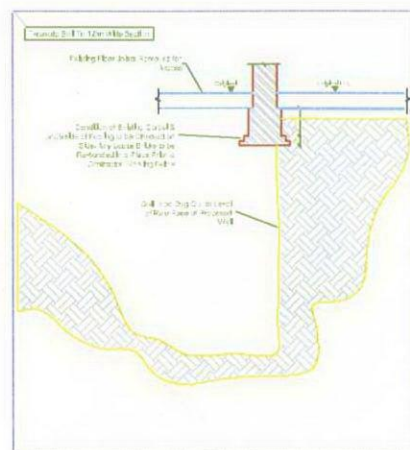

Rev	Date	Description	By
Title: Foundation Plan & Sequence Sections			
Preliminary			

Martin Redston Associates
Consulting Civil & Structural Engineers

3 Edward Square, London N1 0SP
Tel: 020-7637 5377 Fax: 020-7637 3211

6 Hiale Lane, London NW7 3NX
Tel: 020-8909 1868 Fax: 020-8906 8503
Dates: 06/11/2012 Sheet No. Rev

Eng: PS	Scale: 1:5000A1	1
Job No: 12		
Project: 86 Canfield Gdns		