


NOTE:-

- 1) THIS DRAWING IS TO BE READ INCONJUNCTION WITH VENTILATION SCHEMATIC 7871-M-701
- 2) KITCHEN EXTRACT DUCT TO BE FITTED WITH CLEAN OUT ACCESS DOORS EVERY 2M AND CHANGE OF DIRECTION.

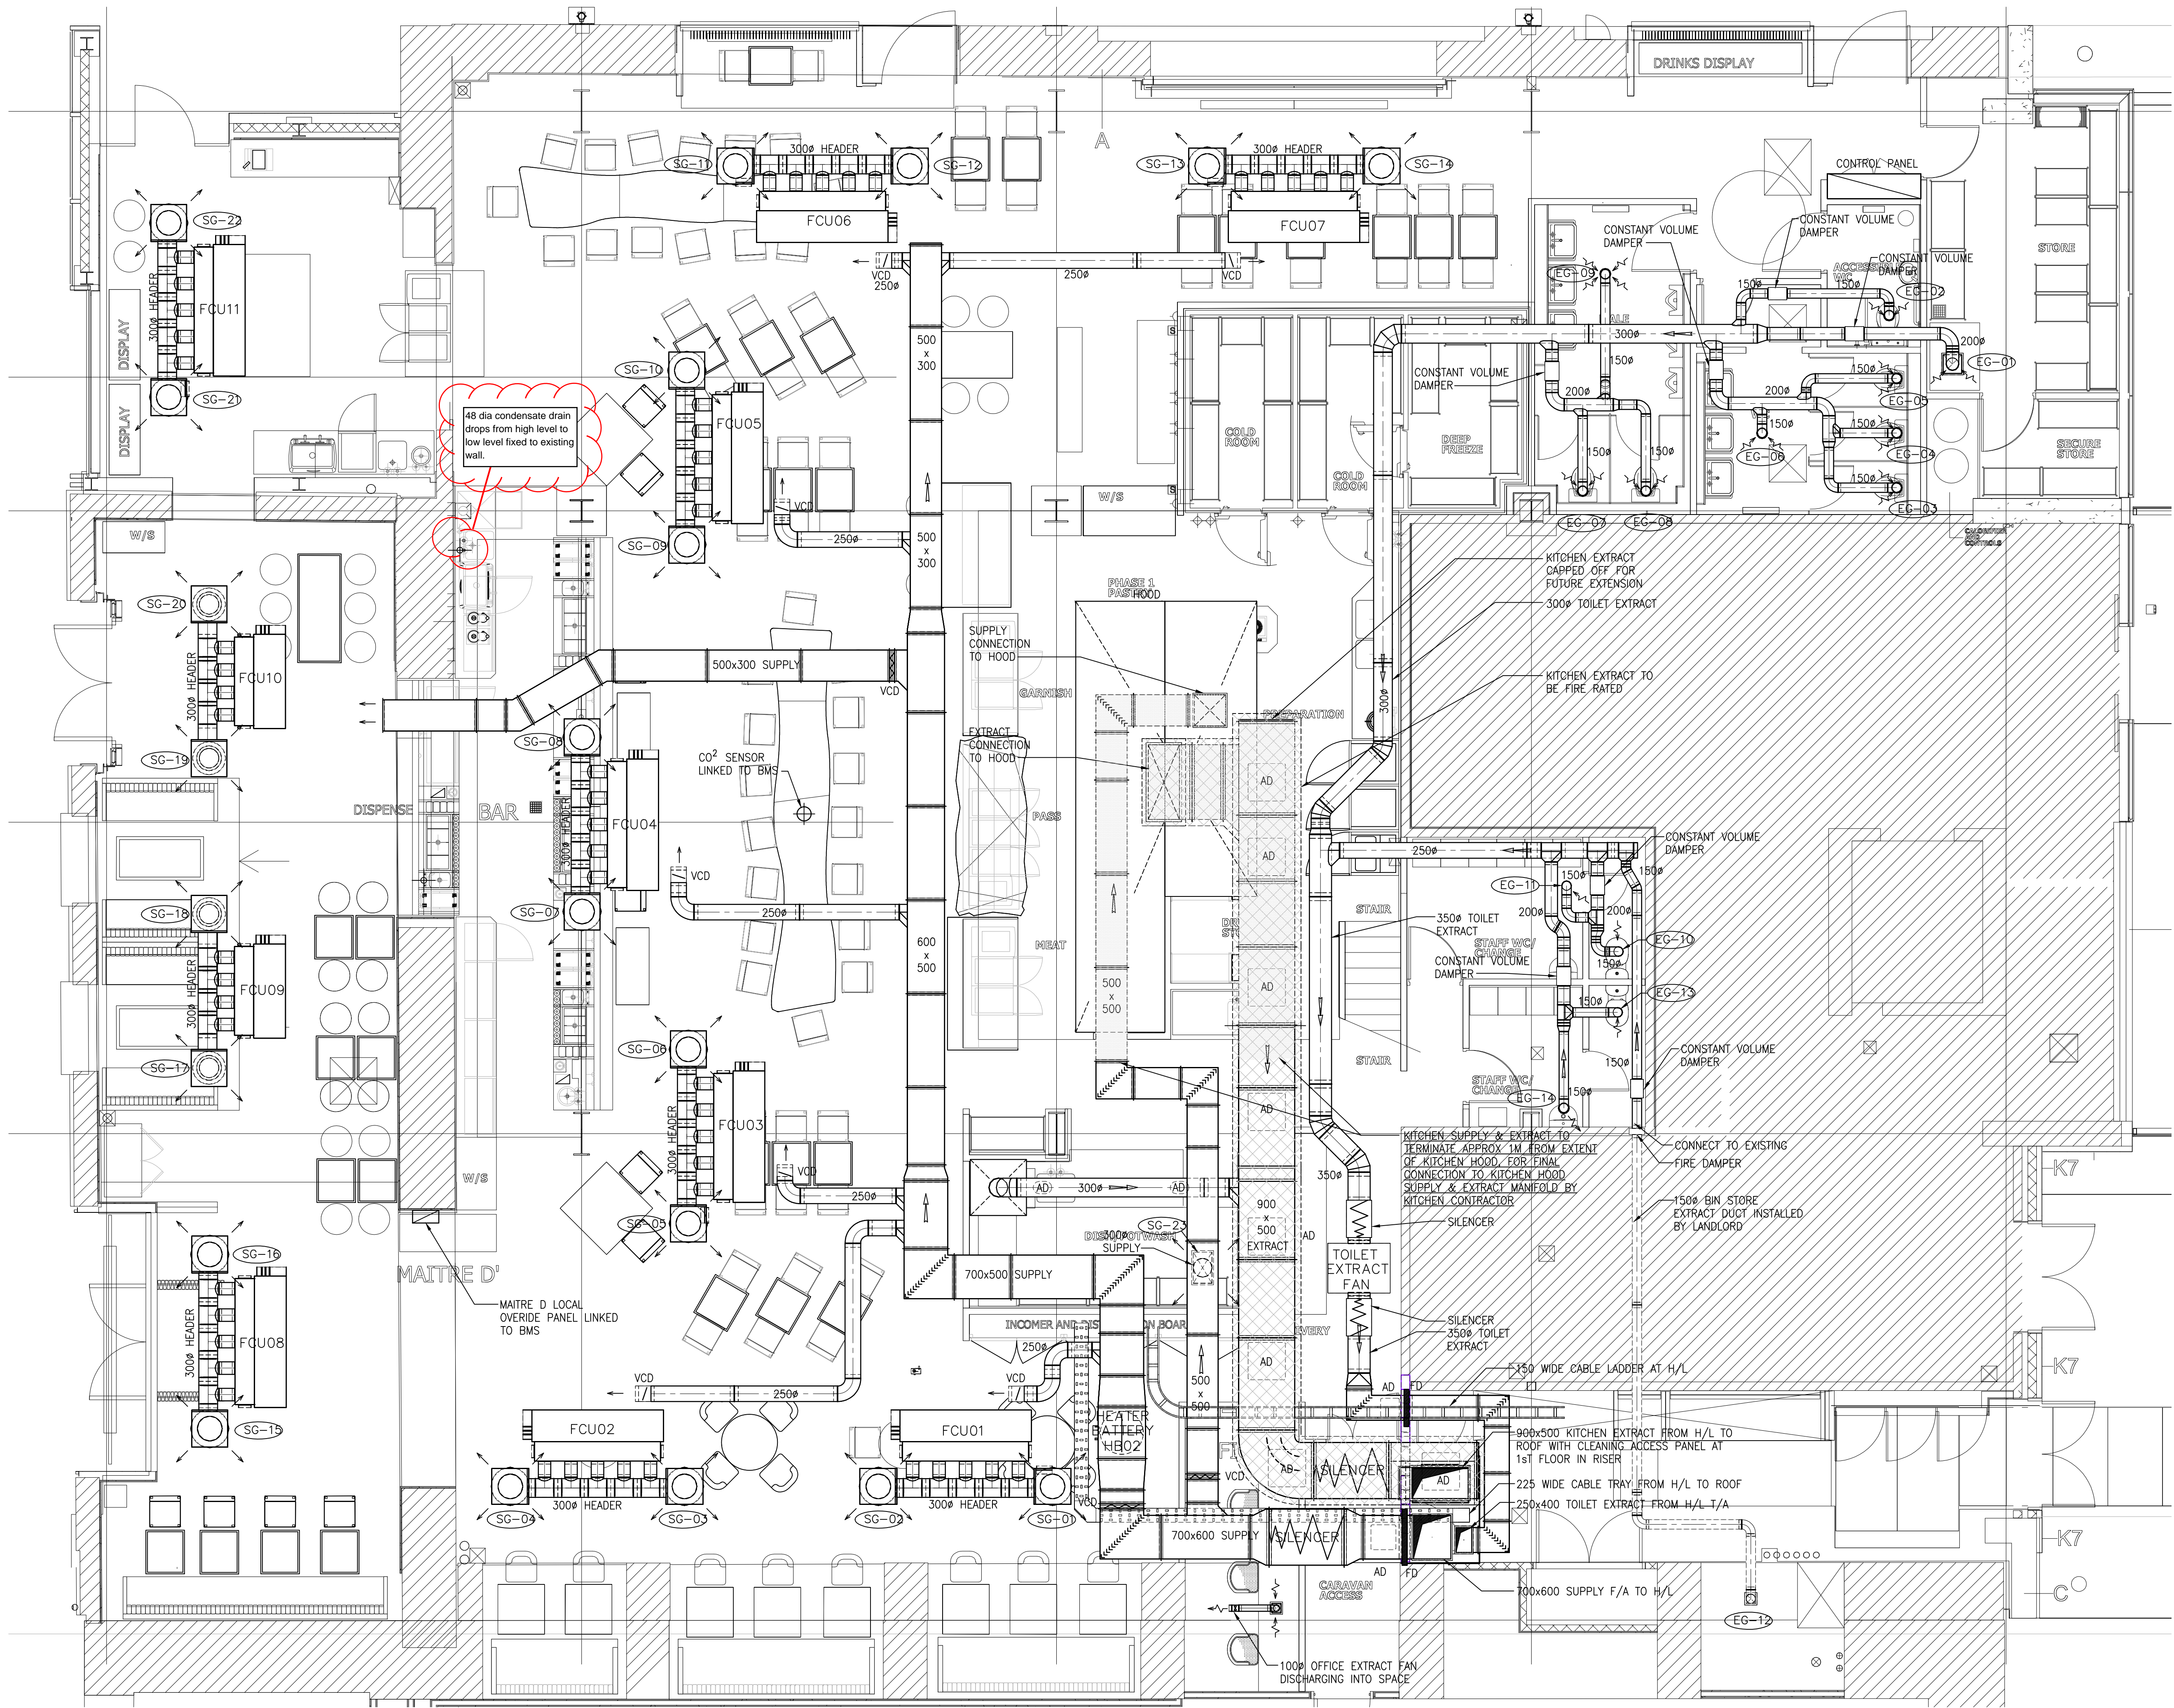

T2	TENDER ISSUE	P.S.	DJB	16.07.12
T1	STAGE E ISSUE	P.S.	DJB	30.06.12
P1	STAGE D ISSUE	P.S.	DJB	01.06.12
REV	DESCRIPTION	CHECKED	DRAWN	DATE

This document is based on an original copyright work created by a company in the Gratte group of companies (Gratte) or a third party (Others) showing the layout of the relevant part of the building and/or the schematics of the fixtures and/or fittings in the relevant part of the building or to be affixed and/or fitted to that part. All property rights including copyright in a drawing created by Gratte or technical additions to that drawing made by Gratte are owned by Gratte. The contents of this document may not be reproduced, copied, stored in any retrieval system in any form or passed to any third party without the express written consent of both Gratte and the relevant Others. Gratte does not accept any responsibility or liability for any errors in the dimensions or scale shown in the drawing.

Client

URBAN HOTEL GROUP

Job

GRANARY SQUARE
KITCHEN & BAR
KINGS CROSS

Description

GROUND FLOOR
AIR CONDITIONING & VENTILATION
LAYOUT

Drg. No.	Rev	Scale
7871-M-101	T2	1:50 @A1
Date	Drawn	Checked
MAY 2012	DJB	P.S.

DAVIS, WILLIS
AND ASSOCIATES
LIMITED



Building services
engineers

2 Regents Wharf
All Saints Street
London N1 9RL
Tel: 020 7837 6433
Fax: 020 7520 8100
email: cad@gratte.com