
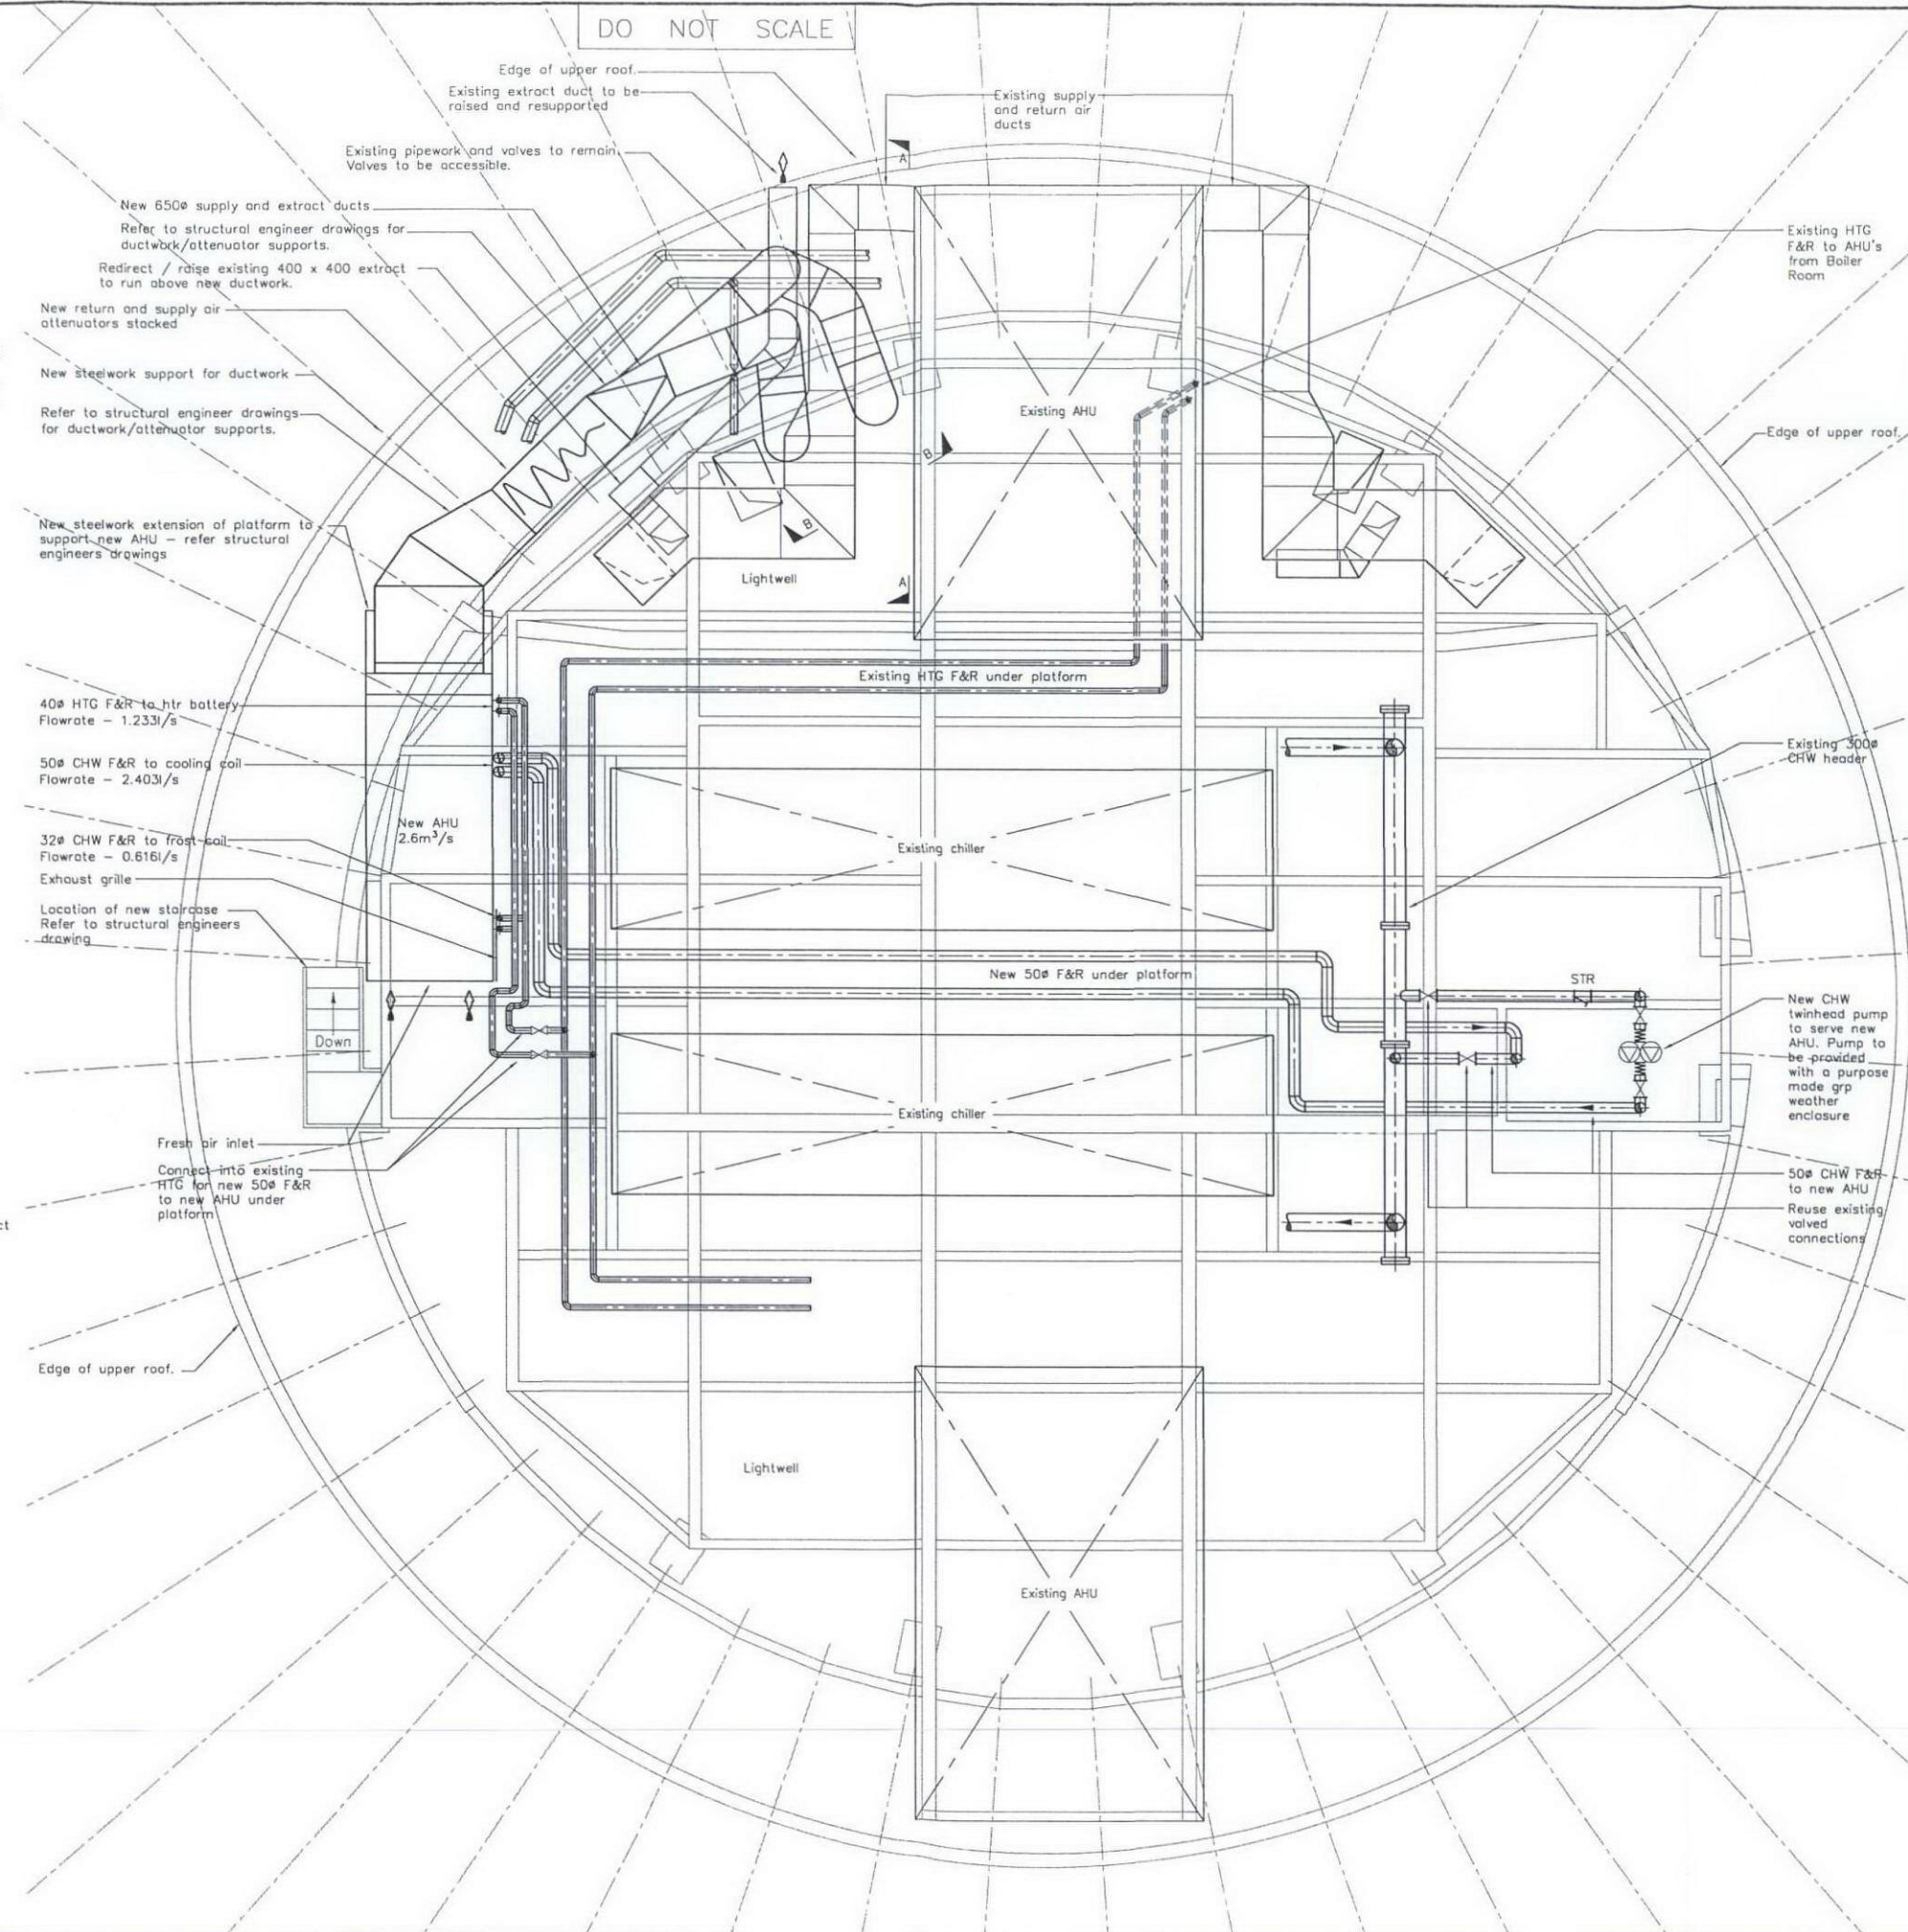
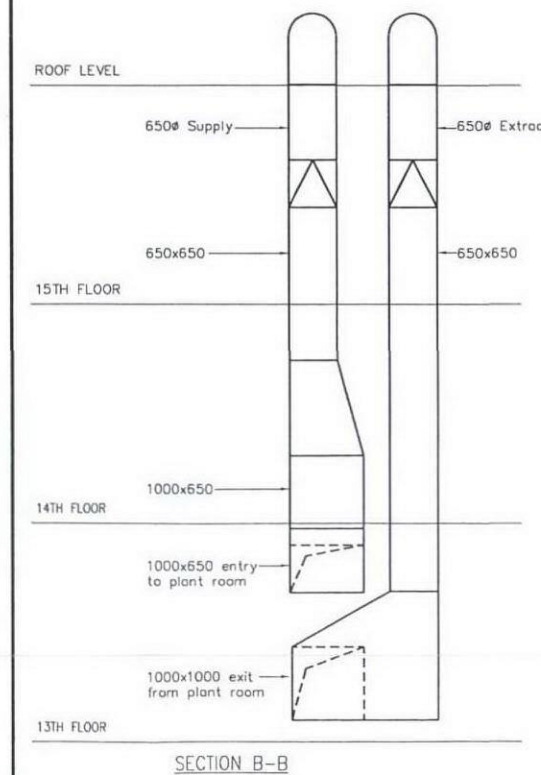


Drawing Number:
9728/M/01

DO NOT SCALE

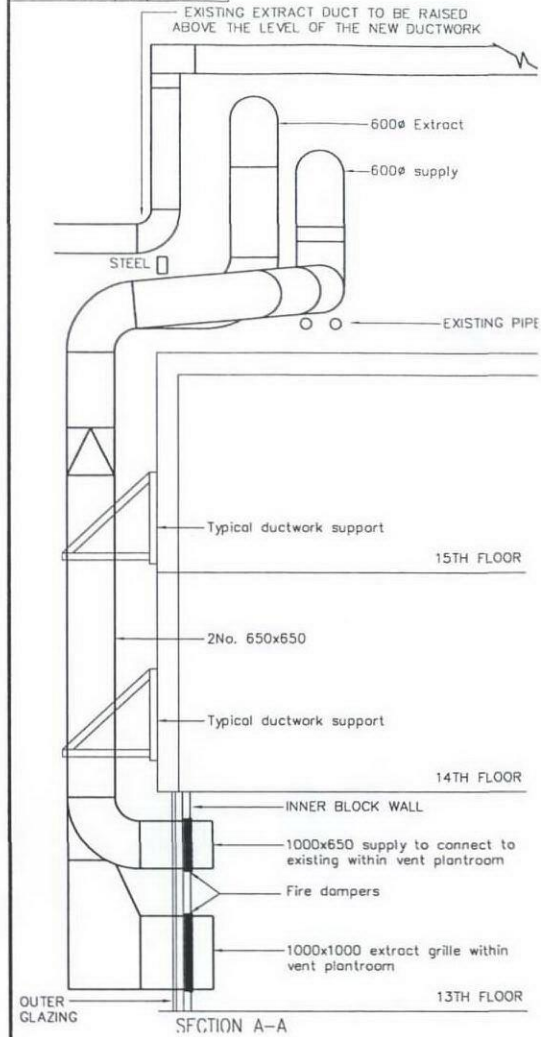


NOTES

1. **Health and Safety:** Method statements and risk assessments to be provided for all activities on the roof area and in lightwell riser. Parts *** care to be taken with regards to safe working and restricted areas.

LEGEND

CHW Chilled water
HTG Heating
F&R Flow and Return
ST Strainer
IV Isolating Valve
DC Drain Cock
CS Commissioning Set
TP Test Point

Existing mechanical services
Proposed mechanical services

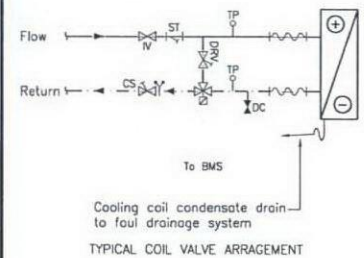

PRELIMINARY

Client

CIVIL AVIATION AUTHORITY
CAA HOUSE
45-59 KINGSWAY LONDON
WC2B 6TE

BA BUTLER & YOUNG ASSOCIATES

Mechanical & Electrical Consulting Engineers
1st FLOOR
54-62 STATION ROAD EAST
OXFORD, SURREY
RH8 0PG

Email: enquiries@bya.co.uk

Tel No. 01883-717172 Fax No. 01883-717174

Project

CAA TOWER ONE KEMBLE ST, LONDON
PROVISIONS OF NEW AIR HANDLING UNIT
AND ASSOCIATED WORKS

Drawing Title

PROPOSED MECHANICAL
MODIFICATIONS TO
ROOF LEVEL

Scales

1:50

Xref:

Drwg Sheet

A1

Drawn

NS

Checked

GS

Date

19.05.11

BYA Ref:

9728

Drawing Number:

9728/M/01

REV:

P