



Allow for replacing stepped lead flashing at abutment to main structure. Code 4 lead.  
 yellow conservation type roof light recessed installation.  
 Roof slates to match existing.  
 Tiles or other approved breathable membrane.  
 Increase depth of existing rafters to accommodate insulation by  
 attaching 25x50mm battens to underside  
 Cellex insulation between rafters GA 440.  
 Cellex insulation below rafters TB445.

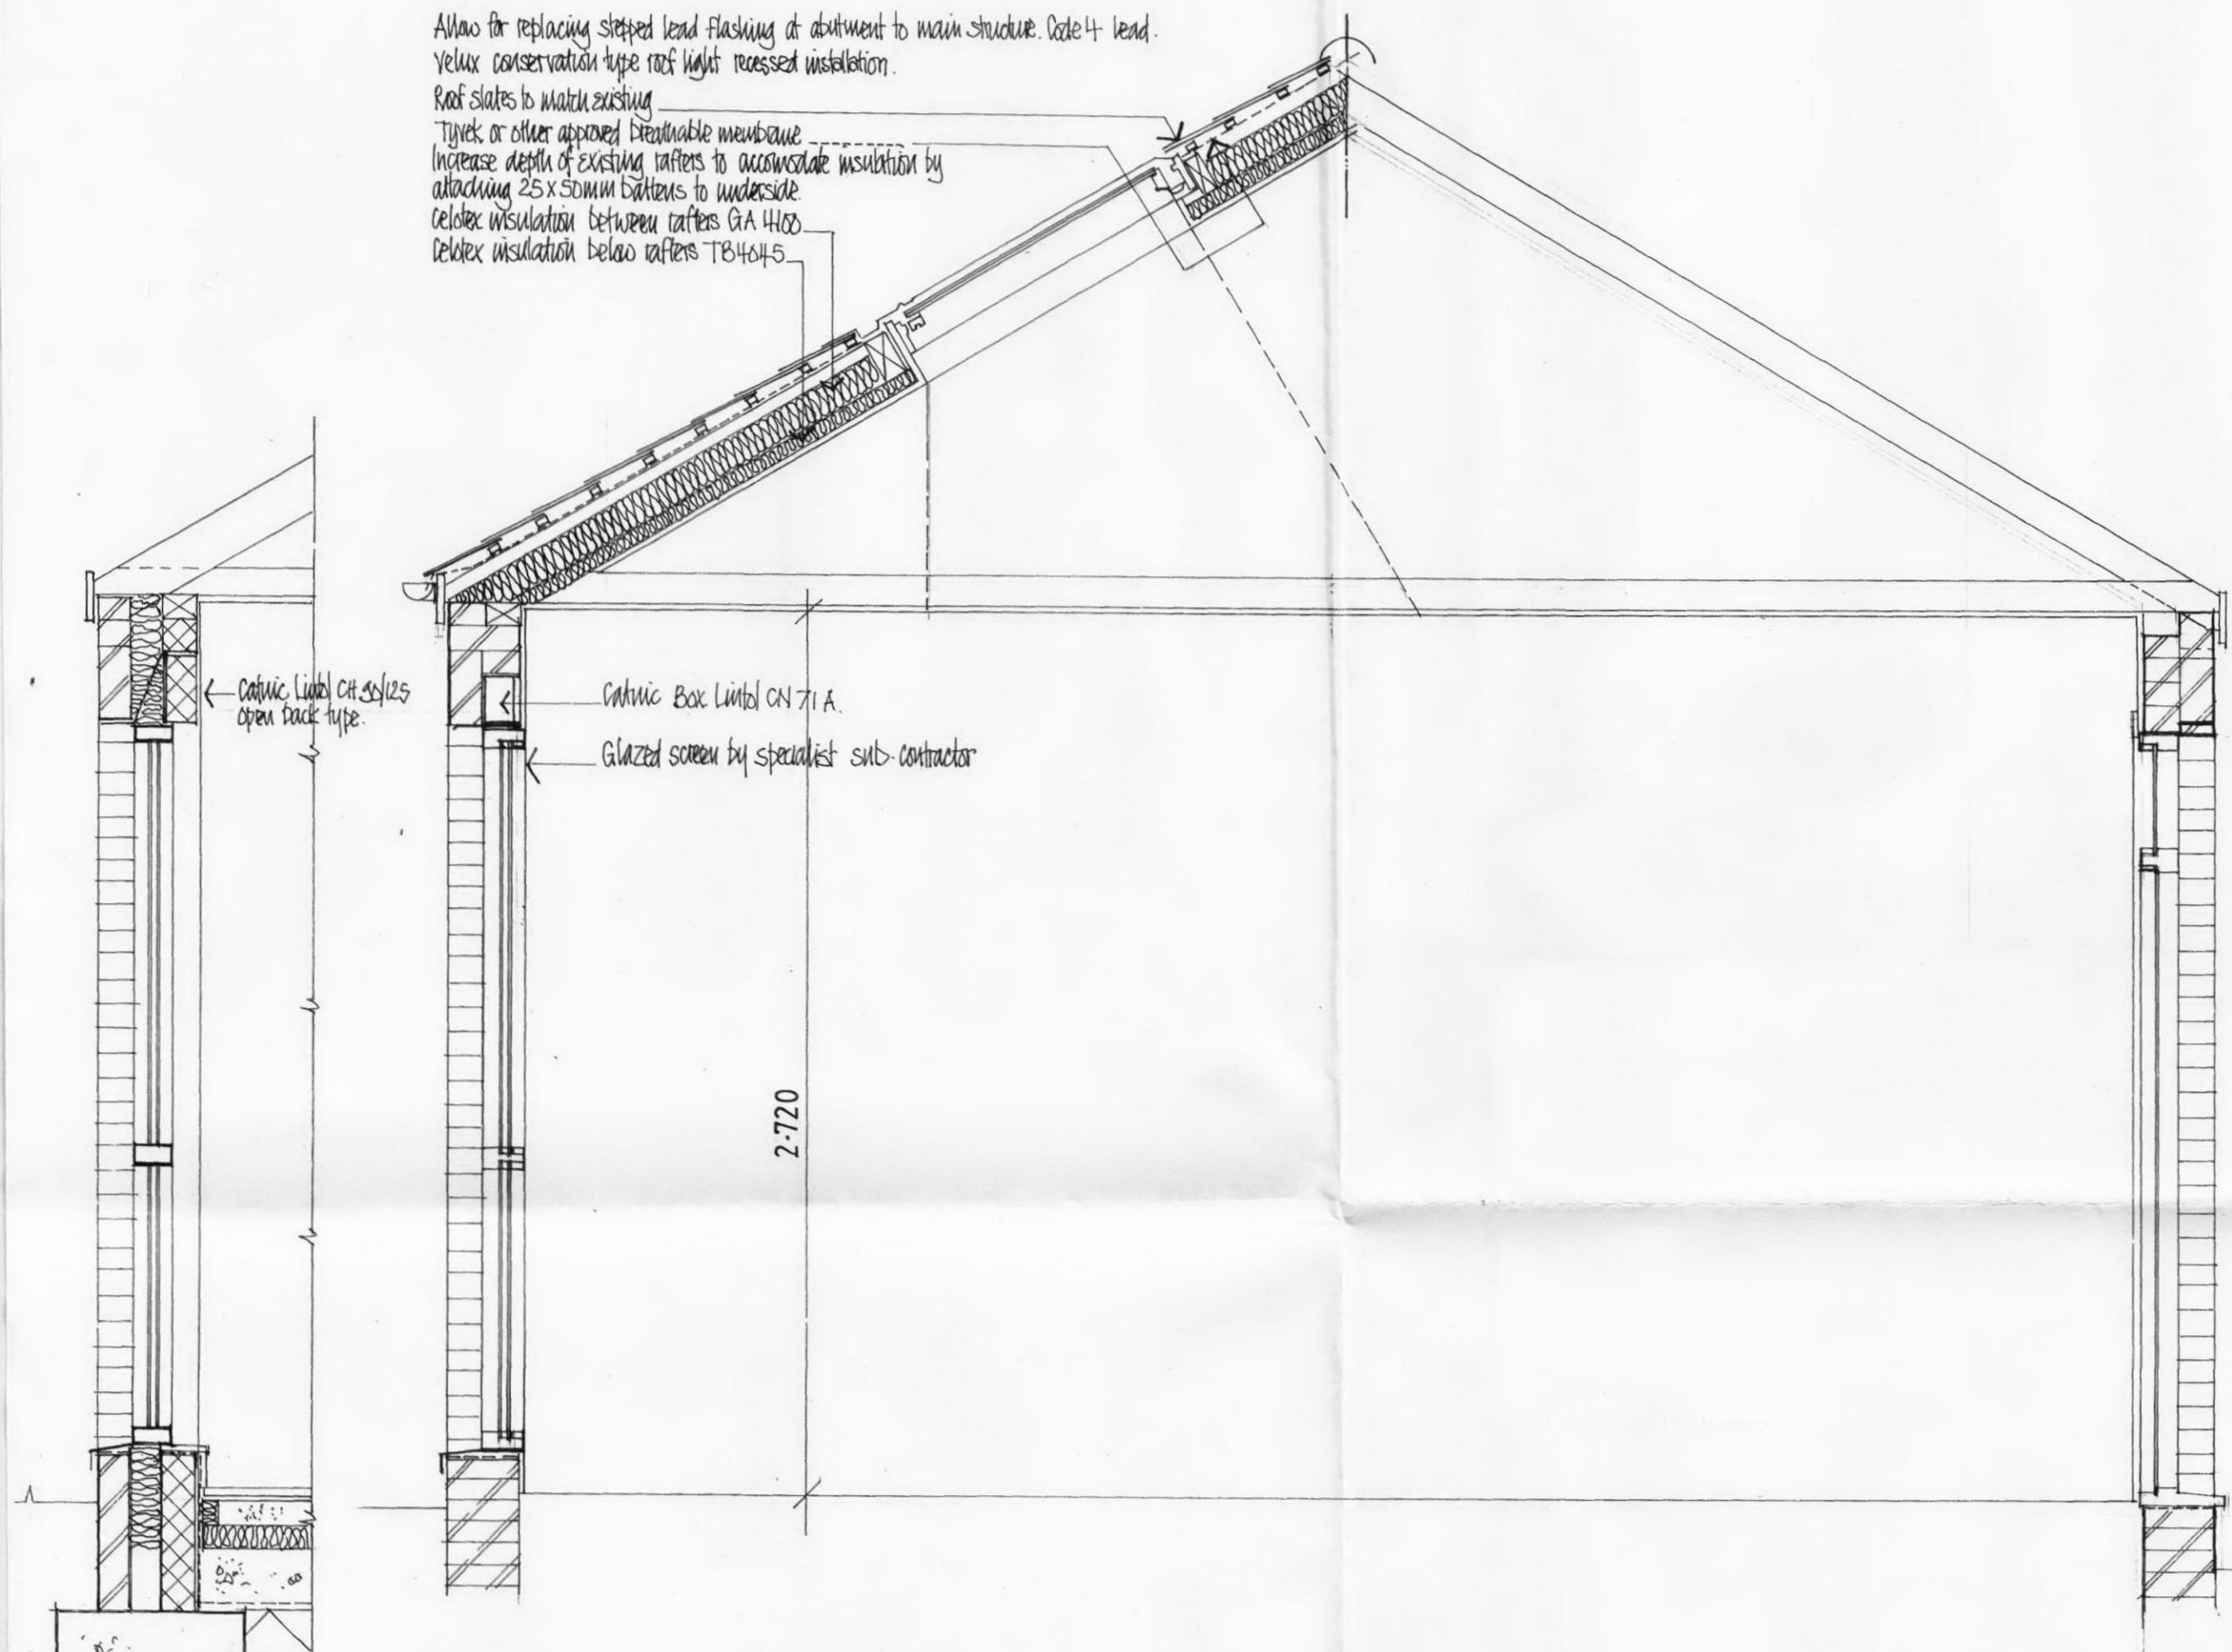


AA.

BB.

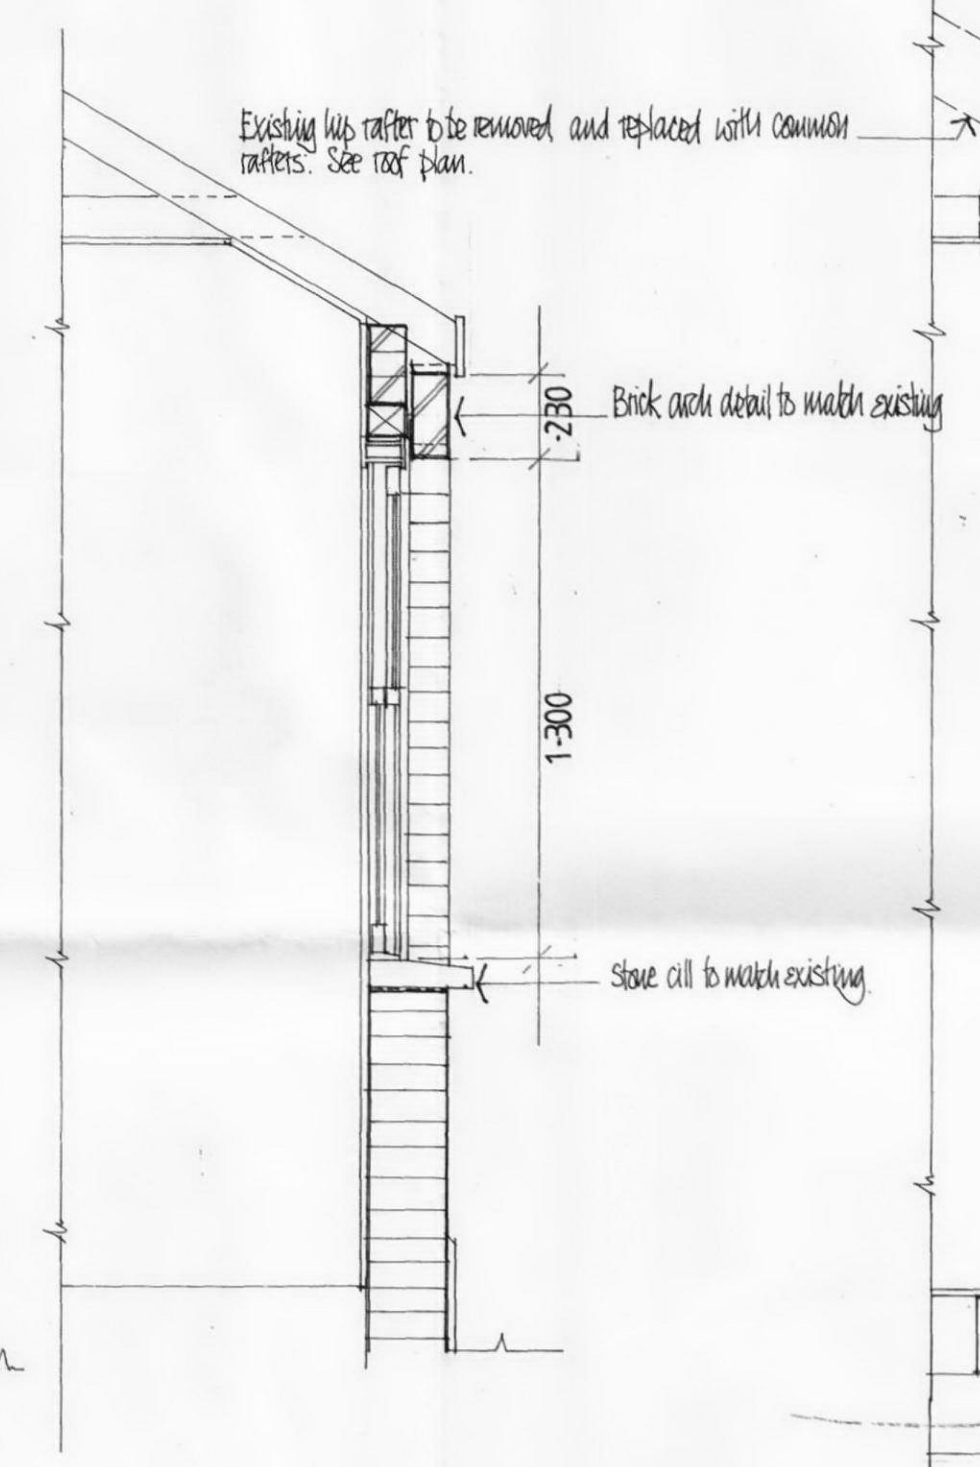

CC.

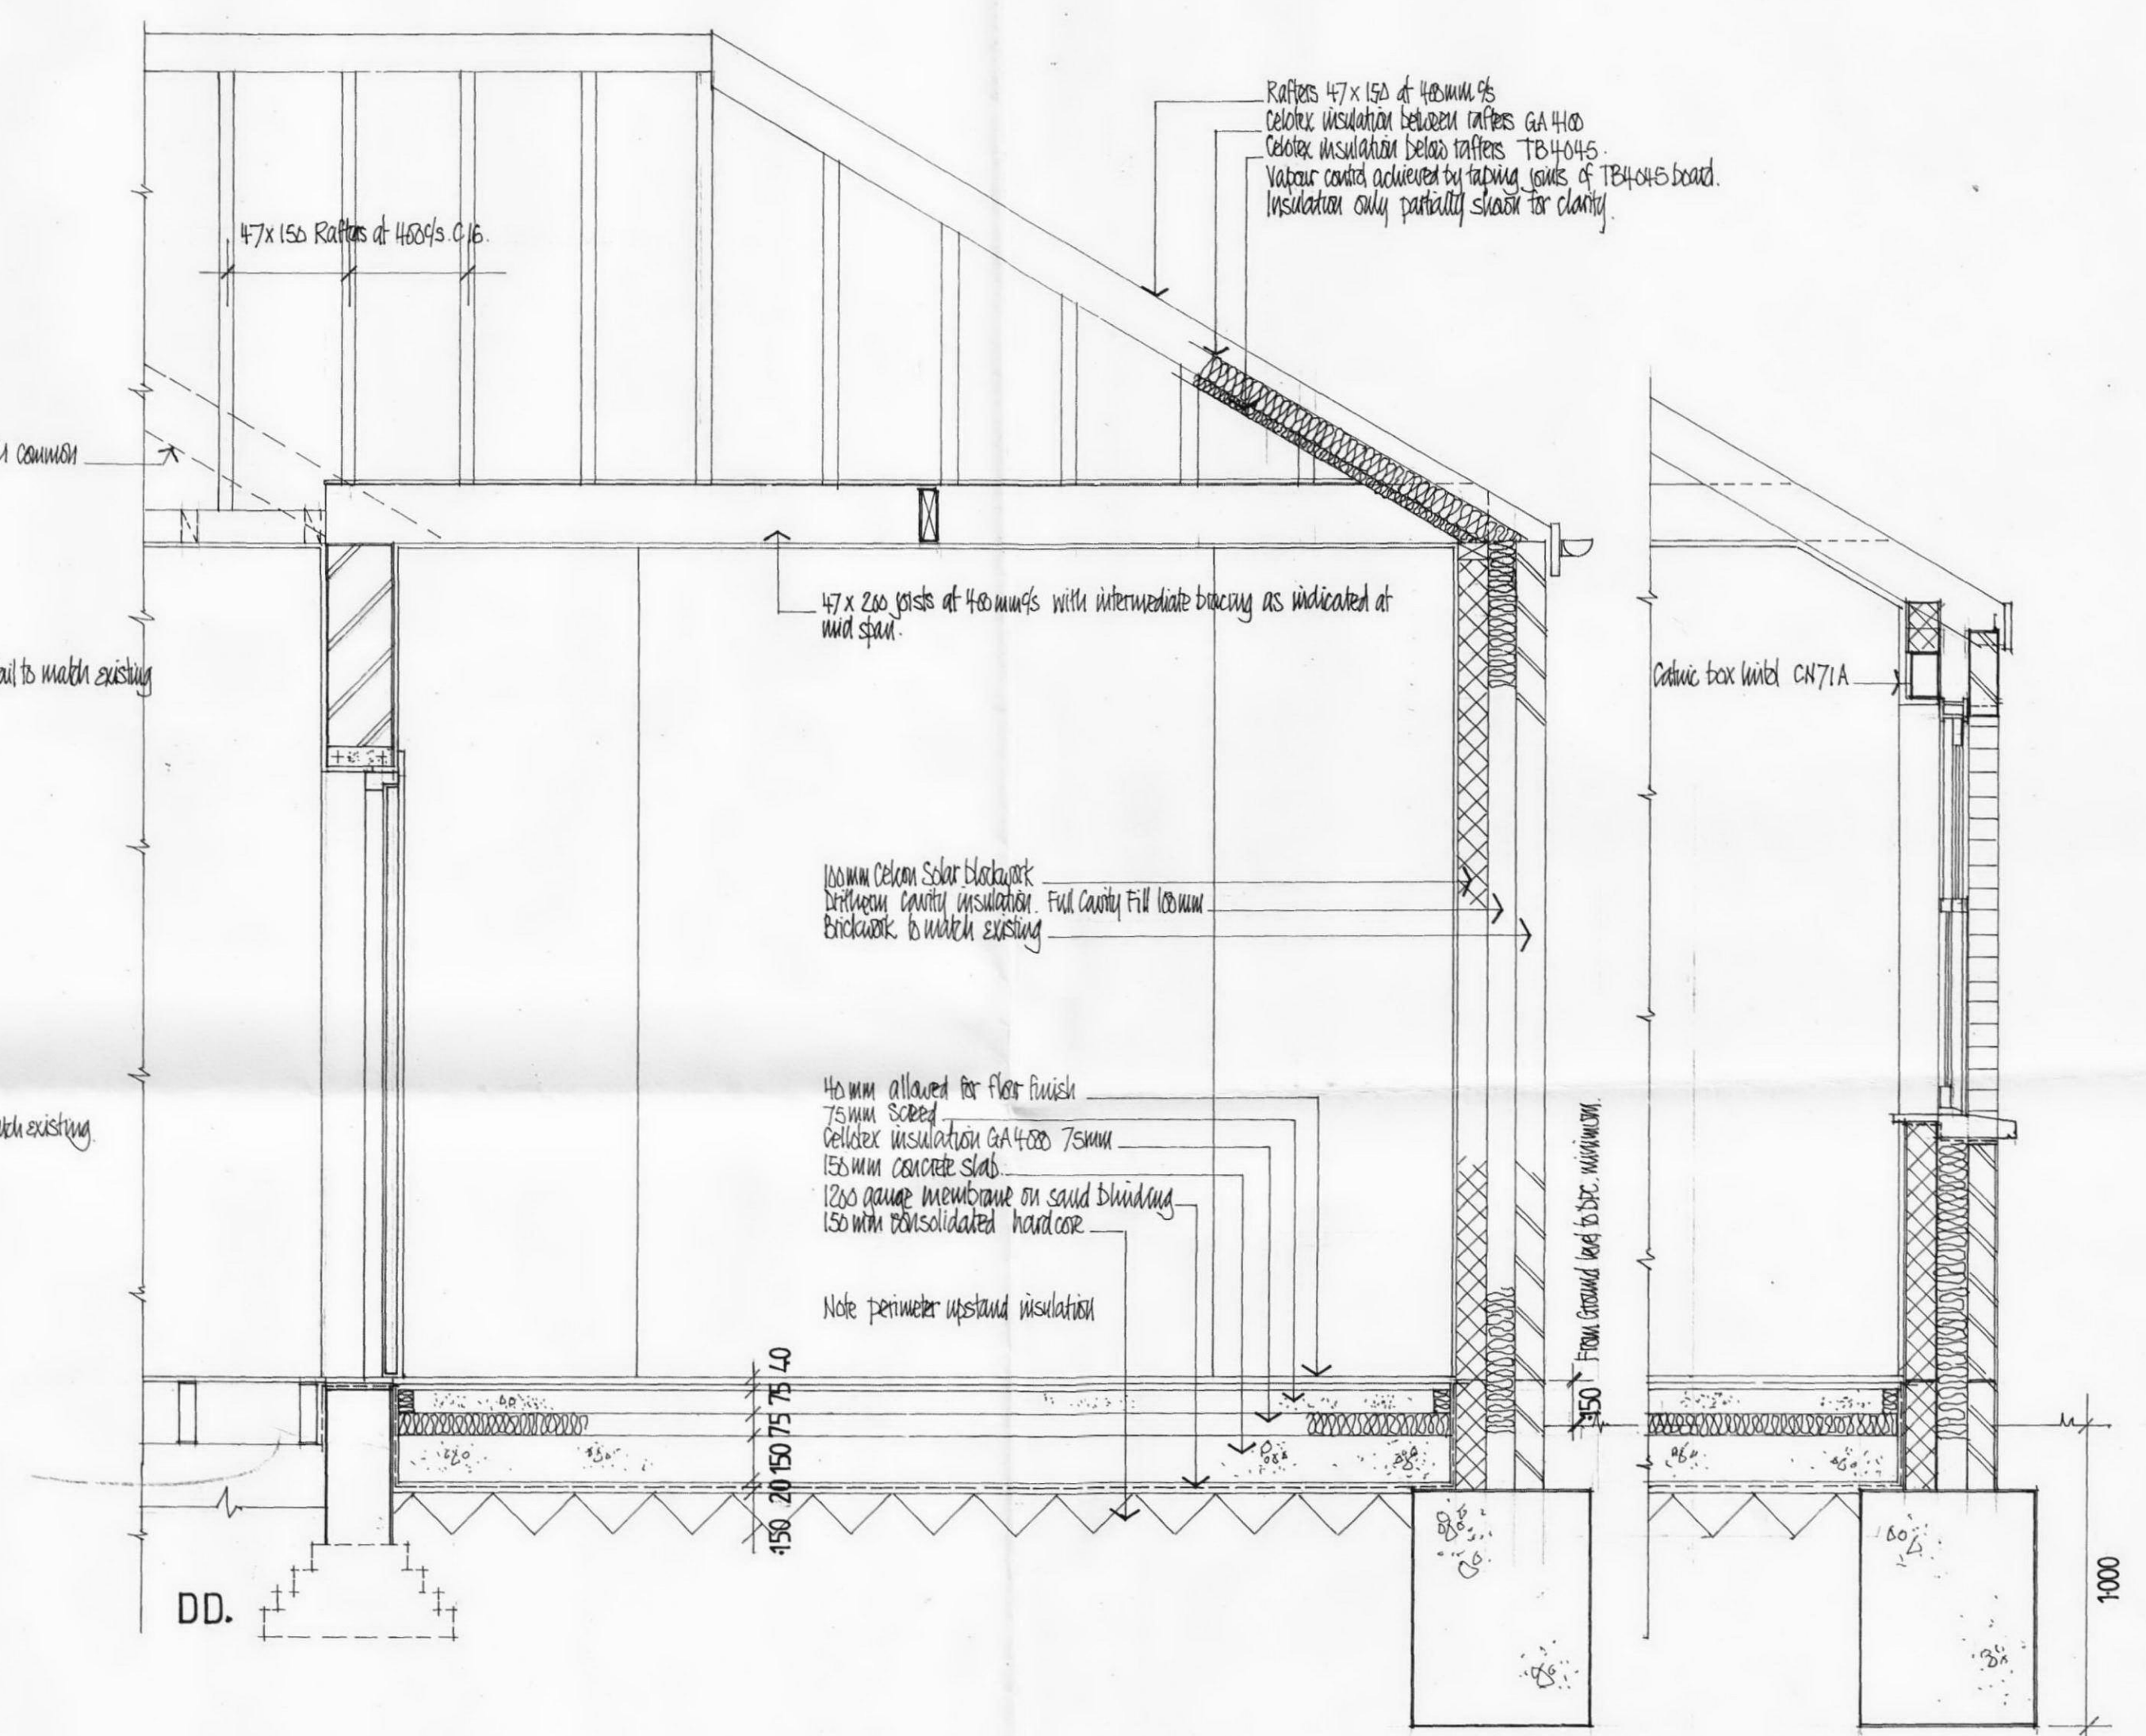

DD.

EE.

Foundation width/depth nominally shown as 600mm wide x 1.00m deep subject to Building Inspector approval.  
 1:20 0 0.5 1 1.5 2 20 NOV 2011

20. ORNAN ROAD. LONDON. NW3 4PX  
 SECTIONS.  
 SCALE: 1:20.  
 Drawing No: 11.11.03.