
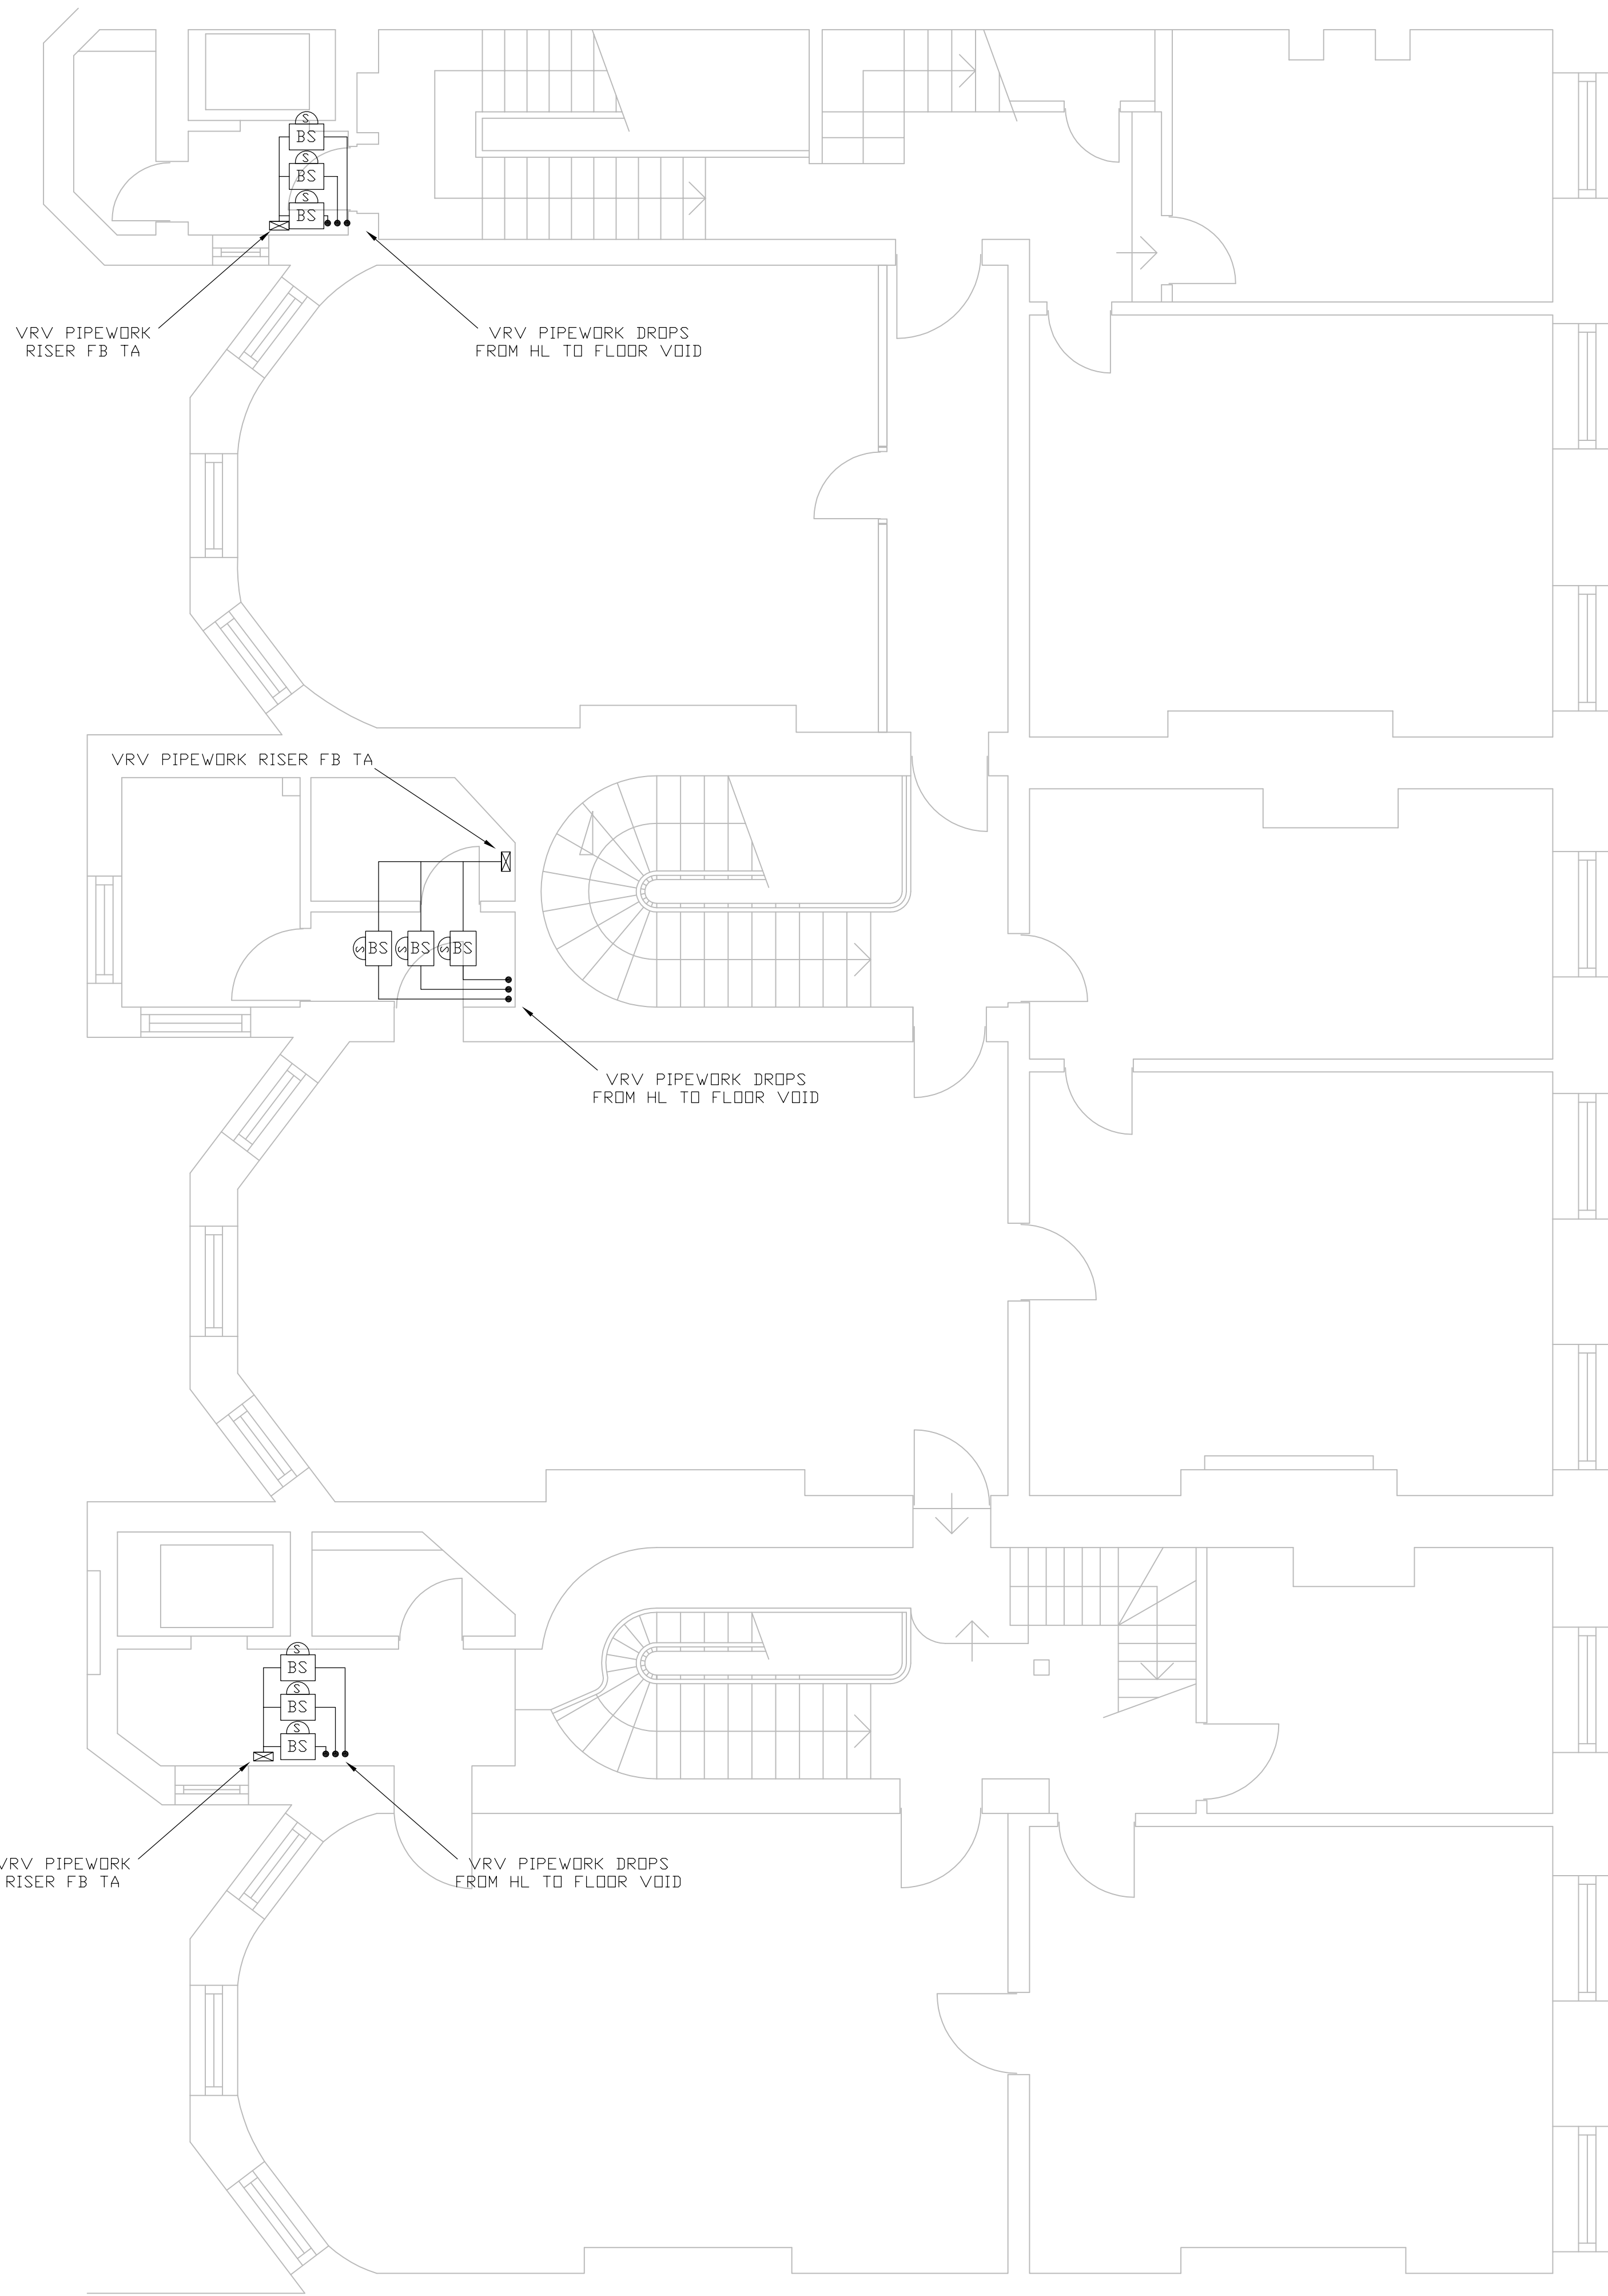


The Mews

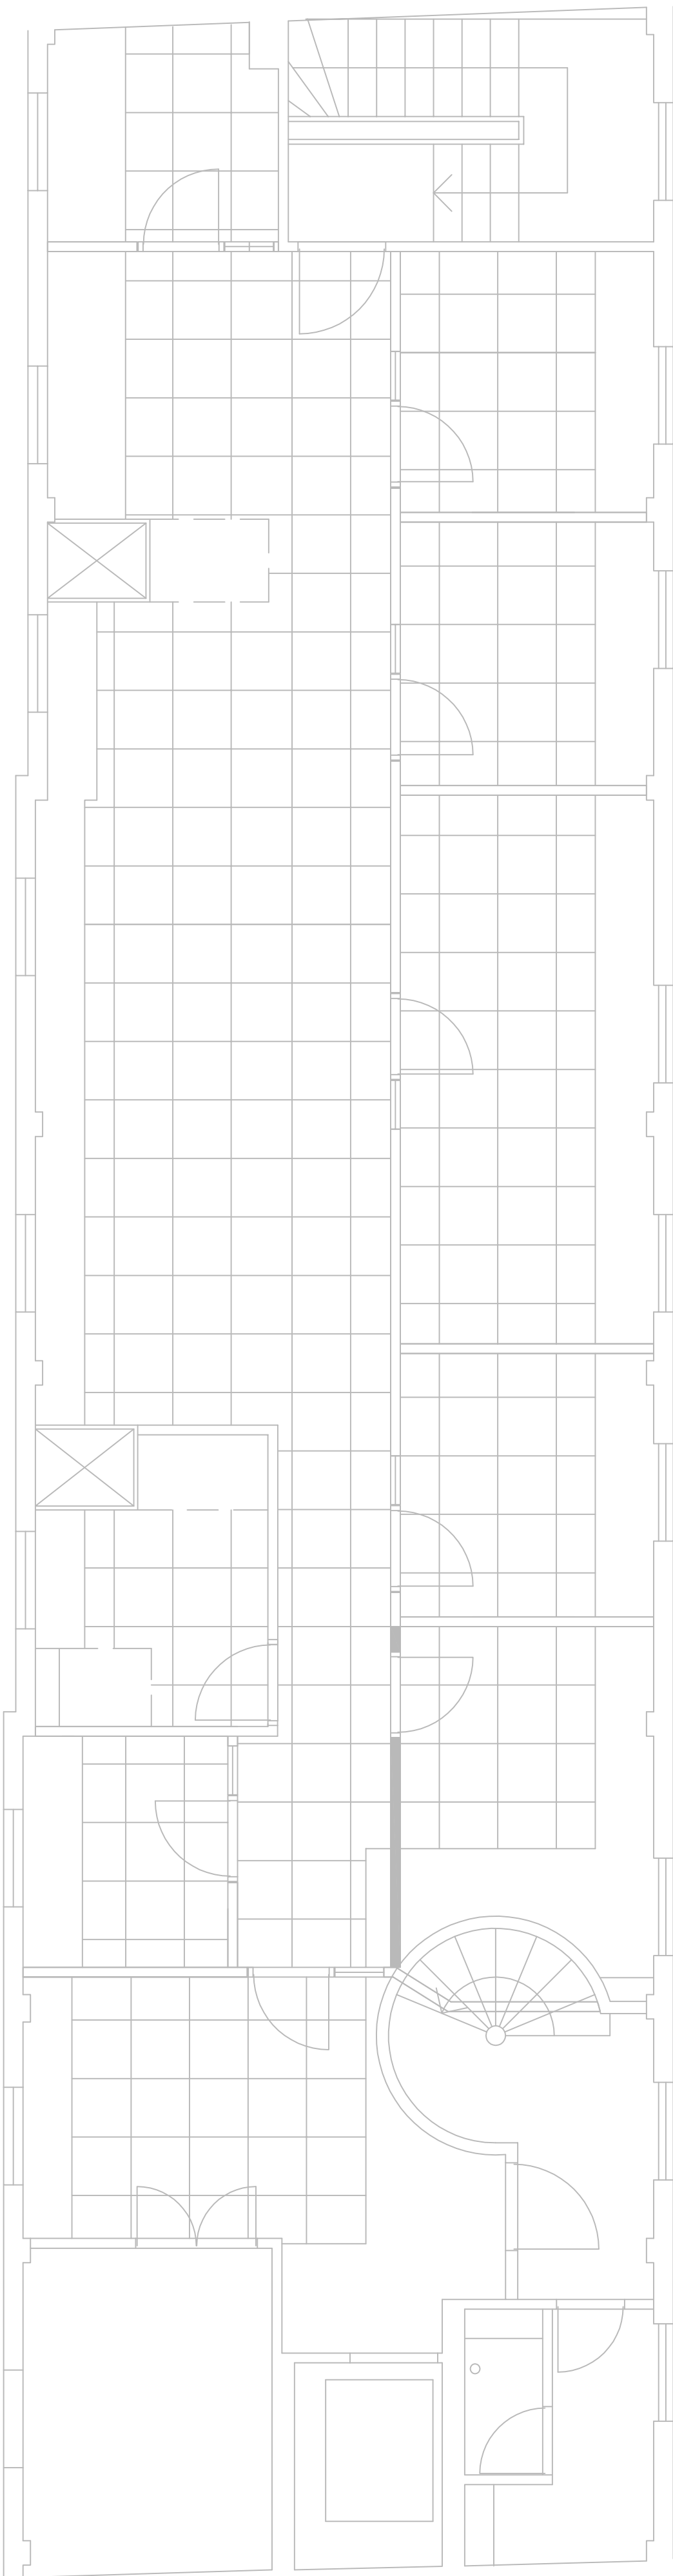

DRAWING STATUS

FOR COMMENT

DO NOT SCALE FROM DRAWING

NOTES

See equipment schedules for heating/cooling loads and equipment details.

All secondary supply ductwork, including plenum boxes are to be thermally insulated.

Condense pipework is to connect to local soil stack/pipe.

Positions of room controllers TBC

All supply ductwork to be thermally insulated. See M001 for supply air schematic

LEGEND



EXTRACT GRILLE



SUPPLY GRILLE



FRIDGE PIPE TRAY



TRAY RISER FB/TA



BRANCH SELECTOR BOX



VRV CONTROL



SWITCHED FUSED SPUR



FIRE DAMPER C/W ACCESS DOOR



VOLUME CONTROL DAMPER

REFRIGERANT PIPE

REV DESCRIPTION DATE

Building Services (Beds) Limited

M & E Contractors
Unit 15 Riboon Way
Progress Park
Luton LU4 9UR
Tel: 01582 565544 Fax: 01582 565566
www.buildingservicesbeds.co.uk



PROPERTY CONSULTANTS

243 Brooklands Road
Weybridge
Surrey KT13 0RH

Tel: 01932 850100
Fax: 01932 841800

Email: business@dhpuk.co.uk
Web: www.dhpuk.co.uk

PROJECT NAME

**Bloomsbury Publishing
49-51 Bedford Square
London
WC1B 3DP**

DRAWING TITLE

**SECOND FLOOR
HIGH LEVEL
MECHANICAL SERVICES
LAYOUT**

SCALE

1:50@A1

DRAWN BY

NB

DATE

09.03.11

CHECKED BY

MD

DATE

09.03.11

PROJECT

11002

DWG No

M108

REV No

0