




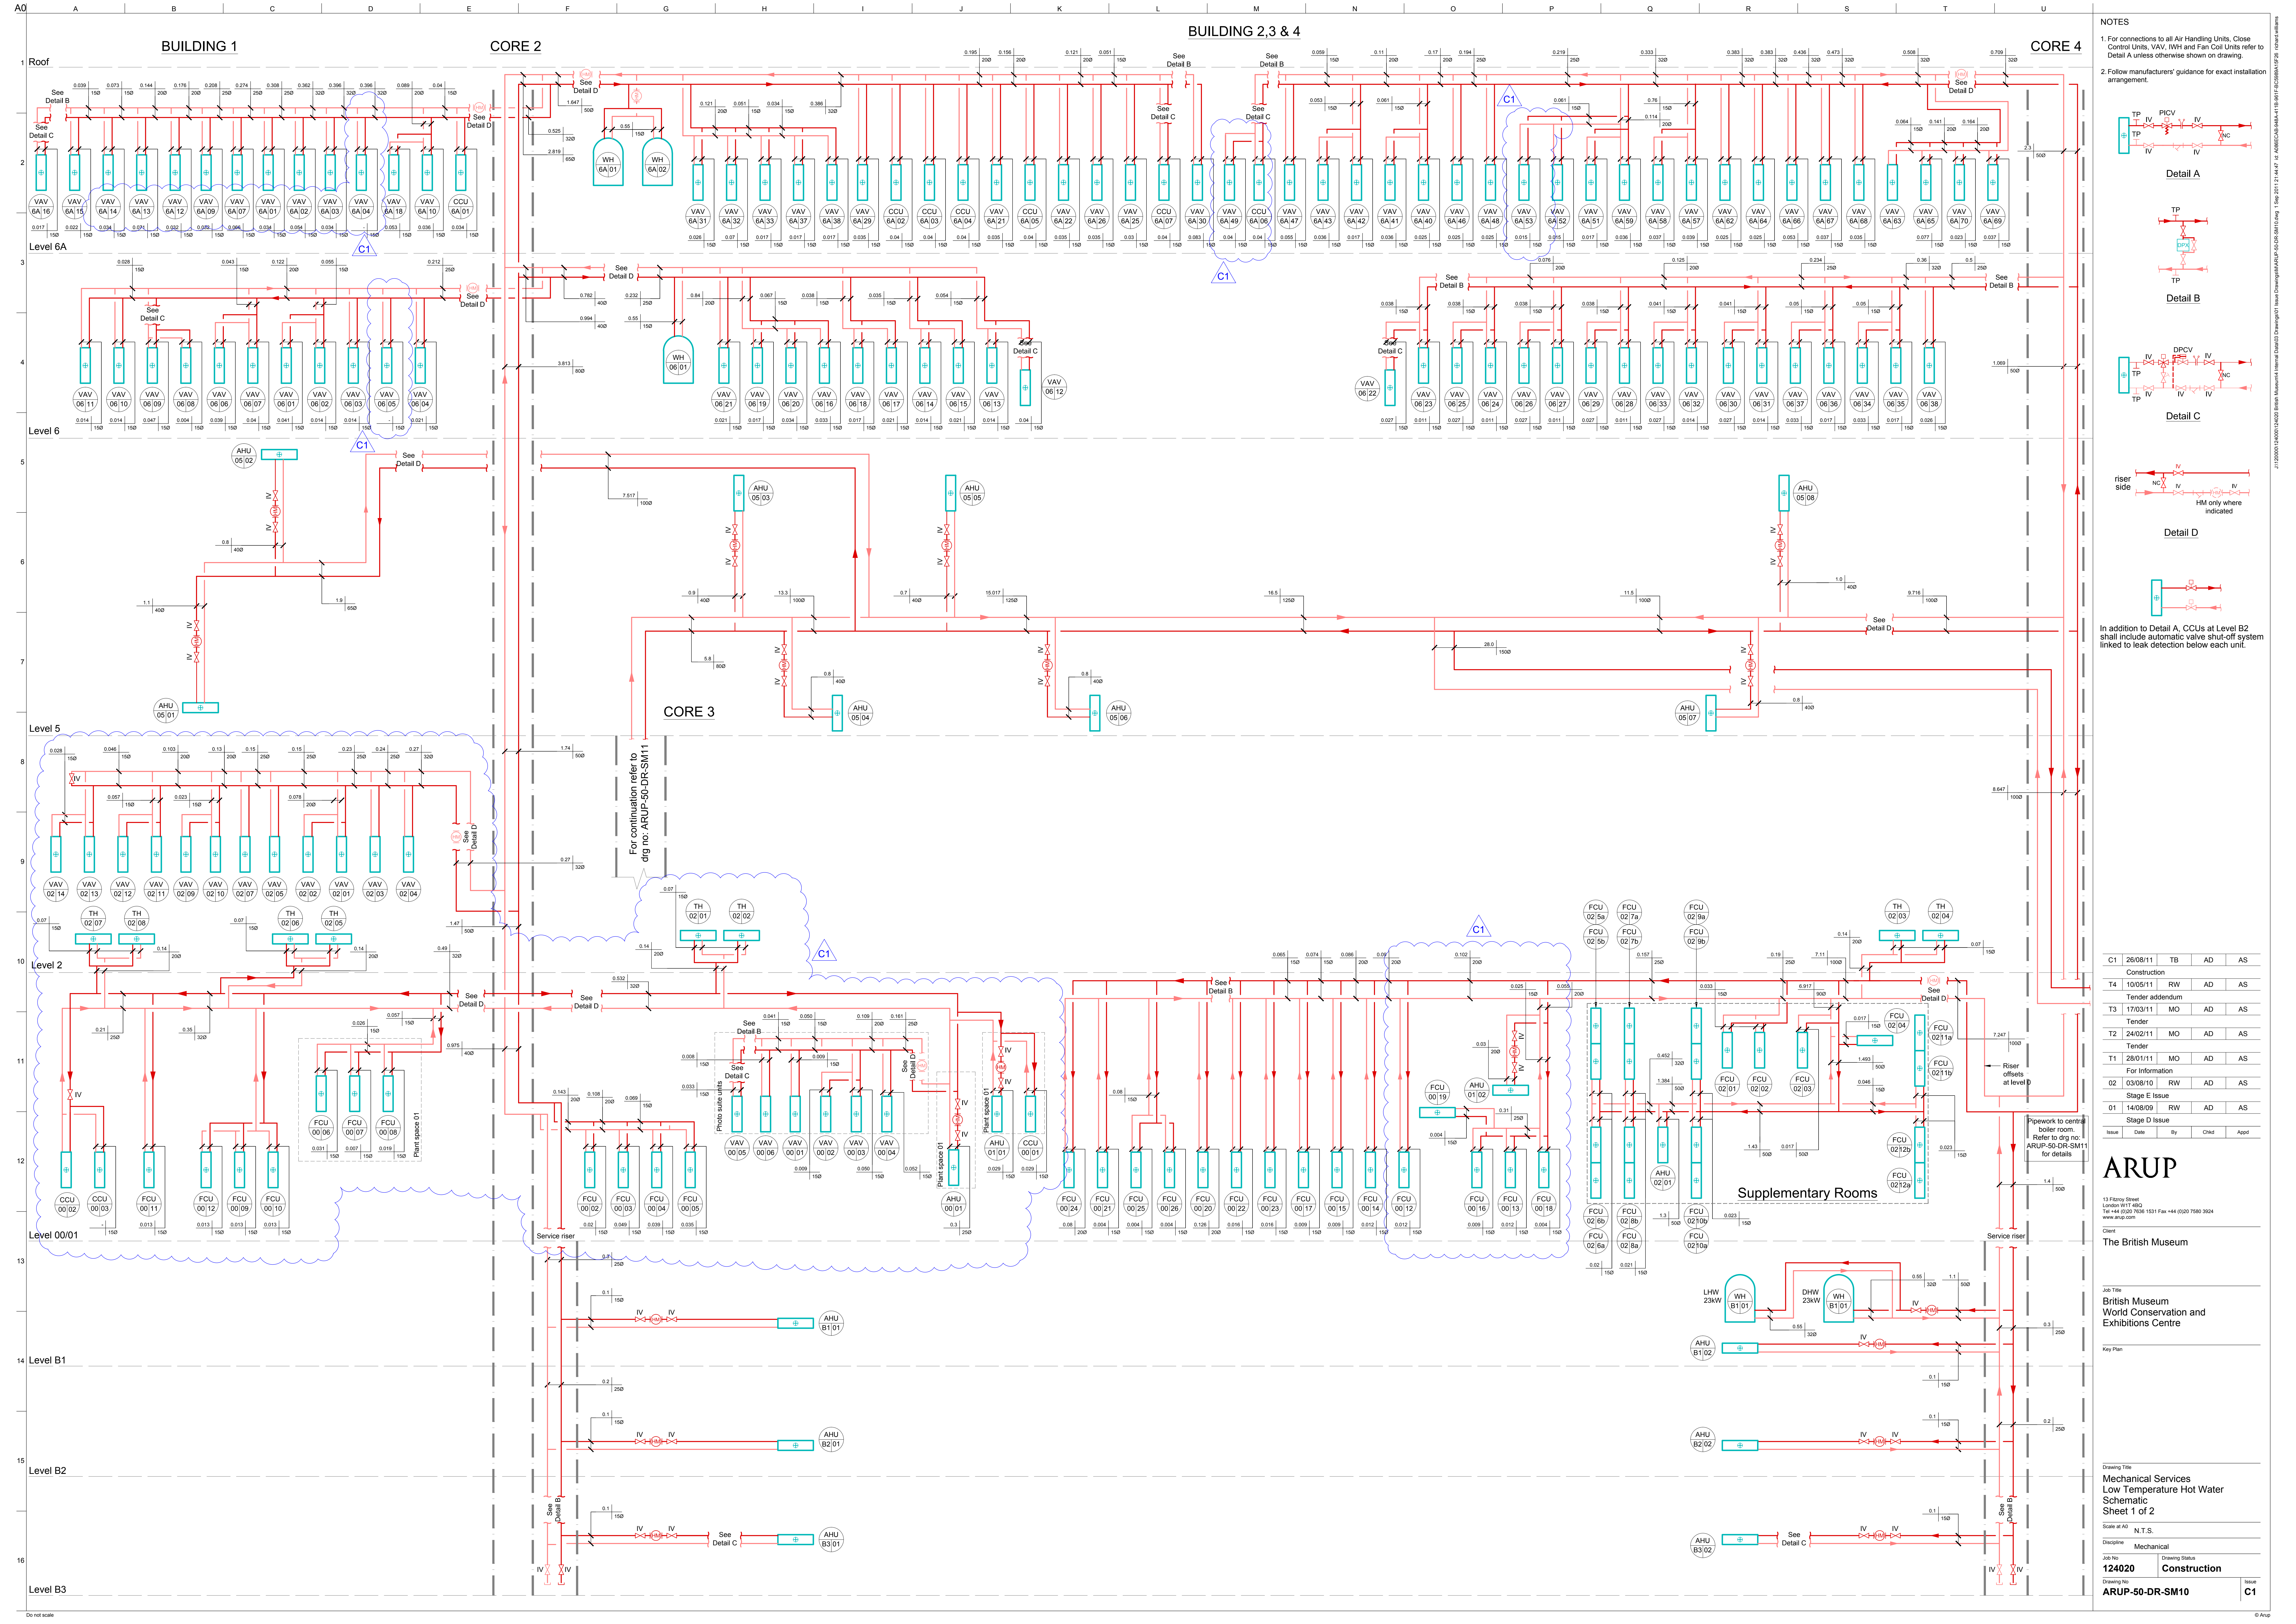


- NOTES
- For connections to all Air Handling Units, Close Control Units, VAV, WH and Fan Coil Units refer to Detail A unless otherwise shown on drawing.
 - Follow manufacturers' guidance for exact installation arrangement.

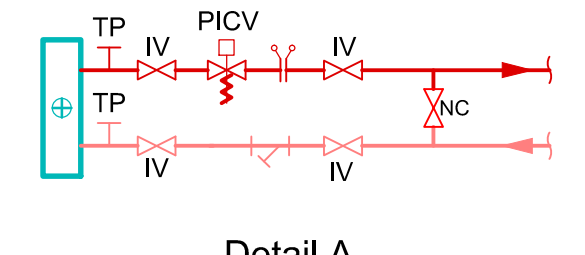


Detail A

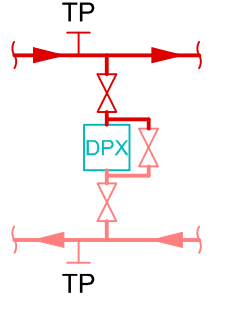

Detail B

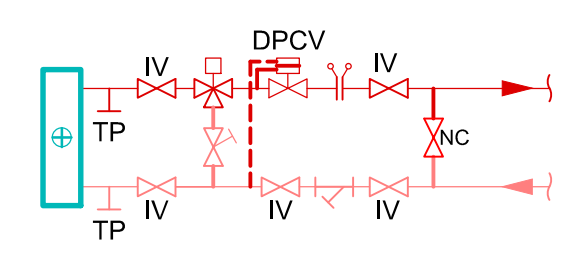

Detail C

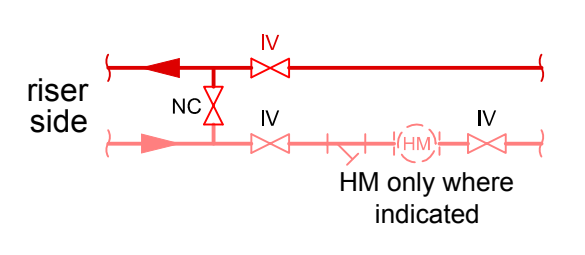

Detail D

In addition to Detail A, CCUs at Level B2 shall include automatic valve shut-off system linked to leak detection below each unit.

C1	26/08/11	TB	AD	AS
Construction				
T4	10/05/11	RW	AD	AS
Tender addendum				
T3	17/03/11	MO	AD	AS
Tender				
T2	24/02/11	MO	AD	AS
Tender				
T1	28/01/11	MO	AD	AS
For Information				
02	03/08/10	RW	AD	AS
Stage E Issue				
01	14/08/09	RW	AD	AS
Stage D Issue				
Issue	Date	By	Chkd	Appd

ARUP

13 Finsbury Street
London EC2M 7HS
Tel: +44 (0)20 7556 1531 Fax: +44 (0)20 7556 3024
www.arup.com

Client

The British Museum
British Museum
World Conservation and Exhibitions Centre

Key Plan

Drawing Title
Mechanical Services
Low Temperature Hot Water
Schematic
Sheet 1 of 2
Scale as AD
N.T.S.
Discipline
Mechanical
Drawing No
124020
Drawing Status
Construction
Issue
C1