


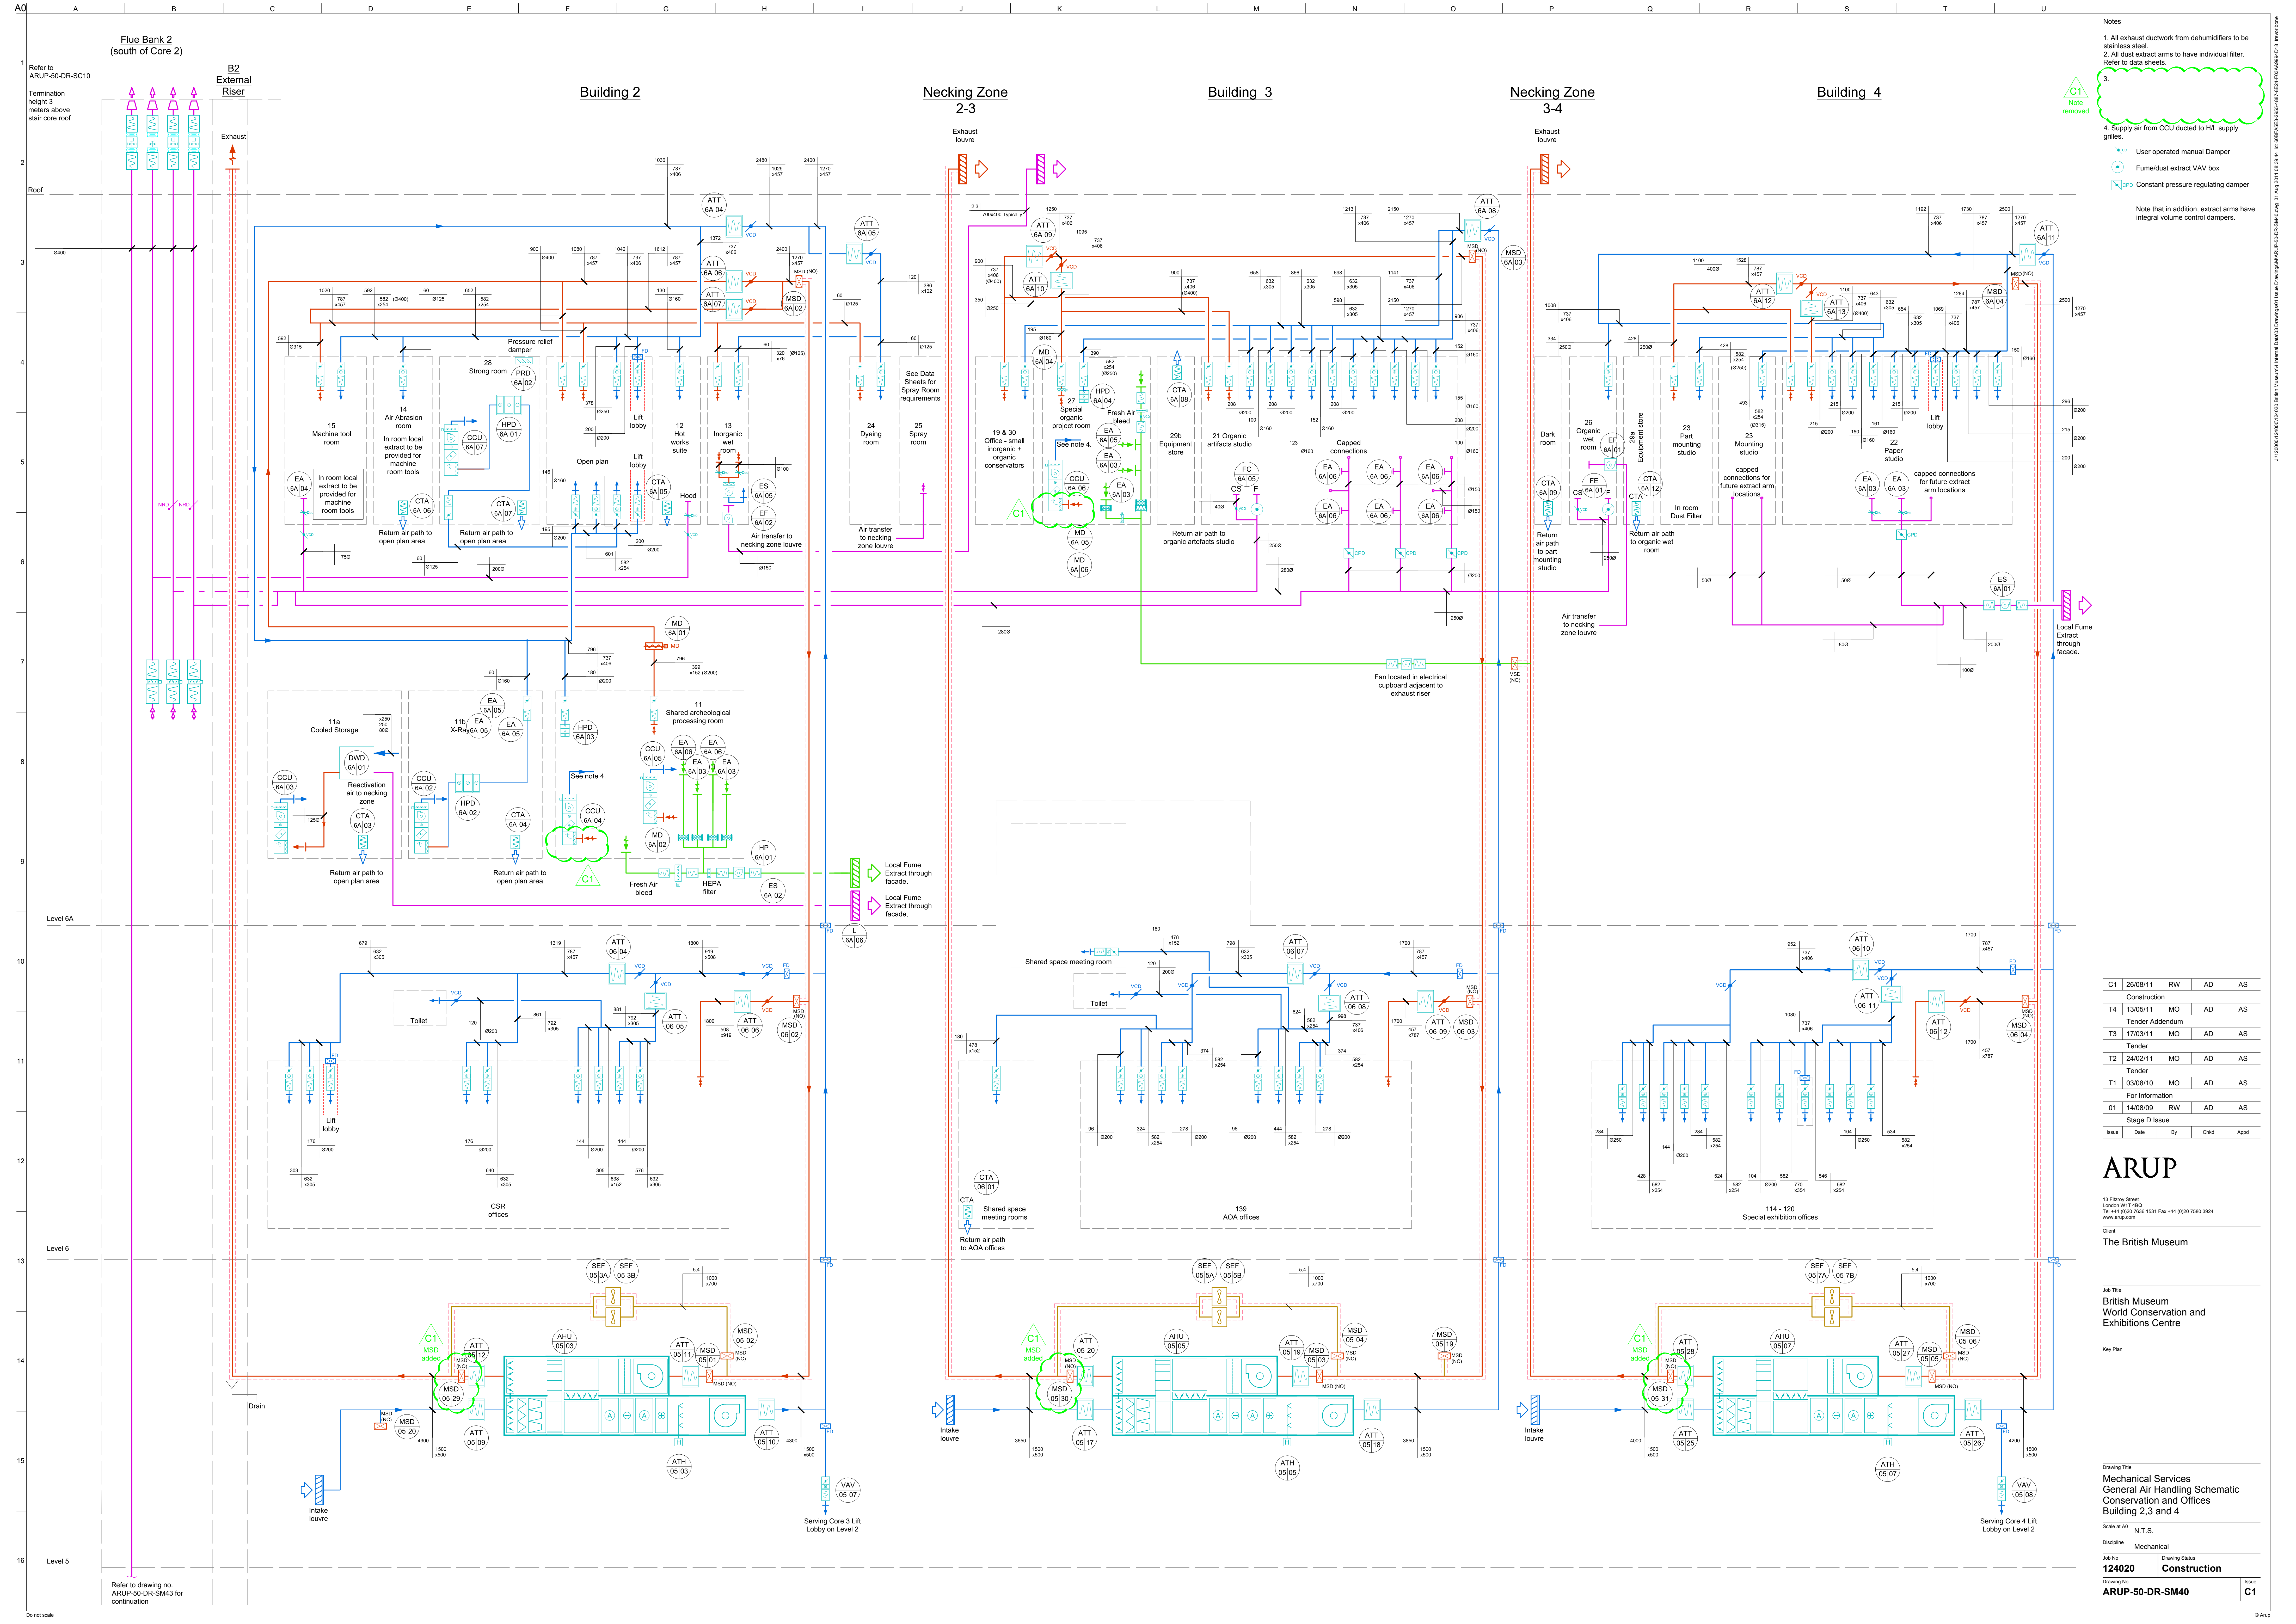

- Notes
1. All exhaust ductwork from dehumidifiers to be stainless steel.
 2. All dust extract arms to have individual filter. Refer to data sheets.
 - 3.
 4. Supply air from CCU ducted to H/L supply grilles.
- Legend:
- User operated manual Damper
 - Fume/dust extract VAV box
 - Constant pressure regulating damper
- Note that in addition, extract arms have integral volume control dampers.

C1	26/08/11	RW	AD	AS
Construction				
T4	13/05/11	MO	AD	AS
Tender Addendum				
T3	17/03/11	MO	AD	AS
Tender				
T2	24/02/11	MO	AD	AS
Tender				
T1	03/08/10	MO	AD	AS
For Information				
01	14/08/09	RW	AD	AS
Stage D Issue				
Issue	Date	By	Chkd	Appd

ARUP

13 Finsbury Street
London EC2M 7ES
Tel: +44 (0)20 7551 1531 Fax: +44 (0)20 7551 3024
www.arup.com

Client
The British Museum

Job Title
**British Museum
World Conservation and
Exhibitions Centre**

Key Plan

Drawing Title
**Mechanical Services
General Air Handling Schematic
Conservation and Offices
Building 2,3 and 4**

Scale as AD
N.T.S.

Discipline
Mechanical

Job No
124020

Drawing Status
Construction

Drawing No
ARUP-50-DR-SM40

Issue
C1