


Lab rooms below AHU plantroom
CCUs for these rooms to be mounted on frames to accommodate attenuators and ducting.
Leak detection below CCUs linked to coil shut-off valves.
Low point in duct work to capture leakage from CCU.
This to include a leak detection system linked to CHW and LTHW shut-off valves.

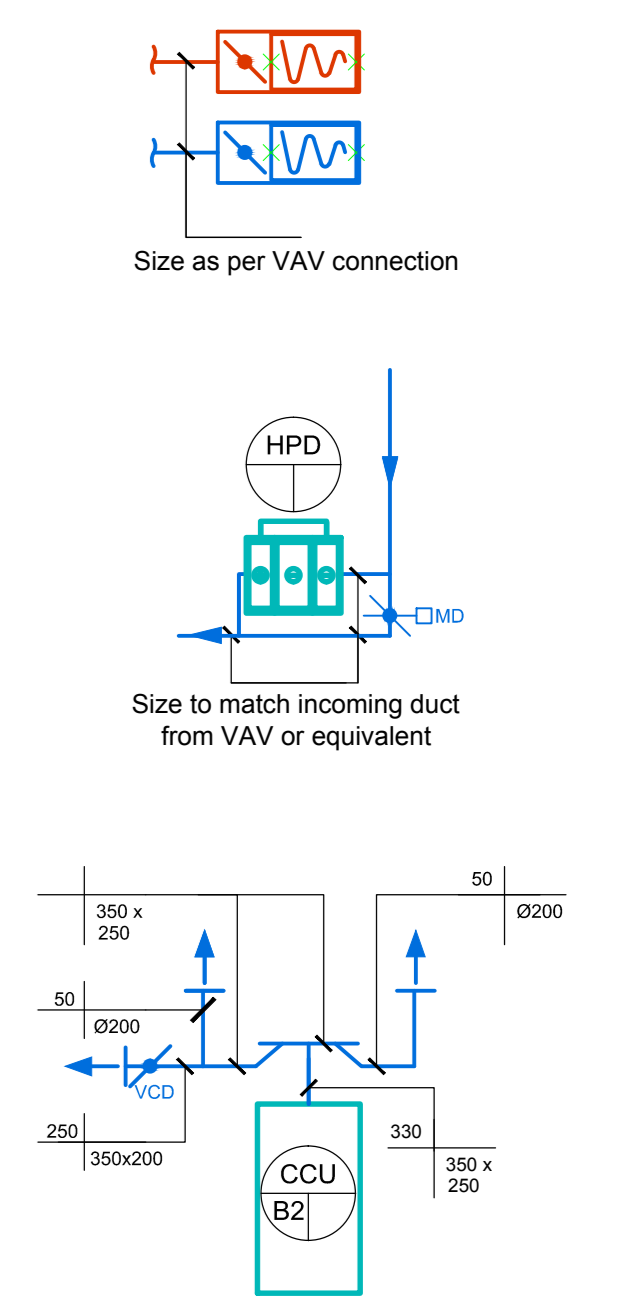

C1	26/08/11	RW	AD	AS
T3	17/03/11	RW	AD	AS
Tender				
T2	24/02/11	RW	AD	AS
Tender				
T1	28/01/11	RW	AD	AS
For Information				
01	14/08/09	RW	AD	AS
Stage D Issue				
Issue	Date	By	Chkd	Appd

ARUP

13 Finsbury Street
London EC2M 6BQ
Tel: +44 (0)20 7551 1511 Fax: +44 (0)20 7551 3024
www.arup.com

Client
The British Museum

Job Title
**British Museum
World Conservation and
Exhibitions Centre**

Key Plan

Drawing Title
**Mechanical Services
General Air Handling Schematic
Science Building 5**

Scale of A3
N.T.S.

Discipline
Mechanical

Job No
124020

Drawing Status
Construction

Drawing No
ARUP-50-DR-SM47

Issue
C1