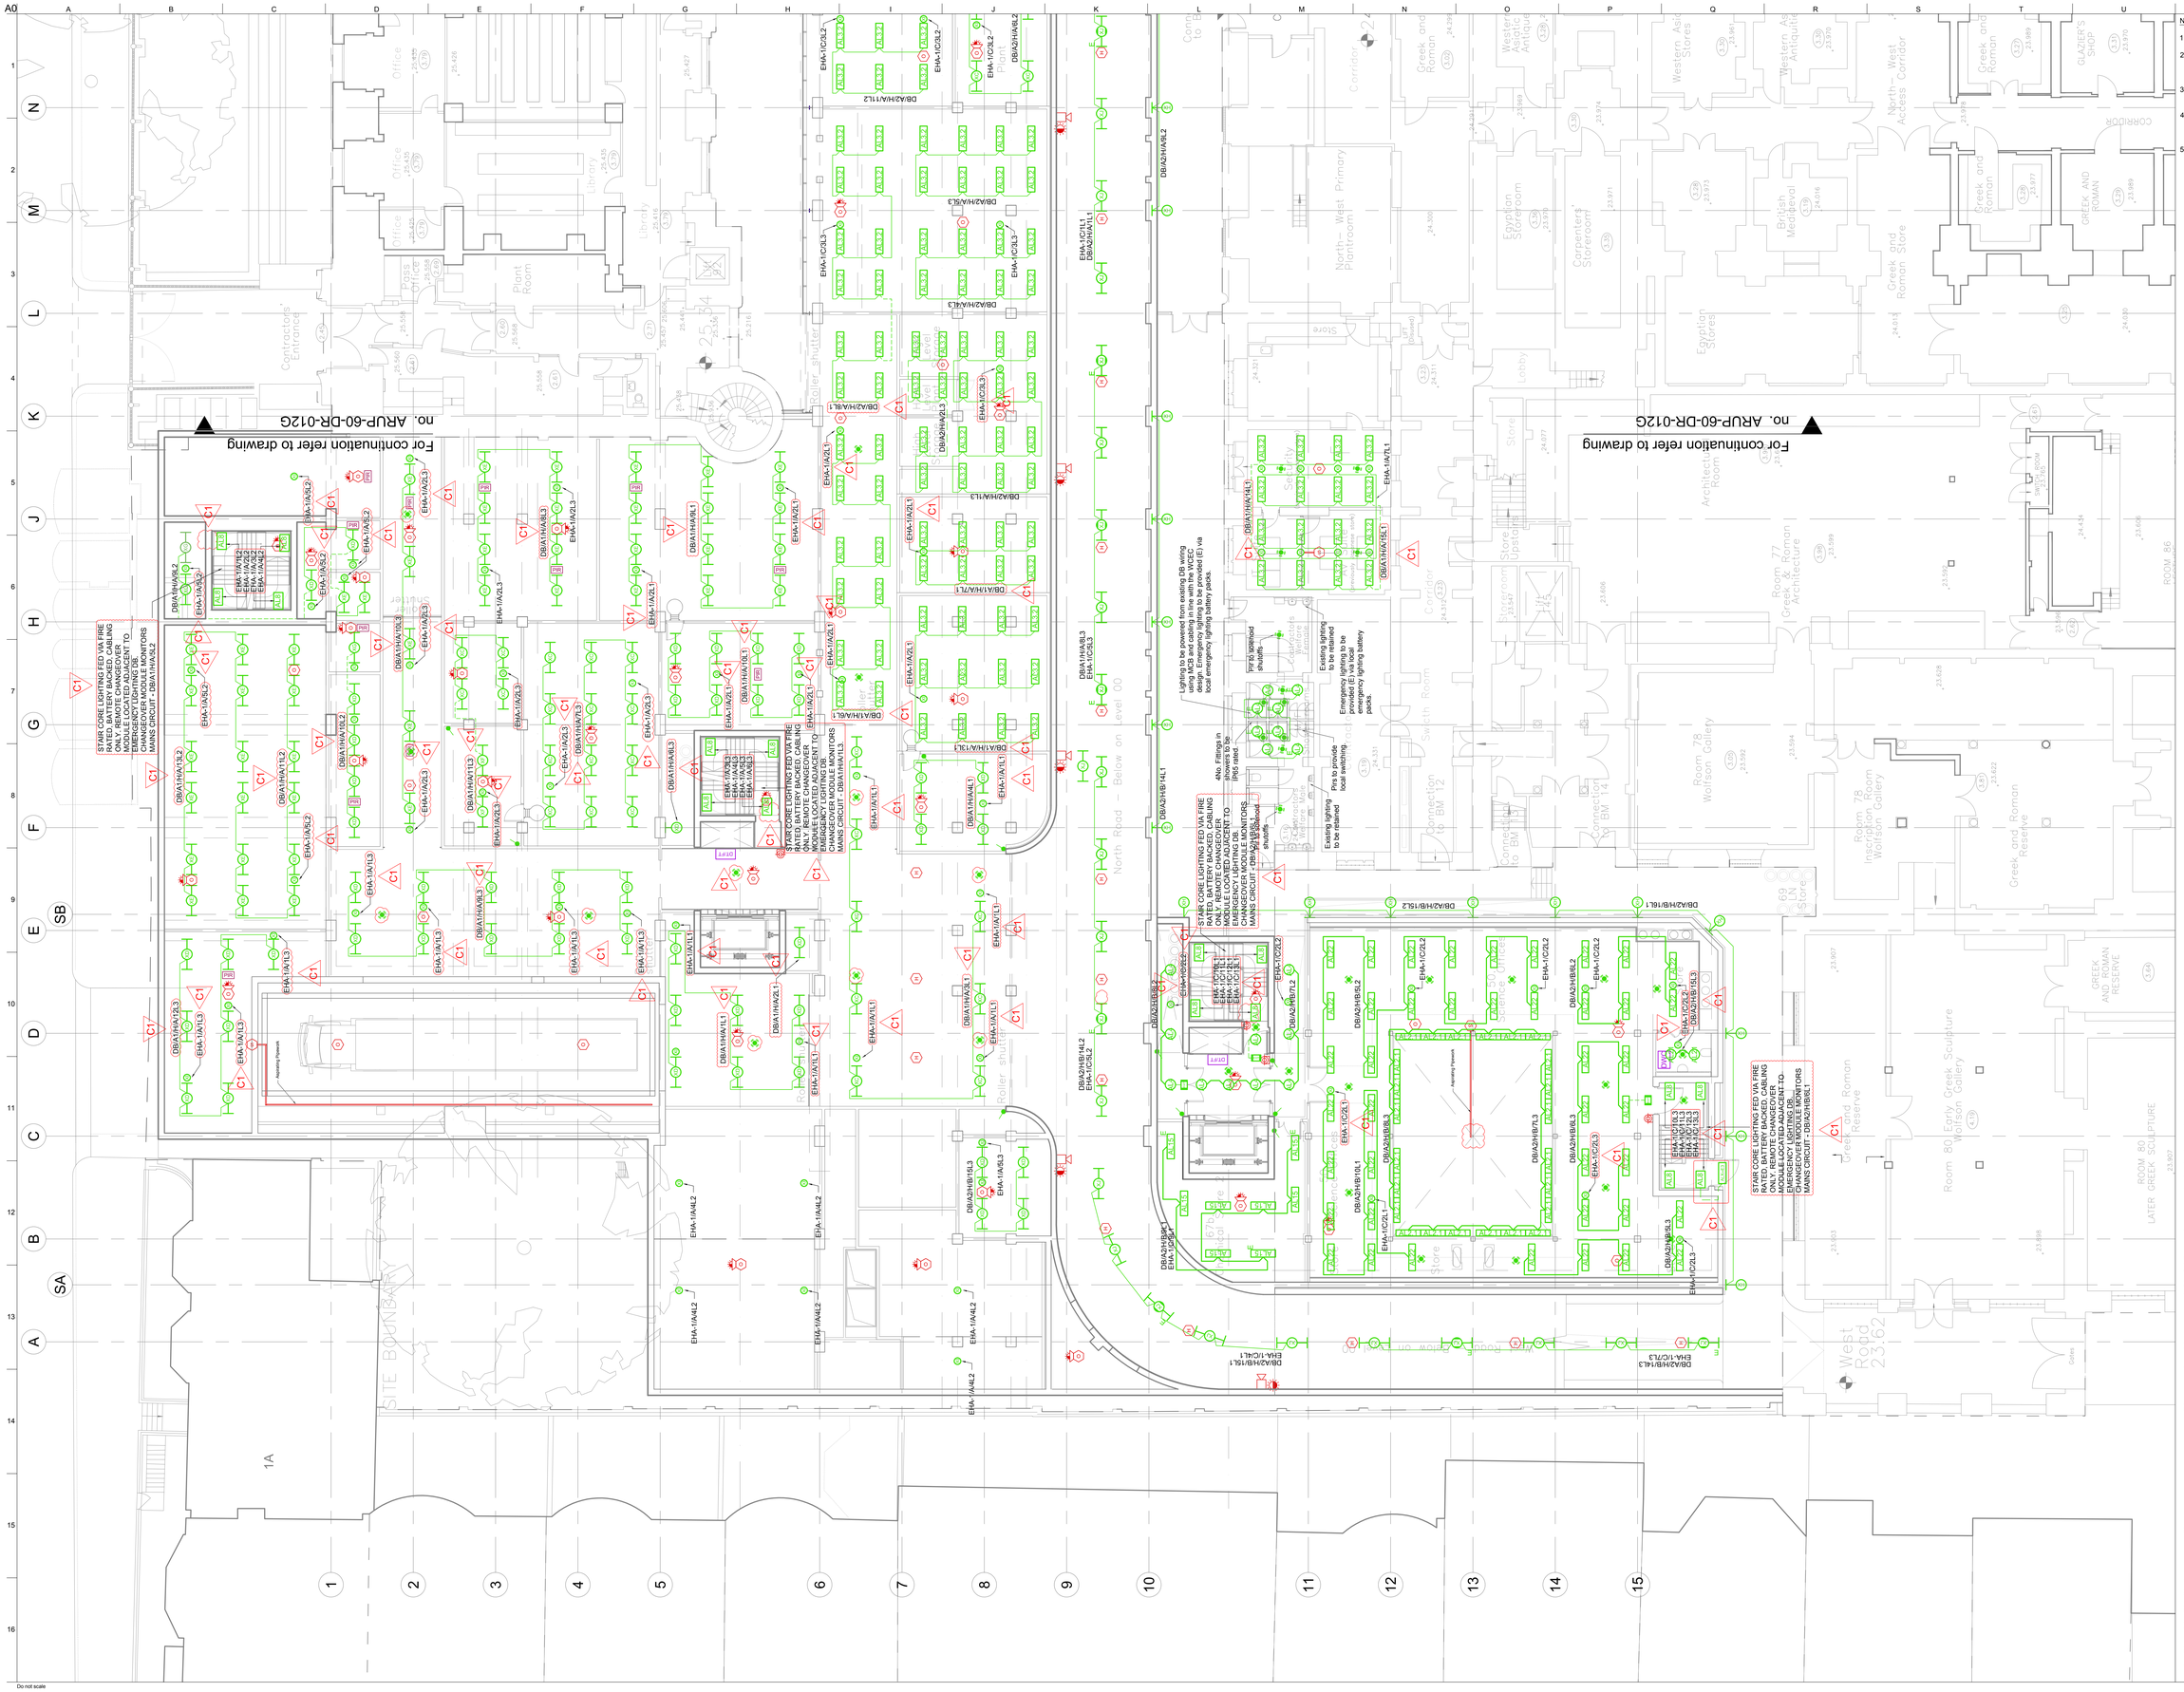

Notes

1. Refer to architects drawings for setting out.
2. This drawing is to be read in conjunction with all Electrical, Mechanical, Public Health, Structural & Architectural drawings.
3. Where no luminaires are indicated cross refer to 63- series drawings.
4. Motorised fire dampers are indicated on mechanical layouts. Allow for a single phase power supply (fused connection unit) to each.
5. Leak detection probes requiredto all cavities in basement levels. Extent to be confirmed during stage F. Make allowance for a probe and power supply every 20m artound perimeter.

Issue	Date	By	Chkd	Appd
C1	26/08/11	IM	DAD	AS
Construction				
T4	13/05/11	MRC	DAD	AS
Tender Addendum				
T3	17/03/11	MRC	DAD	AS
Tender				
T2	24/02/11	MRC	DAD	AS
Tender				
T1	28/01/11	MC	AD	AS
For Information				
01	20/08/10	MC	AD	AS
Stage E				

ARUP

13 Fitzroy Street
London W1T 4BQ
Tel +44 (0)20 7636 1531 Fax +44 (0)20 7580 3924
www.arup.com

Client
The British Museum

Job Title
British Museum
World Conservation and Exhibitions Centre

Key Plan

Drawing Title
Electrical Services
Level 1 Layout - High Level

Sheet F Building 1, 2 & 5

Scale at A0 1:50

Discipline Electrical

Job No 124020

Drawing Status Construction

Drawing No ARUP-60-DR-012F

Issue C1

J:\124000\124020\124020 British Museum\4 Internal Data\03 Drawings\01 Issue Drawings\ARUP-60-DR-012F Aug 2 Sep 2011 16:34:16 id: 999910125-8888-4013-A207-5517CA9A8794 jpg a4landscape

Do not scale

© Arup