


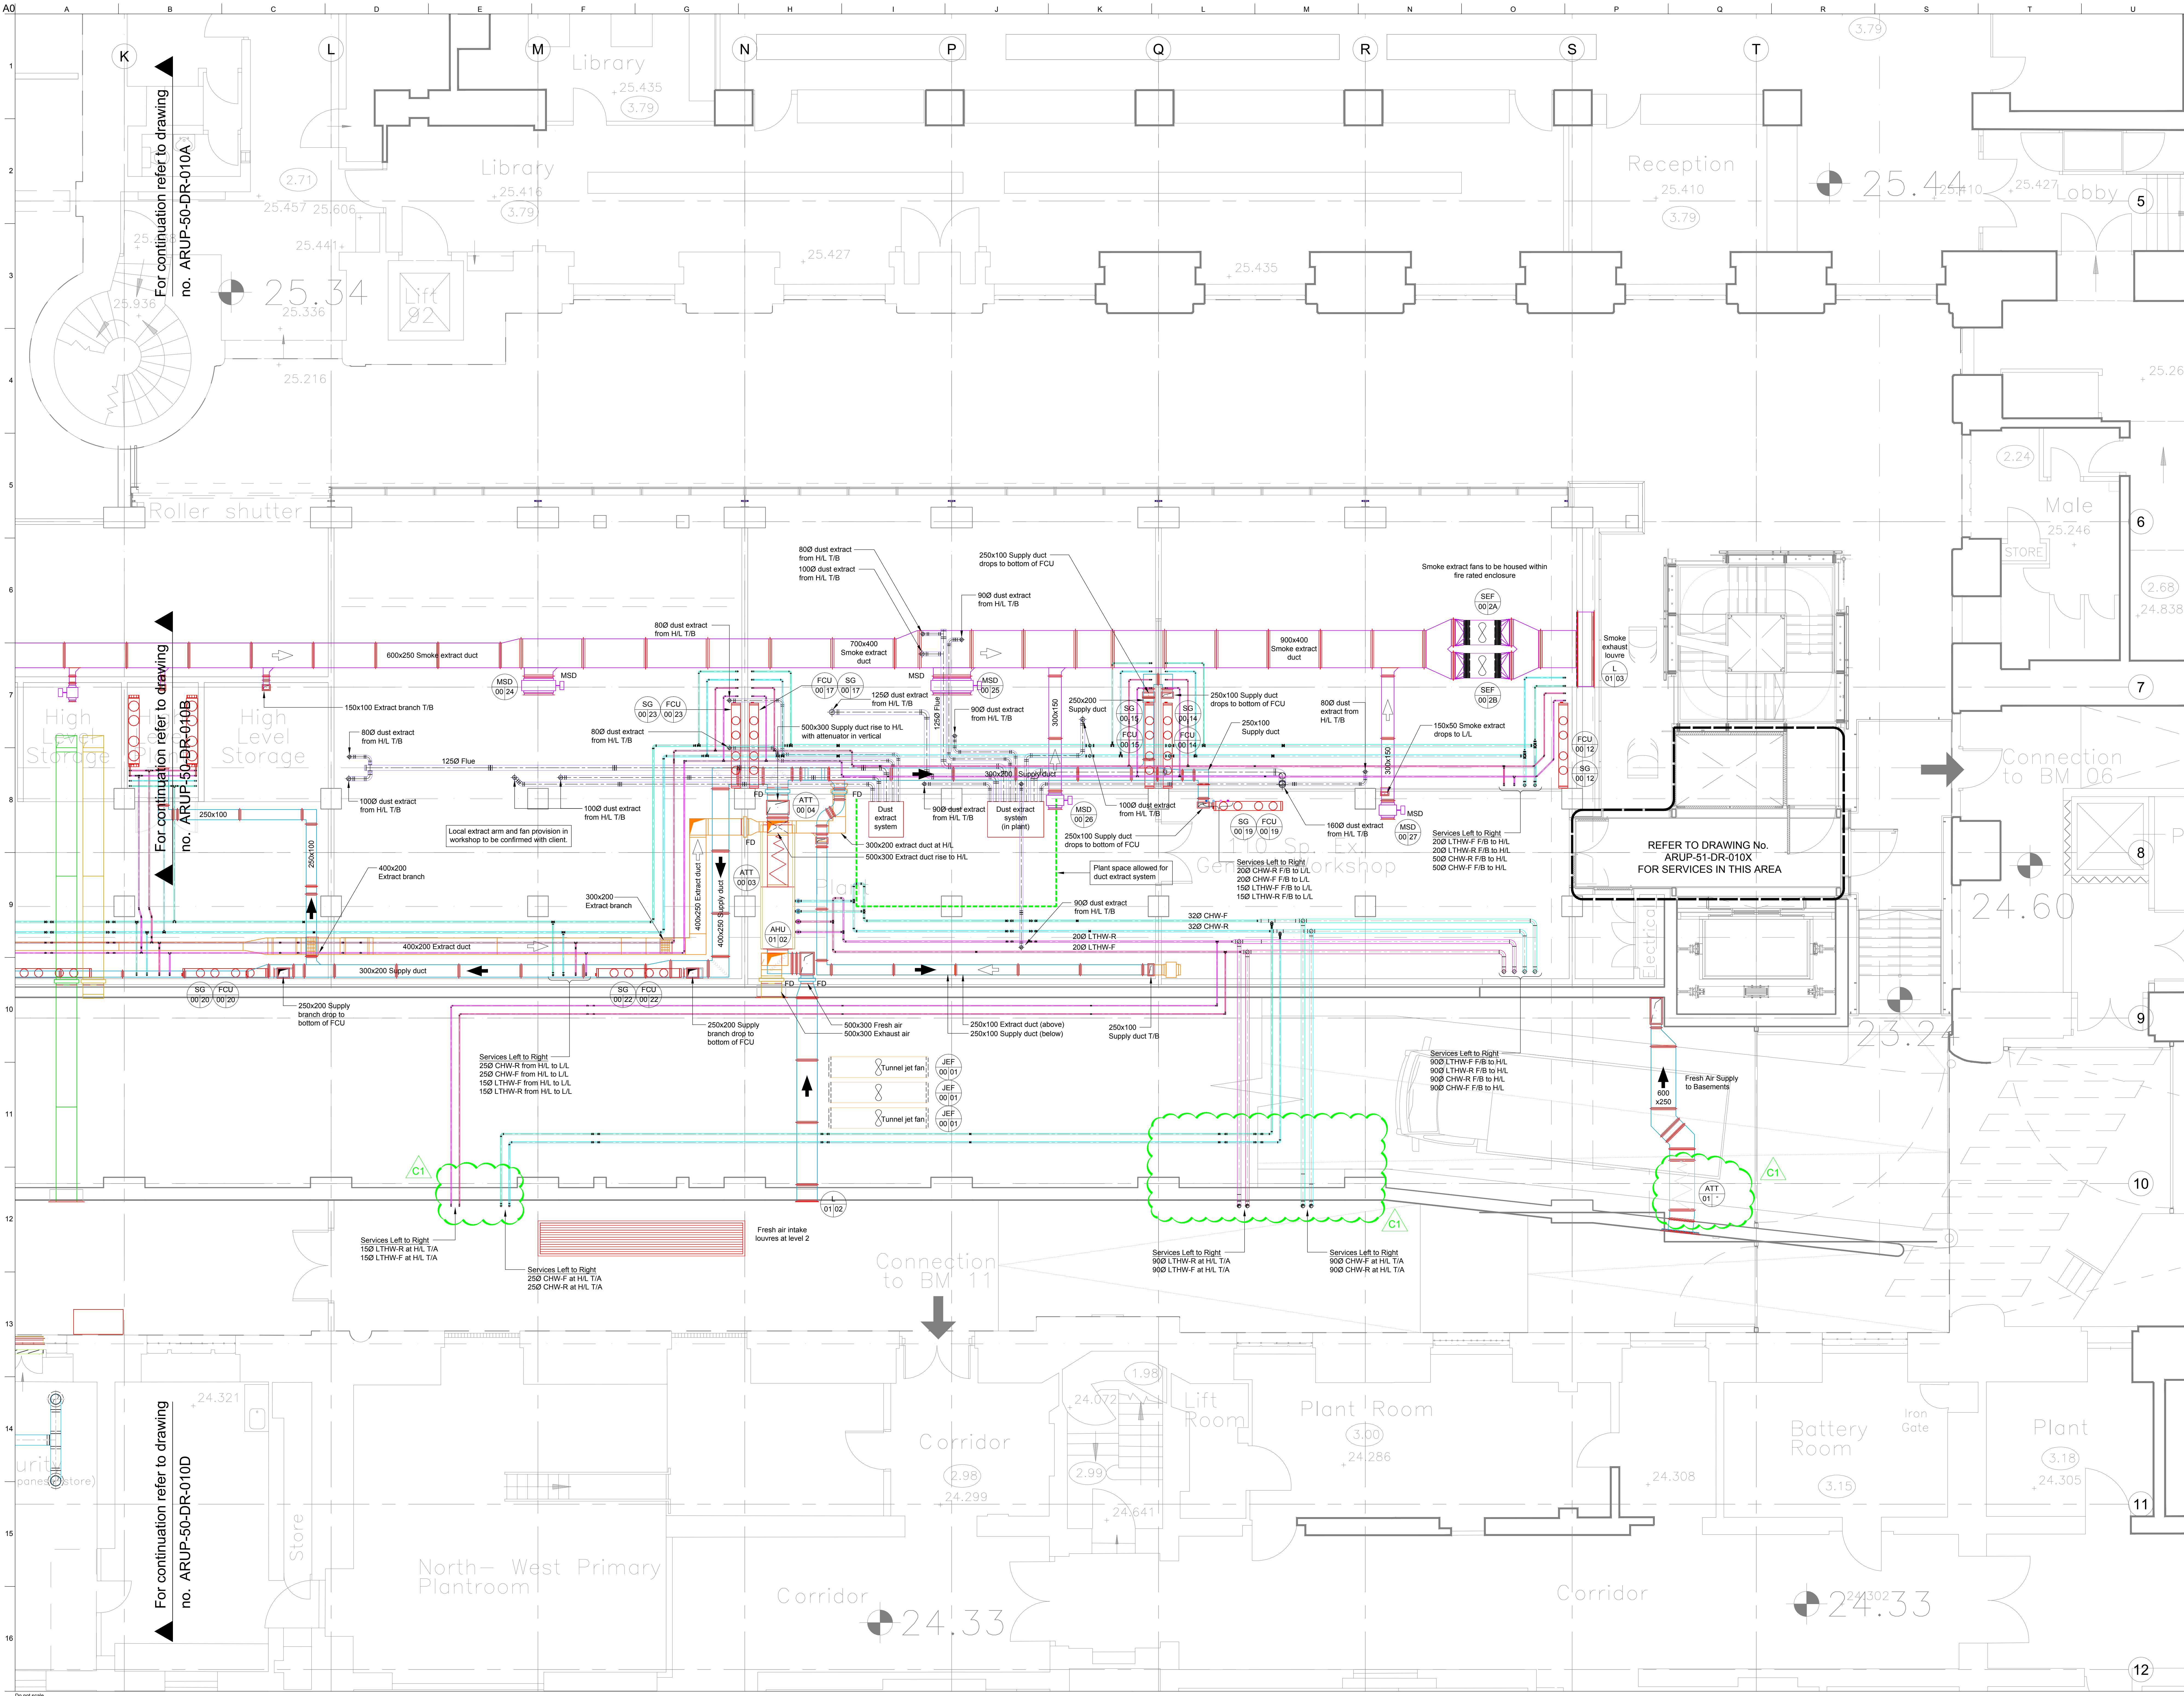

- Notes:-
- This drawing represents design intent but the final built layout is subject to coordination by the architect.
 - This drawing is to be read in conjunction with all Electrical, Mechanical, Public Health, Structural and Architectural drawings.
 - Refer to schematics for ductwork sizes, pipework sizes and volume flow rates.
 - All ductwork terminating in dampers or open ends must be finished with 60% free area insect mesh with maximum hole size 1mm unless otherwise specified.

C1	26/08/11	RW	AD	AS
Construction				
T4	13/05/11	MO	AD	AS
Tender Addendum				
T3	17/03/11	MO	AD	AS
Tender				
T2	24/02/11	MO	AD	AS
Tender				
T1	28/01/11	MO	AD	AS
For Information				
01	20/08/10	TB	AD	AS
Stage E				
Issue	Date	By	Chkd	Appd

ARUP

13 Finsbury Street
London EC2M 7HS
Tel: +44 (0)20 7551 1531 Fax: +44 (0)20 7550 3024
www.arup.com

Client
The British Museum

Job Title
**British Museum
World Conservation and
Exhibitions Centre**

Key Plan

Drawing Title
**Mechanical Services
Level 1 Layout
Sheet C**

Scale at A0
1:50

Discipline
Mechanical

Job No
124020

Drawing Status
Construction

Drawing No
ARUP-50-DR-010C

Issue
C1