

- Notes:-
1. This drawing represents design intent but the final built layout is subject to coordination by the architect.
  2. This drawing is to be read in conjunction with all Electrical, Mechanical, Public Health, Structural and Architectural drawings.
  3. Refer to schematics for ductwork sizes, pipework sizes and volume flow rates.
  4. All ductwork terminating in dampers or open ends must be finished with 60% free area insect mesh with maximum hole size 1mm unless otherwise specified.
  5. All exhaust ductwork from dehumidifiers to be stainless steel


C1	26/08/11	RW	AD	AS
Construction				
T1	13/05/11	MO	AD	AS
Tender				
Issue	Date	By	Chkd	Appd

**ARUP**

13 Finsbury Street  
London EC2A 1BS  
Tel: +44 (0)20 7551 1531 Fax: +44 (0)20 7550 3024  
www.arup.com

Client  
**The British Museum**

Job Title  
**British Museum  
World Conservation and  
Exhibitions Centre**

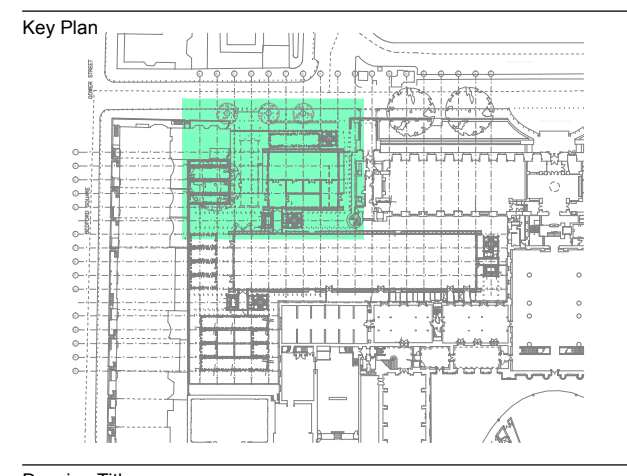

Drawing Title  
**Mechanical Services  
Level 2  
Special Extract - Low Level Layout  
Sheet A**

Scale at A0  
1:50

Discipline  
**Mechanical**

Job No  
**124020**

Drawing No  
**ARUP-50-DR-02YA**

Construction  
**C1**