

- Notes:-
1. This drawing represents design intent but the final built layout is subject to coordination by the architect.
 2. This drawing is to be read in conjunction with all Electrical, Mechanical, Public Health, Structural and Architectural drawings.
 3. Refer to schematics for ductwork sizes, pipework sizes and volume flow rates.
 4. All ductwork terminating in dampers or open ends must be finished with 60% free area insect mesh with maximum hole size 1mm unless otherwise specified.
 5. All supply and extract ductwork to and from Special Exhibitions Gallery to be externally acoustically lined with continuous mass barrier material. All louvres to be acoustically lined.


C1	26/08/11	RW	AD	AS
T3	17/03/11	MO	AD	AS
Tender				
T2	24/02/11	MO	AD	AS
Tender				
T1	28/01/11	MO	AD	AS
For Information				
01	17/08/10	TB	AD	AS
Stage E				
Issue	Date	By	Chkd	Appd

ARUP

13 Finsbury Street
London EC2A 3EA
Tel: +44 (0)20 7551 1531 Fax: +44 (0)20 7551 3024
www.arup.com

Client
The British Museum

Job Title
**British Museum
World Conservation and
Exhibitions Centre**

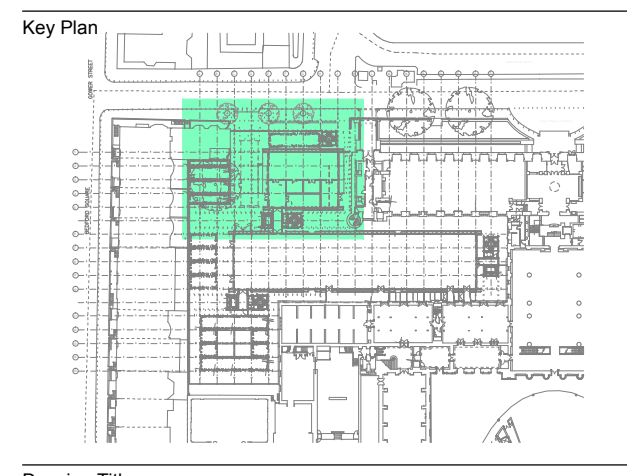

Drawing Title
**Mechanical Services
Level 5 Layout
Sheet A**

Scale of A0	1:50
Discipline	Mechanical
Job No	124020
Drawing No	ARUP-50-DR-050A
Drawing Status	Construction
Issue	C1

For continuation refer to drawing
no. ARUP-50-DR-050B

REFER TO DRAWING No.
ARUP-51-DR-050X
FOR SERVICES IN THIS AREA

For continuation refer to drawing
no. ARUP-50-DR-050B

For continuation refer to drawing
no. ARUP-50-DR-050C