


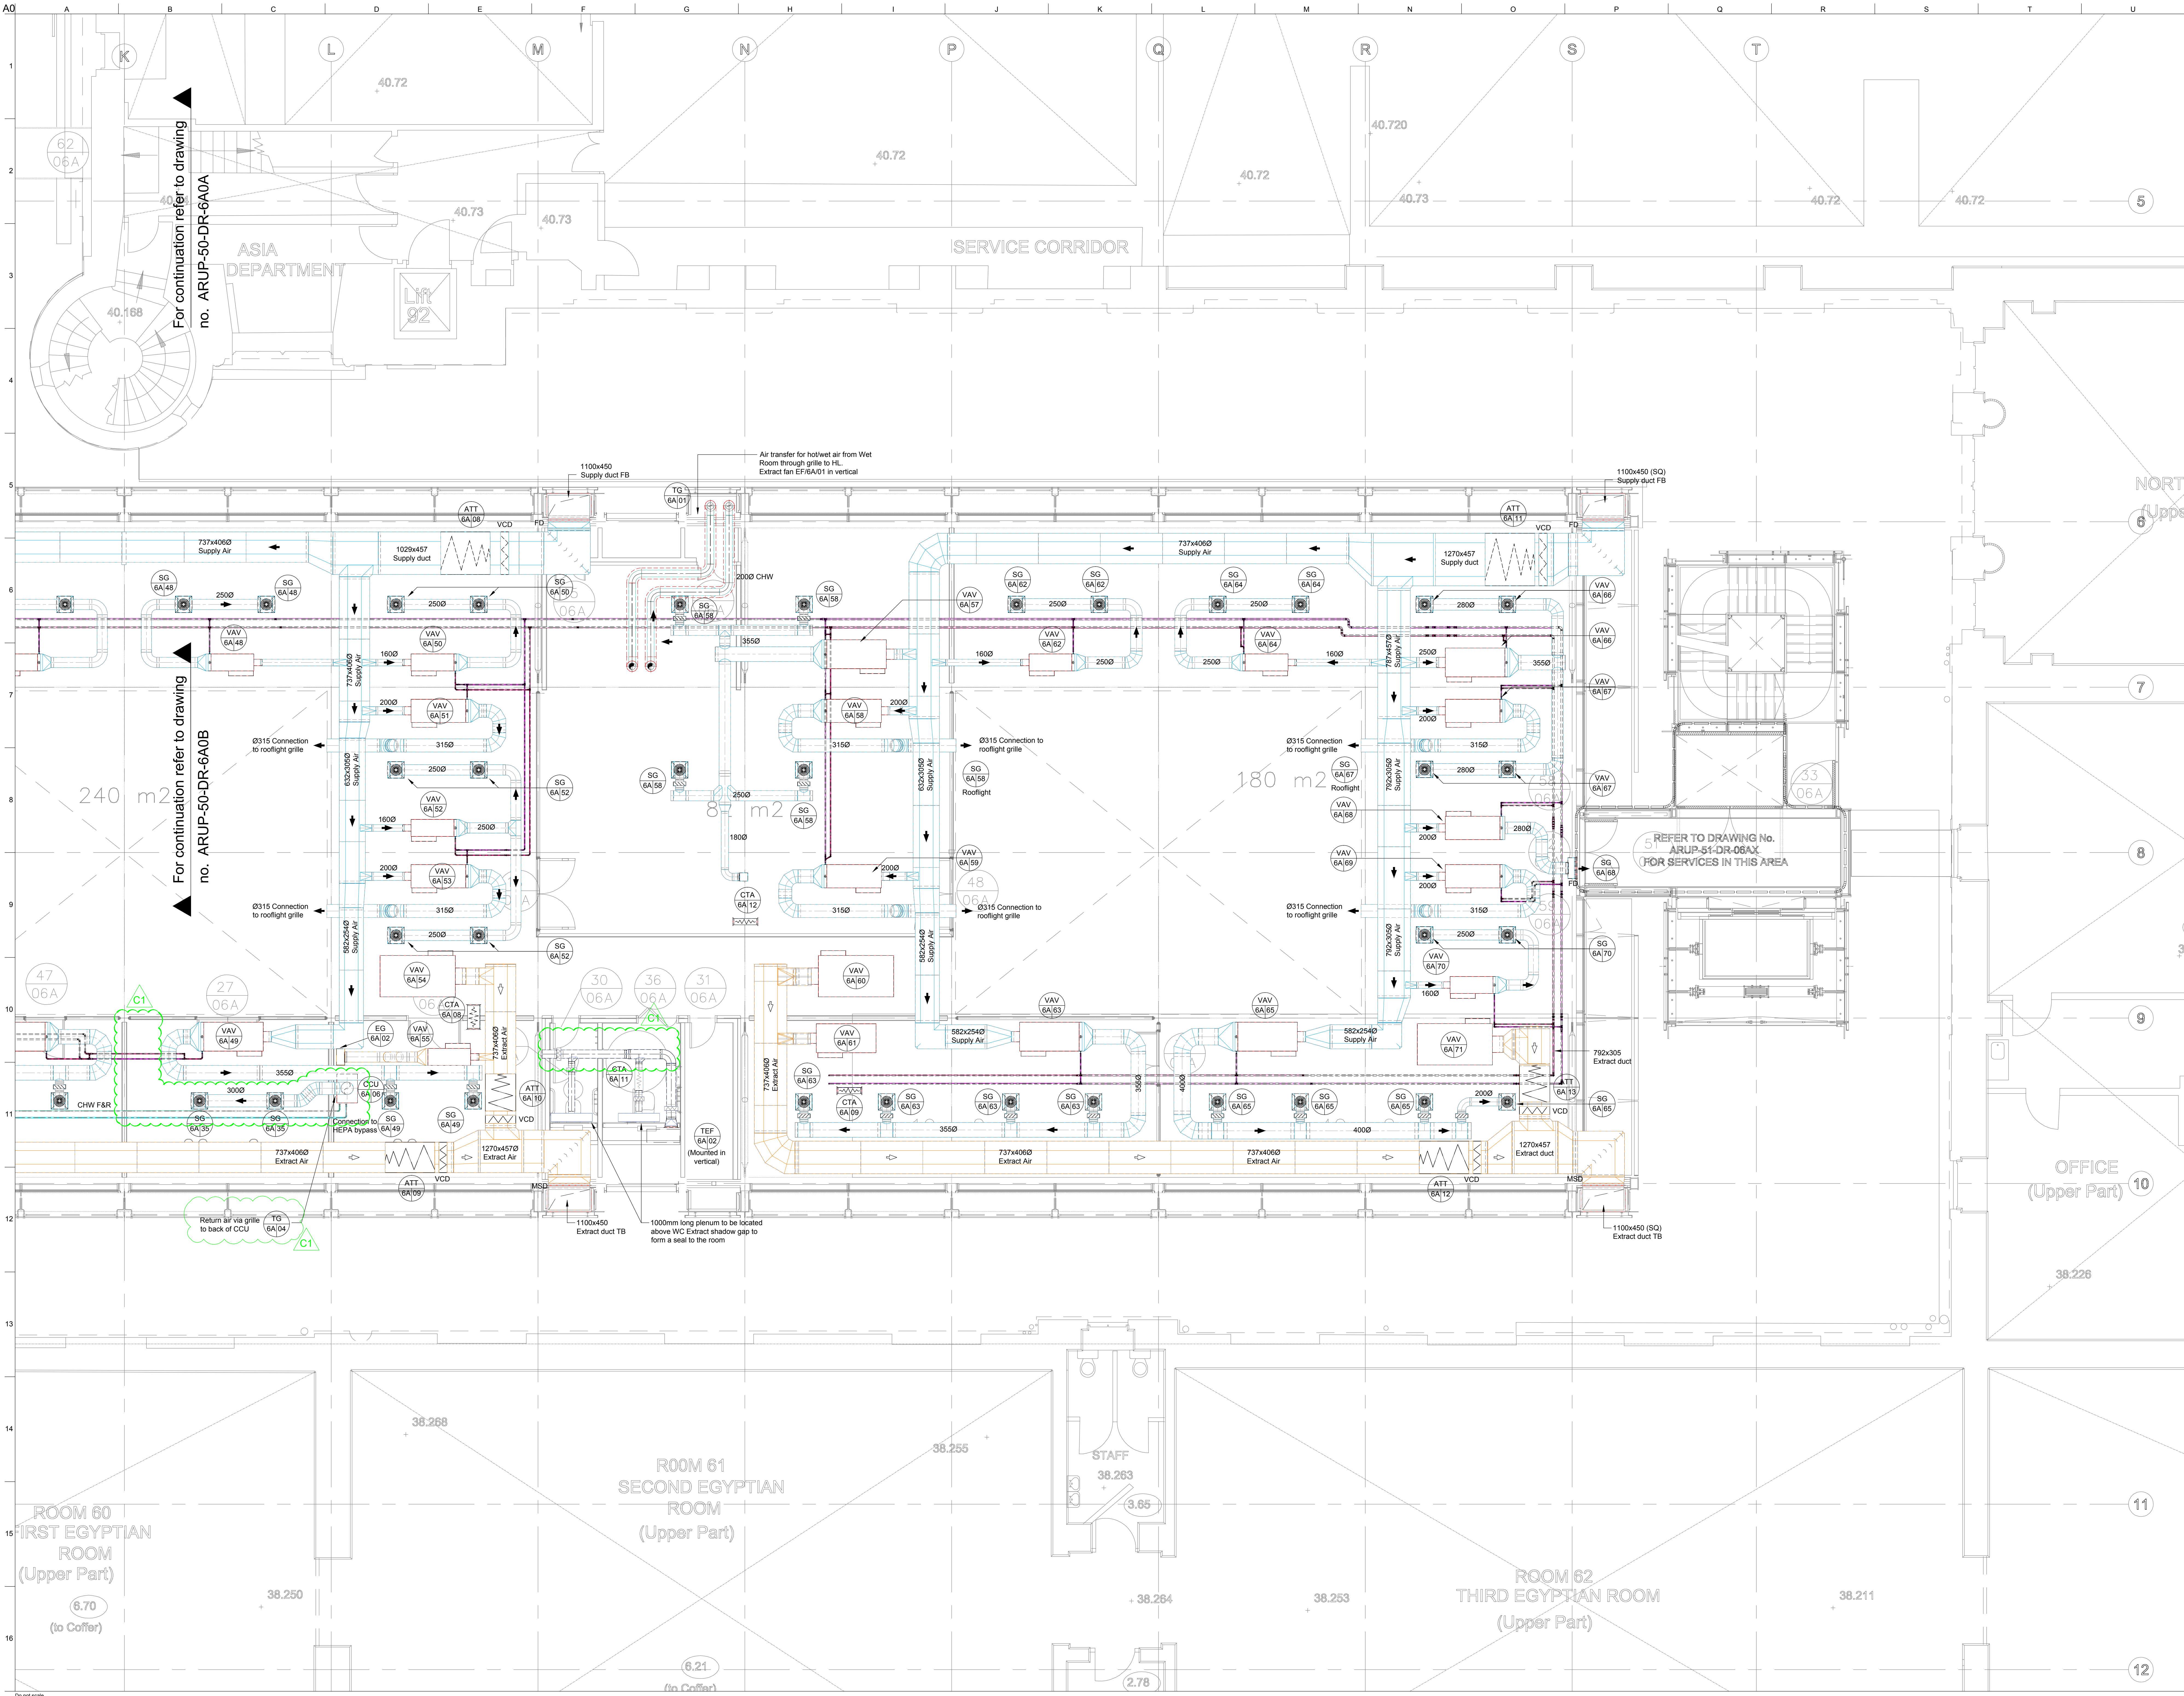

- Notes:-
- This drawing represents design intent but the final built layout is subject to coordination by the architect.
  - This drawing is to be read in conjunction with all Electrical, Mechanical, Public Health, Structural and Architectural drawings.
  - Refer to schematics for ductwork sizes, pipework sizes and volume flow rates.
  - All ductwork terminating in dampers or open ends must be finished with 60% free area insect mesh with maximum hole size 1mm unless otherwise specified.
  - All exhaust ductwork from dehumidifiers to be stainless steel


|                 |          |    |      |      |
|-----------------|----------|----|------|------|
| C1              | 26/08/11 | RW | AD   | AS   |
| Construction    |          |    |      |      |
| T4              | 13/05/11 | MO | AD   | AS   |
| Tender Addendum |          |    |      |      |
| T3              | 17/03/11 | MO | AD   | AS   |
| Tender          |          |    |      |      |
| T2              | 24/02/11 | MO | AD   | AS   |
| Tender          |          |    |      |      |
| T1              | 28/01/11 | MO | AD   | AS   |
| For Information |          |    |      |      |
| O1              | 20/08/10 | TB | AD   | AS   |
| Stage E         |          |    |      |      |
| Issue           | Date     | By | Chkd | Appd |

**ARUP**

13 Finsbury Street  
London EC2A 1EJ  
Tel: +44 (0)20 7551 1511 Fax: +44 (0)20 7551 3024  
www.arup.com

Client  
**The British Museum**

Job Title  
**British Museum  
World Conservation and  
Exhibitions Centre**

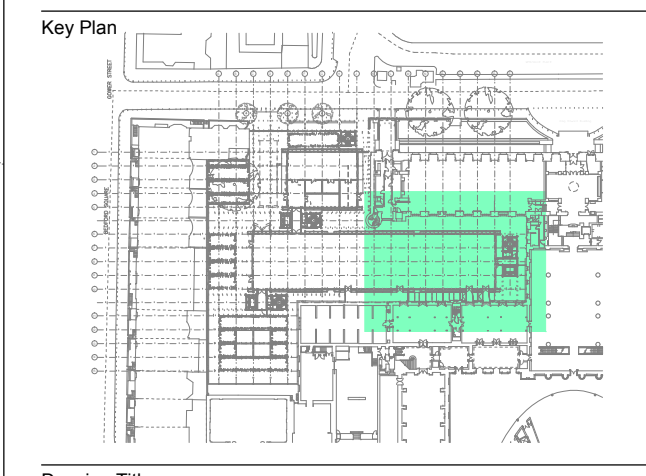

Drawing Title  
**Mechanical Services  
Level 6A Layout  
Sheet C**

|                |                 |
|----------------|-----------------|
| Scale of A0    | 1:50            |
| Discipline     | Mechanical      |
| Job No         | 124020          |
| Drawing No     | ARUP-50-DR-6A0C |
| Drawing Status | Construction    |
| Issue          | C1              |