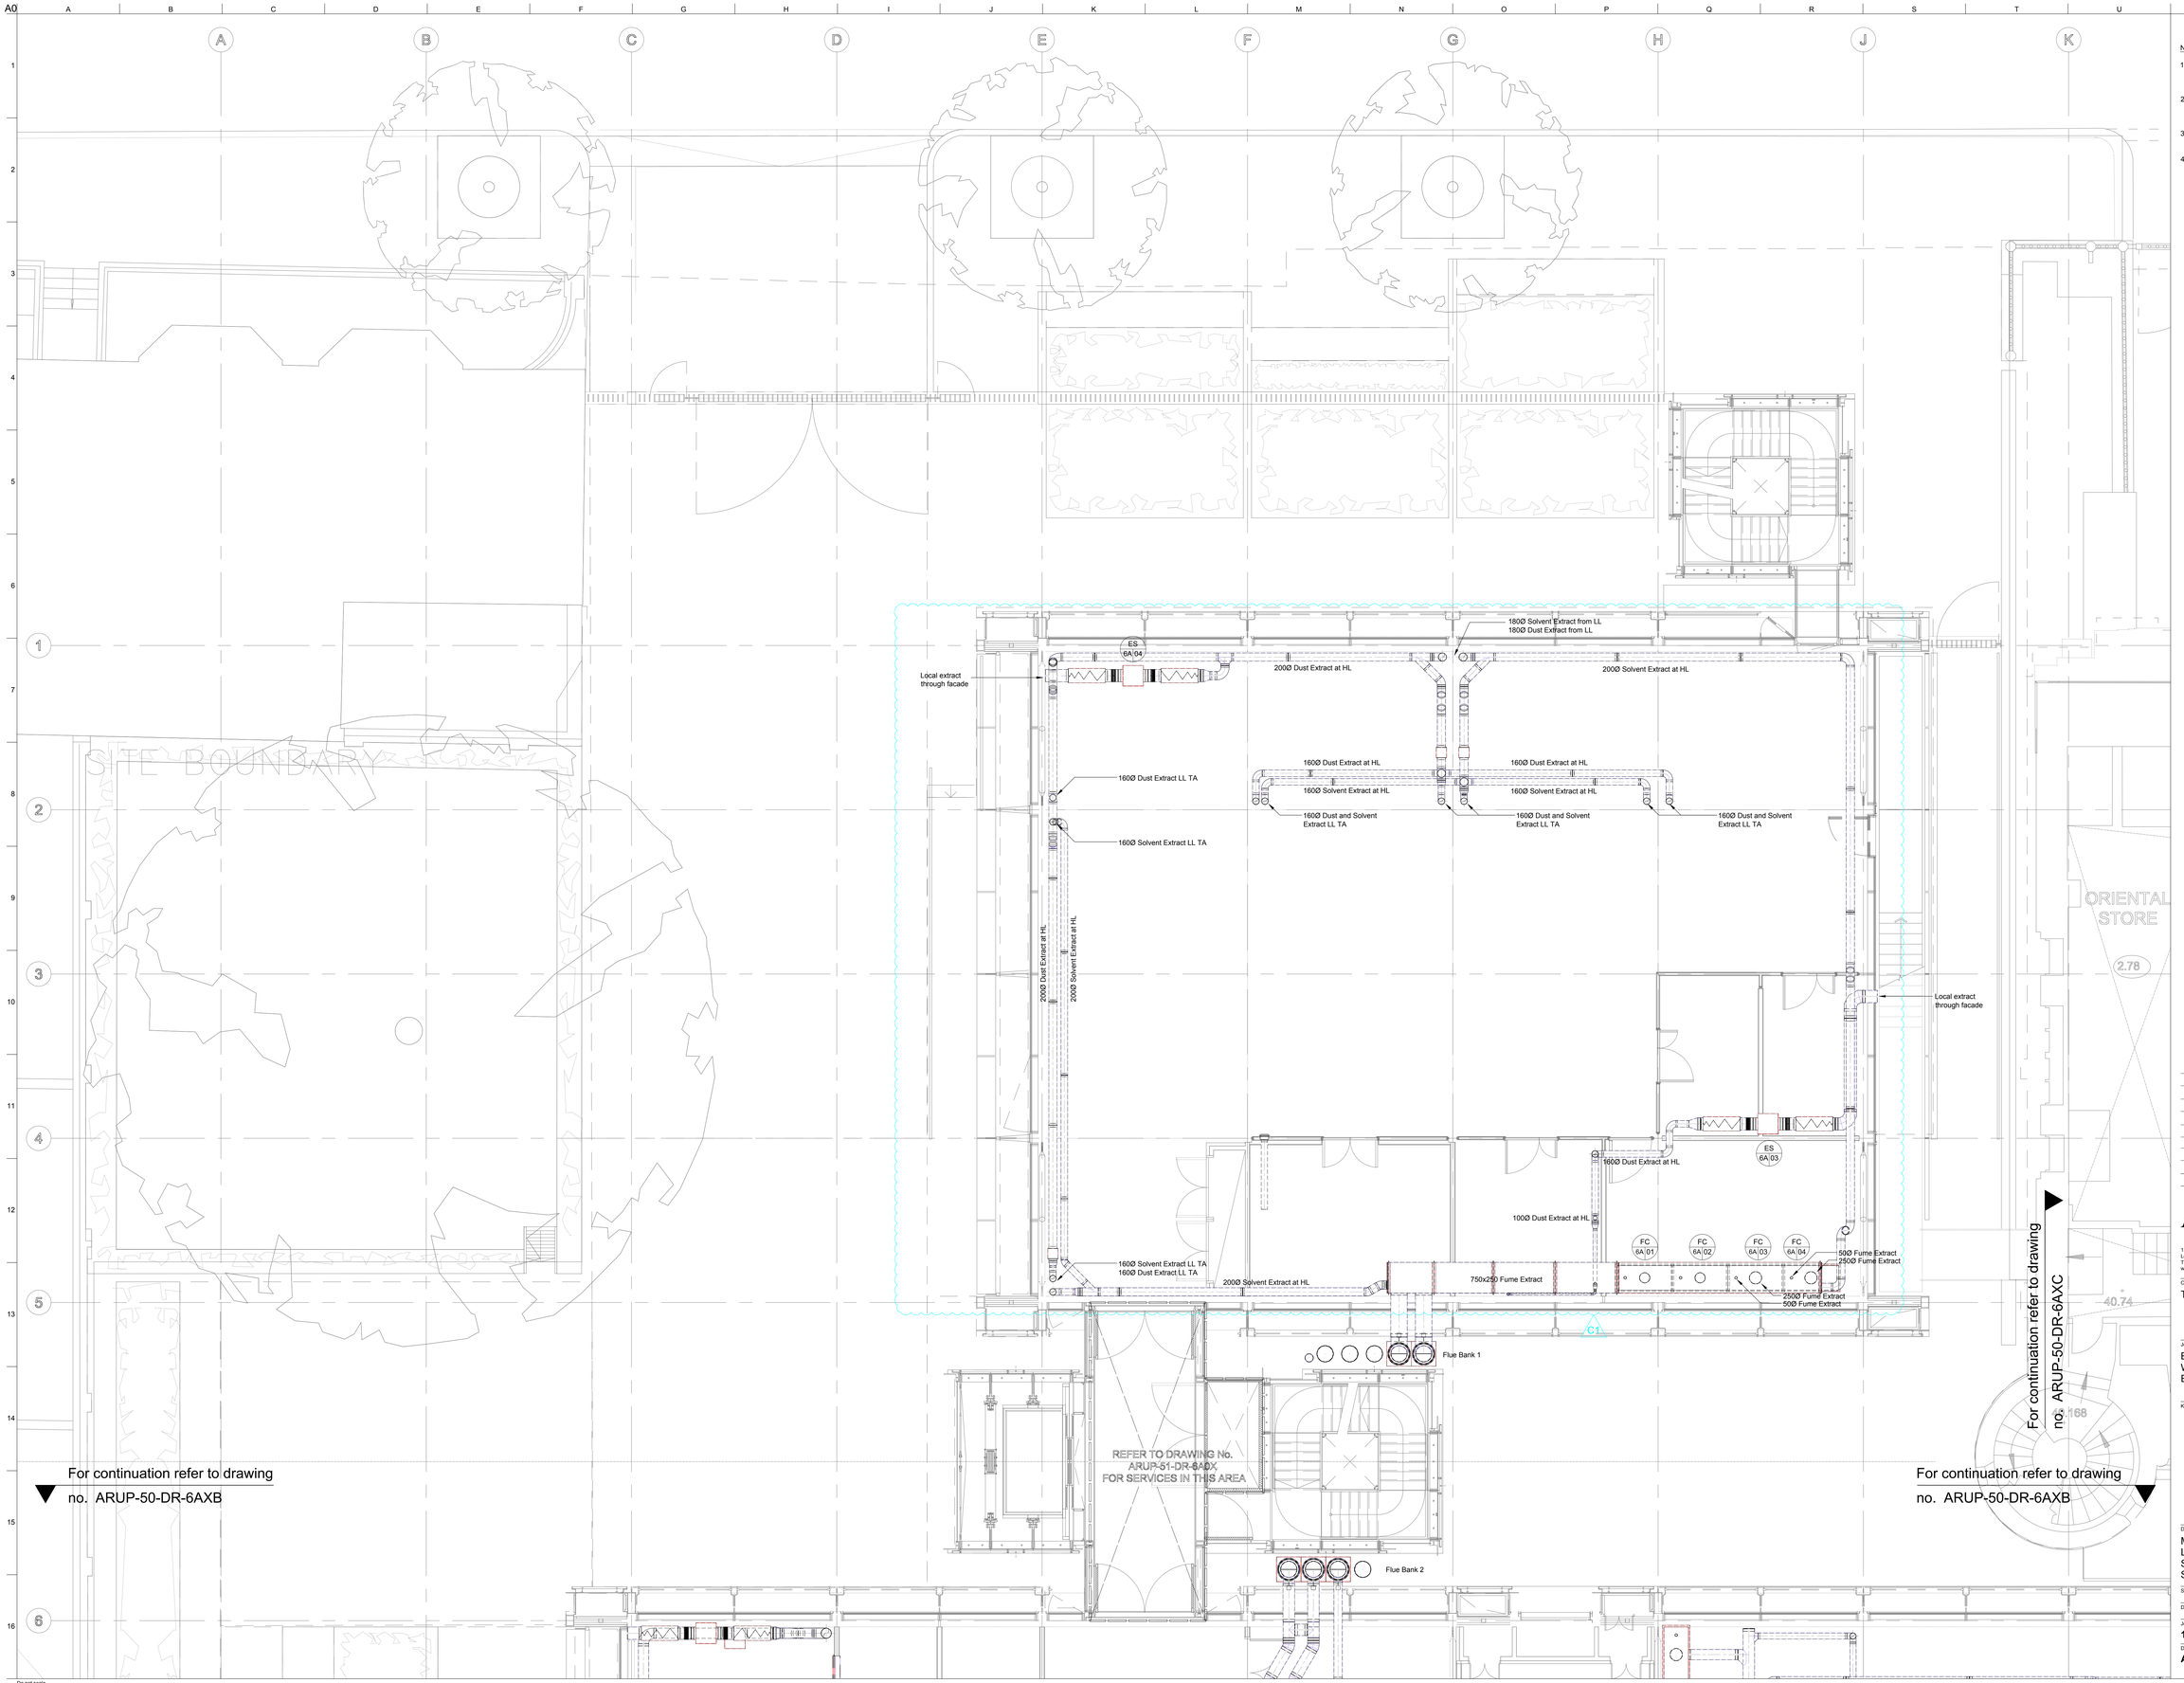

Notes:-

1. This drawing represents design intent but the final built layout is subject to coordination by the architect.
2. This drawing is to be read in conjunction with all Electrical, Mechanical, Public Health, Structural and Architectural drawings.
3. Refer to schematics for ductwork sizes, pipework sizes and volume flow rates.
4. All ductwork terminating in dampers or open ends must be finished with 60% free area insect mesh with maximum hole size 1mm unless otherwise specified.

J:\120000\124000\124020 British Museum\4 Internal Data\03 Drawings\01 Issue Drawings\MA\RUP-50-DR-6AXA.dwg 1 Sep 2011 20:13:34 dr. 1TSE7568-0737-4ED3-DFF1-C6902D3B richard williams

Issue	Date	By	Chkd	Appd
C1	26/08/11	RW	AD	AS
	Construction			
T3	13/05/11	MO	AD	AS
	Tender Addendum			
T2	17/03/11	MO	AD	AS
	Tender			
T1	24/02/11	MO	AD	AS
	Tender			

ARUP
13 Fitzroy Street
London W1T 4BQ
Tel +44 (0)20 7636 1531 Fax +44 (0)20 7580 3924
www.arup.com

Client
The British Museum

Job Title
British Museum
World Conservation and Exhibitions Centre

Key Plan

Drawing Title
Mechanical Services
Level 6A
Special Extract Layout
Sheet A

Scale at A0 1:50

Discipline Mechanical

Job No 124020

Drawing Status Construction

Drawing No ARUP-50-DR-6AXA

Issue C1

Do not scale

© Arup