


22 Gordon Square

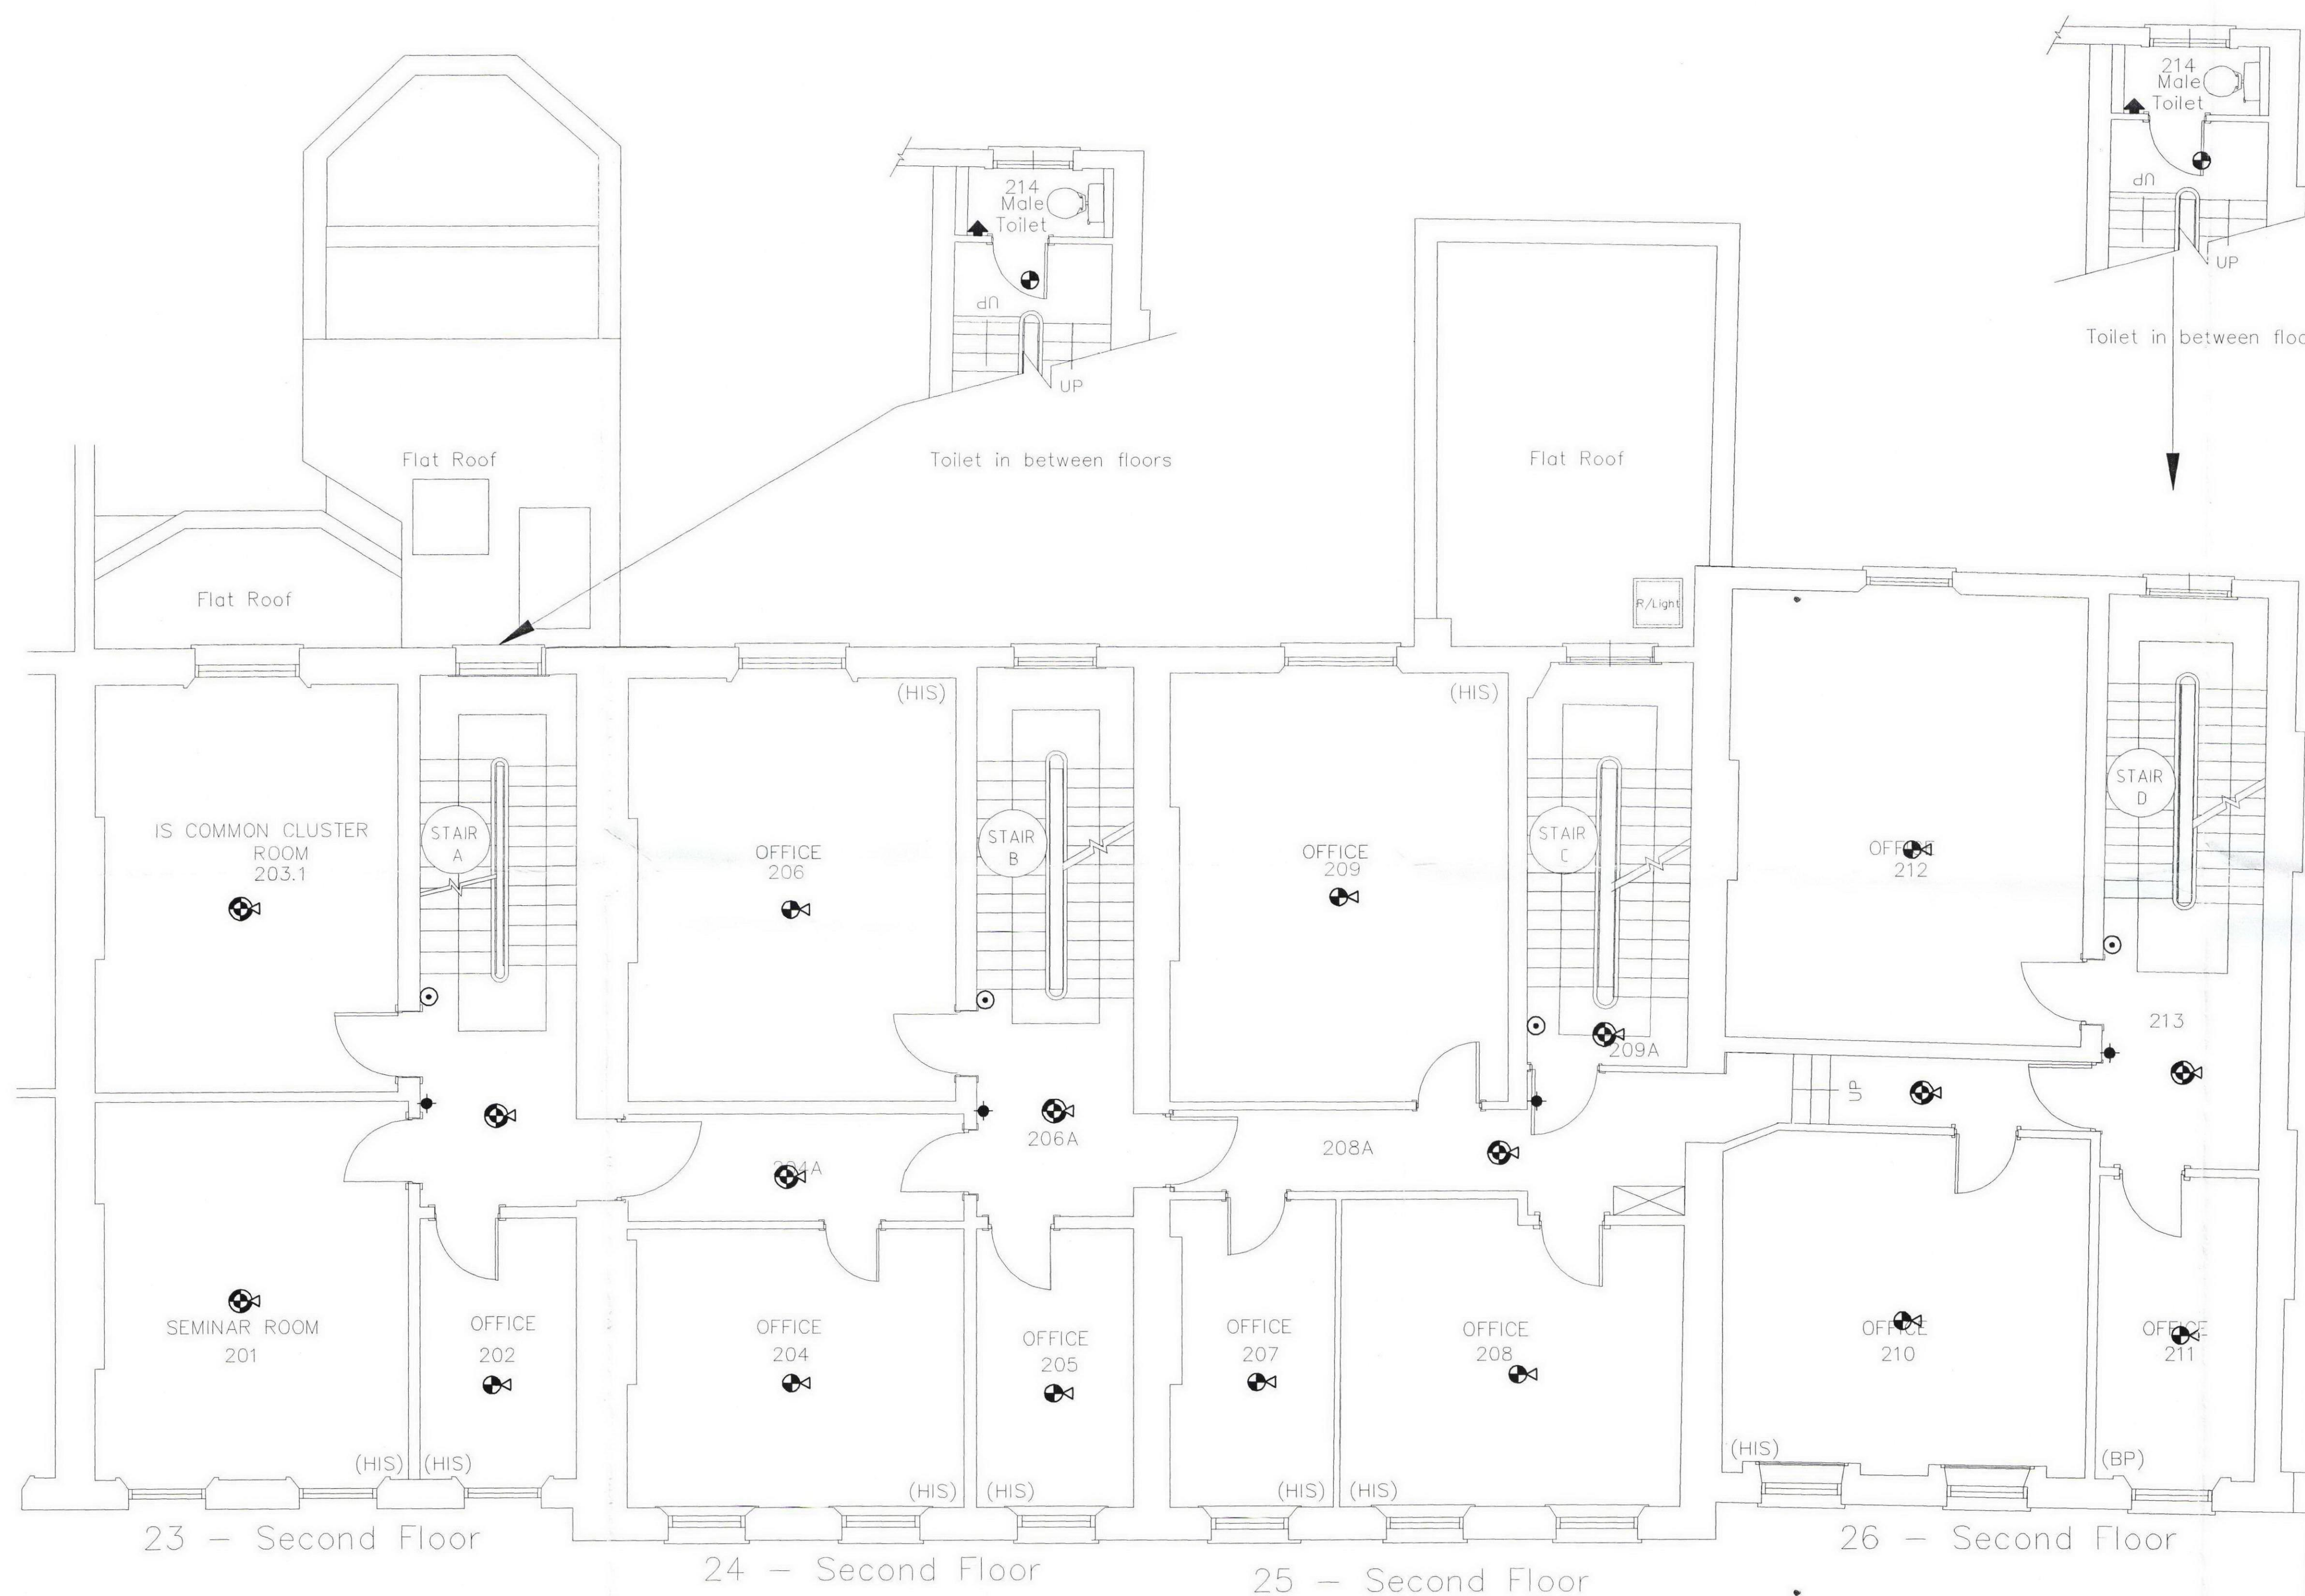

This drawing should be read in conjunction with the specification and shall not be used in lieu of the service contractors working drawings. At construction stage, the service contractors are required to prepare coordinated drawings for construction purposes under the terms of the contract.

A1

LEGEND AND NOTES

- BREAK GLASS CONTACT
- HEAT DETECTOR
- SMOKE DETECTOR
- LOOP INTERFACE
- COMBINED HEAT DETECTOR / SOUNDER BASE
- COMBINED SMOKE DETECTOR / SOUNDER BASE
- COMBINED SOUNDER / FLASHING BEACON
- REMOTE LED INDICATOR
- FUSED CONNECTION UNIT
- COMBINED HEAT DETECTOR / SOUNDER / FLASHING BEACON
- COMBINED SMOKE DETECTOR / SOUNDER / FLASHING BEACON
- COMBINED SMOKE DETECTOR AND FLASHING BEACON
- TRIO PAGE UNIT
- EXISTING DISTRIBUTION BOARD
- FIRE ALARM PANEL
- REPEATER FIRE ALARM PANEL
- UCL NETWORK DATA POINT
- 75mm DIA CORE DRILLED HOLE THROUGH FLOOR SLAB (FORM AND MAKE GOOD) RISE POSITION FOR FIRE ALARM AND EMERGENCY LIGHTING DATA CABLES TO ALL FLOORS

REV	DATE	DESCRIPTION	ALT	DO	ORIG	APP
-----	------	-------------	-----	----	------	-----

TGA Consulting Engineers LLP  
Armstrong House,  
Norton Road,  
Stevenage  
Hertfordshire, SG1 2LX  
T: 01438 314422  
F: 01438 314433  
E: stevenage@tga.co.uk



**Project**  
UNIVERSITY COLLEGE LONDON  
23-26 GORDON SQUARE HOUSES

**Title**  
ELECTRICAL ENGINEERING SERVICES  
SECOND FLOOR PLAN  
REPLACEMENT FIRE ALARM LAYOUT

**Architect**

**Client**  
UCL ESTATES AND FACILITIES DIVISION.

Drawing Number	Revision	Scale
6888E(67)-010		A1 1:50
		A3 N.T.S.
		A4 N.T.S.

**Path**  
J:\6888\ELEC\6888E(67)-010

**Architects Drawing Reference**

Drawn	DO Check	Originator	Approved
JB	GK	ED	ED
Date			Status
JAN 2010			TENDER

This drawing is the copyright of TGA Consulting Engineers LLP and must not be reproduced without their permission. This drawing shall not be scaled for construction purposes.