
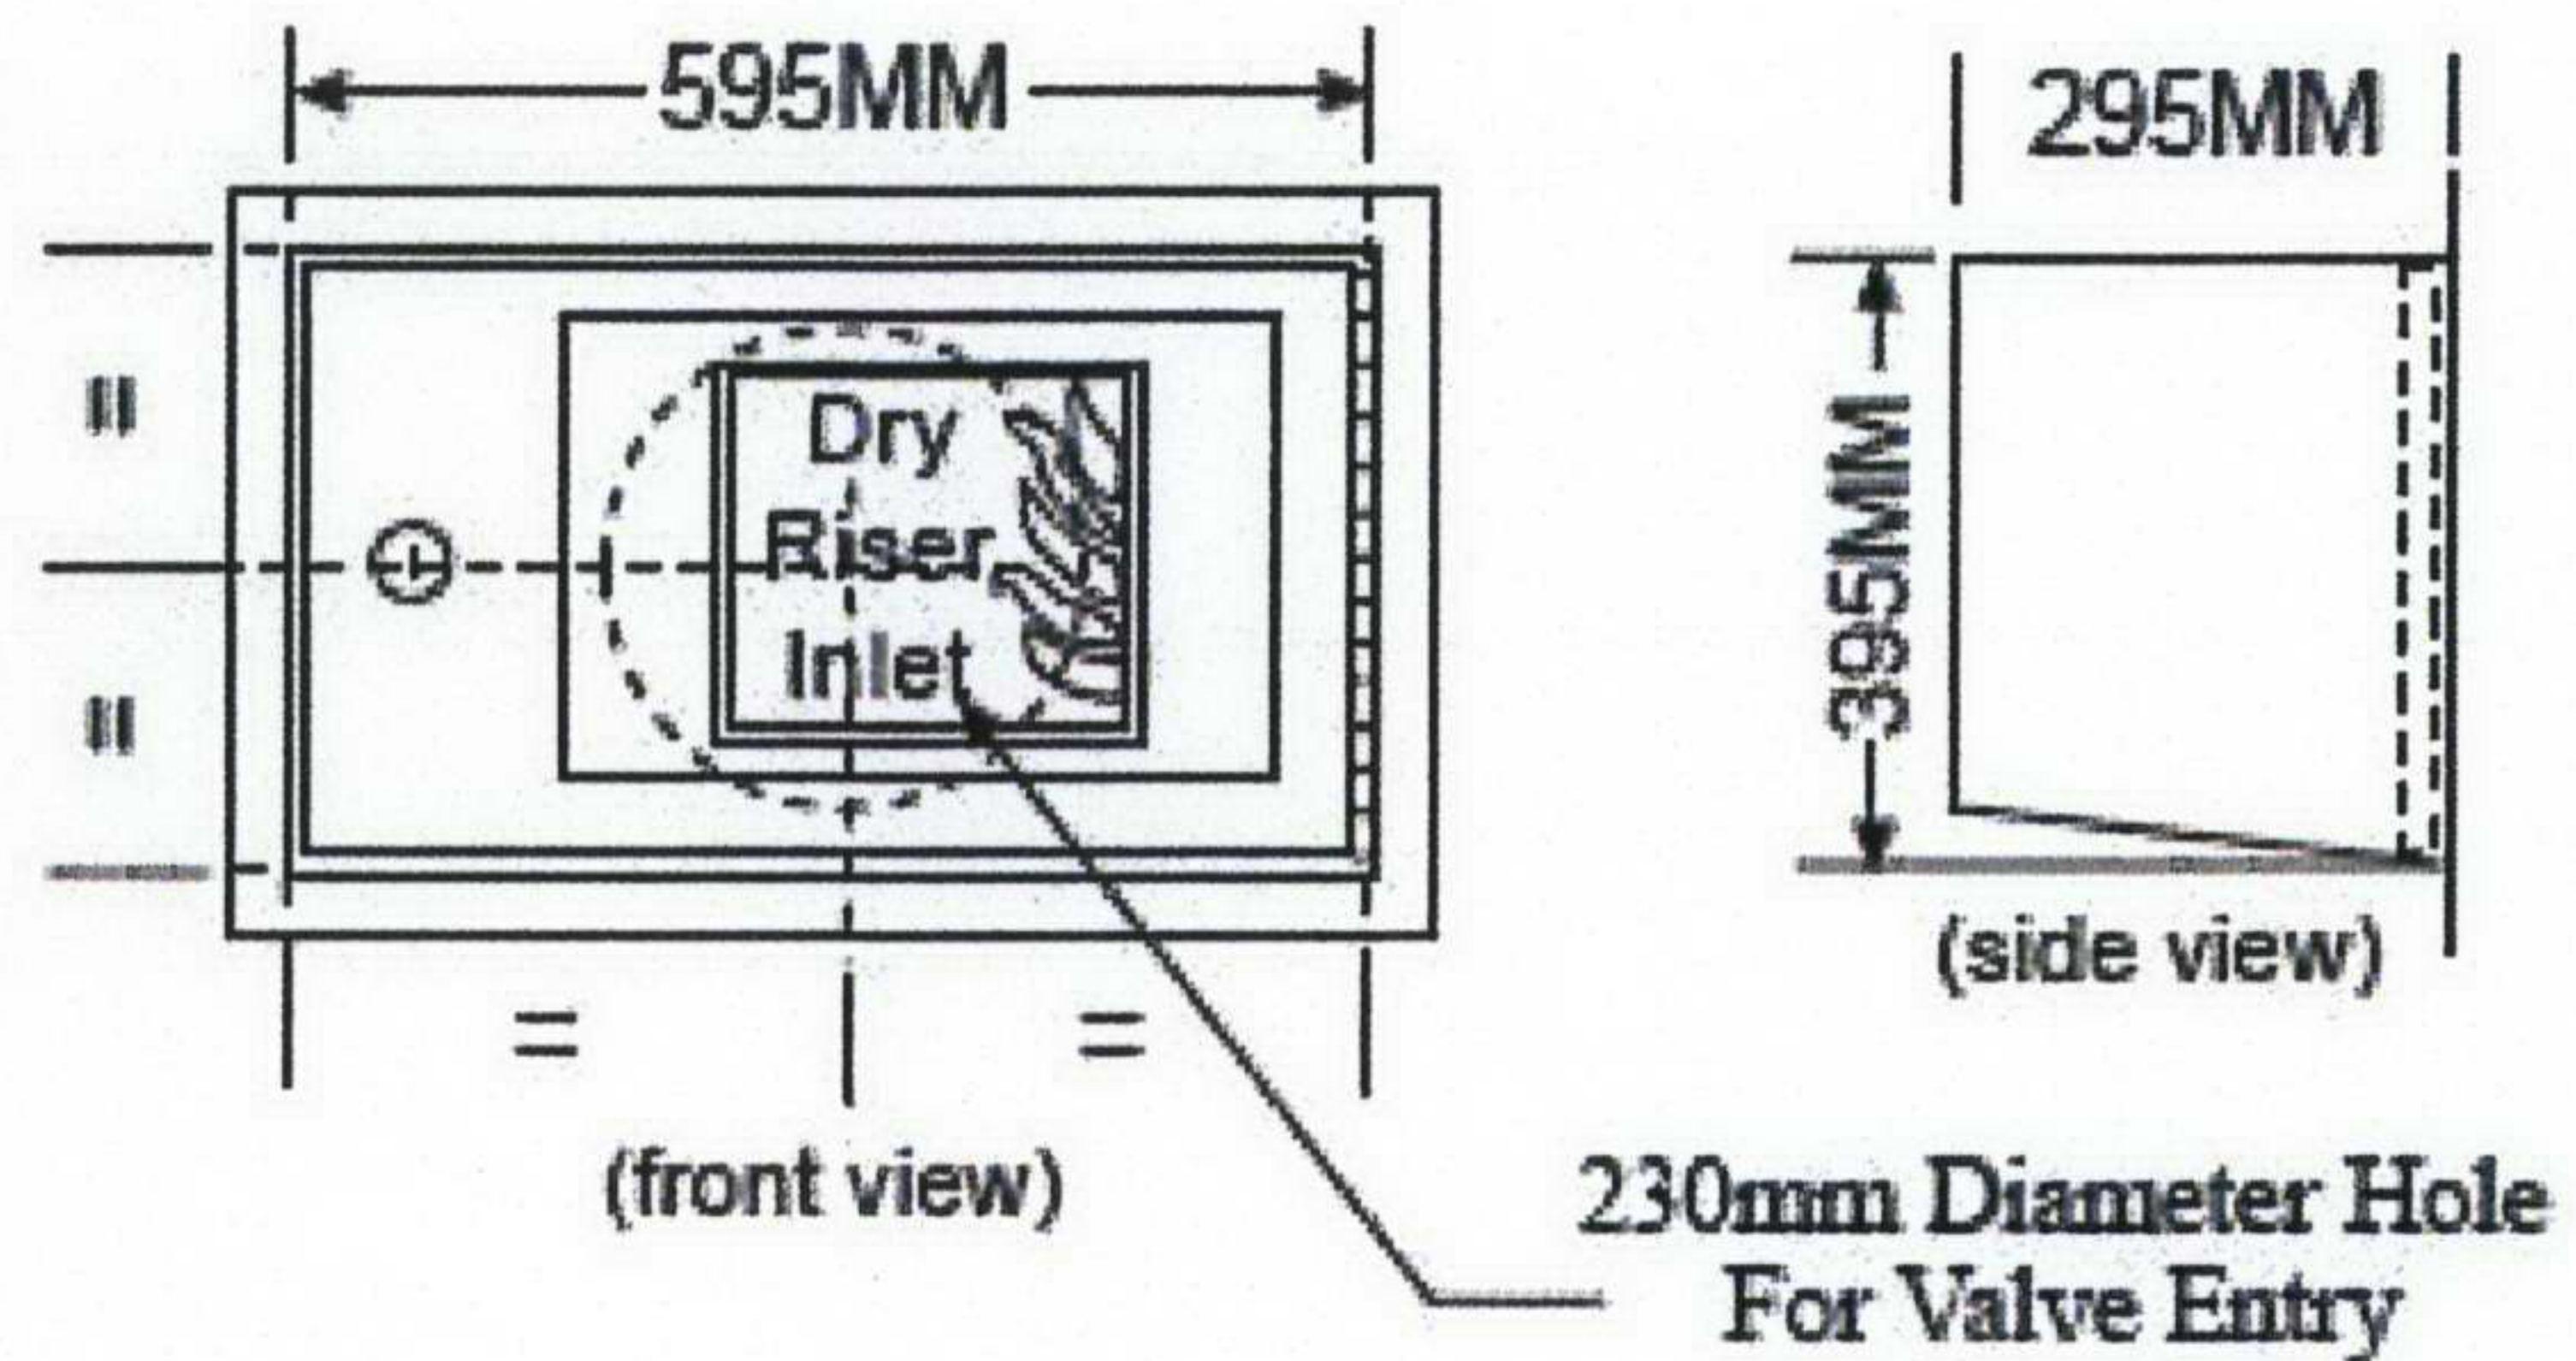


Dry riser inlet to Gower Street

Typical proposed cabinet

Horizontal Inlet Cabinet

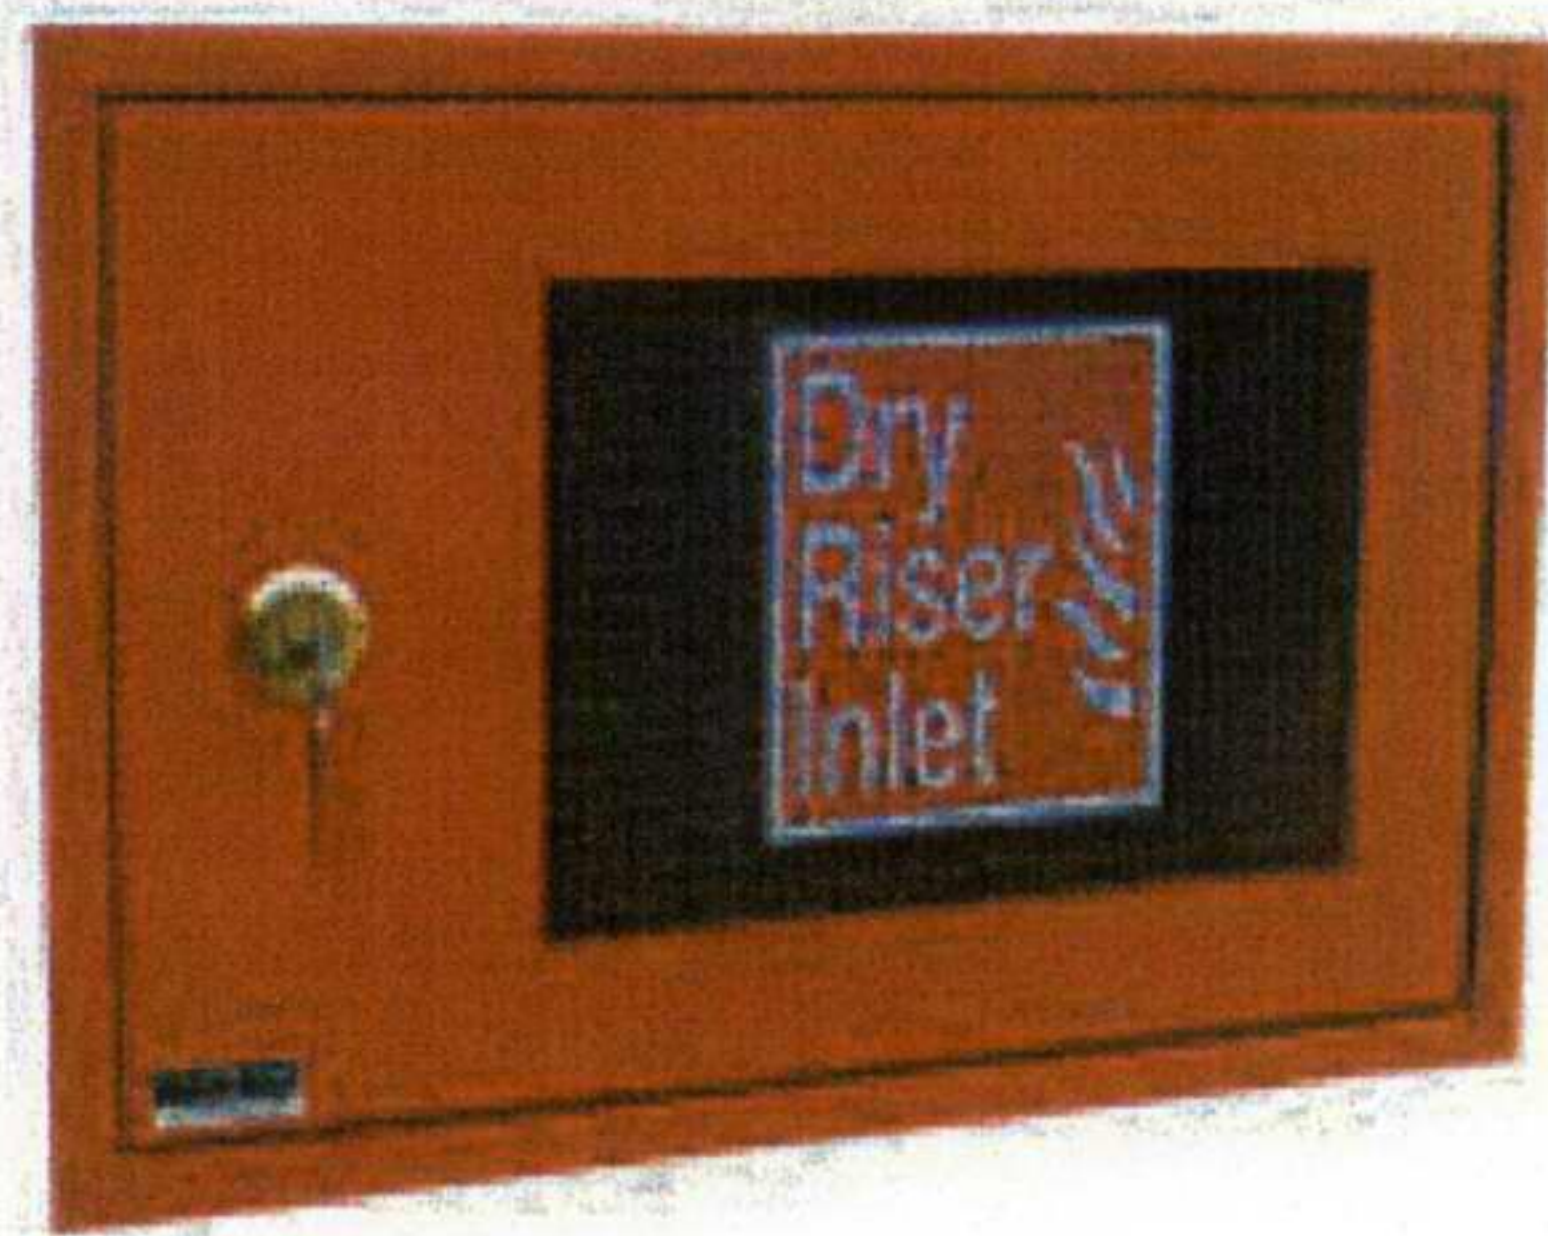

Available in:

Red RAL 3002


Backbox Dimensions

395mm High x 595mm Wide
x 295mm Deep

- High quality steel for strength and durability.
- Wired glass door panel and cylinder lock.
- Red polyester coated finish.

1



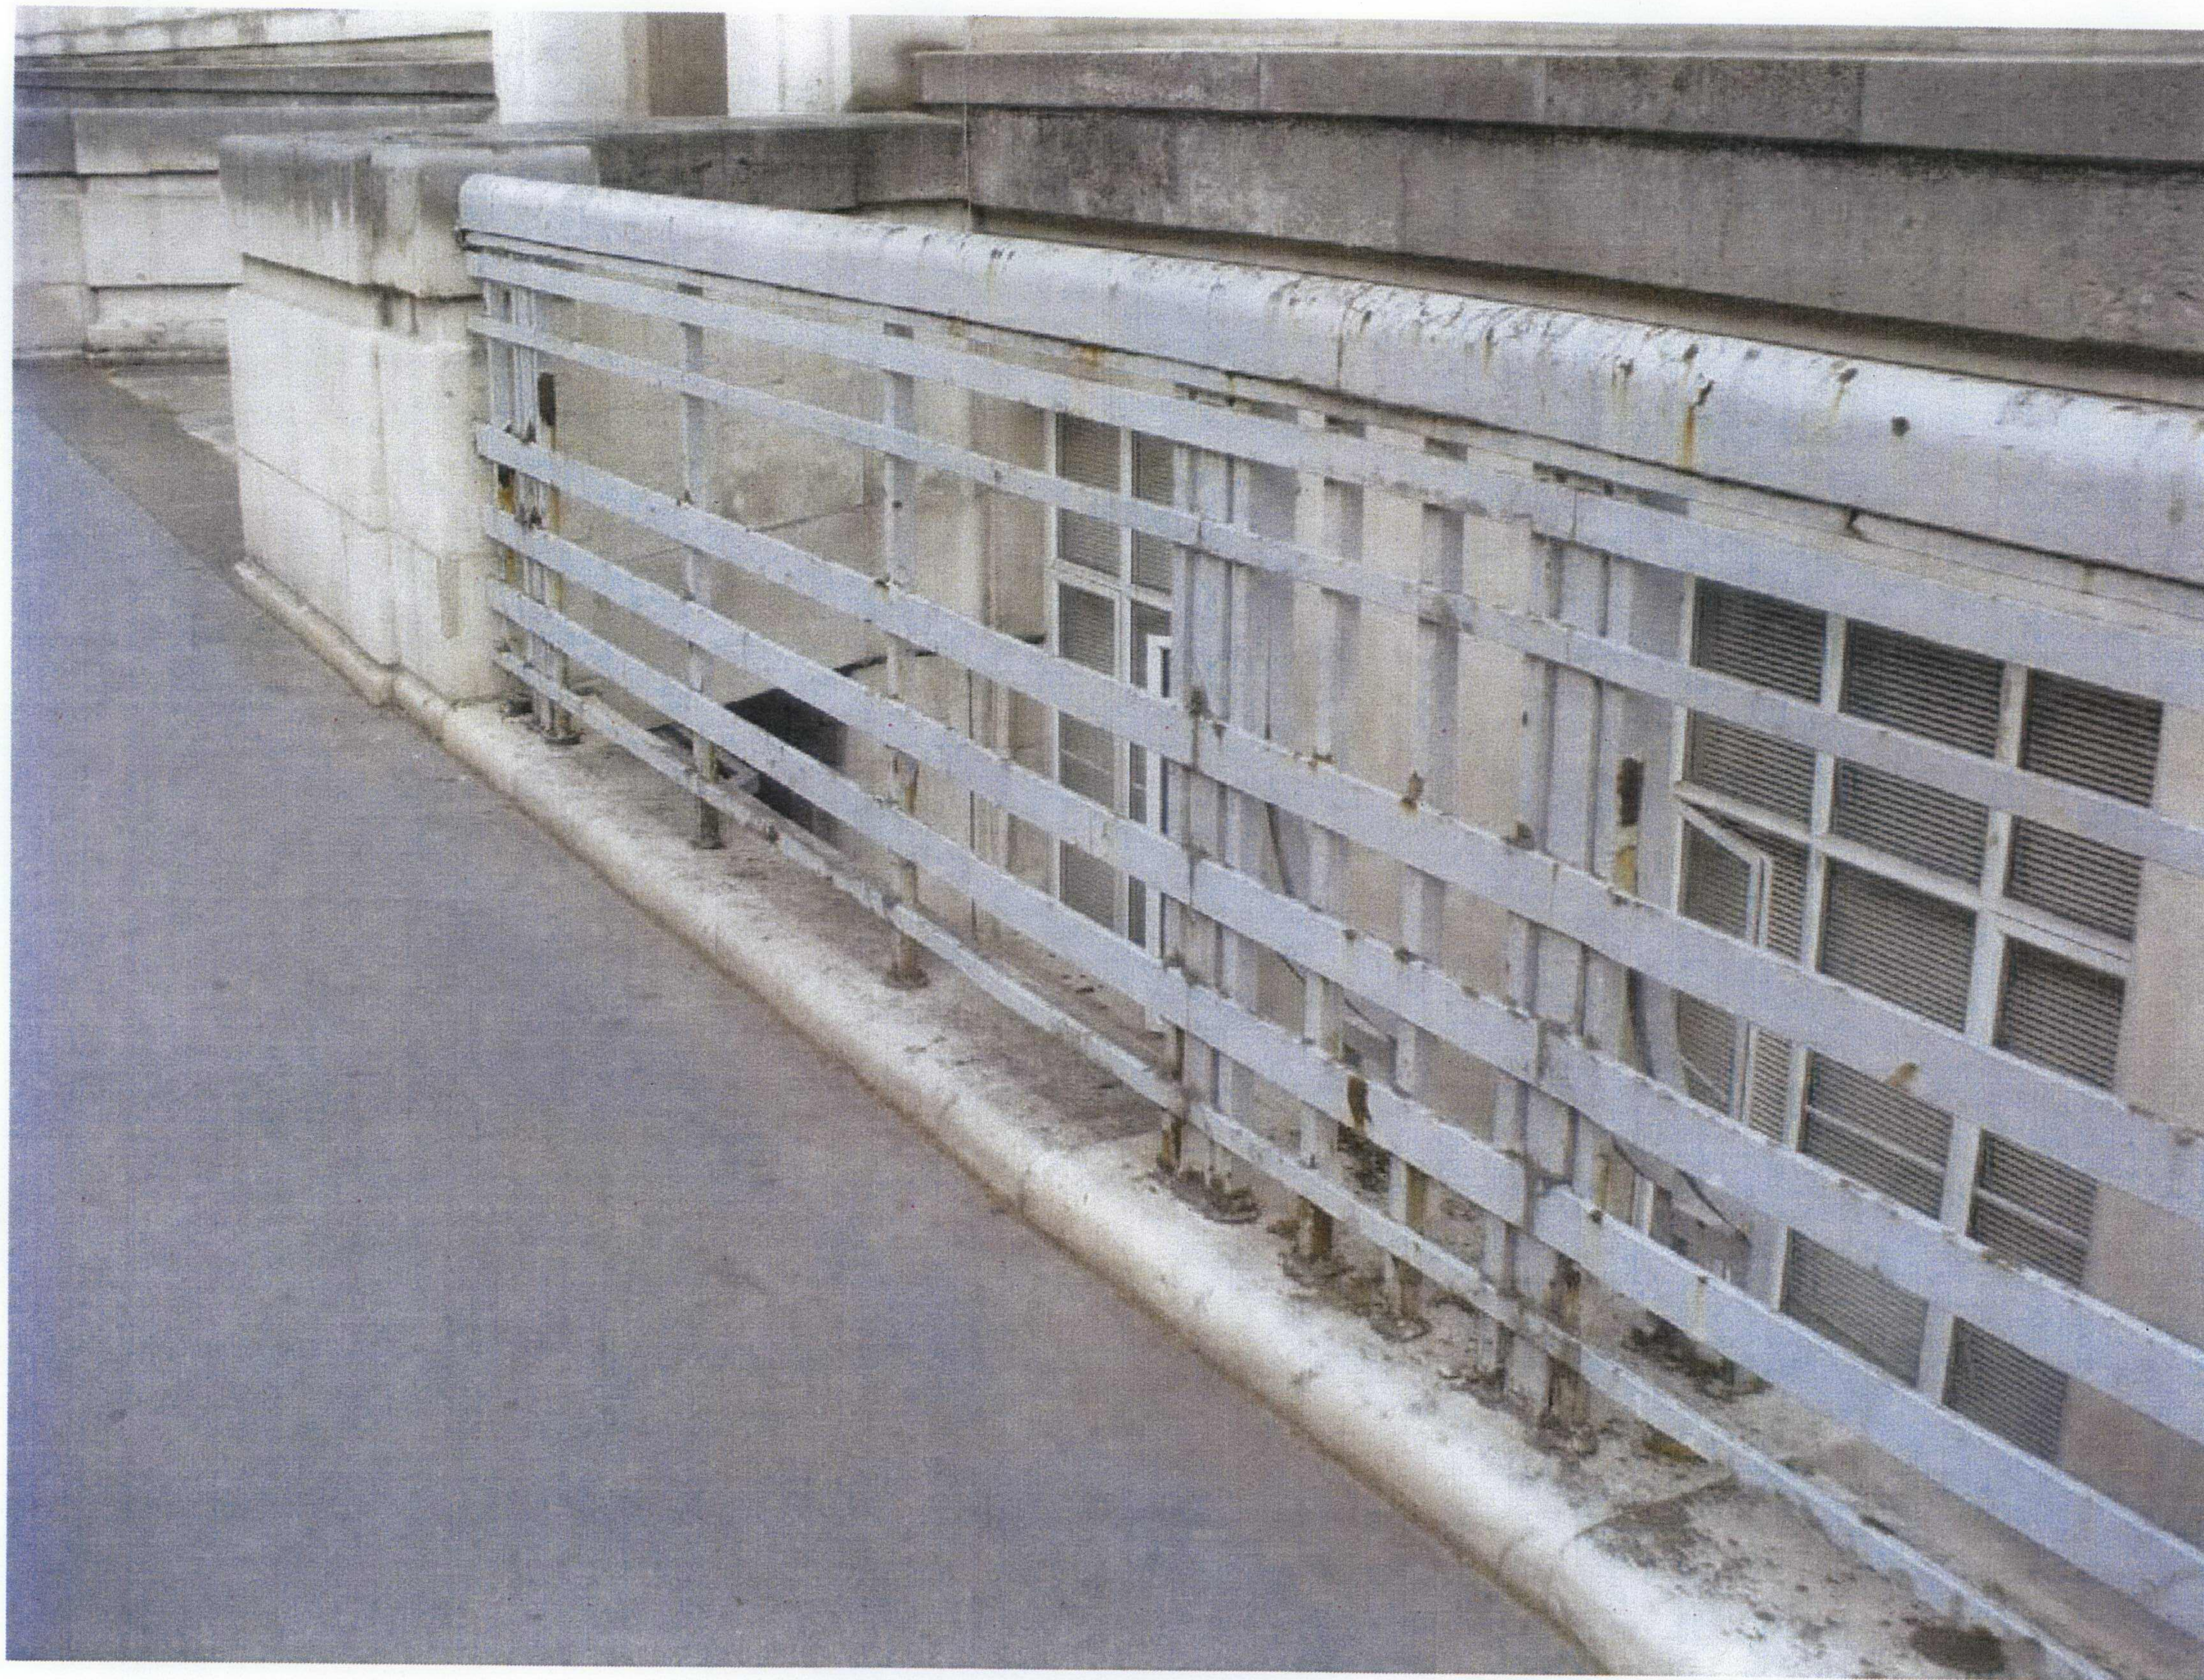





5

London School of Hygiene & Tropical Medicine 05301/H1

Dry riser inlet to Gower Street

Computer Room photos

Dry riser pipe to run above suspended ceiling.



(Photo's to accompany Plan Location Key)



1. Lobby Area - Dry Riser Outlet position on Lift Core, high level (South).



2. Lobby Area - Dry Riser Outlet position on Lift Core, low level (South).

RECEIVED
19 FEB 2008



3. Lobby Area – Dry Riser penetration, Internal window W/LG/VV/04 (South).



4. Lobby Area - Dry Riser Outlet position on Lift Core, high level (North).




5. Lobby Area – Dry Riser penetration, Internal window W/LG/W/04 (North).



6. Hall between Lobby Area & computer room - Dry Riser penetration, Internal window W/LG/W/04 (North).



7. Hall between Lobby Area & computer room - Dry Riser penetration, Internal window W/LG/W/04 (East).

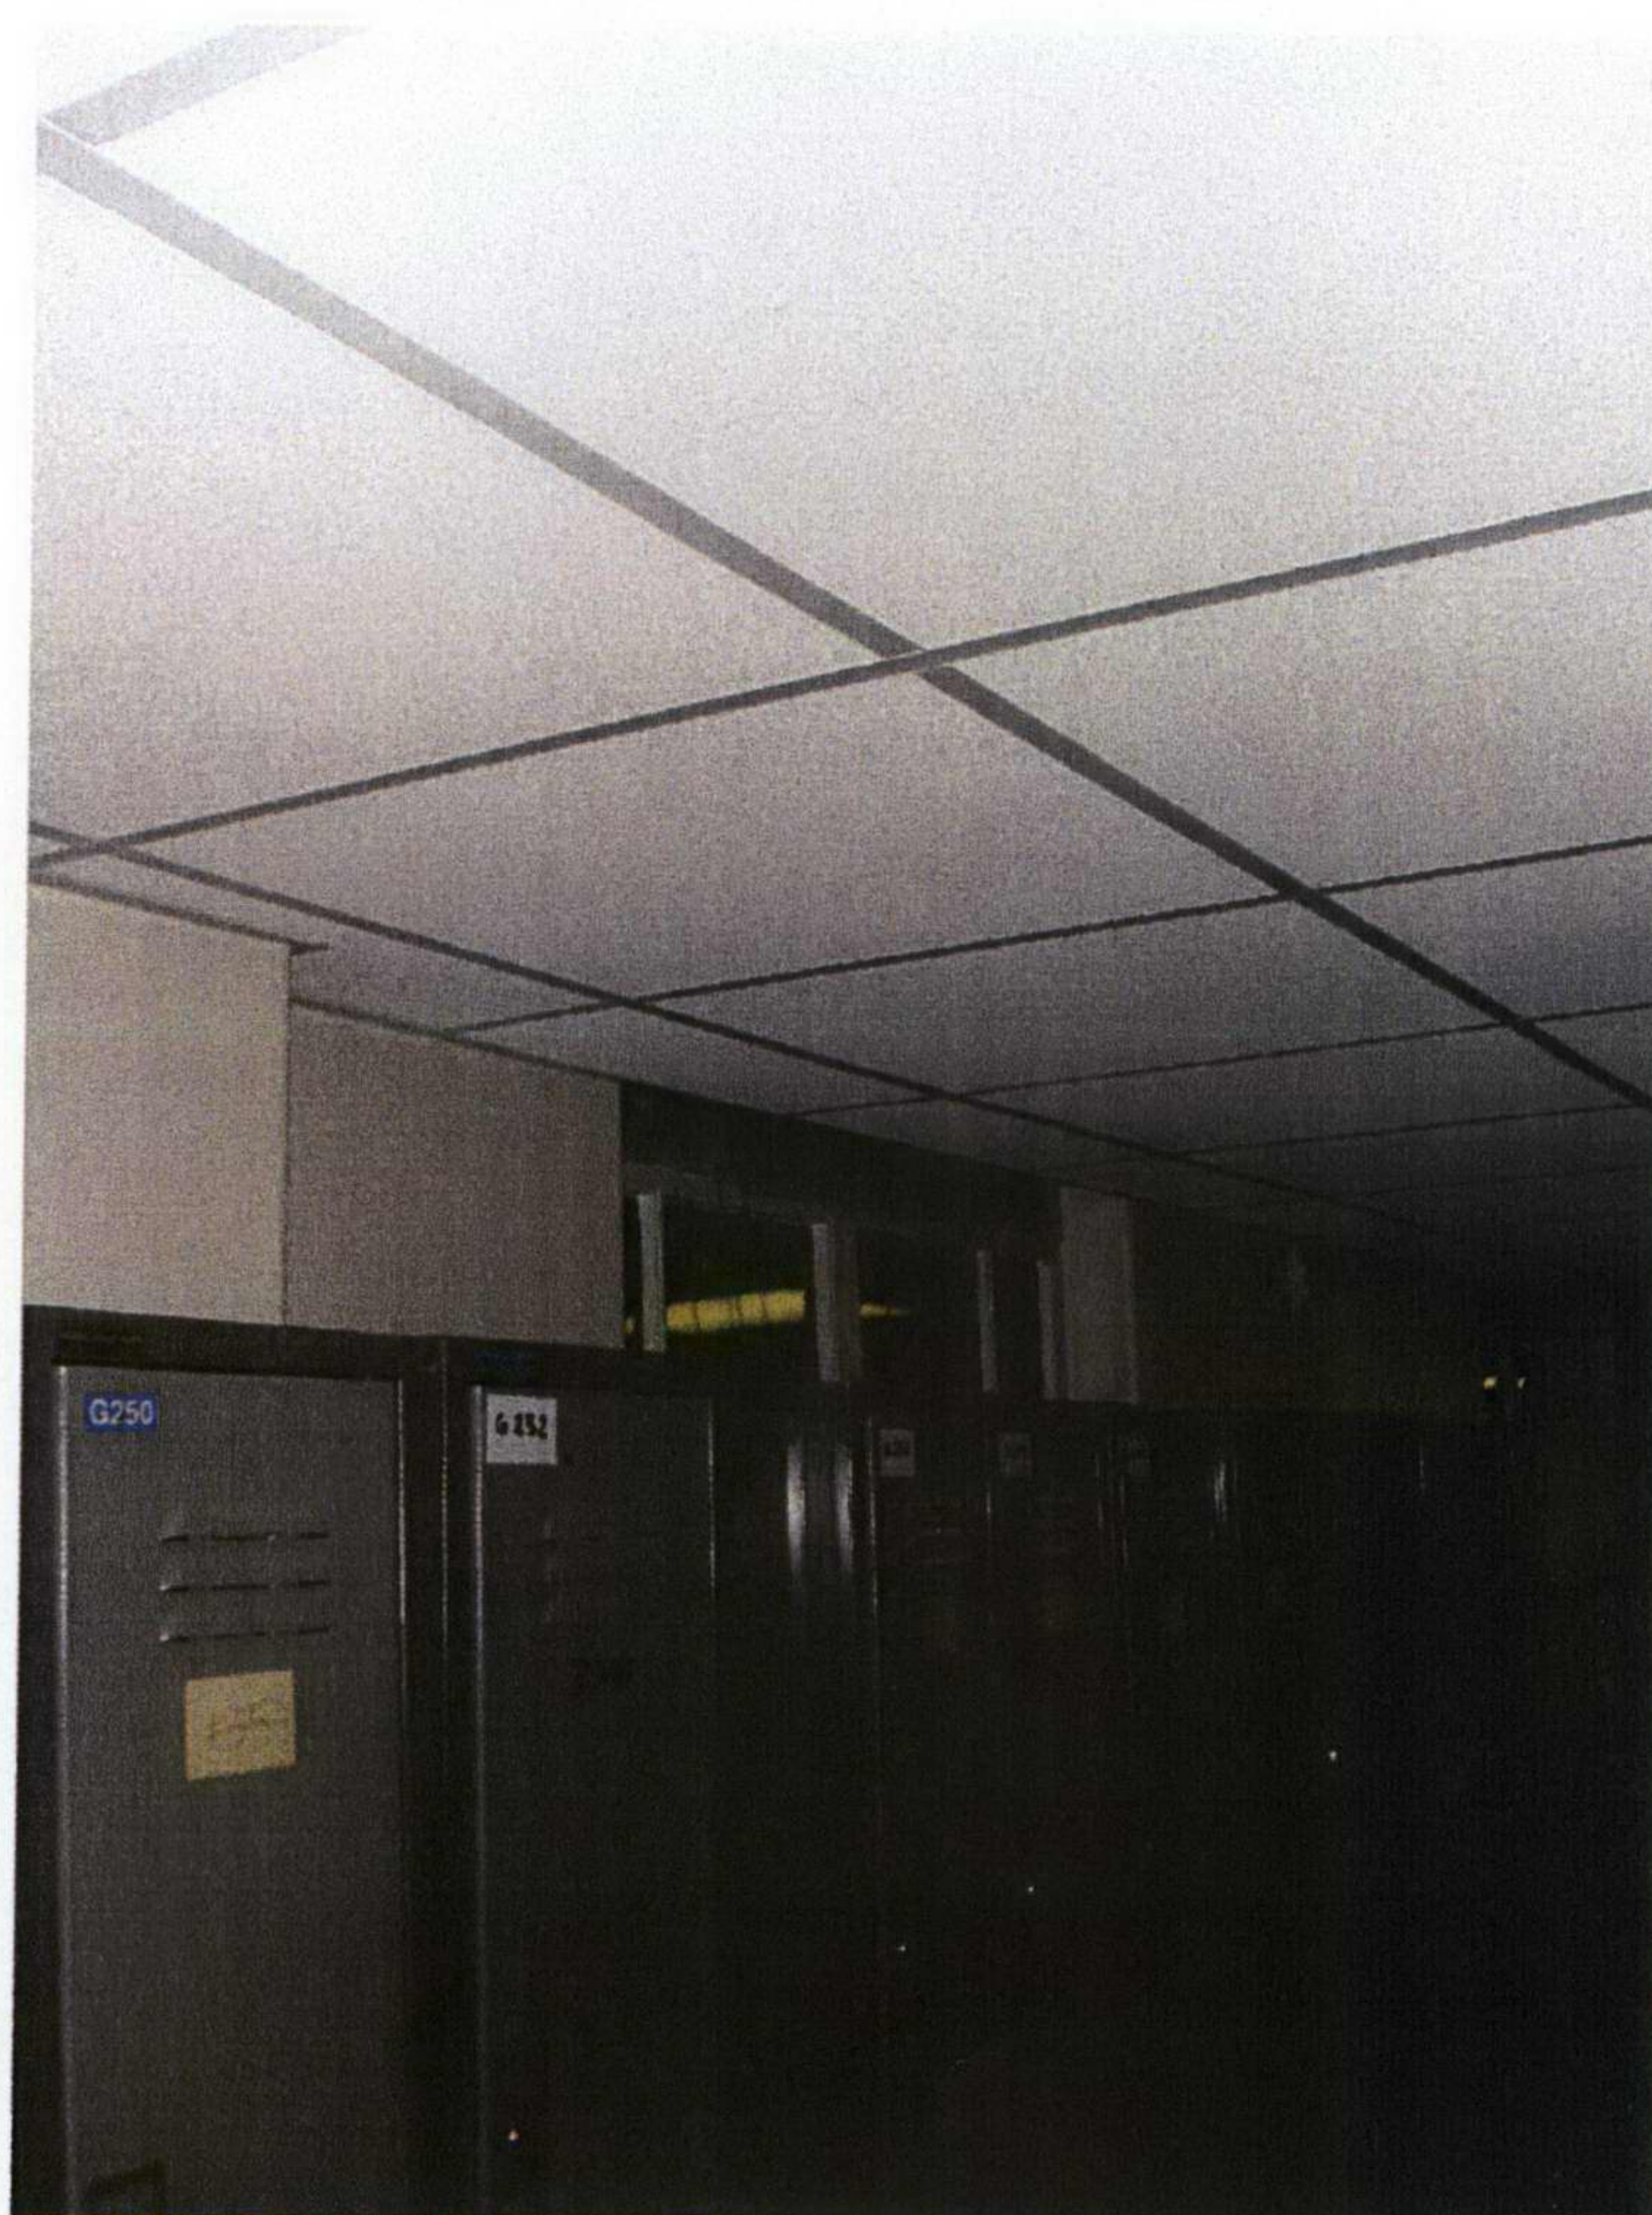

8. Hall between Lobby Area & computer room - Dry Riser penetration, Internal window W/LG/W/04 (South).